



OVERALL FLOOR PLAN


SCALE: 1" = 20'-0" 0" 10" 20"

PROJECT SUMMARY

PATIENT ROOMS:	
PRIVATE:	60 ROOMS (60 BEDS)
SEMI-PRIVATE:	20 ROOMS (40 BEDS)
TOTAL:	80 ROOMS (100 BEDS)
BUILDING AREA:	50,022 S.F.

GENERAL NOTES

- ARCHITECTURAL DIMENSIONS AND DESIGN INTENT ARE INDICATED ON ARCHITECTURAL DRAWINGS. IF THE INSTALLATION OF MECHANICAL, ELECTRICAL, AND PLUMBING INTERFERES WITH COMPLIANCE TO THE DESIGN INTENT, NOTIFY ARCHITECT IMMEDIATELY.
- DRAWINGS ARE NOT TO BE SCALED FOR DIMENSIONS. FIELD VERIFY ALL EXISTING CONSTRUCTION CONDITIONS.
- IT IS THE RESPONSIBILITY OF ALL SUBCONTRACTORS TO VERIFY ALL FIELD CONDITIONS AND OPENINGS PRIOR TO FABRICATION AND/OR INSTALLATION OF MATERIALS & EQUIPMENT. INFORM G.C. OF ANY DISCREPANCIES IMMEDIATELY.
- ALL PENETRATIONS THROUGH FIRE RATED CONSTRUCTION ARE TO BE PROTECTED WITH UL TESTED ASSEMBLIES OF WALL RATING OR BETTER APPLICABLE FOR CONDITIONS & MATERIALS OF PROJECT. SUBCONTRACTORS ARE TO SUBMIT DOCUMENTATION OF PROPOSED JOINT ASSEMBLY TO LOCAL AUTHORITY FOR APPROVAL PRIOR TO INSTALLATION.
- PROVIDE PORTABLE MULTI-PURPOSE ABC MIN. 5 GALLON FIRE EXTINGUISHERS OR TYPE & SIZE AS REQUIRED FOR CONDITIONS AND PER VCC 808.1 & NFPA 10. VERIFY QUANTITY & LOCATIONS W/ LOCAL FIRE AUTHORITY. DURING CONSTRUCTION CONTRACTOR TO PROVIDE PORTABLE FIRE EXTINGUISHERS W/ A MAX. DISTANCE OF 75' TO ALL PARTS OF BUILDING.
- ALL NEW AREAS OF WORK SHALL COMPLY WITH ACCESSIBILITY REQUIREMENTS OF THE AMERICANS WITH DISABILITIES ACT (ADA), VCC CHAPTER 11 AND ICC A117.1 AS AMENDED BY VCC 1102. INCLUDING BUT NOT LIMITED TO THE FOLLOWING:
 - CONTROLS AND OPERATING MECHANISMS SHALL BE ACCESSIBLE AND HAVE MOUNTING HEIGHTS COMPLYING WITH ADA/VCC A117.1, SECTION 308.
 - THRESHOLD TO BE A MAX. 1/2" ABOVE ADJACENT FINISH FLOOR.
 - MAXIMUM EFFORT TO OPERATE DOORS SHALL NOT EXCEED 5 LBS. FOR INTERIOR DOORS AND 15 LBS. FOR EXTERIOR DOORS.
 - ALL ROOM, DIRECTIONAL & INFORMATION SIGNS SHALL BE ACCESSIBLE DESIGN COMPLYING WITH ADA/VCC A117.1, SECTION 703.
- INTERIOR WALL AND CEILING FINISH MATERIALS & INSTALLATION ARE TO COMPLY WITH VCC 803, 806 & THE MINIMUM CLASSIFICATION AS FOLLOWS FOR SPRINKLERED "1-2" USE GROUPS. SUBCONTRACTORS TO SUBMIT MANUFACTURER'S PRODUCT INFORMATION TO LOCAL AUTHORITY & RECEIVE APPROVAL PRIOR TO PURCHASING PRODUCTS.
 - ALL AREAS: CLASS B- FLAME SPREAD 26-75 SMOKE DEVELOPED 0-450
- INTERIOR FLOOR FINISH MATERIALS & INSTALLATION ARE TO COMPLY W/VCC 804 & THE MINIMUM CLASSIFICATION AS FOLLOWS FOR SPRINKLERED "1-2" USE GROUPS. SUBCONTRACTORS TO SUBMIT MANUFACTURER'S PRODUCT INFORMATION TO LOCAL AUTHORITY & RECEIVE APPROVAL PRIOR TO PURCHASING PRODUCTS.
 - ALL AREAS: MATERIALS COMPLYING W/ DOC FF-1 FILL TEST (PSC 16 CFR, PART 1630).
- ALL ELEVATIONS AND SECTIONS ARE REFERENCED TO FINISH FLOOR ELEVATION (100'-0").
- * DENOTES DOOR TYPE. SEE SHEET "A6.1" FOR DOOR INFORMATION.
- BL-X * DENOTES BORROWED LITE. SEE SHEET "A6.2" FOR BORROWED LITE INFORMATION.
- * DENOTES WALL TYPE. SEE SHEET "A12" FOR WALL TYPE LEGEND & ADDITIONAL INFORMATION.
- ◇ * DENOTES WINDOW TYPE. SEE SHEET "A4.1" FOR WINDOW INFORMATION.
- ALL DIMENSIONS ARE TO FACE OF EXISTING CONSTRUCTION, FACE OF MASONRY, CENTERLINE OF COLUMN OR CENTERLINE OF NEW METAL STUD PARTITION UNLESS NOTED OTHERWISE.
- DIMENSIONS NOTED AS "HOLD" OR "CLEAR" SHALL NOT VARY MORE THAN 1/8" FROM SIDE TO SIDE, FRONT TO REAR, FINISH FACE TO FINISH FACE. "MIN.", "MAX." AND "ALIGN" DIMENSIONS ARE CRITICAL. SHOULD ANY FIELD CONDITIONS NOT PERMIT CONSTRUCTION OF DESIGN INTENT IN ANY AREA, G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
- "TYP." OR "TYPICAL" MEANS THE CONDITION INDICATED IS THE SAME OR REPRESENTATIVE FOR ALL SIMILAR CONDITIONS UNLESS NOTED OTHERWISE.
- ARCHITECTURAL DIMENSIONS AND DESIGN INTENT ARE INDICATED ON ARCHITECTURAL DRAWINGS. IF THE INSTALLATION OF MECHANICAL, ELECTRICAL, AND PLUMBING INTERFERES WITH COMPLIANCE TO THE DESIGN INTENT, NOTIFY ARCHITECT IMMEDIATELY.
- DRAWINGS ARE NOT TO BE SCALED FOR DIMENSIONS. FIELD VERIFY ALL EXISTING CONSTRUCTION CONDITIONS AND NOTIFY G.C. AND ARCHITECT OF ANY DISCREPANCIES.
- ALL VERTICAL DIMENSIONS SHOWN FOR NEW CONSTRUCTION AS "A.F.F." ARE FROM TOP OF FLOOR SLAB. G.C. TO VERIFY DIMENSIONAL THICKNESS OF ALL FLOOR FINISHES.
- IT IS THE RESPONSIBILITY OF ALL SUBCONTRACTORS TO VERIFY ALL FIELD CONDITIONS AND OPENINGS PRIOR TO FABRICATION AND/OR INSTALLATION OF MATERIALS & EQUIPMENT. INFORM G.C. OF ANY DISCREPANCIES IMMEDIATELY.
- ALL PENETRATIONS THROUGH FIRE RATED CONSTRUCTION ARE TO BE PROTECTED WITH UL TESTED ASSEMBLIES OF WALL RATING OR BETTER APPLICABLE FOR CONDITIONS & MATERIALS OF PROJECT. SUBCONTRACTORS ARE TO SUBMIT DOCUMENTATION OF PROPOSED JOINT ASSEMBLY TO LOCAL AUTHORITY FOR APPROVAL PRIOR TO INSTALLATION.
- ALL WOOD BLOCKING, NAILERS, ETC. USED IN CONSTRUCTION OF EXTERIOR WALLS & ROOF TO BE PRESERVATIVE TREATED.
- UNLESS SPECIFICALLY INDICATED ON DRAWINGS, DESIGN OF METAL FRAMING SIZE, THICKNESS (GAUGE), CONNECTIONS & FASTENERS ARE THE RESPONSIBILITY OF THE FRAMING MANUFACTURER, WHO IS TO RETAIN THE SERVICES OF A STATE OF OHIO PROFESSIONAL ENGINEER FOR THE DESIGN OF THE METAL FRAMING FOR THE PROJECT. THE FRAMING SUBCONTRACTOR IS TO NOTIFY THE ARCHITECT SHOULD THE REQUIREMENTS OF THE FRAMING DESIGN CONFLICT WITH THE INTENDED CONSTRUCTION INDICATED.

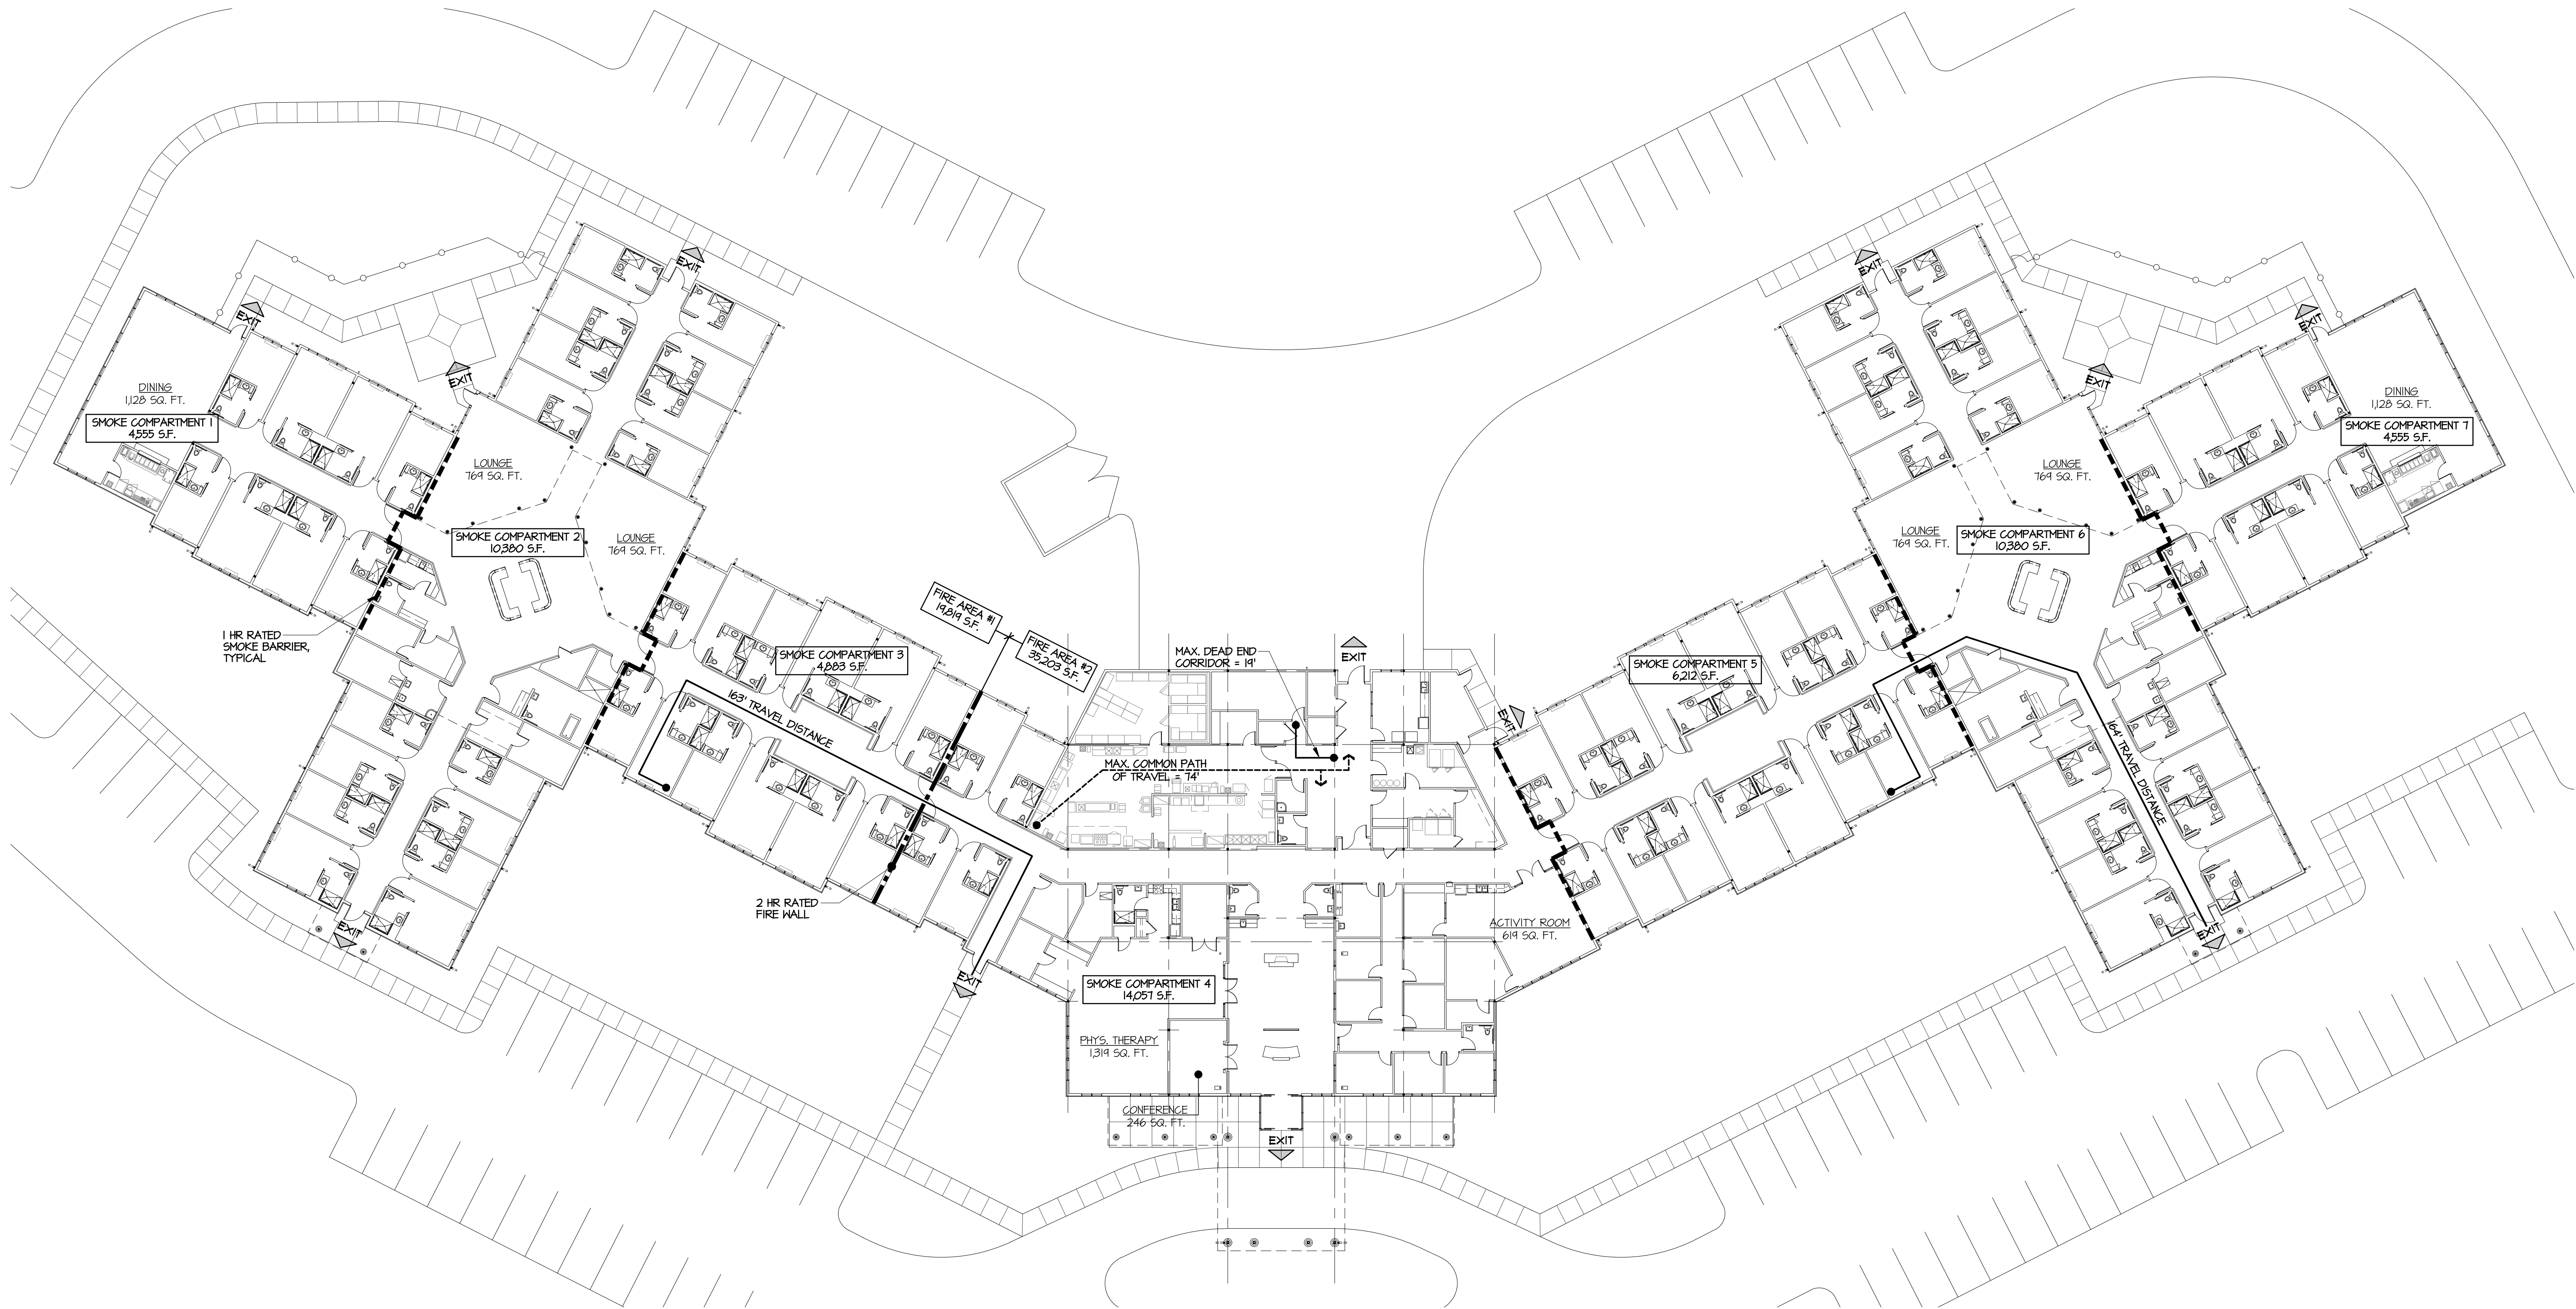

OVERALL LIFE SAFETY PLAN

SCALE: 1" = 20'-0" 0' 1" 20'

CODE INFORMATION

- ALL WORK IS TO CONFORM TO ALL APPLICABLE NATIONAL, STATE & LOCAL CODE REQUIREMENTS, INCLUDING BUT NOT LIMITED TO THE FOLLOWING:
 - VIRGINIA CONSTRUCTION CODE (VCC) 2021 EDITION
 - VIRGINIA MECHANICAL CODE (VMC) 2021 EDITION
 - VIRGINIA PLUMBING CODE (VPC) 2021 EDITION
 - 2022 NFPA 13 - STANDARD FOR INSTALLATION OF SPRINKLER SYSTEMS
 - NFPA 70 - NATIONAL ELECTRICAL CODE (NEC) 2020 EDITION
 - 2014 NFPA 72 - NATIONAL FIRE ALARM AND SIGNALING CODE
 - 2021 NFPA 101 - LIFE SAFETY CODE
 - 2021 INTERNATIONAL FUEL GAS CODE
 - 2021 VIRGINIA FIRE PREVENTION FIRE CODE
 - AMERICANS WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES (ADAAG)/ANSI ICC A117.1 2011, INCLUDING BUT NOT NECESSARILY LIMITED TO VCC CHAPTER 11
 - APPLICABLE PROVISIONS OF THE INTERNATIONAL ENERGY CONSERVATION CODE (IECC) OR ASHRAE 90.1 PER VCC CHAPTER 13
- BUILDING VCC USE GROUP: 1-2' CONDITION I, NURSING HOME
- VCC CONSTRUCTION CLASSIFICATION: V-A' FULLY SPRINKLERED
- GENERAL BUILDING LIMITATIONS
 - BUILDING HEIGHT PER VCC TABLE 504.3: 50'
 - STORIES PER VCC TABLE 504.4: 1
 - ALLOWABLE AREA PER VCC 506.2:
 - $A_a = A_t + (N_s \times I)$
 - $30,000 + (400 \times 0.75)$
 - $= 45,125 \text{ S.F.}$

- BUILDING STATISTICS

STORIES:	1
BUILDING HEIGHT:	25'
BUILDING AREA:	19,814 S.F.
FIRE AREA #1:	19,814 S.F.
FIRE AREA #2:	35,203 S.F.
TOTAL AREA:	50,022 S.F.
- SUMMARY OF FIRE RESISTANCE RATINGS OF STRUCTURAL ELEMENTS IN V-A' CONSTRUCTION PER TABLE 601 OF THE VCC AS FOLLOWS:

STRUCTURAL FRAME:	1 HR. RATING REQUIRED
BEARING WALLS:	1 HR. RATING REQUIRED
NON-BEARING WALLS:	0 HR. RATING REQUIRED
FLOOR CONSTRUCTION:	1 HR. RATING REQUIRED
ROOF CONSTRUCTION:	1 HR. RATING REQUIRED
- OCCUPANT LOAD (PER VCC TABLE 1004.5)

SLEEPING:	23,136 S.F. / 120	= 193
INPATIENT AREAS:	1,015 S.F. / 240	= 4
OUTPATIENT AREAS:	2,001 S.F. / 100	= 20
BUSINESS AREAS:	2,244 S.F. / 150	= 15
KITCHEN:	2,485 S.F. / 200	= 12
ACCESSORY AREAS:	4,181 S.F. / 300	= 14
TOTAL OCCUPANT LOAD:		= 240 OCCUPANTS
- MAXIMUM EXIT ACCESS TRAVEL DISTANCE PER VCC TABLE 1017.2

REQUIRED:	200' MAX.
PROVIDED:	164'


- MAXIMUM COMMON PATH OF TRAVEL PER VCC TABLE 1006.2.1 AND SECTION 407.4:


REQUIRED:	75'
PROVIDED:	74'
- MAXIMUM DEAD-END CORRIDOR PER VCC SECTION 1020.5:

REQUIRED:	20'
PROVIDED:	19'
- EGRESS WIDTH PER VCC 1005.3:

EGRESS WIDTH REQUIRED:	
2' / OCCUPANT: 2 x 240 =	50.0"
EGRESS WIDTH PROVIDED:	
(4) @ 34" =	136.0"
(6) @ 42" =	252.0"
(1) @ 46" =	46.0"
(1) @ 56" =	56.0"
	490.0" TOTAL
- NUMBER OF EXITS PER VCC TABLE 1006.3.3:

REQUIRED:	2
PROVIDED:	12
- BUILDING TO BE FULLY SPRINKLERED. STATE OF VIRGINIA LICENSED DESIGN PROFESSIONAL SHALL BE RESPONSIBLE FOR PLAN PREPARATION, SUBMITTAL AND OBTAINING APPROVALS FOR FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH VCC 403.3. SYSTEM DESIGN TO BE SUBMITTED AND APPROVED PRIOR TO COMMENCEMENT OF FIRE SUPPRESSION SYSTEM WORK.

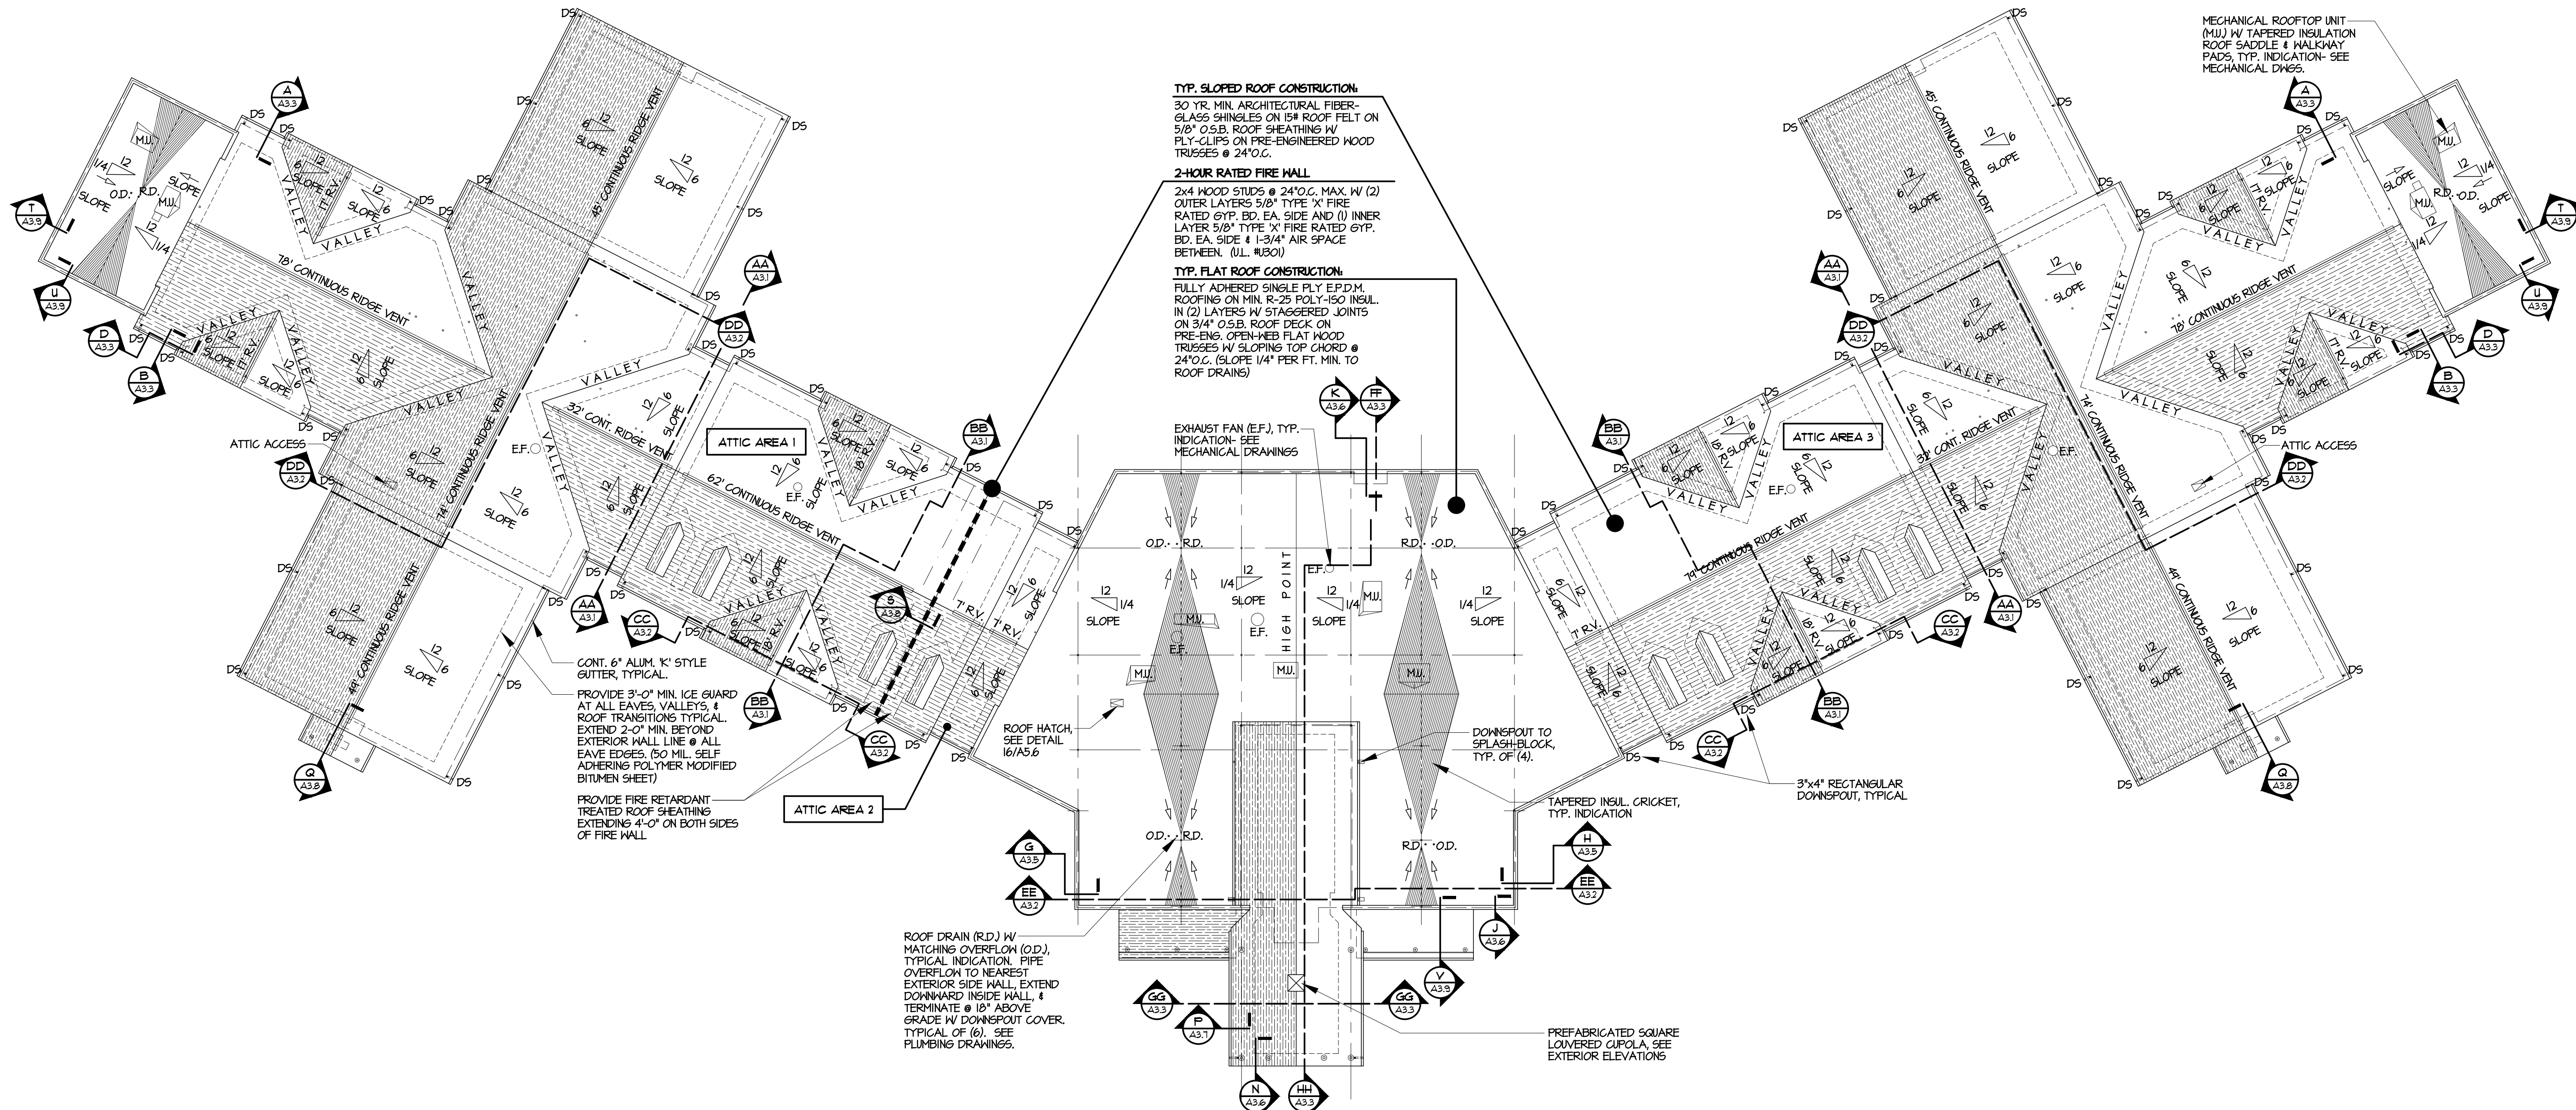

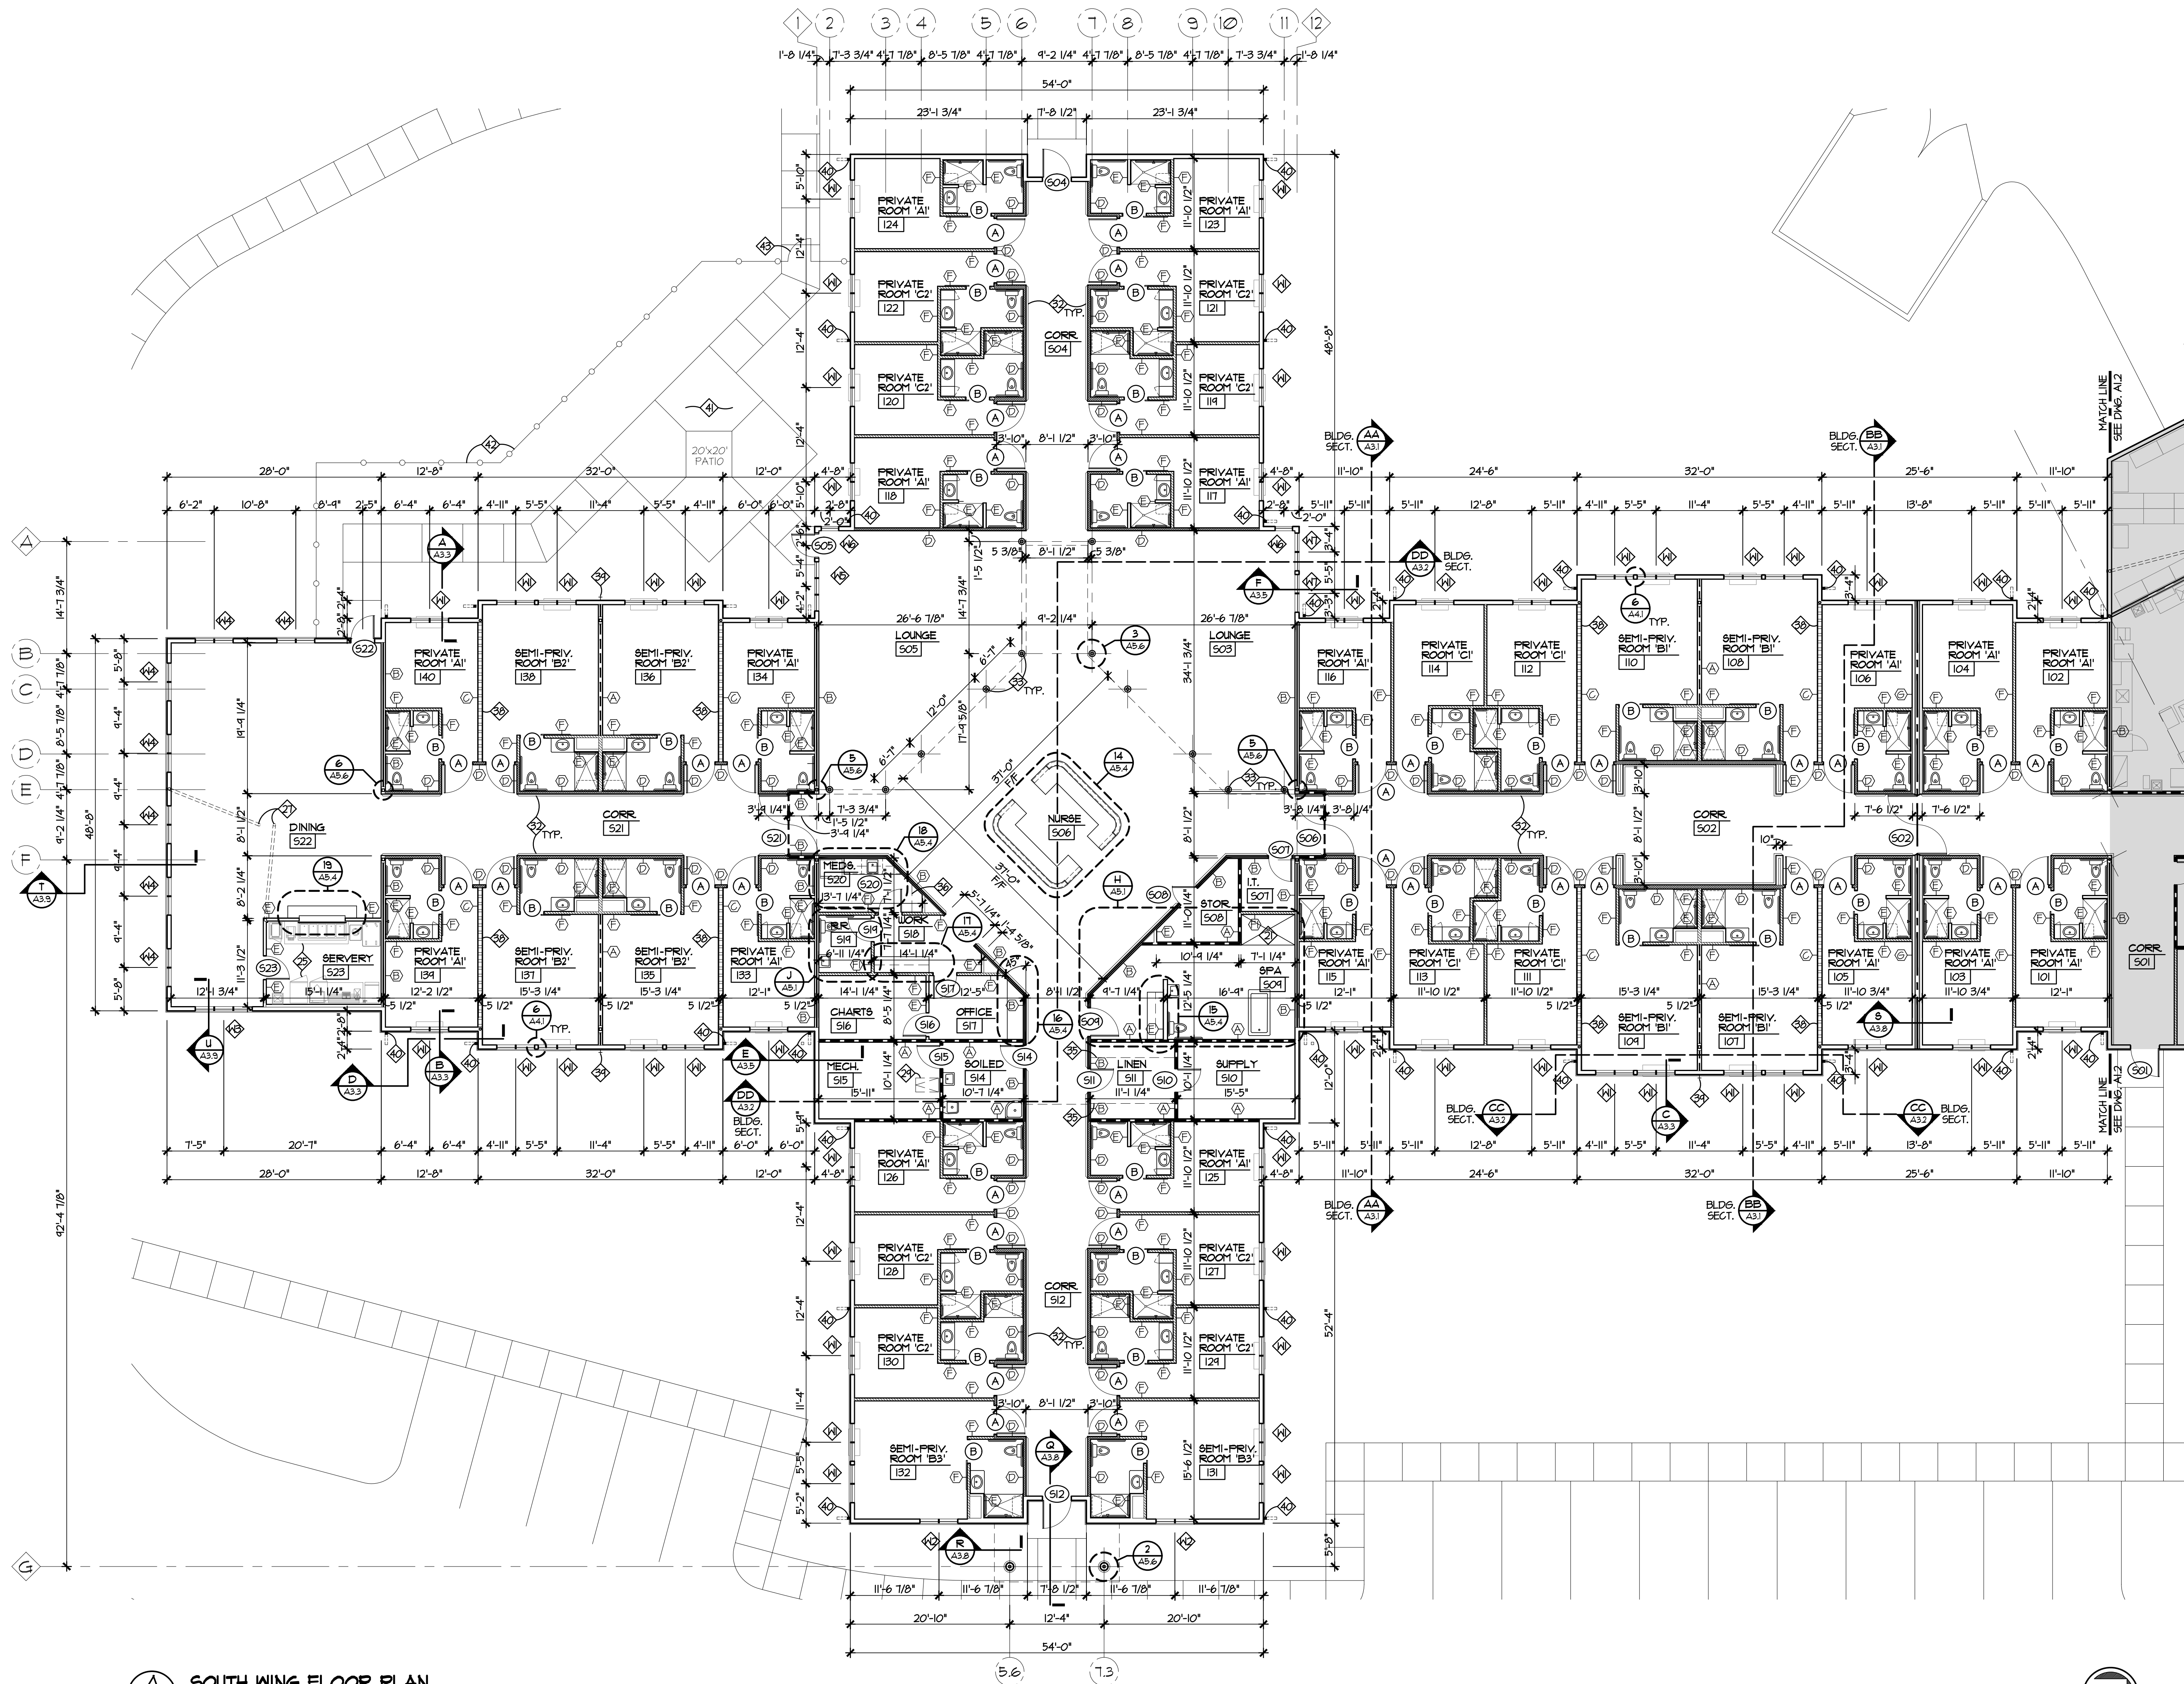


SOUTH WING FLOOR PLAN

SCALE: 1" = 10'-0" 0' 10'

NOTES:

- SEE DRAWING A1.2 FOR WALL TYPE LEGEND
- SEE DRAWING A5.1 FOR KEYNOTE LEGEND

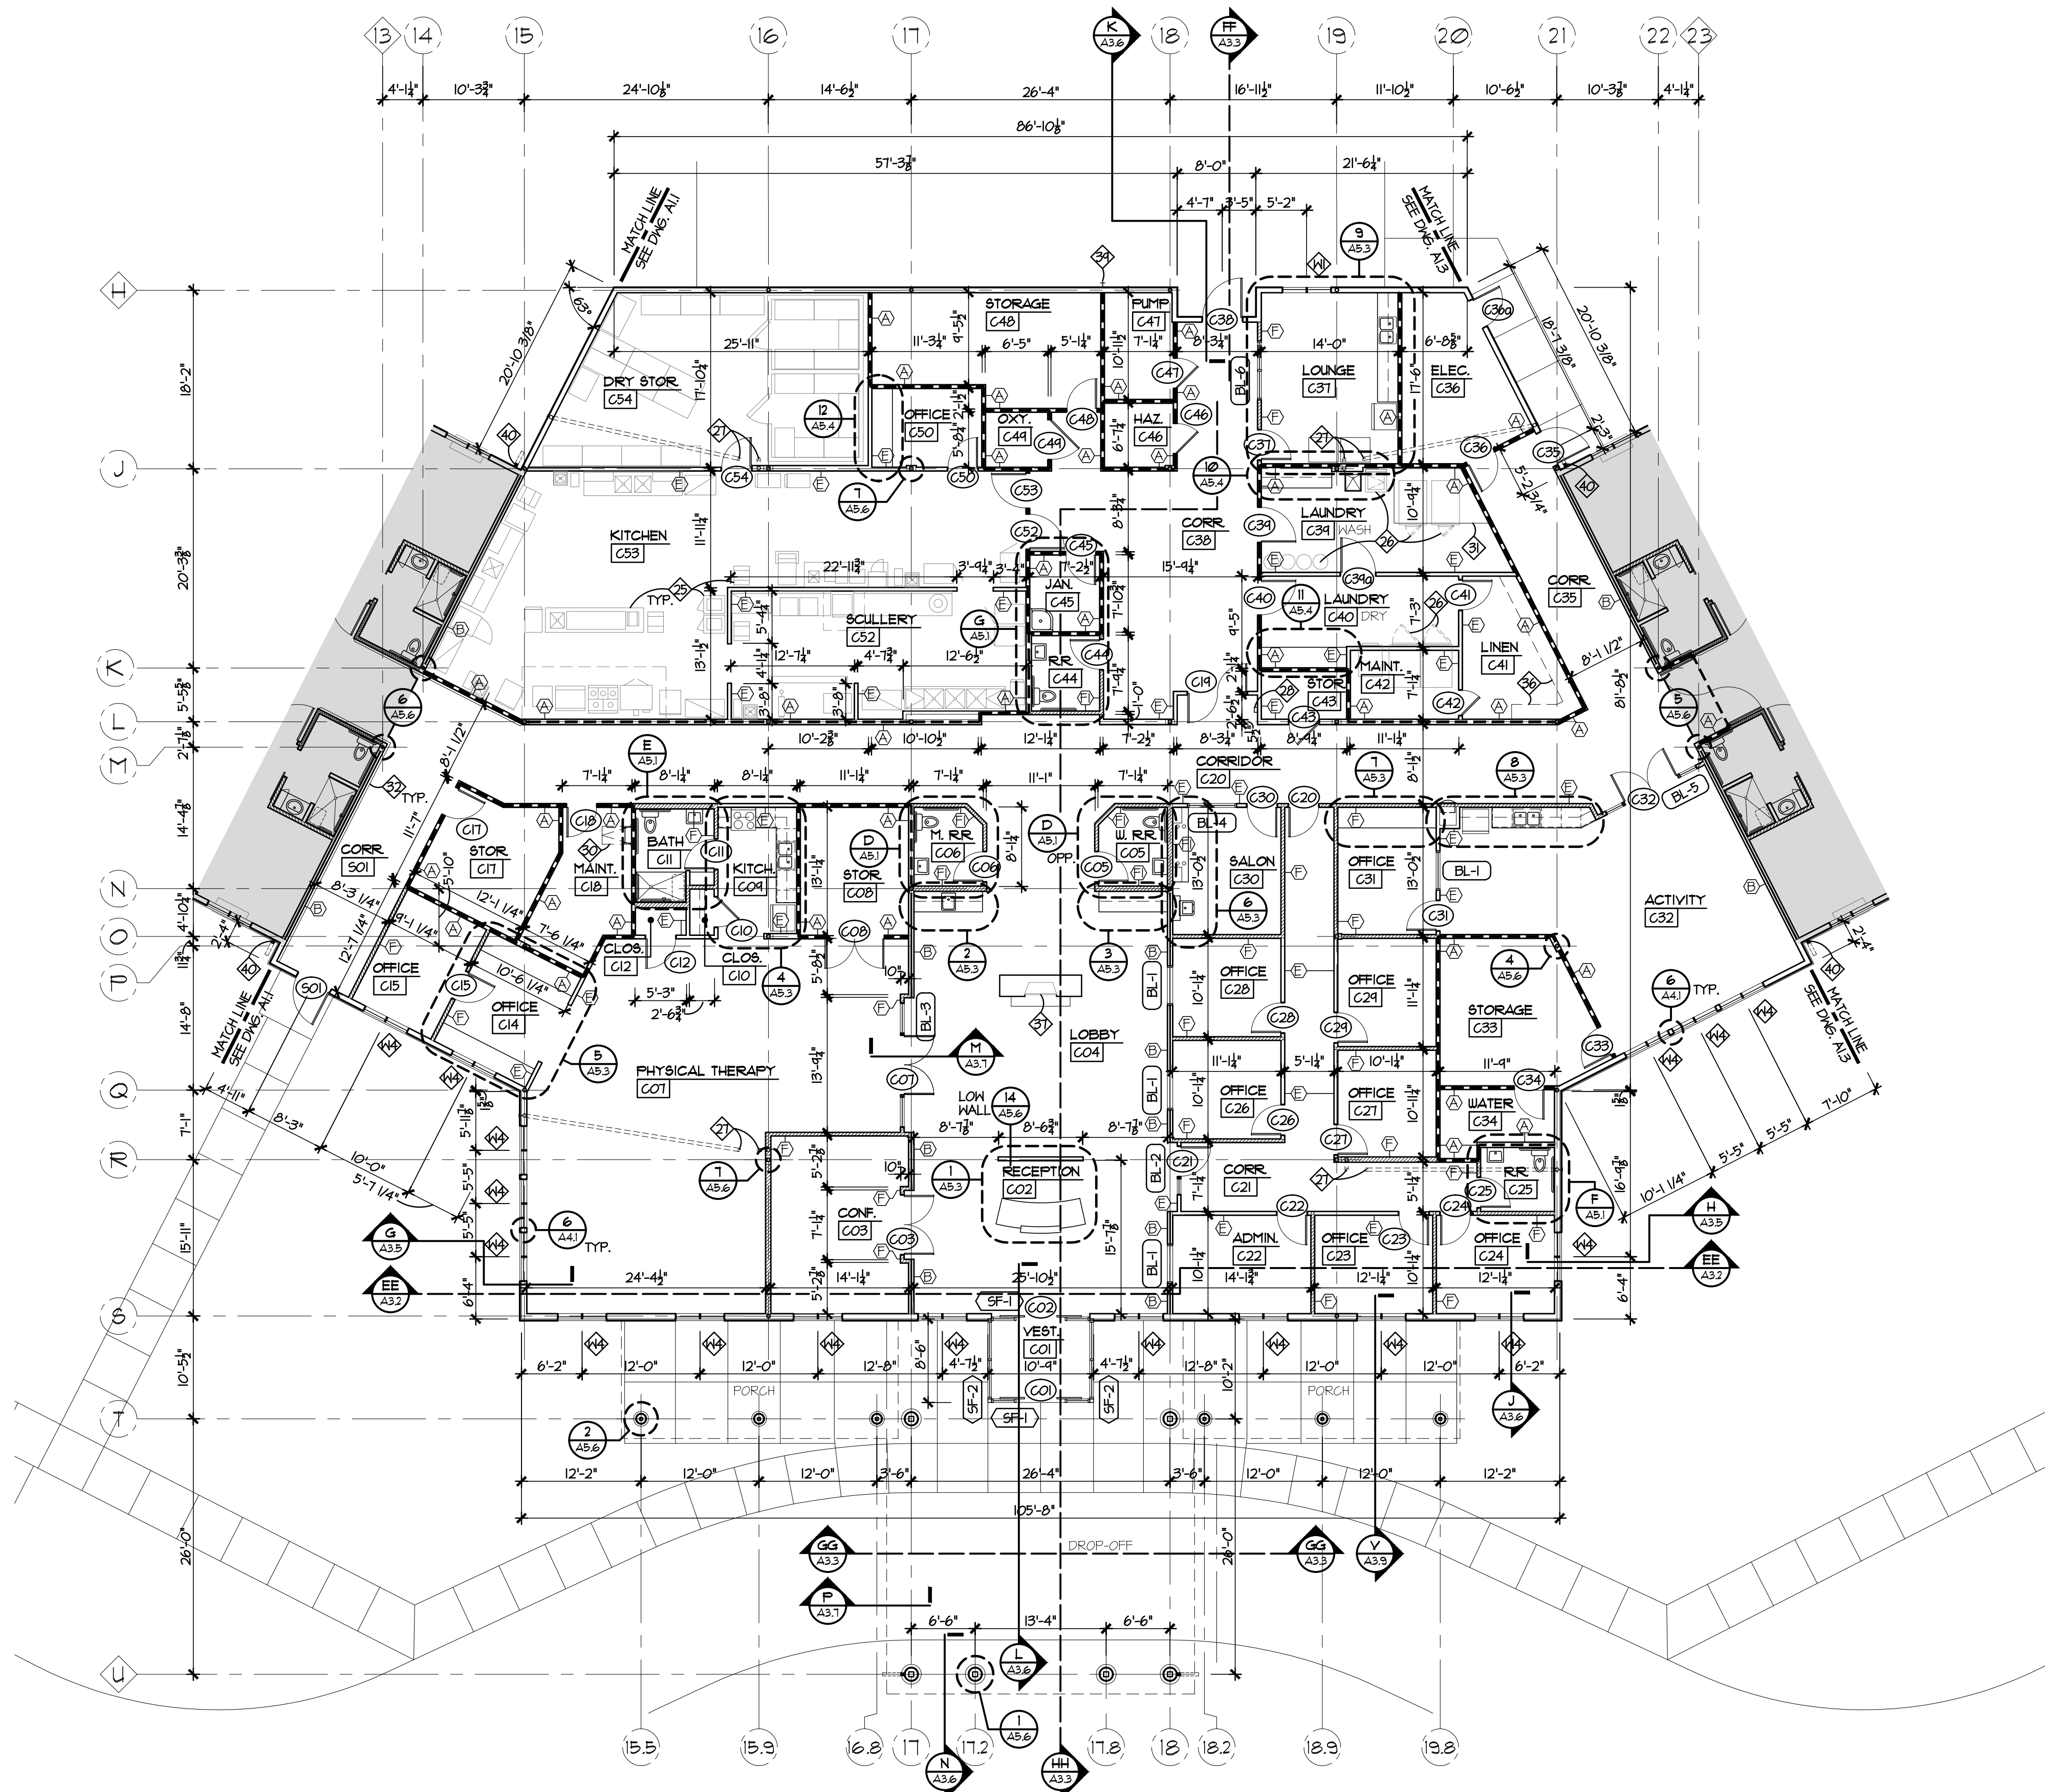


WALL LEGEND

NOTES:

1. PROVIDE 5/8" WATER RESISTANT CEMENTITIOUS BACKER BOARD ON ALL SHOWER WALLS SCHEDULED FOR TILE FINISH.
2. PROVIDE MOISTURE RESISTANT GYPSUM BOARD ON ALL OTHER WET WALL LOCATIONS (WATER CLOSETS, SINKS ETC.)
3. FURR OUT WALLS AS REQUIRED TO ACCOMMODATE PLUMBING.
4. PROVIDE 3-1/2" ACOUSTIC BATT INSULATION FULL HEIGHT IN STUD CAVITY AROUND RESIDENT ROOMS & RESTROOMS, TYPICAL.
5. 1 HOUR RATED GYPSUM BOARD CEILING (UL #522) TO BE CONTINUOUS THROUGHOUT. ONLY 1 HOUR RATED FIRE BARRIERS, SMOKE BARRIERS, LOAD BEARING WALLS AND SHEAR WALLS WITH A DOUBLE TOP PLATE PER VCC T14.5.2 EXCEPTION 1 MAY INTERRUPT FIRE RATED CEILING CONSTRUCTION. ALL OTHER NON-RATED PARTITIONS ARE TO UNDERSIDE OF GYPSUM BOARD CEILING MEMBRANE, TYPICAL.
6. PROVIDE 5 LB. MULTI-PURPOSE DRY CHEMICAL EXTINGUISHER IN SEMI-RECESSED CABINET, LARSEN ARCHITECTURAL SERIES #2404-R4 W/ SOLID DOOR & BLACK VERTICAL DIE-CUT LETTERS OR APPROVED EQUAL. VERIFY LOCATION AND QUANTITIES WITH LOCAL FIRE DEPARTMENT.

- 1 HOUR RATED LOAD BEARING EXTERIOR WALL
LOAD BEARING EXTERIOR WALL CONSTRUCTION. UL DESIGN #826. SEE WALL SECTIONS ON DRAWINGS A3.4 THRU A3.8.
- 1 HOUR RATED FIRE BARRIER / SMOKE BARRIER
5/8" TYPE 'X' GYPSUM BOARD EACH SIDE ON 2x4/2x6 WOOD STUDS @ 16" O.C. TO UNDERSIDE OF FIRE RATED CEILING/ STRUCTURE ABOVE. PROVIDE 3 1/2" ACOUSTIC INSULATION FULL HEIGHT IN STUD SPACE. UL DESIGN #B05/#B714.
- 1 HOUR RATED LOAD BEARING INTERIOR WALL
5/8" TYPE 'X' GYPSUM BOARD EACH SIDE ON 2x4/2x6 WOOD STUDS (SEE FLOOR PLANS) @ 16" O.C. TO UNDERSIDE OF FIRE RATED CEILING/ STRUCTURE ABOVE. PROVIDE 3 1/2" ACOUSTIC INSULATION FULL HEIGHT IN STUD SPACE. UL DESIGN #B05/#B714.
- 1 HOUR RATED INTERIOR SHEAR WALL
5/8" TYPE 'X' GYPSUM BOARD EACH SIDE ON 1/16" STRUCTURAL OSB ON 2x6 WOOD STUDS @ 16" O.C. TO UNDERSIDE OF FIRE RATED CEILING/ STRUCTURE ABOVE. PROVIDE 3 1/2" ACOUSTIC INSULATION FULL HEIGHT IN STUD SPACE. UL DESIGN #xxx. SEE STRUCTURAL PLANS.
- NON-RATED CORRIDOR SMOKE PARTITION
5/8" TYPE 'X' GYP. BOARD EA. SIDE OF 2x4 WOOD STUDS @ 16" O.C. TO UNDERSIDE OF FIRE RATED CEILING. GYPSUM BOARD TO BE SEALED SMOKE TIGHT ON NON-CORRIDOR SIDE. PROVIDE 3 1/2" ACOUSTIC INSULATION FULL HEIGHT IN STUD SPACE. SEAL ALL PENETRATIONS ON NON-CORRIDOR SIDE SMOKE TIGHT.
- TYPICAL INTERIOR PARTITION
5/8" GYP. BOARD EA. SIDE ON 2x4 WOOD STUDS @ 16" O.C. TO UNDERSIDE OF GYP. BOARD CEILING ABOVE OR TO 6" ABOVE SUSPENDED ACOUSTIC TILE CEILINGS UNO. BRACE FOR STABILITY AS REQUIRED.
- TYPICAL SOUND INSULATED INTERIOR PARTITION
5/8" GYP. BOARD EA. SIDE OF 2x4 / 2x6 WOOD STUDS @ 16" O.C. TO 6" ABOVE SUSPENDED ACOUSTICAL TILE CEILINGS WHERE INDICATED '(C)'. OR TO UNDERSIDE OF RATED CEILING ABOVE WHERE INDICATED '(F)'. PROVIDE 3 1/2" ACOUSTIC INSULATION FULL HEIGHT IN STUD SPACE. BRACE FOR STABILITY AS REQUIRED.
- 2-HOUR RATED NON-BEARING FIRE WALL
(2) LAYERS 5/8" TYPE 'X' GYPSUM BOARD ON EA. SIDE OF 2x6 WOOD STUDS @ 16" O.C. TO TERMINATE AT UNDERSIDE OF ROOF SHEATHING ABOVE PER VCC T06.6 (EXCEPTION 4) (UL #B301). PROVIDE WALL FURRING EACH SIDE, (1) LAYER 5/8" GYP. BD. ON 2x4 WOOD STUDS @ 16" O.C. TO UNDERSIDE OF CEILING CONSTRUCTION ABOVE W/ ACOUSTIC INSULATION FULL HEIGHT IN STUD SPACE. SEE SECTION 5/A3.8.



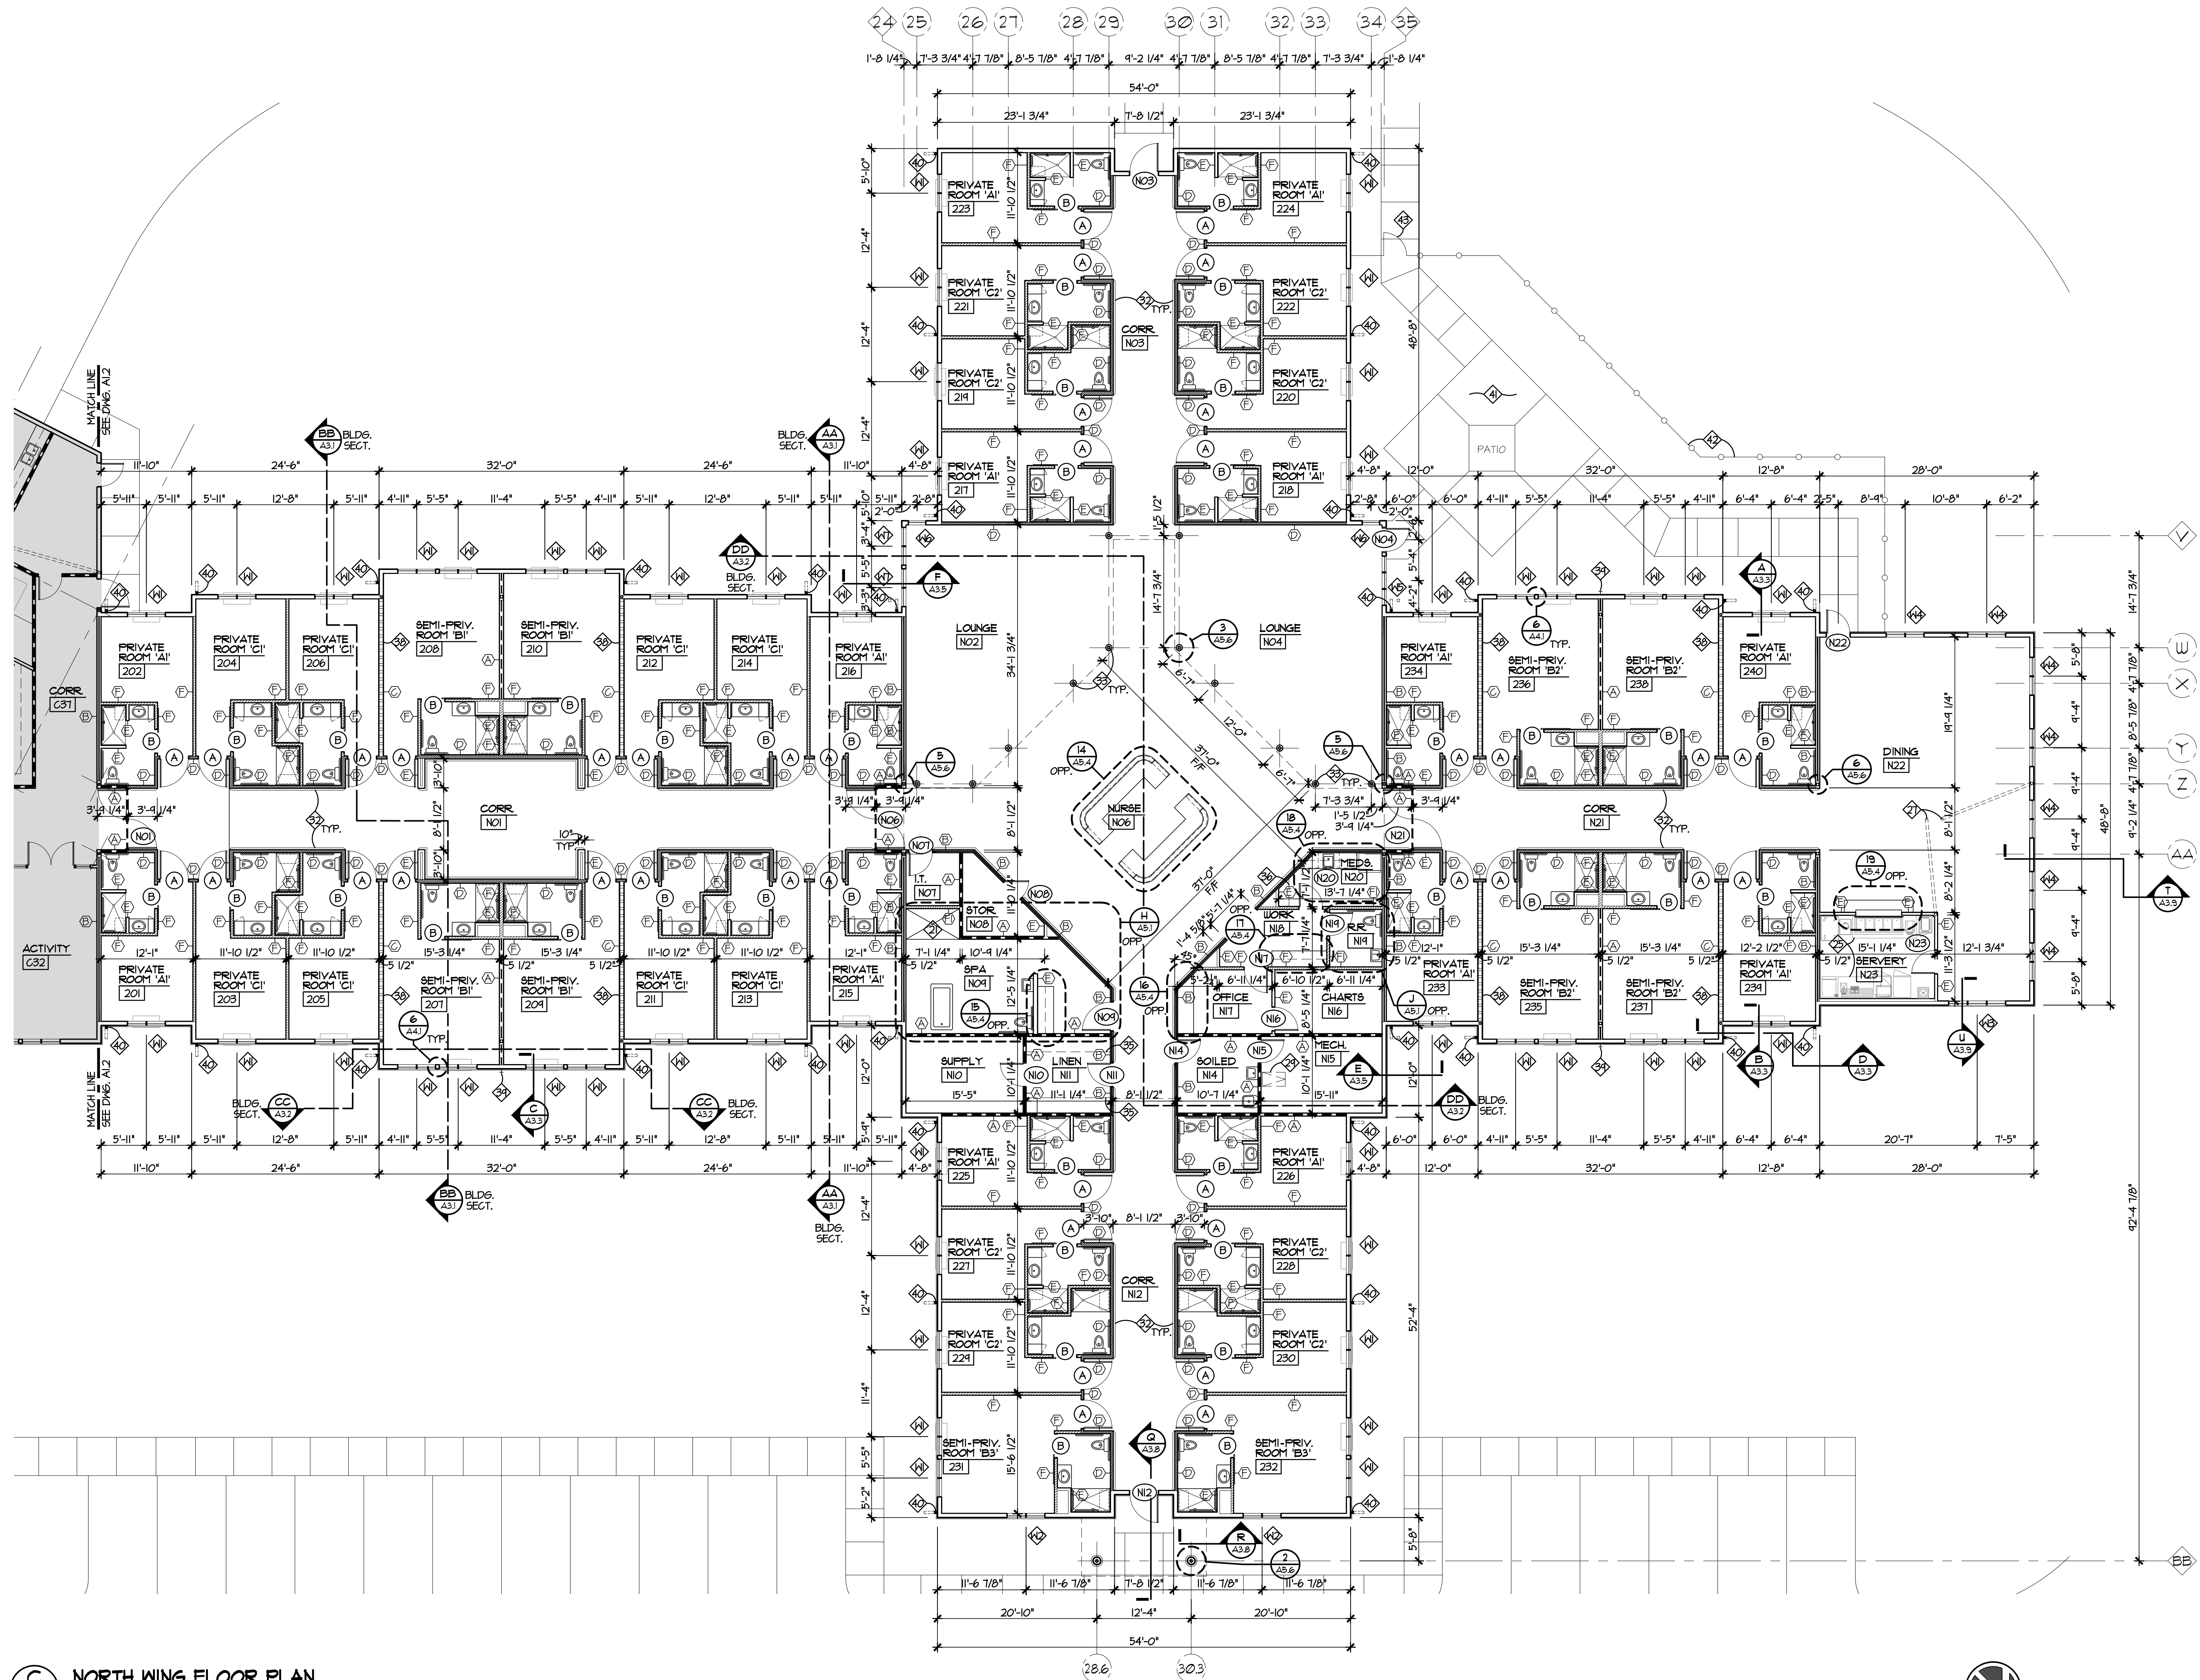



C NORTH WING FLOOR PLAN

A1.3 SCALE: 1" = 10'-0" 

NOTES:

- SEE DRAWING A1.2 FOR WALL TYPE LEGEND
- SEE DRAWING A5.1 FOR KEYNOTE LEGEND

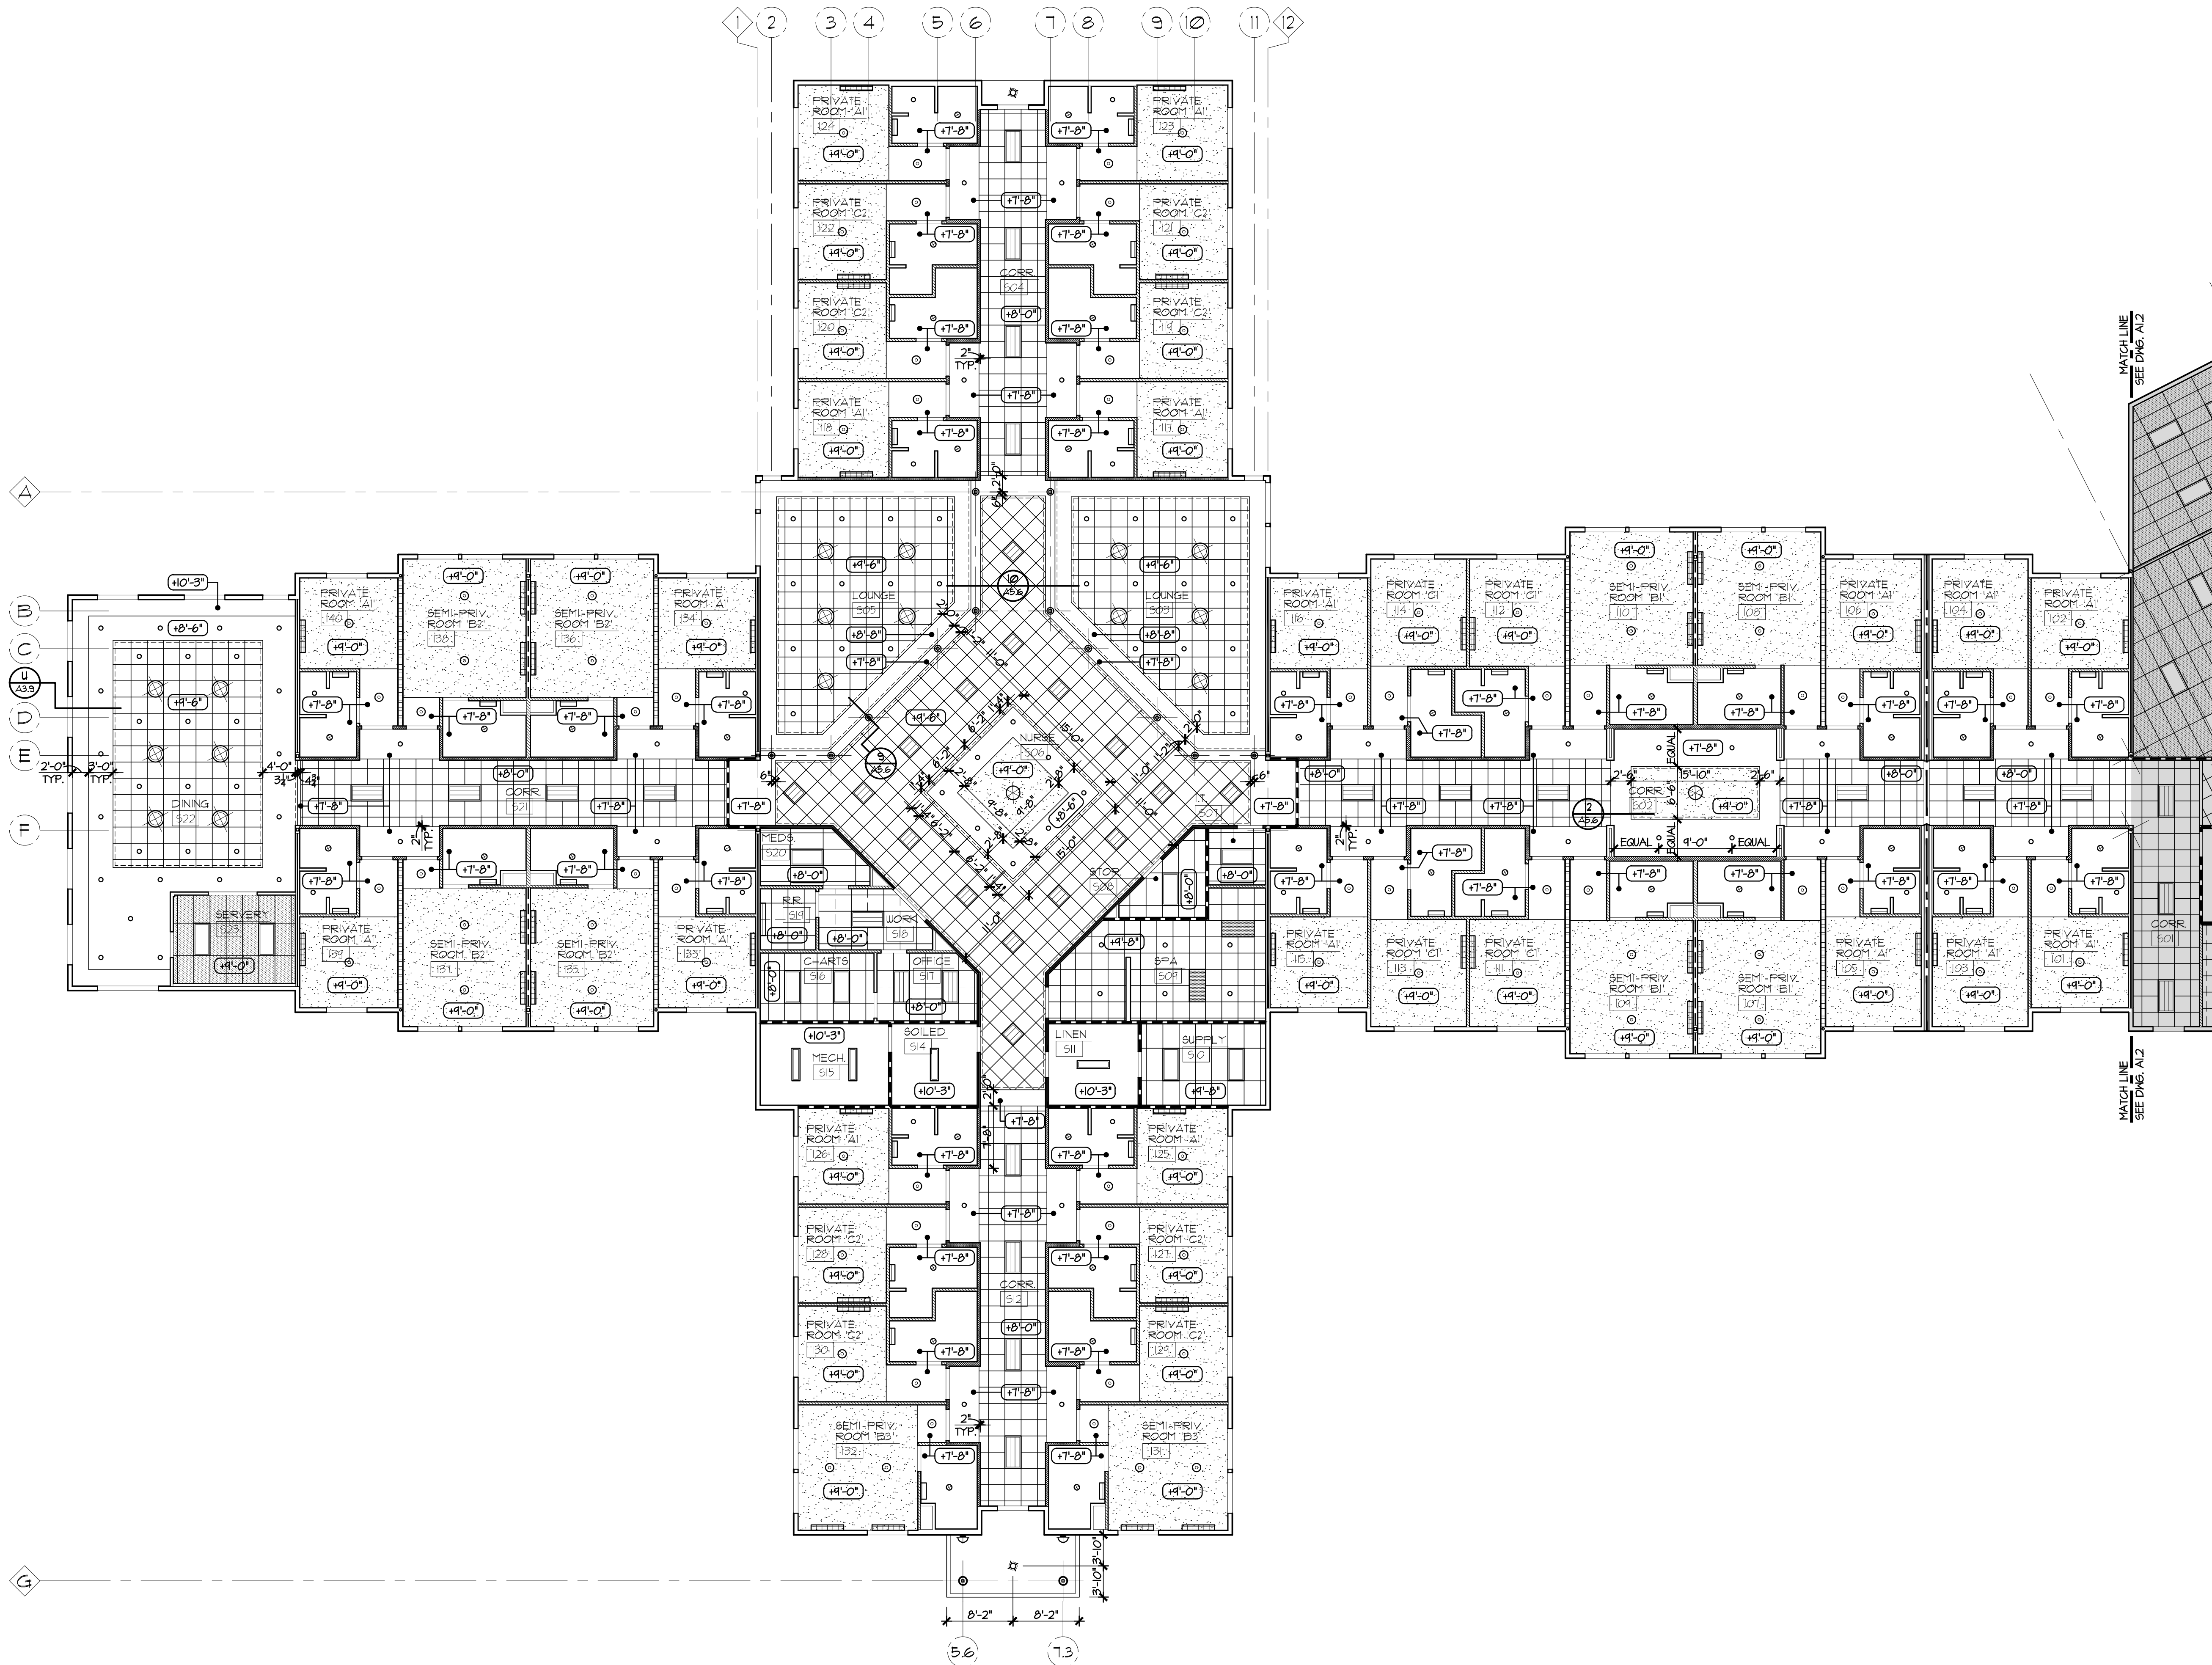

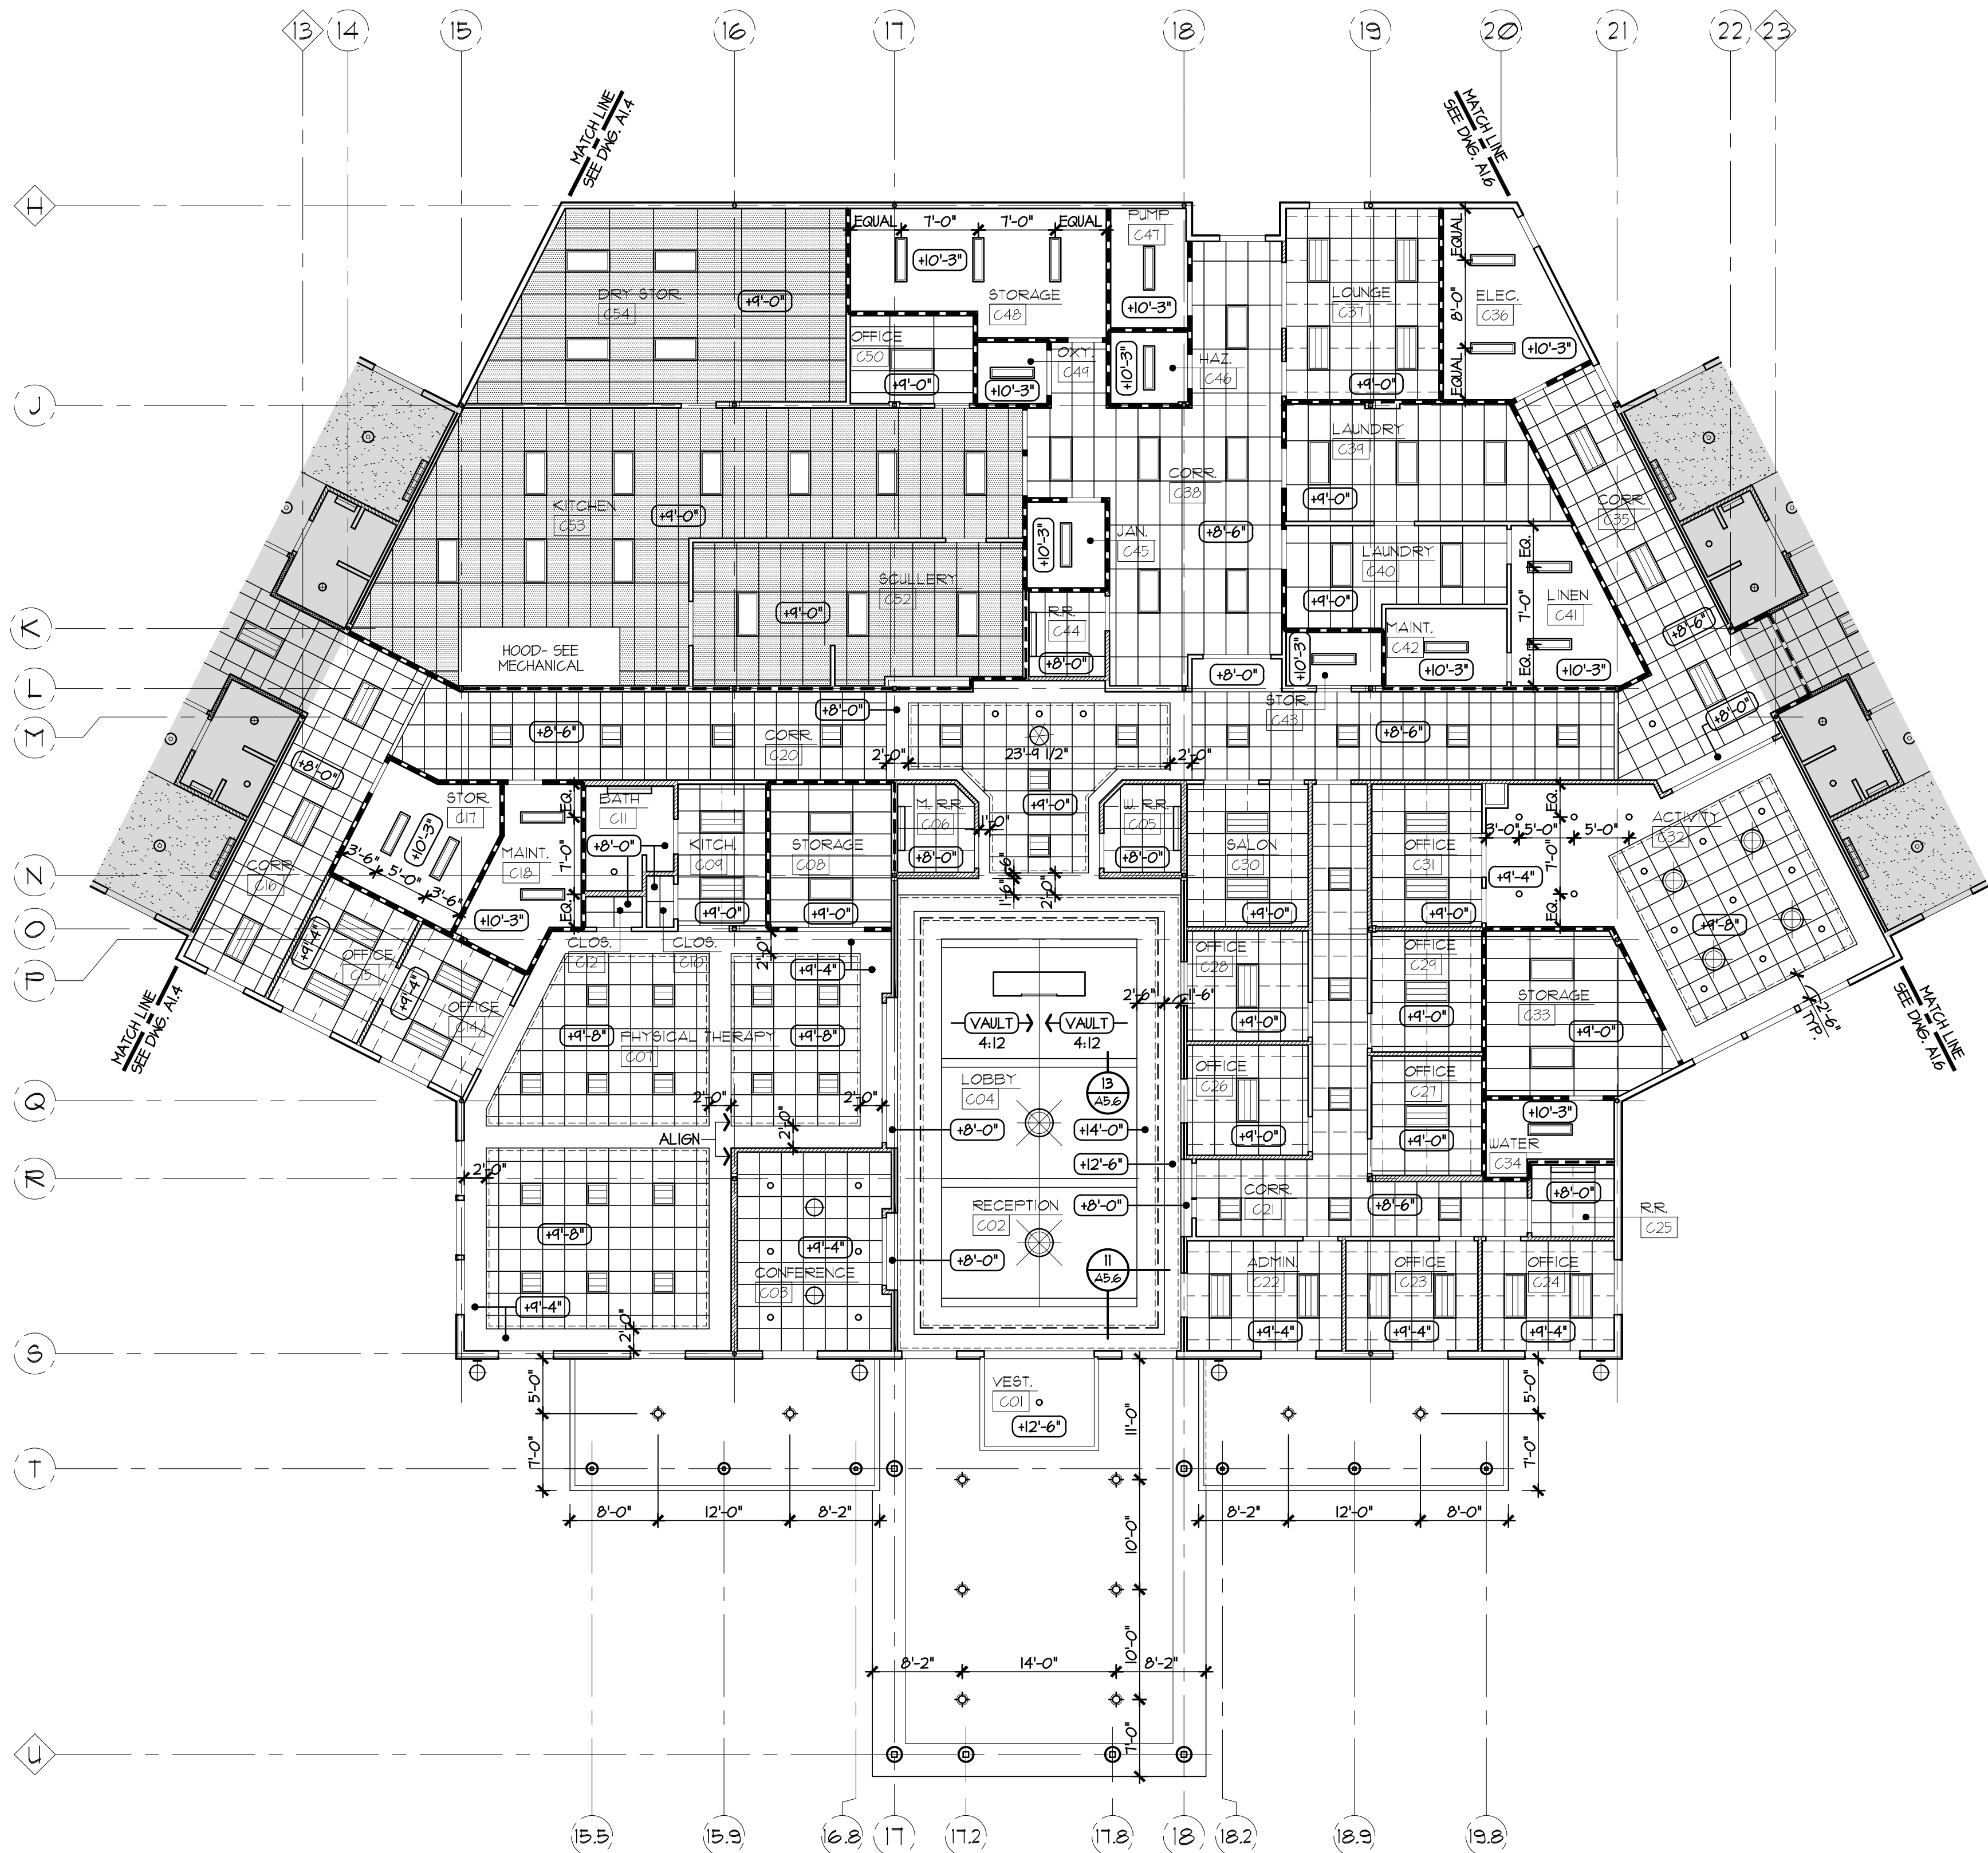

REFLECTED CEILING LEGEND

- NOTES:
- LOCATE CEILING GRID IN ROOMS AS SHOWN.
 - CENTER DOWN LIGHTS, SPRINKLER HEADS, ETC., IN CENTER OF SIMULATED 2X2 CEILING PANELS UNLESS INDICATED OTHERWISE.
 - SEE ROOM FINISH SCHEDULE ON SHEET ATJ FOR CEILING SPECIFICATIONS.
 - SEE ELECTRICAL & MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- 2X2 SUSPENDED ACOUSTIC TILE CEILING SYSTEM
 - 2X4 (2X2 SIMULATED) SUSPENDED ACOUSTIC TILE CEILING SYSTEM
 - 2X4 SUSPENDED ACOUSTIC TILE CEILING SYSTEM
 - 2X4 SUSPENDED WASHABLE CEILING SYSTEM
 - SMOOTH GYPSUM BOARD FINISHED CEILING / SOFFIT / BULKHEAD
 - TEXTURED GYPSUM BOARD FINISHED CEILING
 - CROWN MOLDING AT SOFFIT
 - 2X4' RECESSED LIGHT FIXTURE
 - 2X4' DIRECT / INDIRECT RECESSED LIGHT FIXTURE
 - 2X2' DIRECT / INDIRECT RECESSED LIGHT FIXTURE
 - 4' LINEAR SURFACE MOUNTED LIGHT FIXTURE
 - WALL MOUNTED LINEAR ABOVE-BED LIGHT FIXTURE, COORDINATE LOCATION & MOUNTING HEIGHT W/OWNER
 - 4' WALL MOUNTED VANITY LIGHT FIXTURE
 - 2' WALL MOUNTED VANITY LIGHT FIXTURE- CENTER OVER SINK
 - COVE LIGHT FIXTURE
 - LARGE DECORATIVE CHANDELIER
 - LARGE DECORATIVE SURFACE MOUNTED LIGHT FIXTURE
 - LARGE PENDANT MOUNT LIGHT FIXTURE
 - MEDIUM PENDANT MOUNT LIGHT FIXTURE
 - SMALL DECORATIVE PENDANT LIGHT FIXTURE
 - CEILING MOUNTED RESTROOM LIGHT FIXTURE
 - RECESSED DOWNLIGHT FIXTURE
 - EXTERIOR RECESSED DOWNLIGHT FIXTURE
 - EXTERIOR LARGE DECORATIVE SCONCE LIGHT FIXTURE
 - EXTERIOR SMALL DECORATIVE SCONCE LIGHT FIXTURE


CENTER REFLECTED CEILING PLAN

SCALE: 1" = 10'-0" 0' 10'

NOTES:

- ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE FROM FINISHED FACE



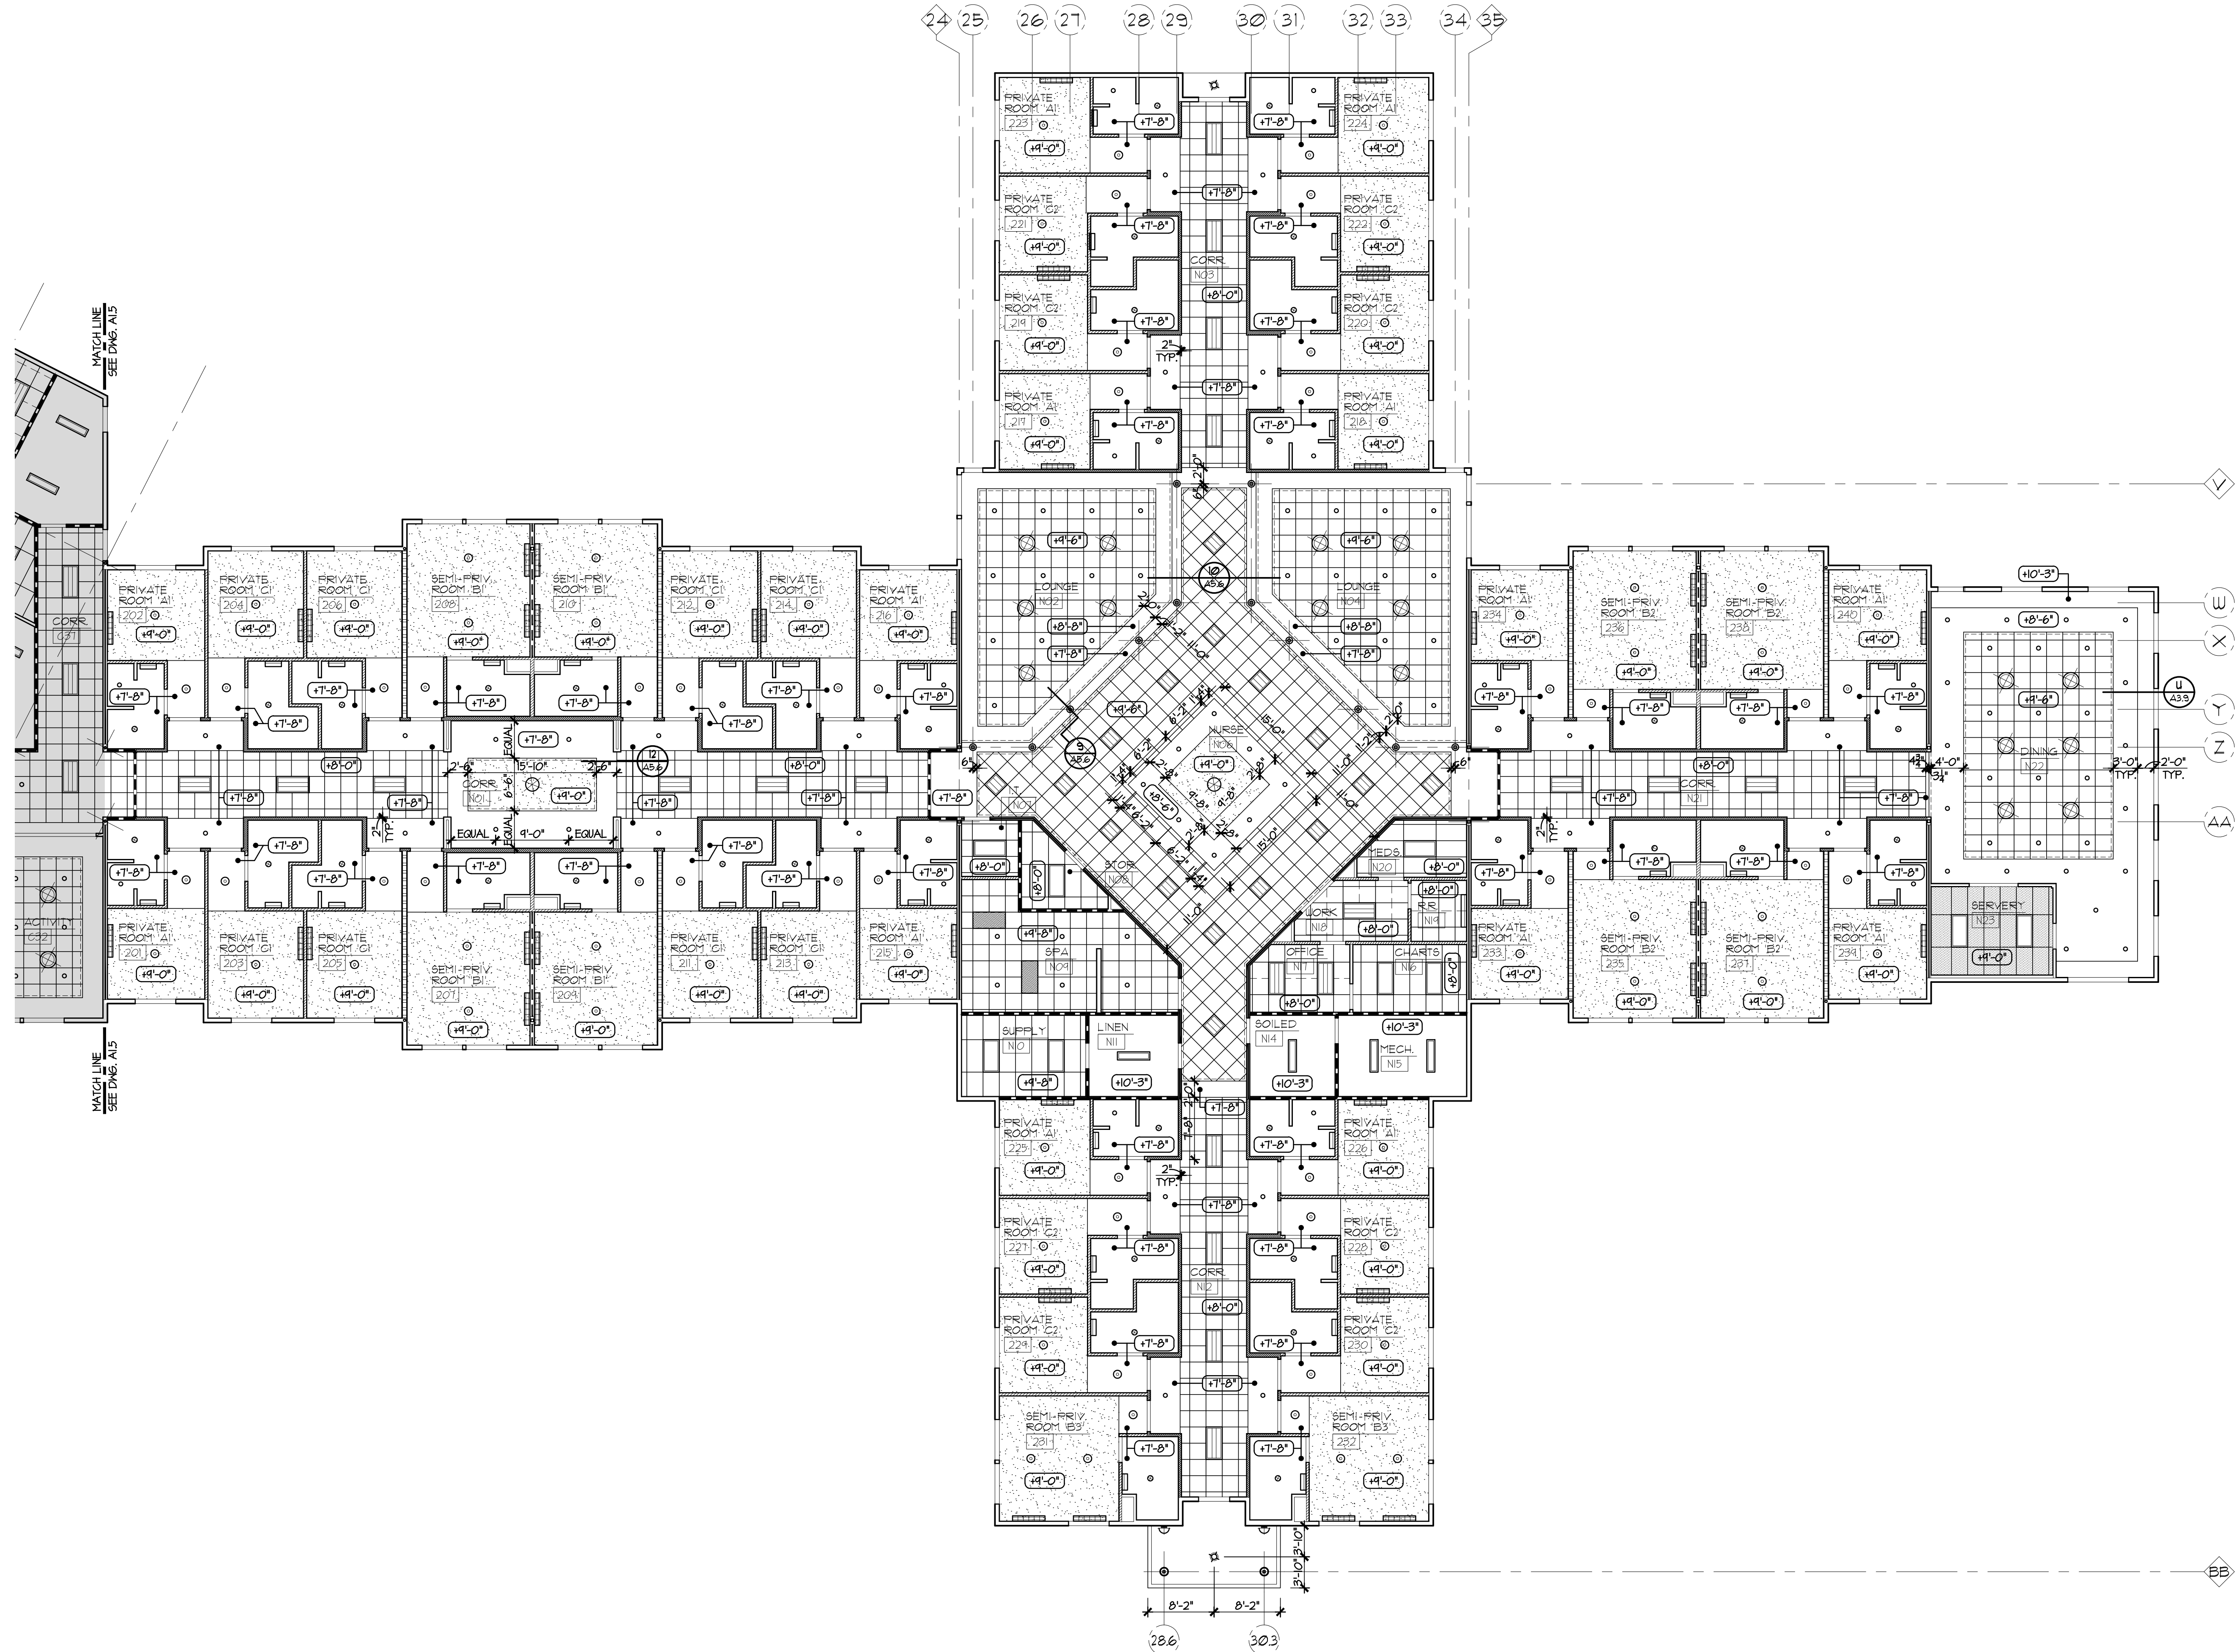

NORTH WING REFLECTED CEILING PLAN


SCALE: 1" = 10'-0" 0" 10"

NOTES:
- SEE DRAWING A1.5 FOR REFLECTED CEILING LEGEND
- ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE FROM FINISHED FACE







A PARTIAL EAST ELEVATION
A2.1 SCALE: 1/8" = 1'-0"

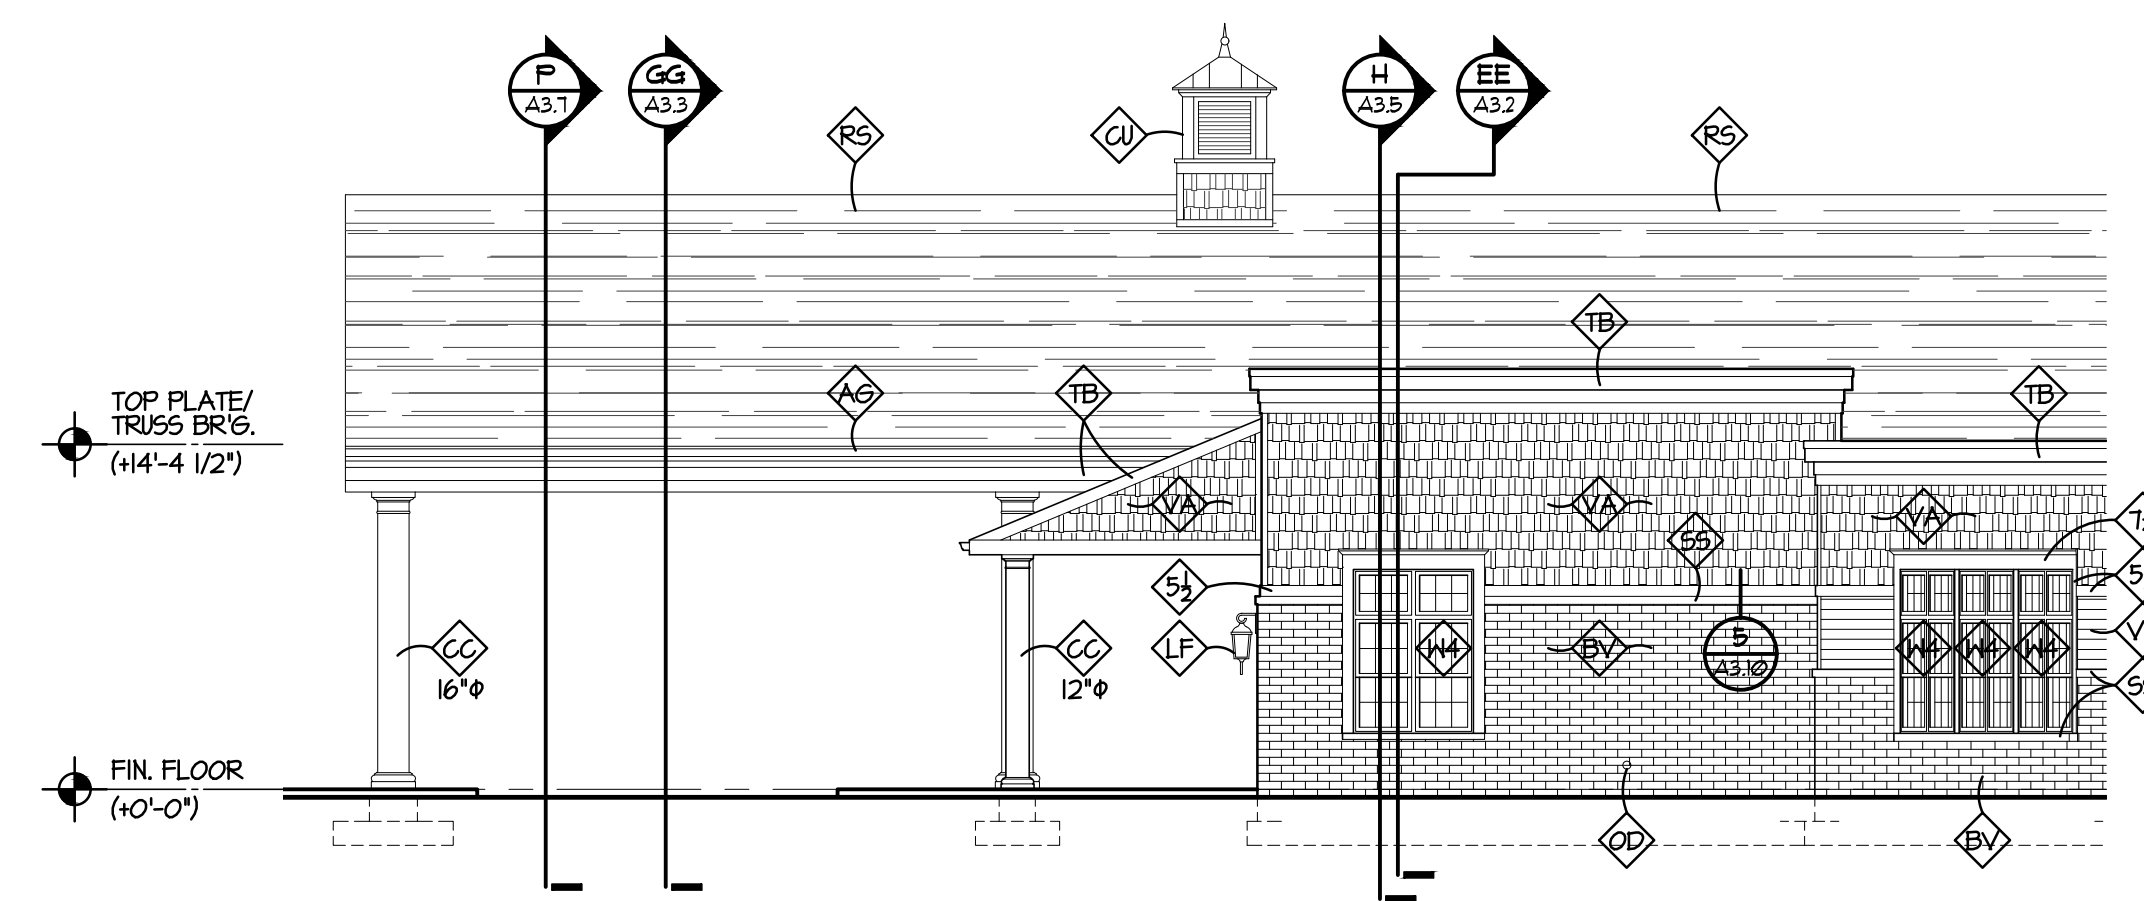


B PARTIAL NORTH ELEVATION
A2.1 SCALE: 1/8" = 1'-0"

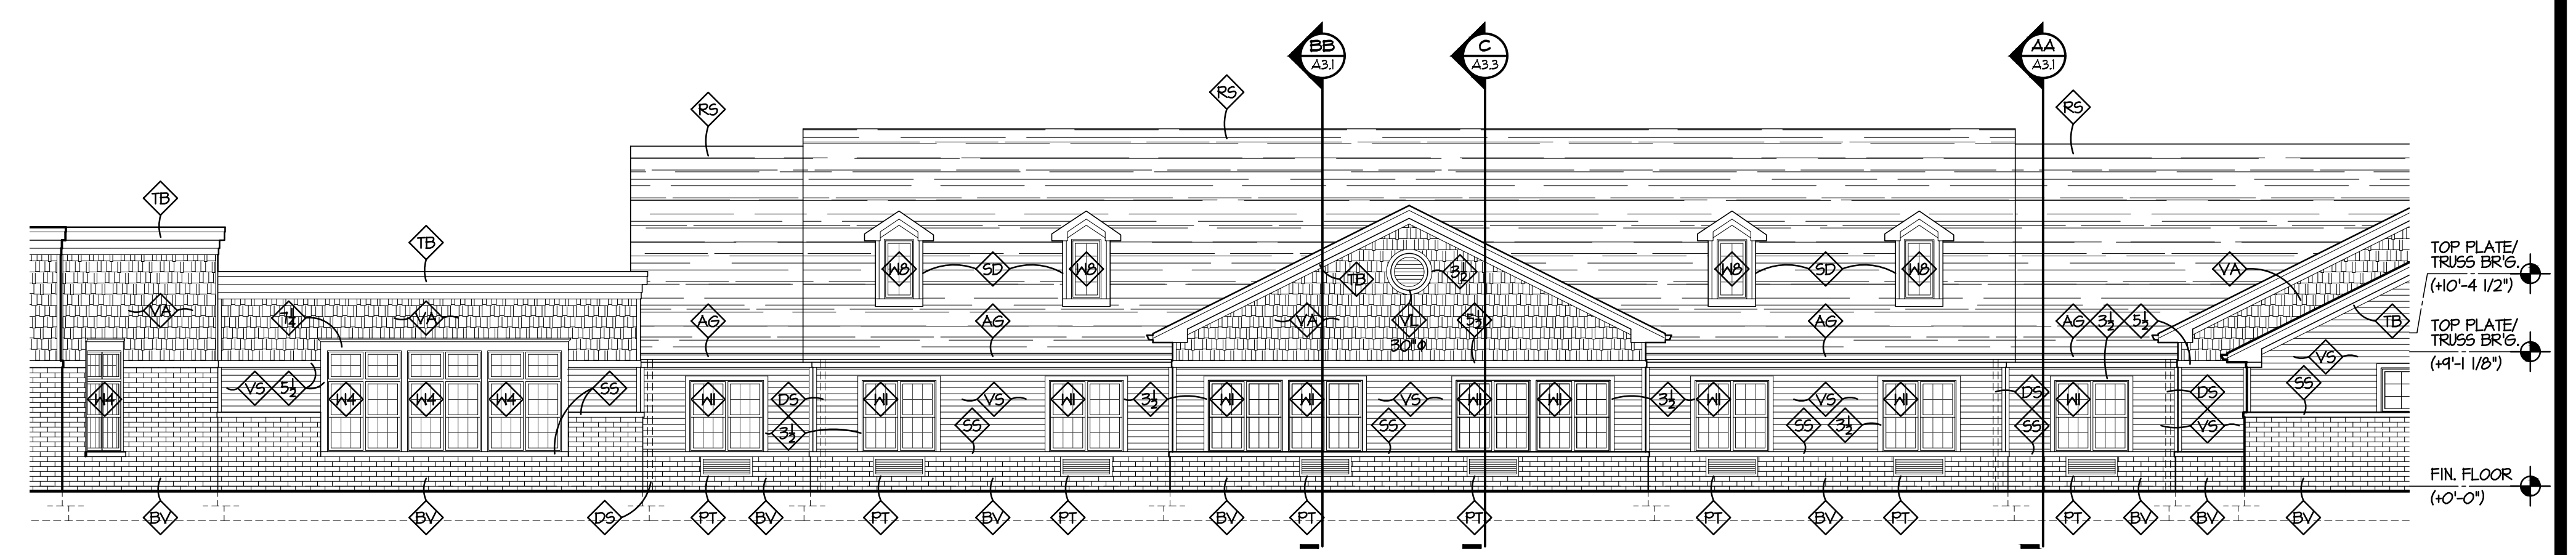


C PARTIAL NORTHEAST ELEVATION
A2.1 SCALE: 1/8" = 1'-0"

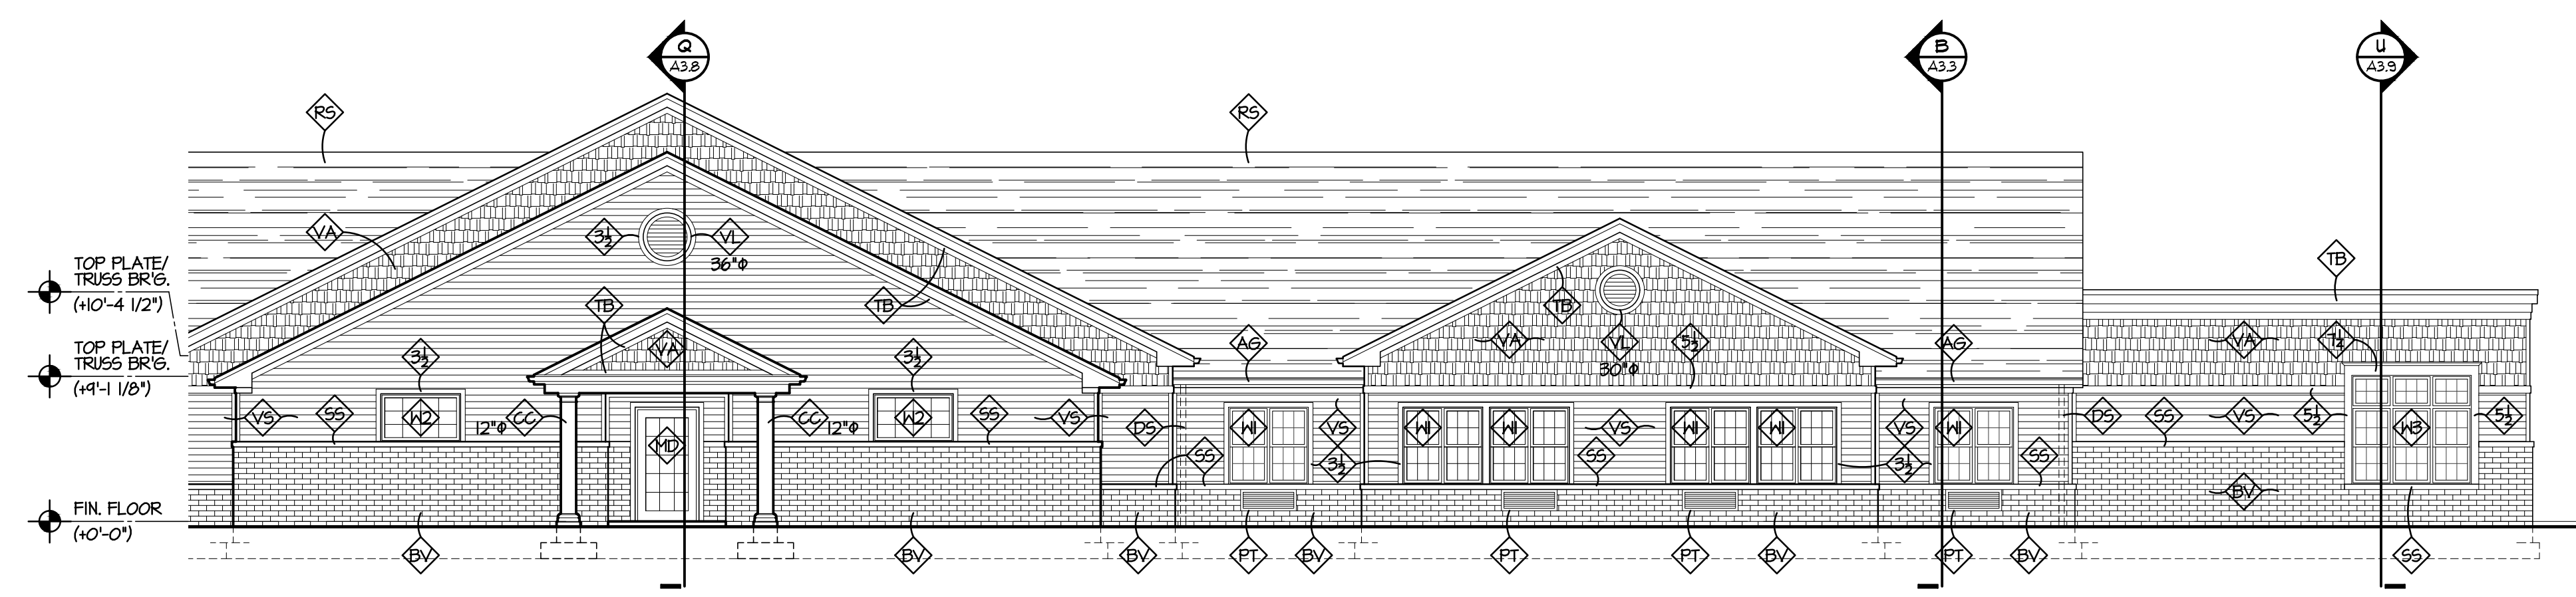


D PARTIAL NORTHEAST ELEVATION
A2.1 SCALE: 1/8" = 1'-0"

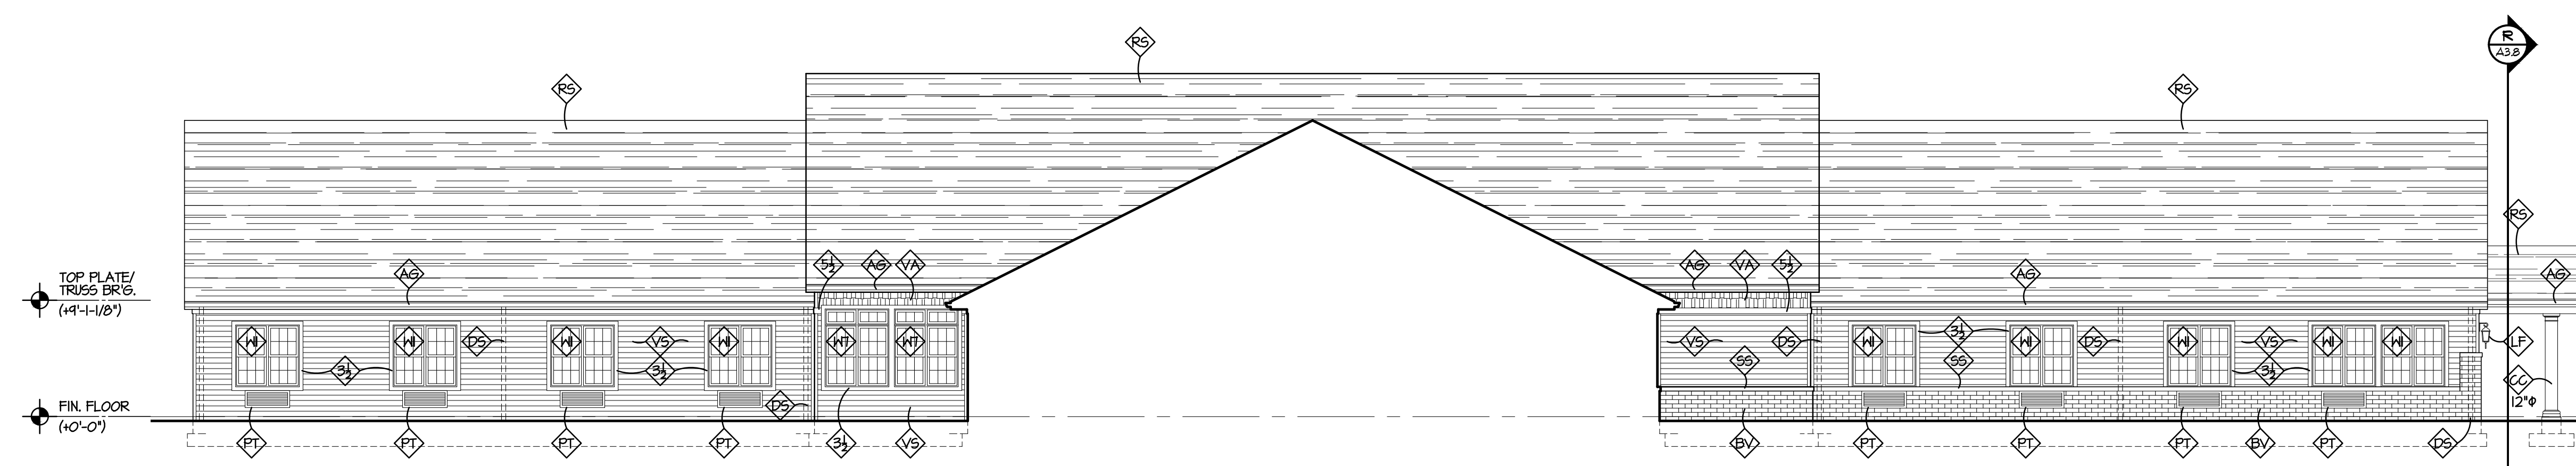


E PARTIAL SOUTHEAST ELEVATION
A2.1 SCALE: 1/8" = 1'-0"

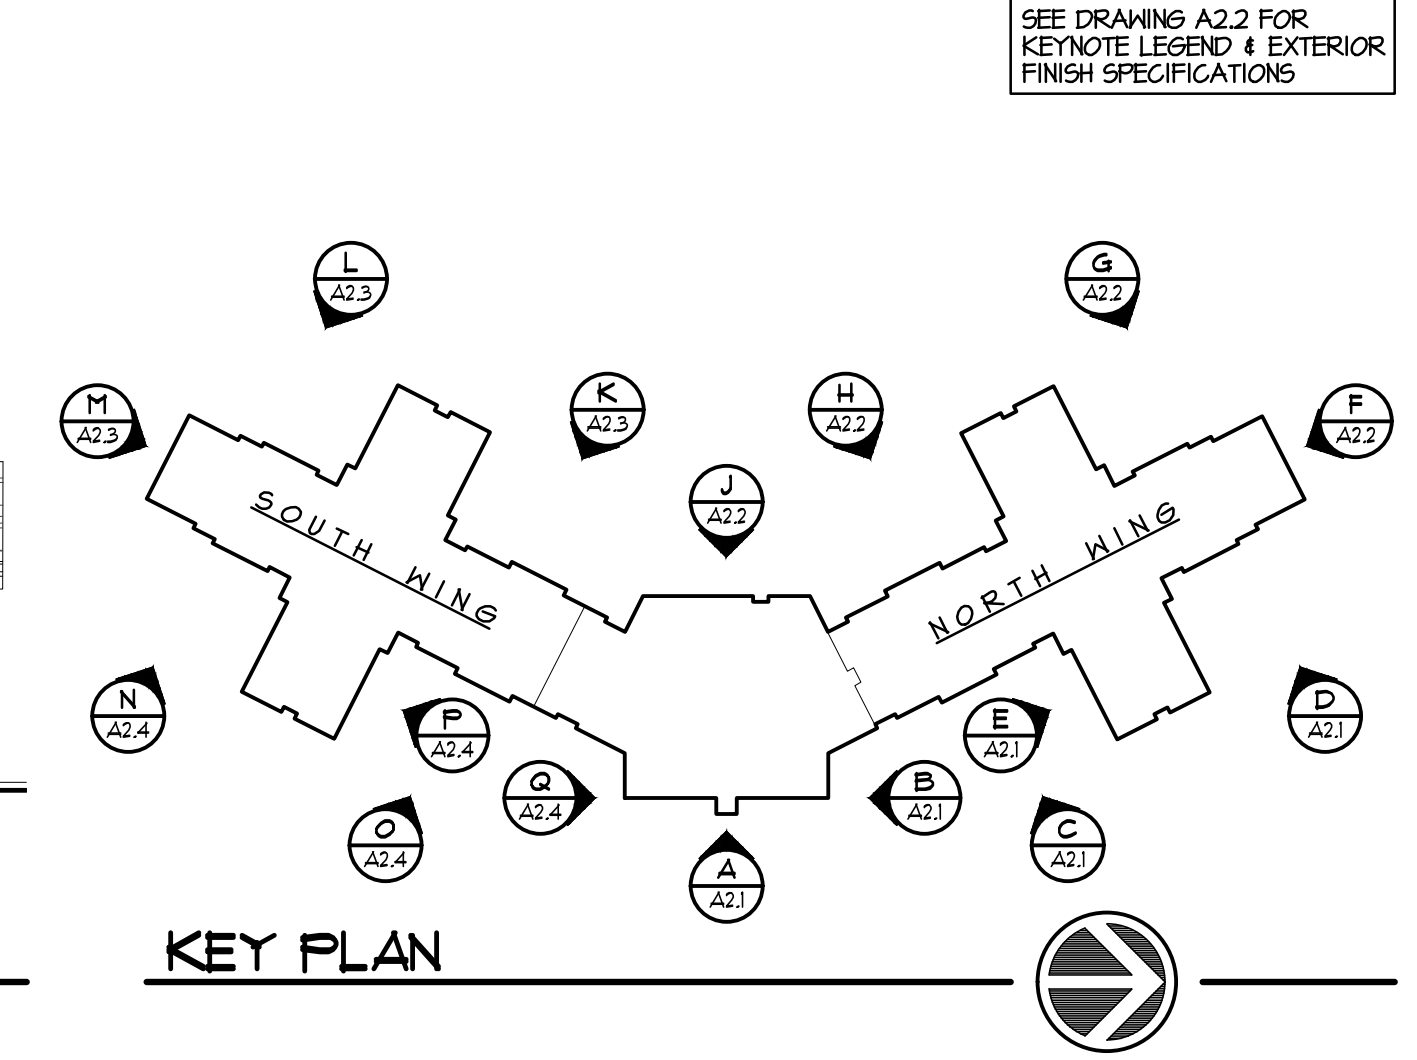


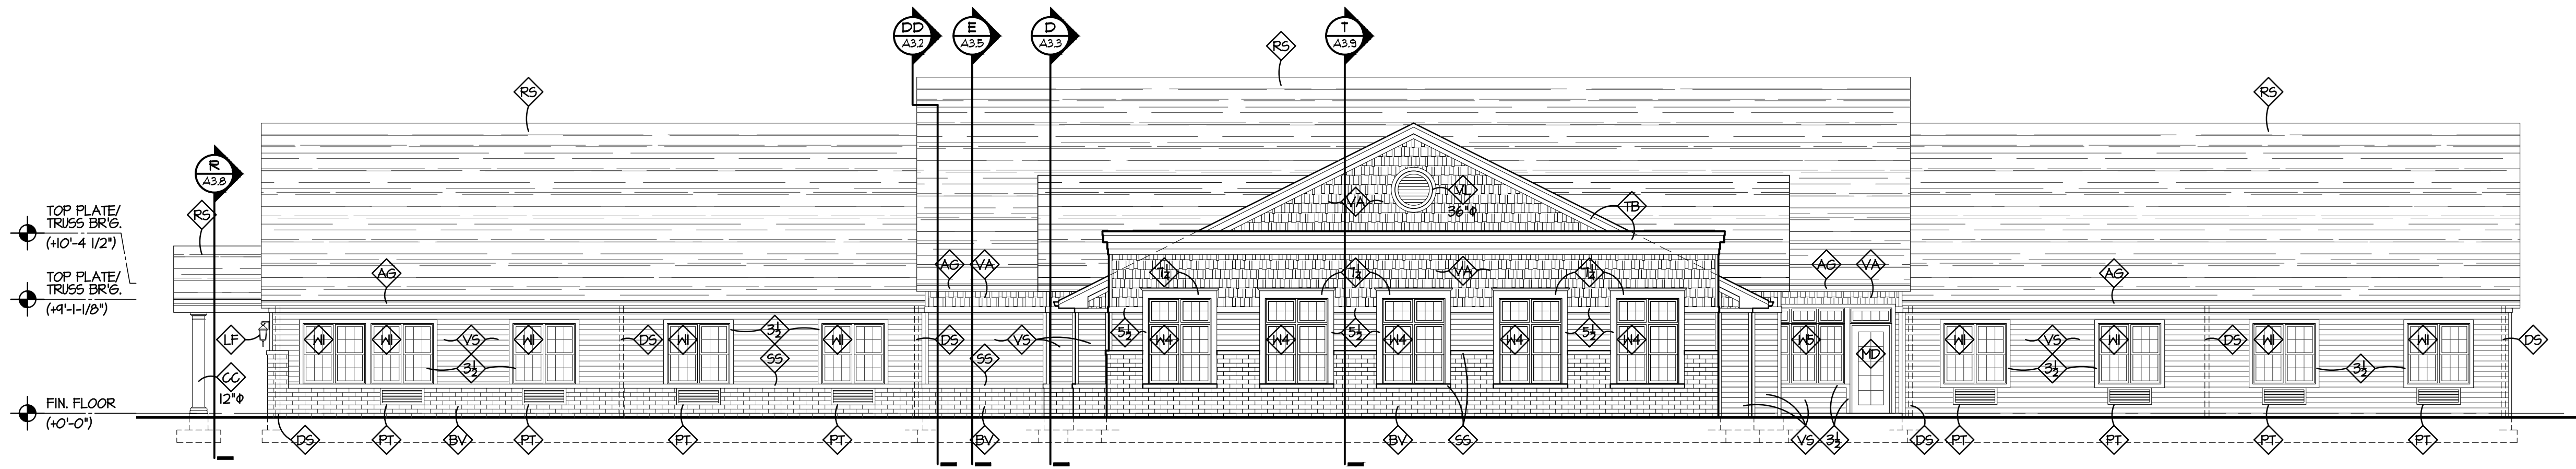


F PARTIAL NORTHWEST ELEVATION
A22 SCALE: 1/8" = 1'-0"

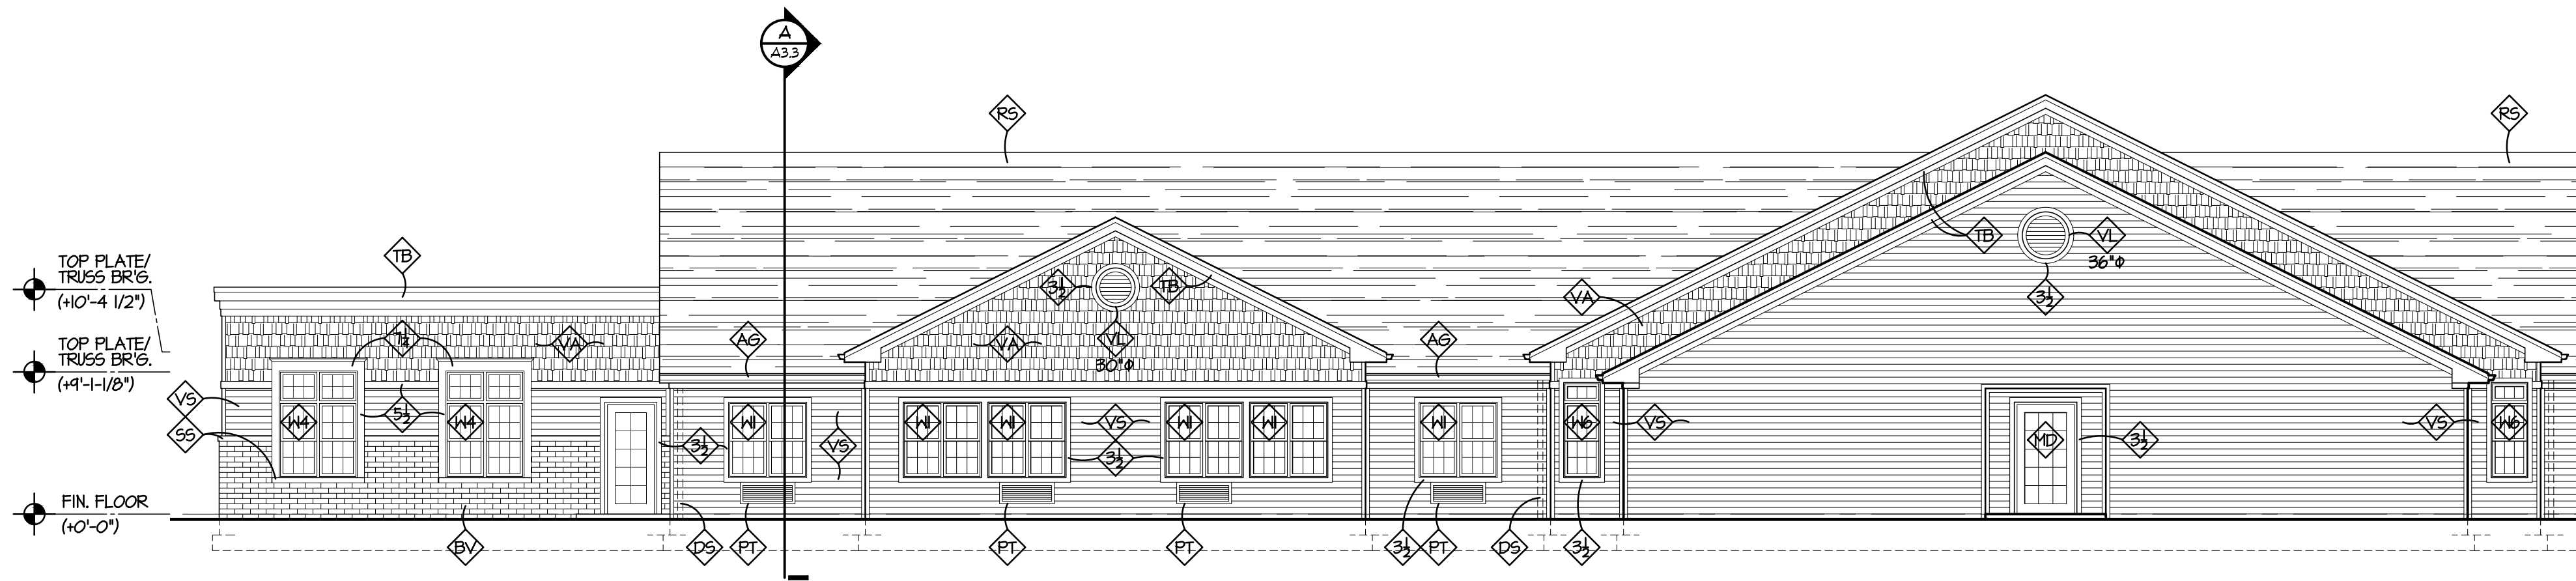

G PARTIAL SOUTHWEST ELEVATION
A22 SCALE: 1/8" = 1'-0"

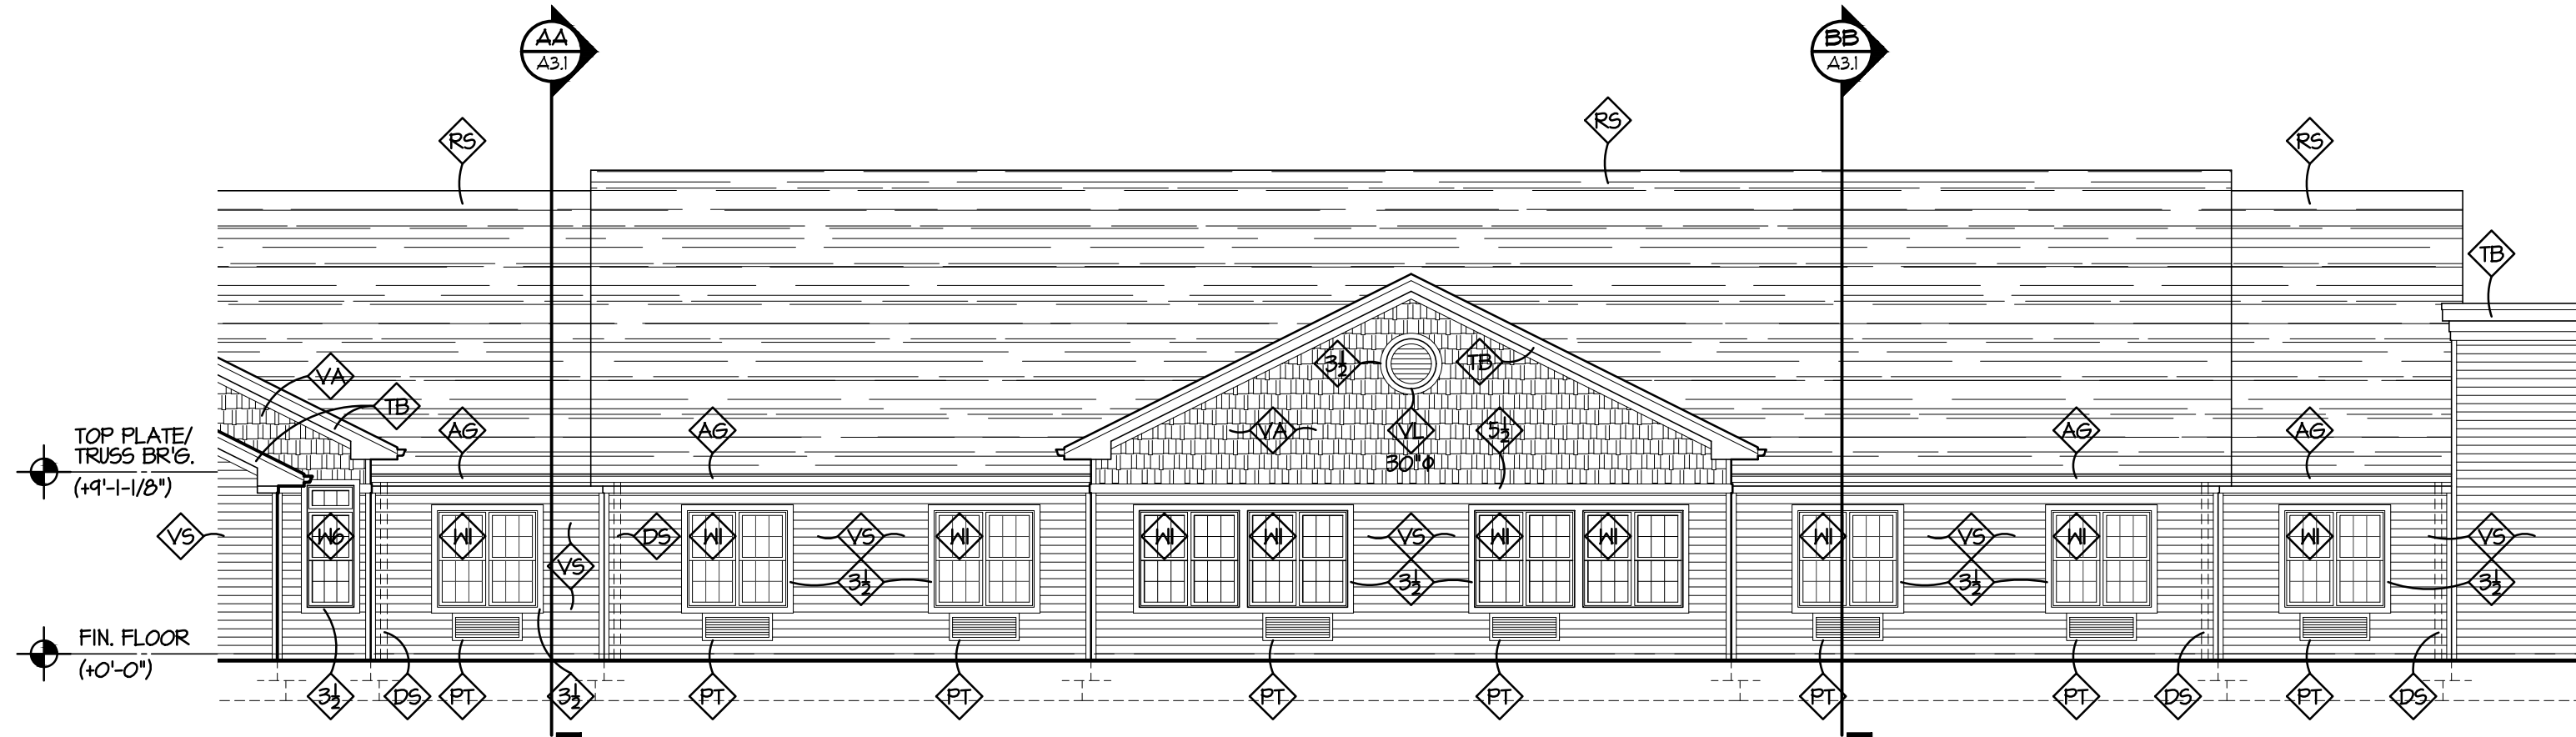

H PARTIAL SOUTHWEST ELEVATION
A22 SCALE: 1/8" = 1'-0"

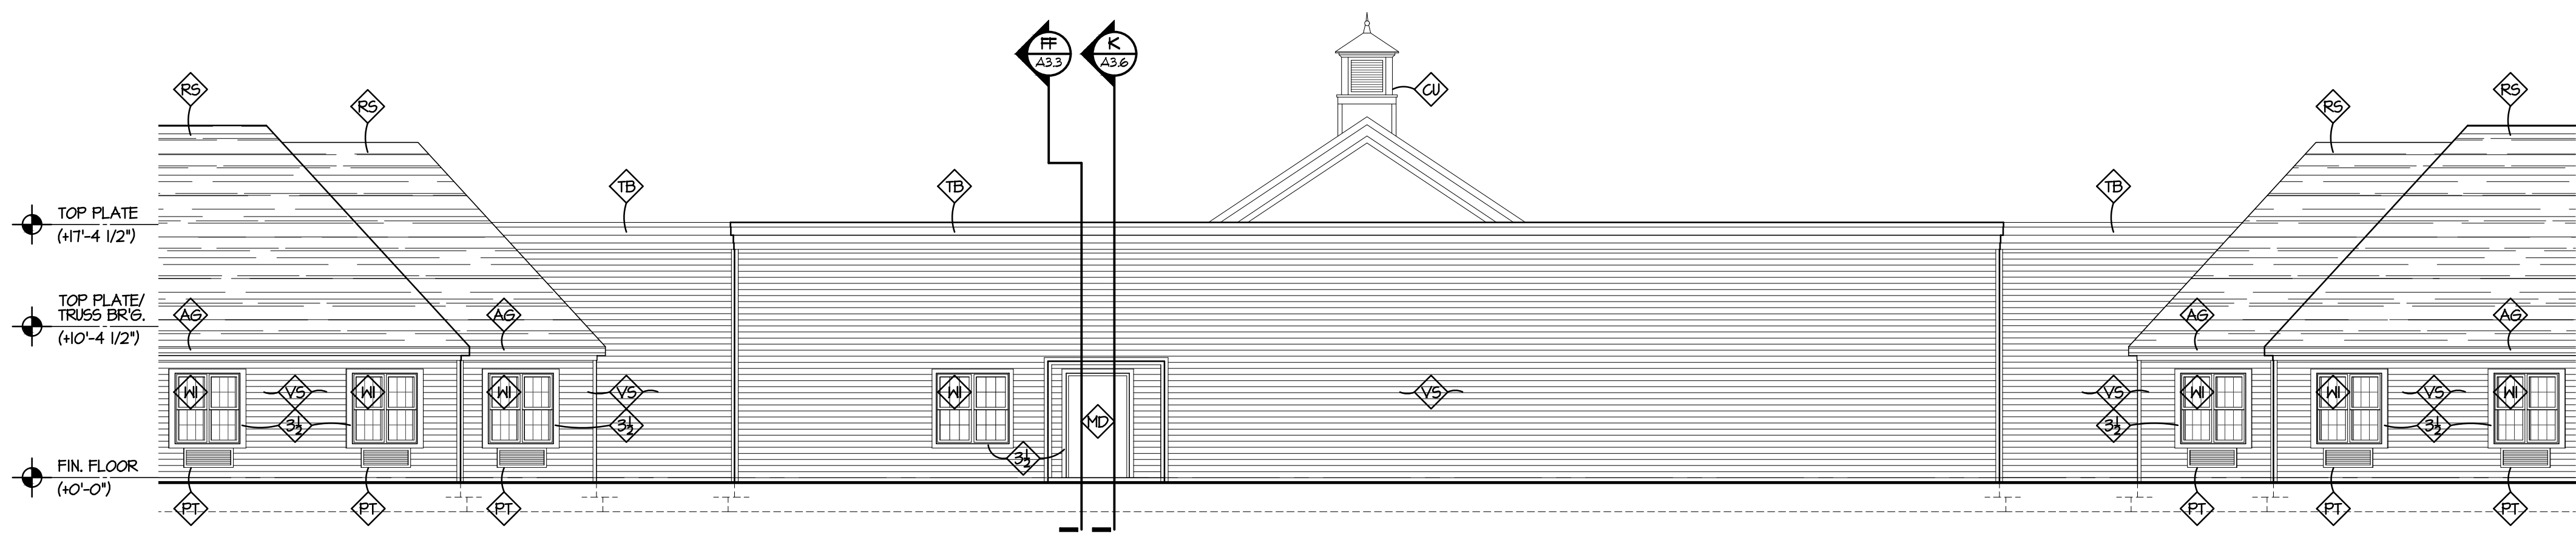


J PARTIAL WEST ELEVATION
A22 SCALE: 1/8" = 1'-0"


KEYNOTE LEGEND

- AG PREFINISHED ALUMINUM GUTTER ON 1x PVC TRIM BOARD, SEE WALL SECTIONS
- EV THIN BRICK VENEER, SEE EXTERIOR FINISH SPECIFICATIONS. SUBMIT BRICK & MORTAR SAMPLES TO ARCHITECT FOR APPROVAL.
- LC FIBERGLASS COLUMN COVER PER EXTERIOR FINISH SPECIFICATIONS
- CU PREFABRICATED SQUARE LOUVERED ZUPOLA W/ SOLID PVC VINYL CONSTRUCTION & STANDING SEAM METAL ROOF. APPROXIMATE SIZE: 48"x48"x10"H. SUBMIT SHOP DRAWINGS TO ARCHITECT FOR APPROVAL.
- DS PREFINISHED ALUMINUM DOWNSPOUT
- LF WALL MOUNTED DECORATIVE LIGHT FIXTURE, SEE ELECTRICAL DRAWINGS
- MD EXTERIOR MAN DOOR, SEE DOOR SCHEDULE ON SHEET A6.1
- OD ROOF OVERFLOW DRAIN @ 18" ABOVE GRADE W/ DOWNSPOUT COVER- SEE PLUMBING DRAWINGS.
- PT PTAC THRU-WALL HVAC UNIT, SEE MECHANICAL DRAWINGS
- RS ROOF SHINGLES, SEE EXTERIOR FINISH SPECS.
- SD SHINGLED DORMER WITH 2'x4' VINYL WINDOW
- SE PRECAST STONE WATERTABLE / SILL, SEE EXTERIOR FINISH SPECIFICATIONS
- TB 1x PVC RAKE, FASCIA, OR TRIM- SEE WALL SECTIONS FOR SIZES
- VA VINYL ACCENT SHAKE SIDING, SEE EXTERIOR FINISH SPECIFICATIONS.
- VL DECORATIVE VINYL ACCENT LOUVER- SIZE AS NOTED.
- VS HORIZONTAL VINYL SIDING, SEE EXTERIOR FINISH SPECIFICATIONS
- WH SINGLE-HUNG INSULATED VINYL WINDOW BY PROVIA OR APPROVED EQUAL. SEE WINDOW DETAILS & SPECIFICATIONS ON SHEET A4.1.
- 34 3-1/2" (1x4) PVC TRIM - WINDOW/DOOR CASINGS
- 54 5-1/2" (1x6) PVC TRIM - ACCENT BAND AND WINDOW CASING
- 74 7-1/4" (1x8) PVC TRIM W/ DRIP CAP - WINDOW MANTEL


EXTERIOR FINISH SPECIFICATIONS

- BRICK VENEER**
NOMINAL THIN BRICK VENEER BY WATSONTOWN BRICK OR APPROVED EQUAL. INSTALL PER M.V.M.A. GUIDELINES. COLOR: ATLANTIC SERIES 'CHELSEA'.
- COLUMN COVERS**
PAINTED FACTORY-SPLIT, SMOOTH ROUND FIBERGLASS COLUMN COVER W/ POLY TUSCAN CAP & BASE, PERMACAST® BY H&G OR APPROVED EQUAL - 16" @ FRONT ENTRY CANOPY AND 12" @ FRONT PORCHES & SIDE ENTRY CANOPIES, SEE ELEVATIONS & WALL SECTIONS. COLOR: WHITE.
- GUTTER/RAKE BD. TRIM BD.**
1x PVC TRIM, SEE WALL SECTIONS & DETAILS FOR SIZES. COLOR: WHITE.
- GUTTERS & DOWNSPOUTS**
24 GA. PREFINISHED ALUMINUM GUTTERS & DOWNSPOUTS. STANDARD 'OGEE' PROFILE W/ 3"x4" RECTANGULAR DOWNSPOUTS AS MANUFACTURED BY PETERSON ALUMINUM CORP. OR APPROVED EQUAL. COLOR: WHITE.
- PRECAST STONE SILL**
PRECAST STONE WATERTABLE / SILL BY READING ROCK OR APPROVED EQUAL. COLOR: CHARLOTTE TAN.
- ROOF SHINGLES**
30 YEAR ARCHITECTURAL FIBERGLASS BASE ASPHALT ROOF SHINGLES. 'TIMBERLINE HDZ' LIFETIME HIGH DEFINITION SHINGLES BY GAF OR APPROVED EQUAL. COLOR: APPALACHIAN SKY.
- VINYL SIDING - ACCENT SHAKE**
ARCHITECTURAL SHAKE SIDING, CEDAR DIMENSIONS DOUBLE 2" SHINGLE BY PLY GEM OR APPROVED EQUAL. COLOR: DUBLIN.
- VINYL SIDING - HORIZONTAL**
2x4" THICK HORIZONTAL VINYL SIDING, DIMENSIONS DOUBLE 4" PROFILE AS MANUFACTURED BY PLY GEM OR APPROVED EQUAL. COLOR: SAND.
- VINYL SOFFIT**
V-GROOVE VINYL SOFFIT, 'PERFORMANCE' DOUBLE 5" VINYL SOFFIT BY PLY GEM OR APPROVED EQUAL. SEE WALL SECTIONS FOR SOLID AND VENTED LOCATIONS. COLOR: WHITE.
- VINYL TRIM**
VINYL CORNER TRIM BY PLY GEM OR APPROVED EQUAL INSTALLED PER MANUFACTURER'S REQUIREMENTS. TRIM TO BE FACTORY FINISHED IN COLOR TO MATCH ADJACENT SIDING.
- NOTES:**
- VERIFY ALL COLORS WITH OWNER PRIOR TO ORDERING.
- CONTRACTOR TO SUBMIT (2) PHYSICAL SAMPLES TO ARCHITECT PRIOR TO ORDERING/FABRICATION.

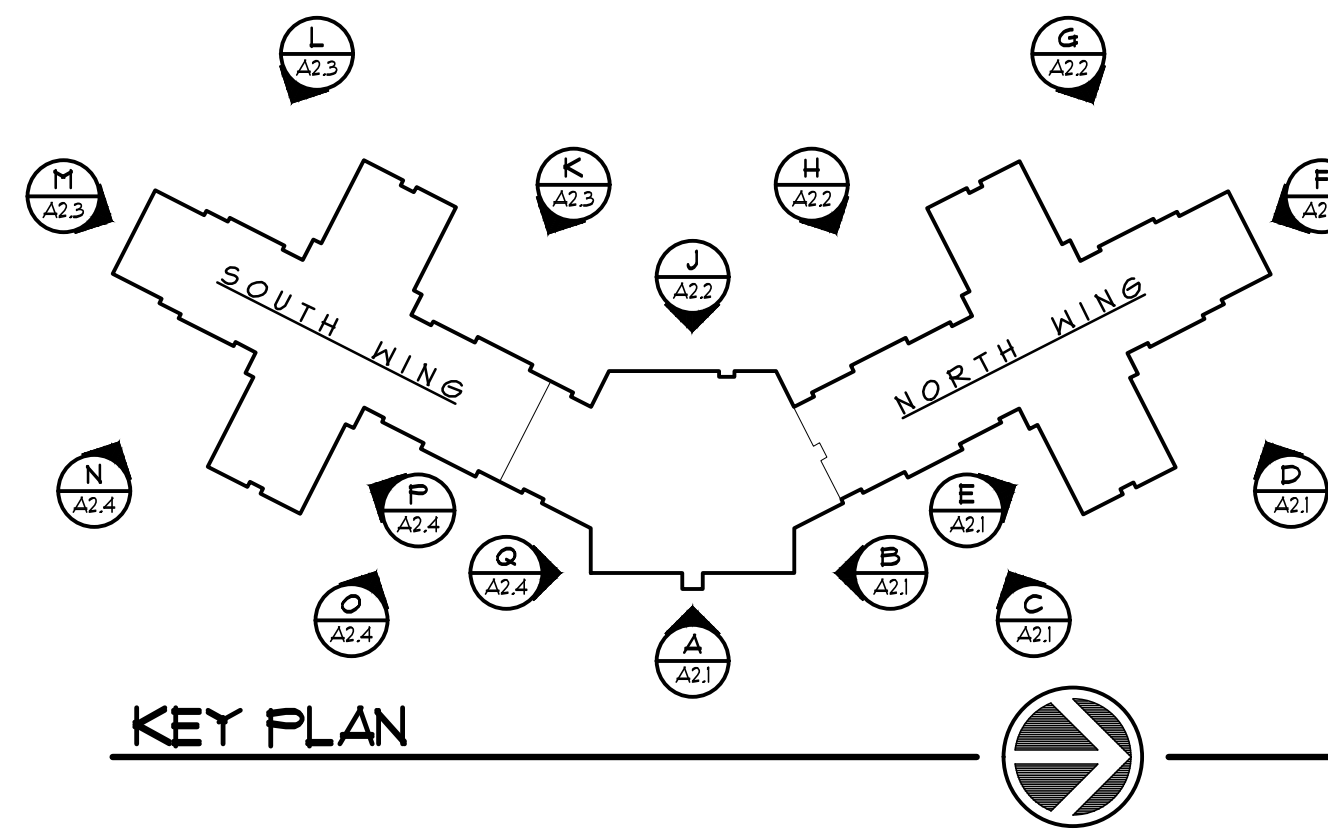


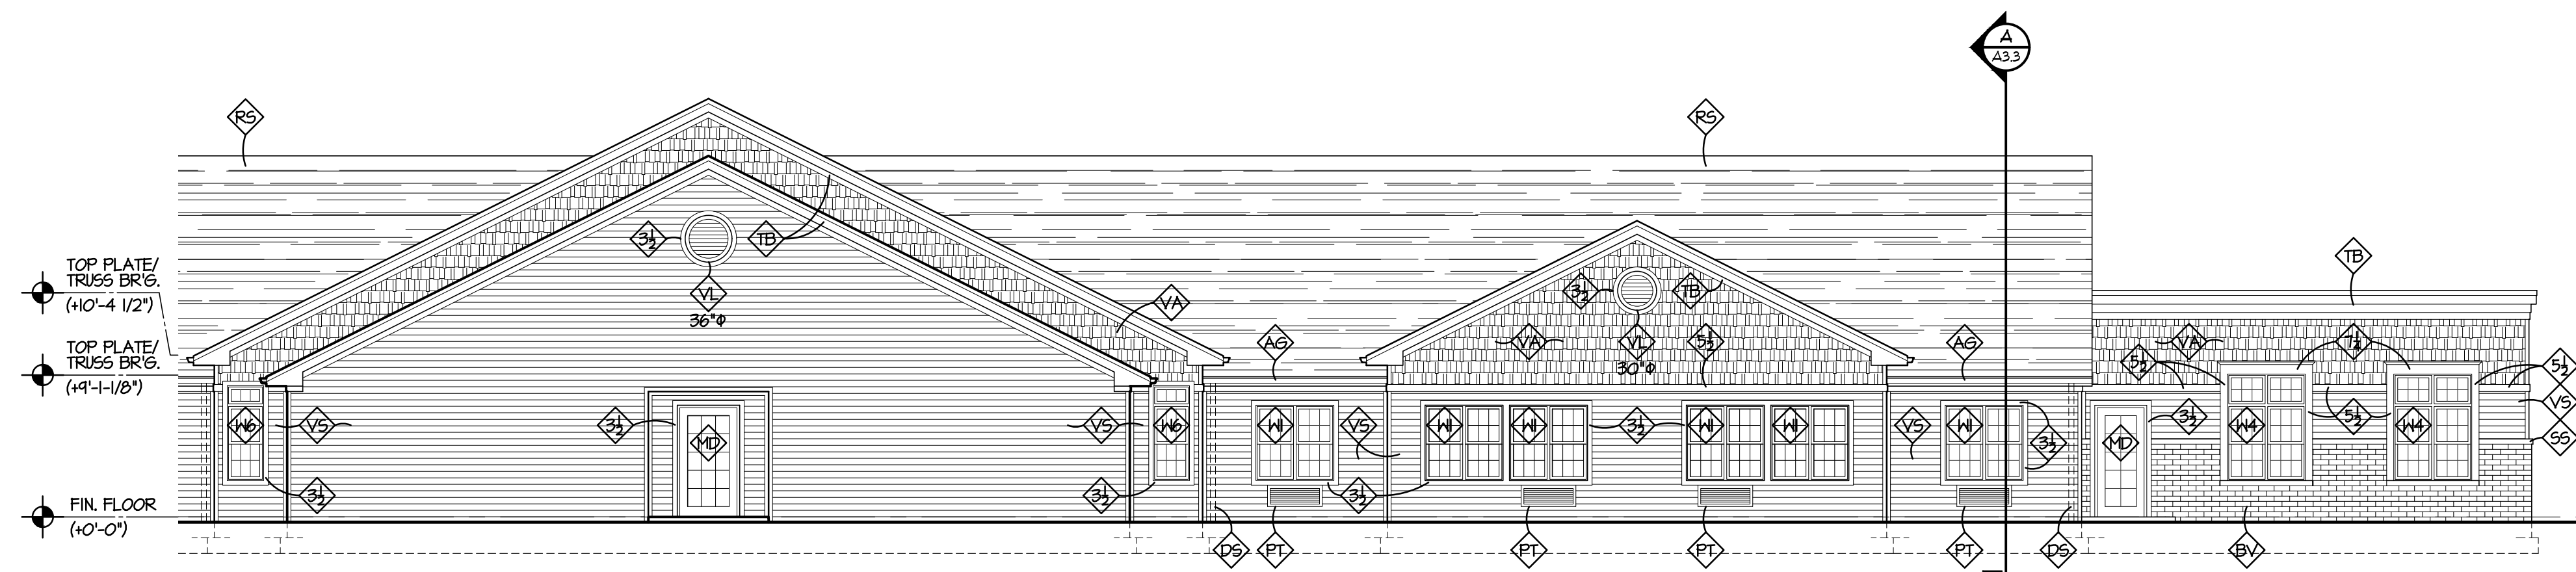



K PARTIAL NORTHWEST ELEVATION
A23 SCALE: 1/8" = 1'-0"

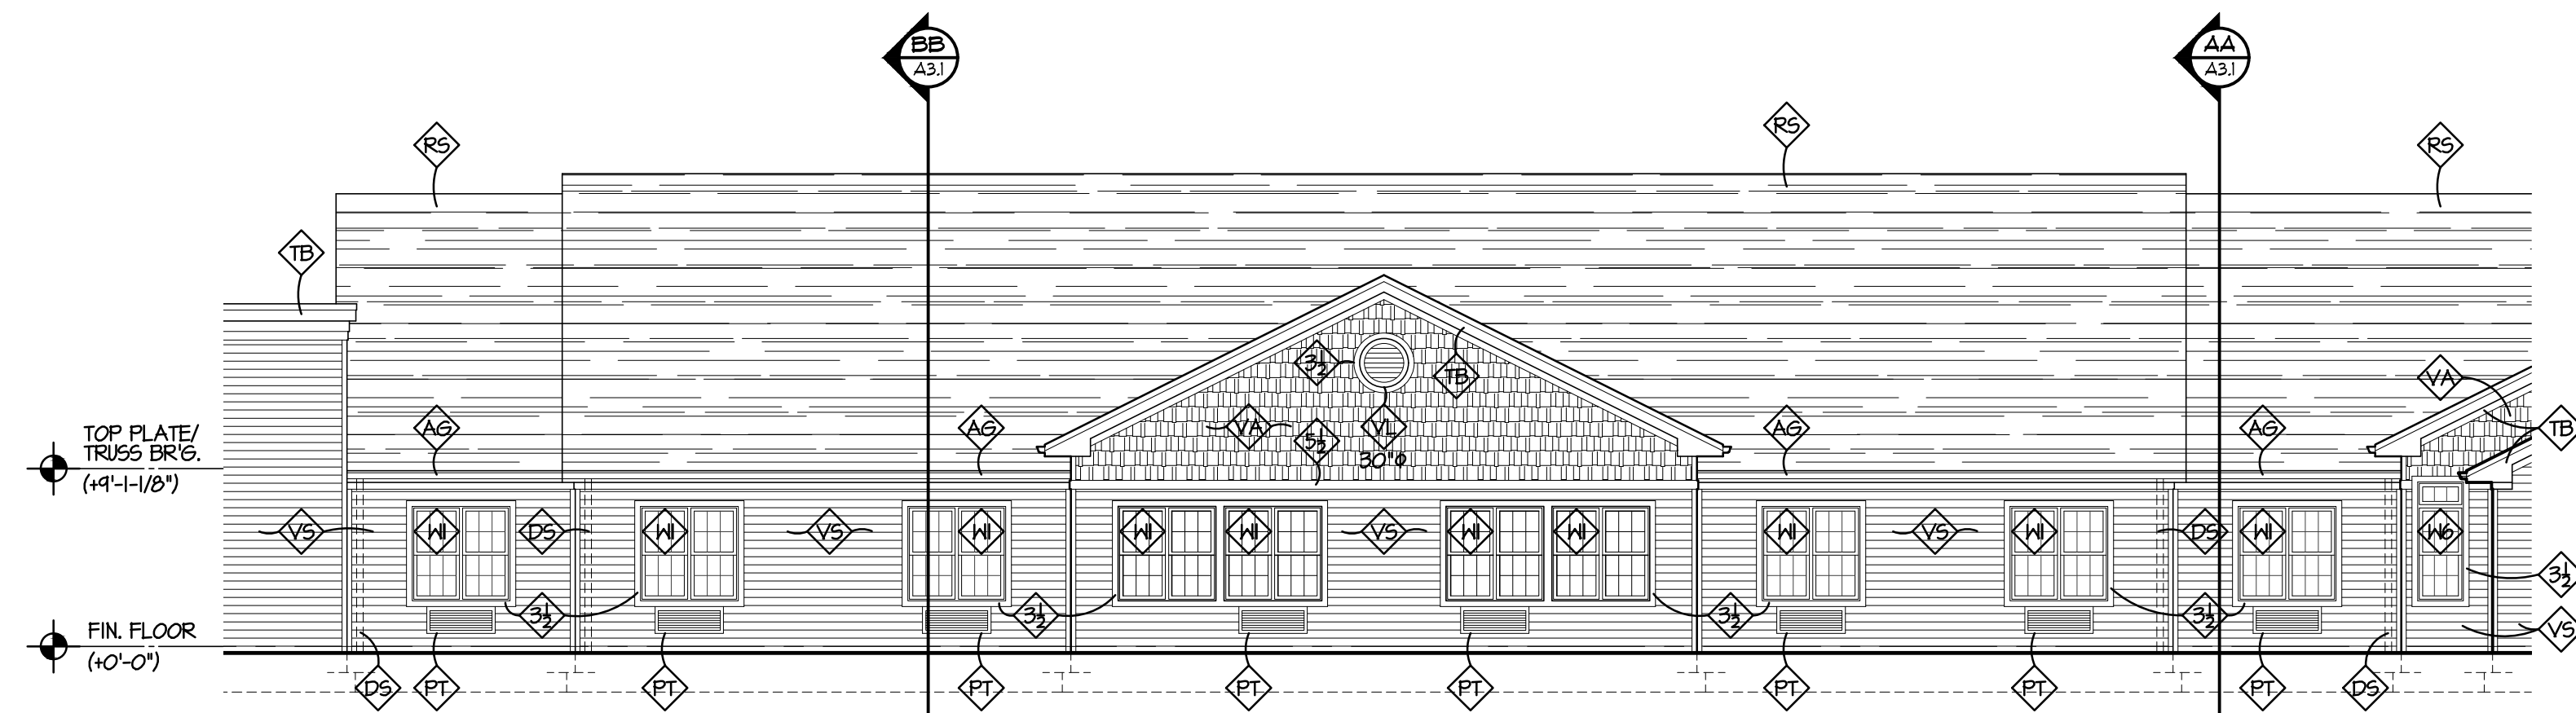

L PARTIAL NORTHWEST ELEVATION
A23 SCALE: 1/8" = 1'-0"

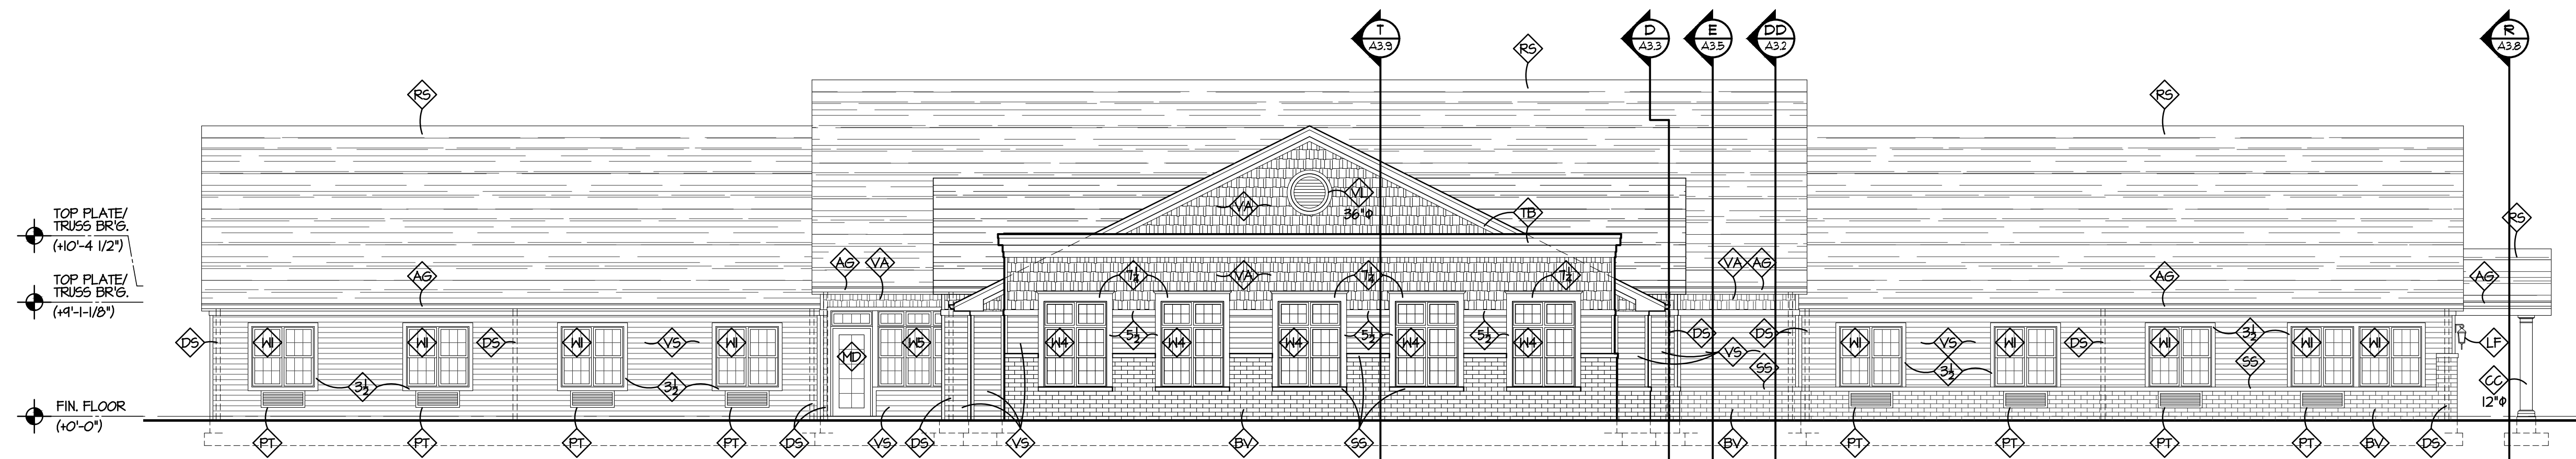

M PARTIAL SOUTHWEST ELEVATION
A23 SCALE: 1/8" = 1'-0"

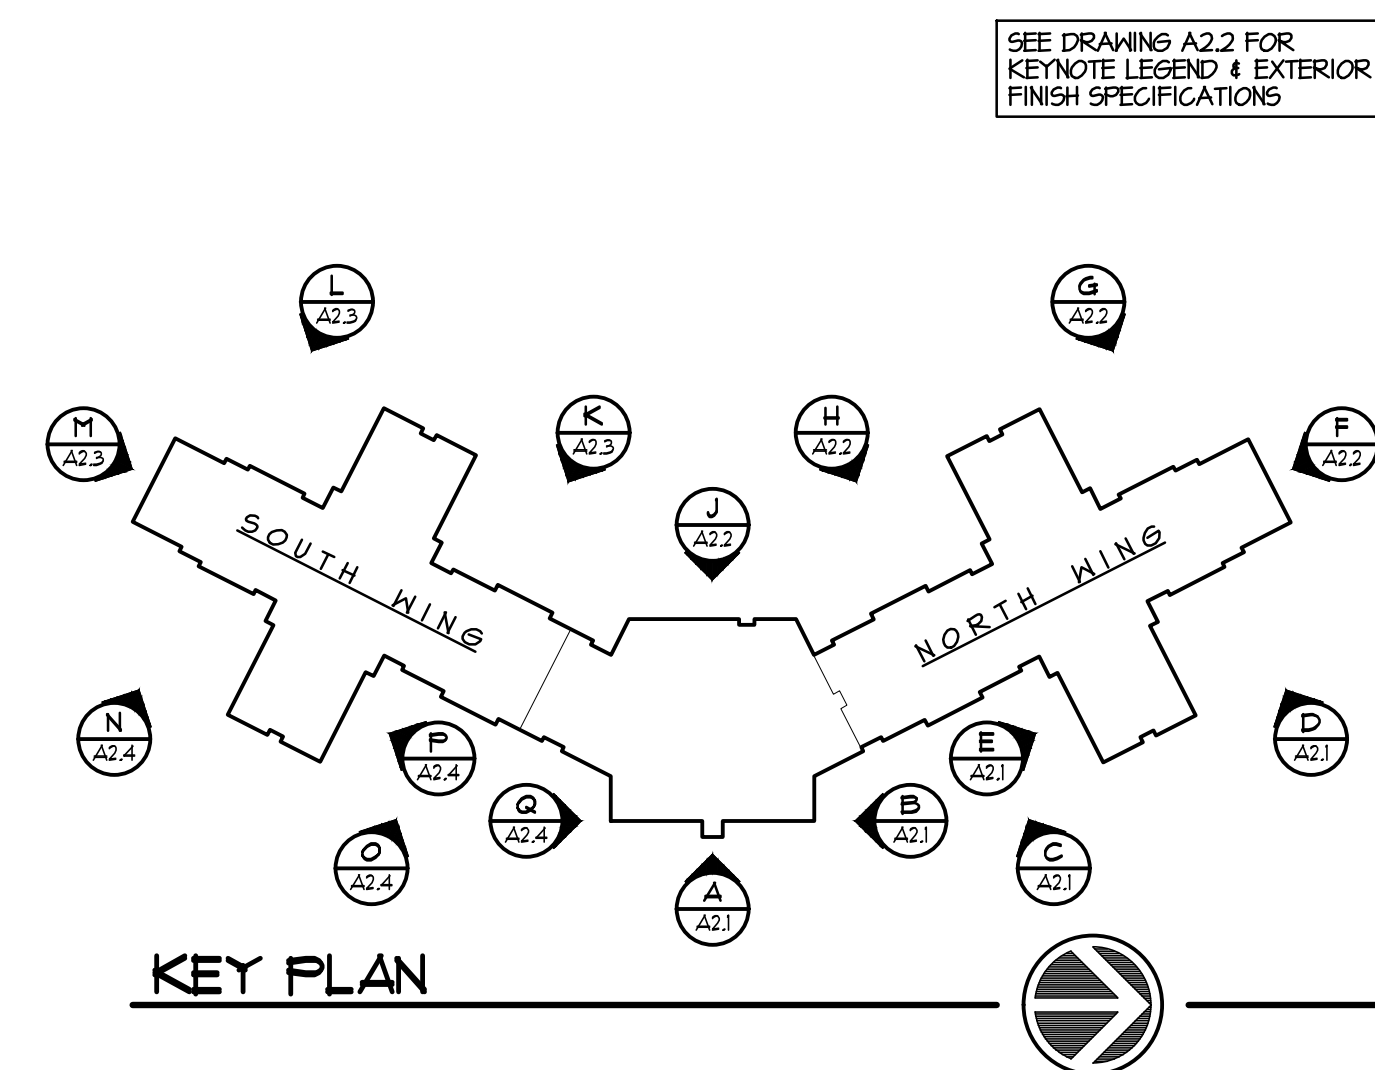

DSC
ARCHITECTS
401 FRONT STREET
BEREA, OHIO 44017
PHONE: 440.835.3957
mail@dscarchitects.com

DATE:
PERMIT SUBMISSION:
06.14.26


BENNETT'S CREEK
HEALTH & REHABILITATION CENTER
1931/975 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA




DRAWING NAME
EXTERIOR
ELEVATIONS

DSCA PROJECT NO.
24.061


A2.3

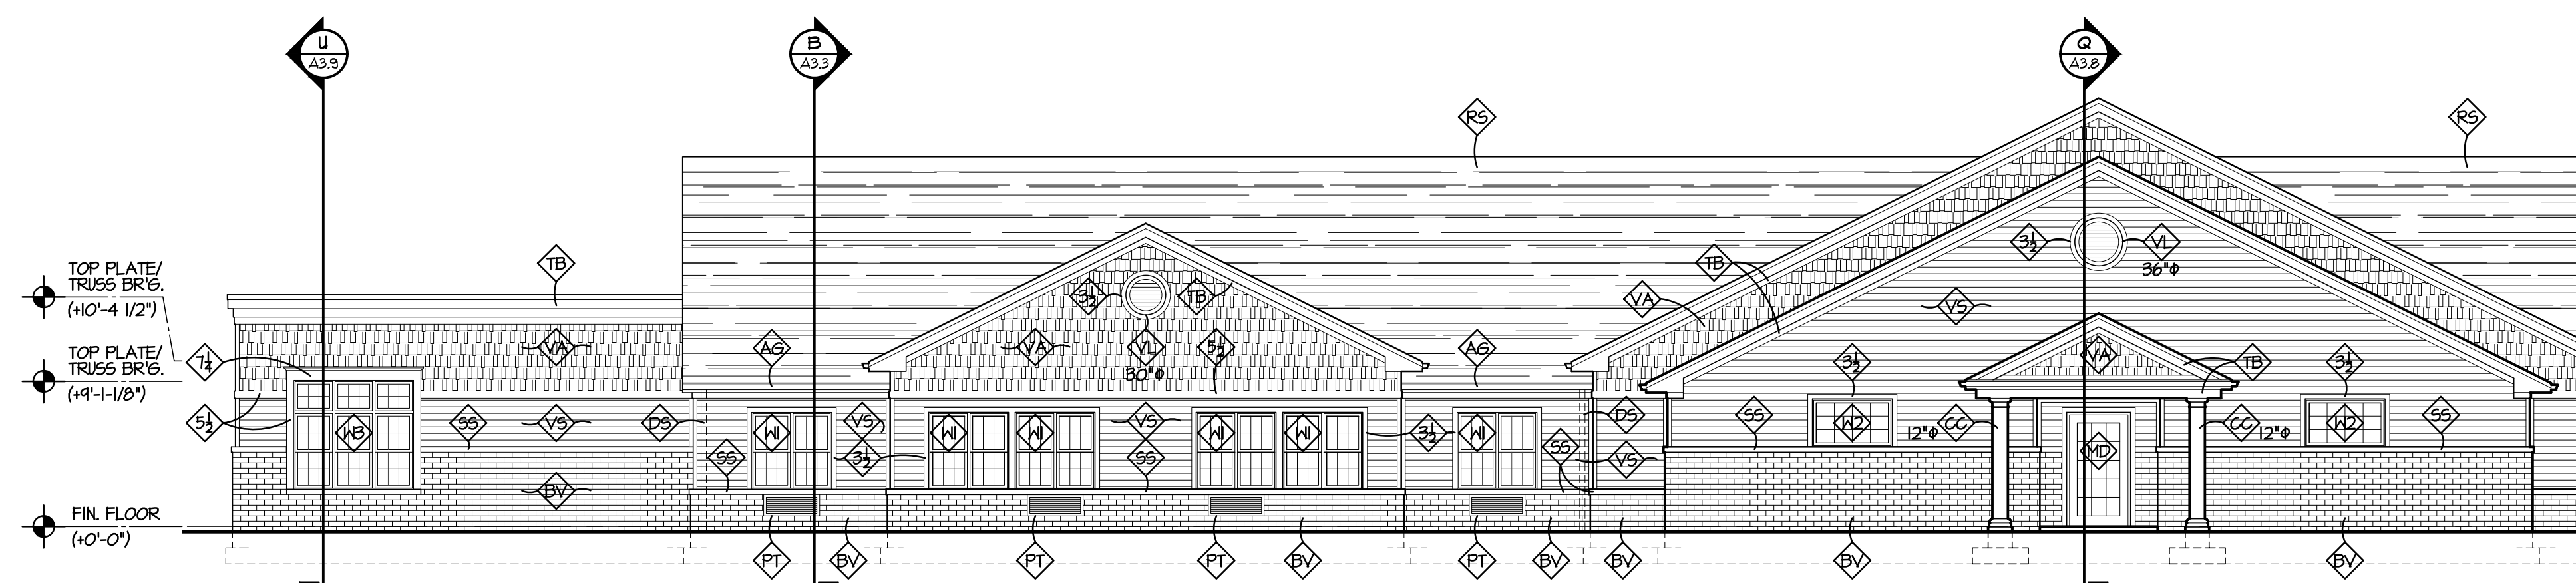


N PARTIAL SOUTHEAST ELEVATION
A2.4 SCALE: 1/8" = 1'-0"

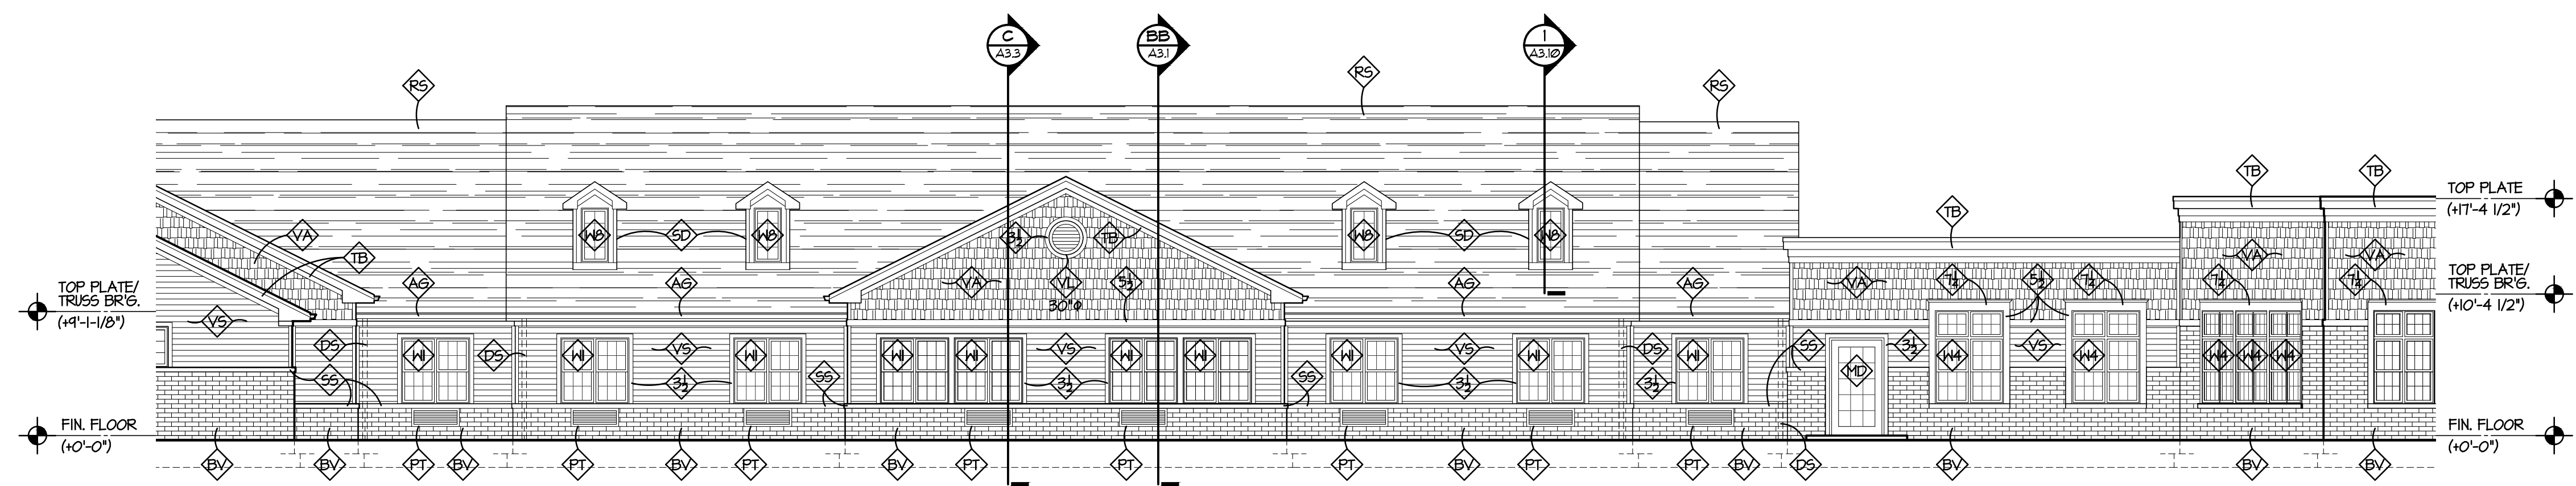


O PARTIAL SOUTHEAST ELEVATION
A2.4 SCALE: 1/8" = 1'-0"

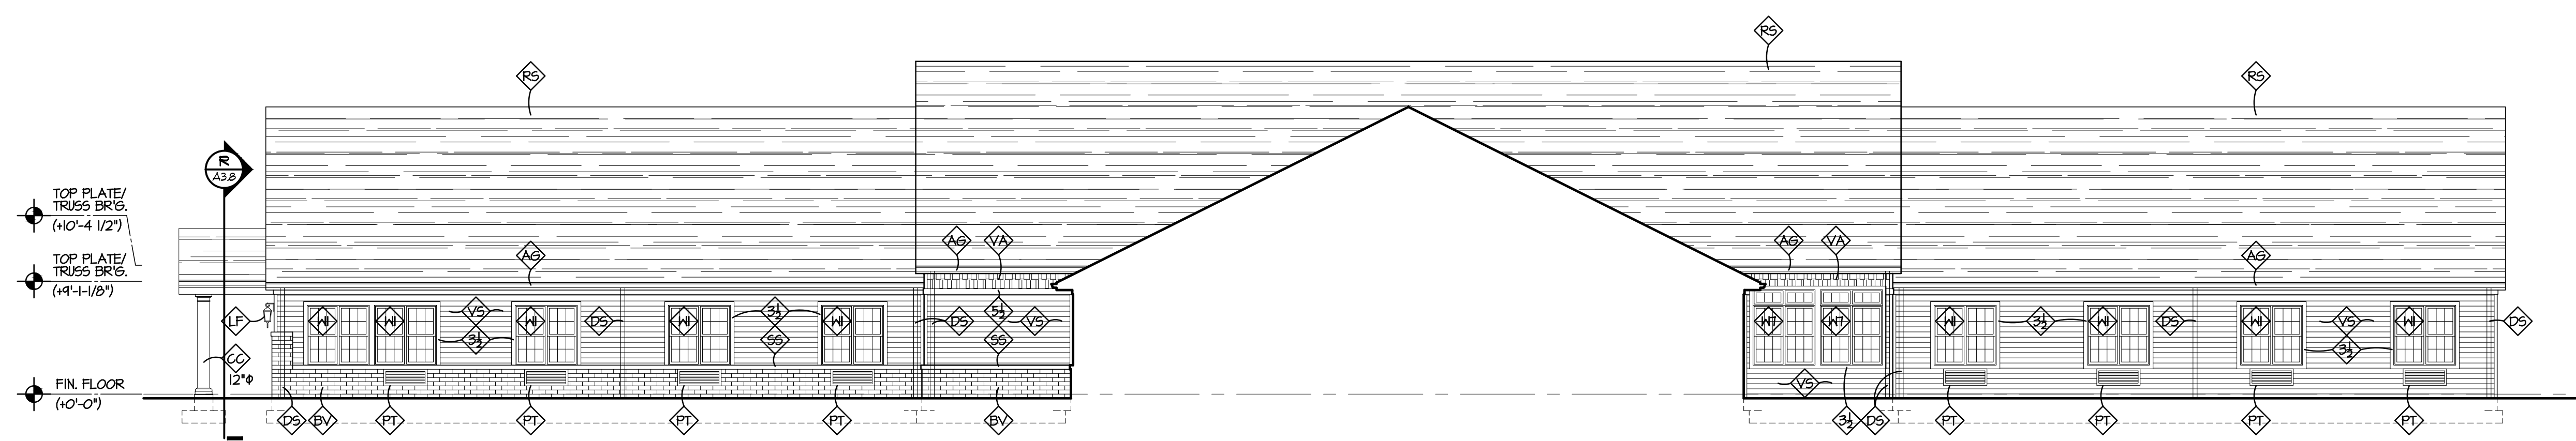


P PARTIAL NORTHEAST ELEVATION
A2.4 SCALE: 1/8" = 1'-0"

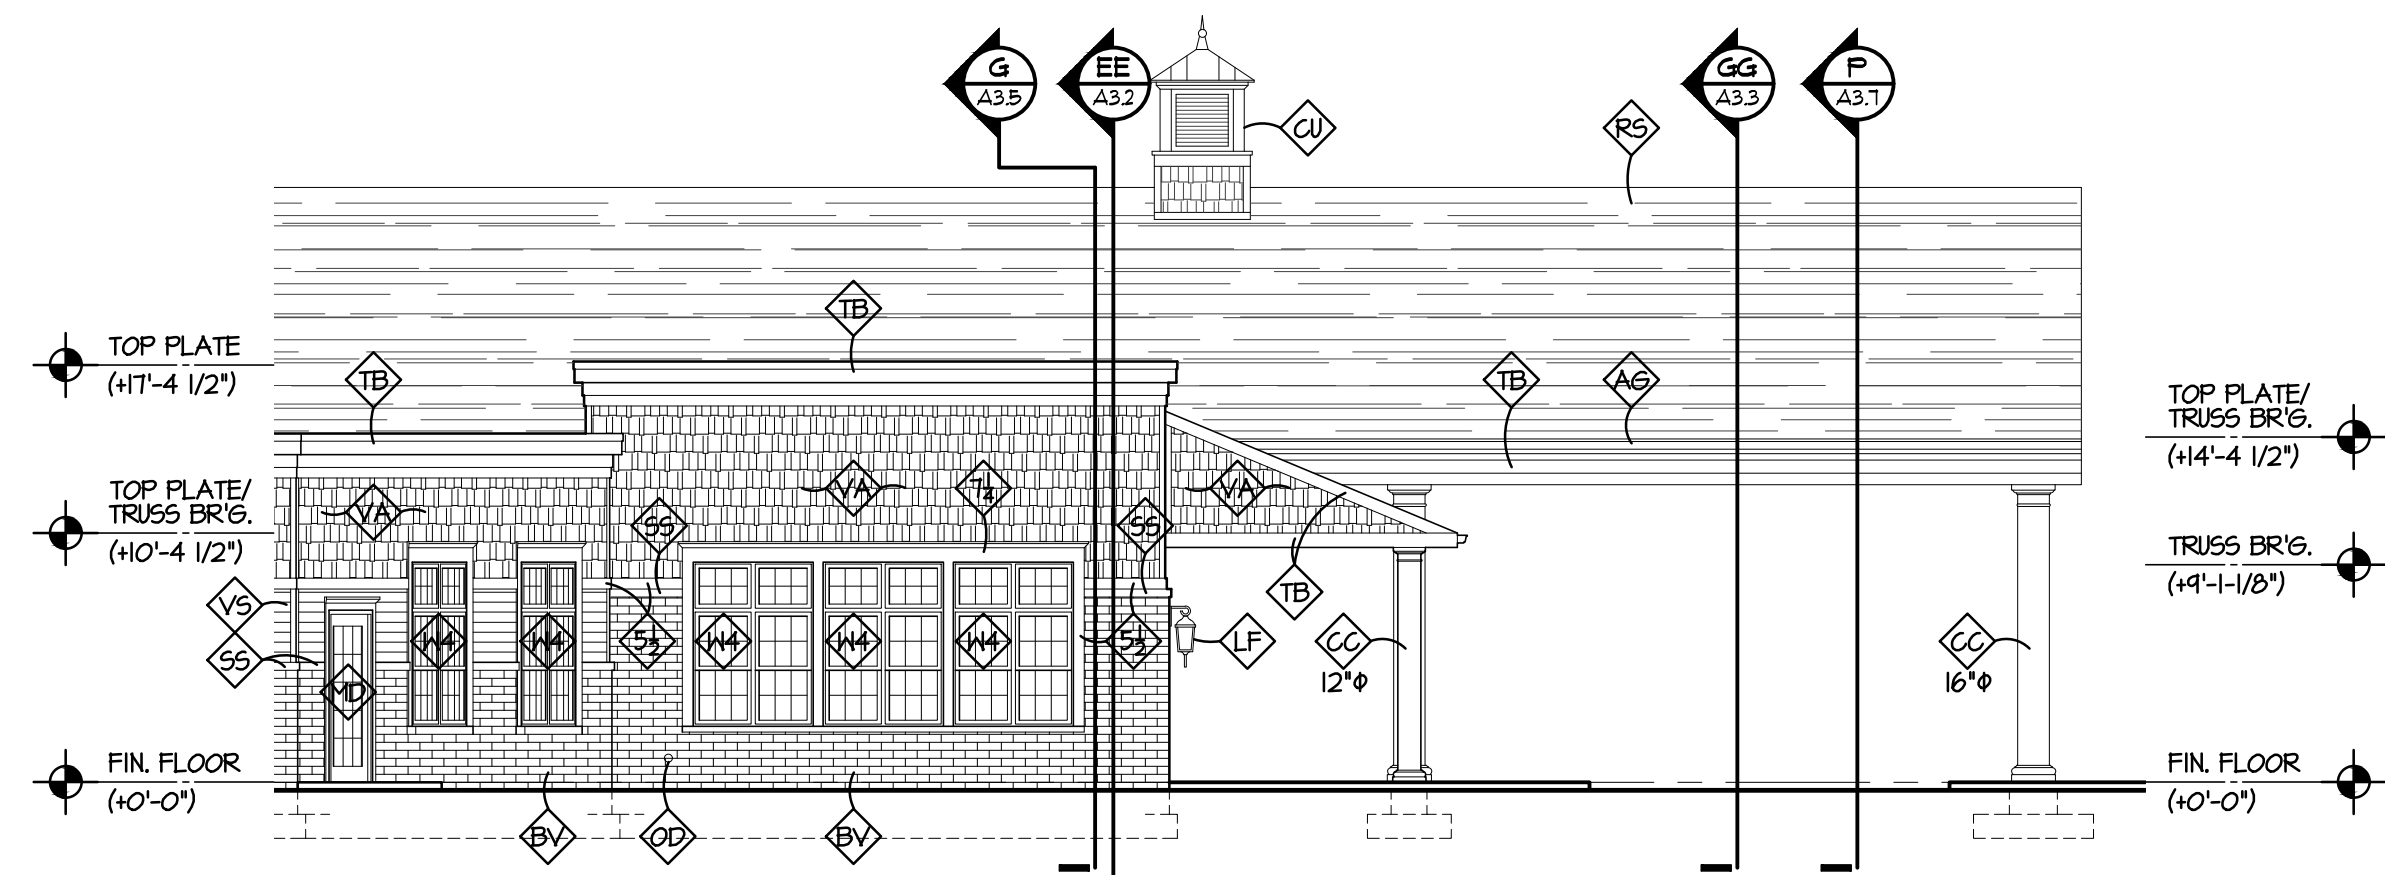


Q PARTIAL SOUTH ELEVATION
A2.4 SCALE: 1/8" = 1'-0"

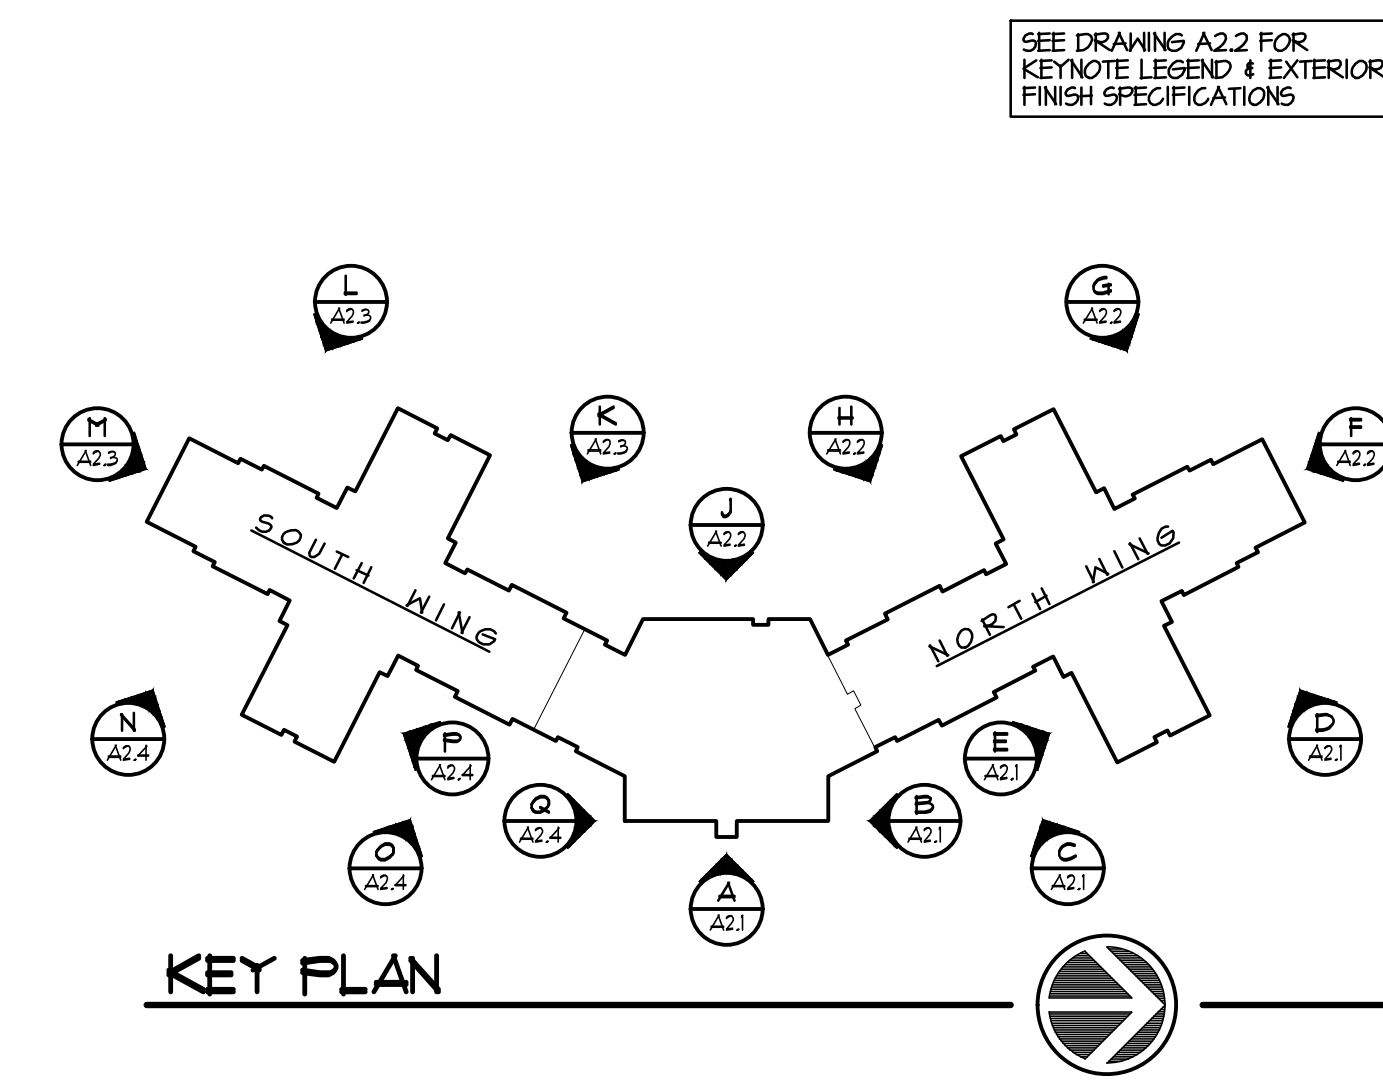


SEE DRAWING A2.2 FOR KEYNOTE LEGEND & EXTERIOR FINISH SPECIFICATIONS

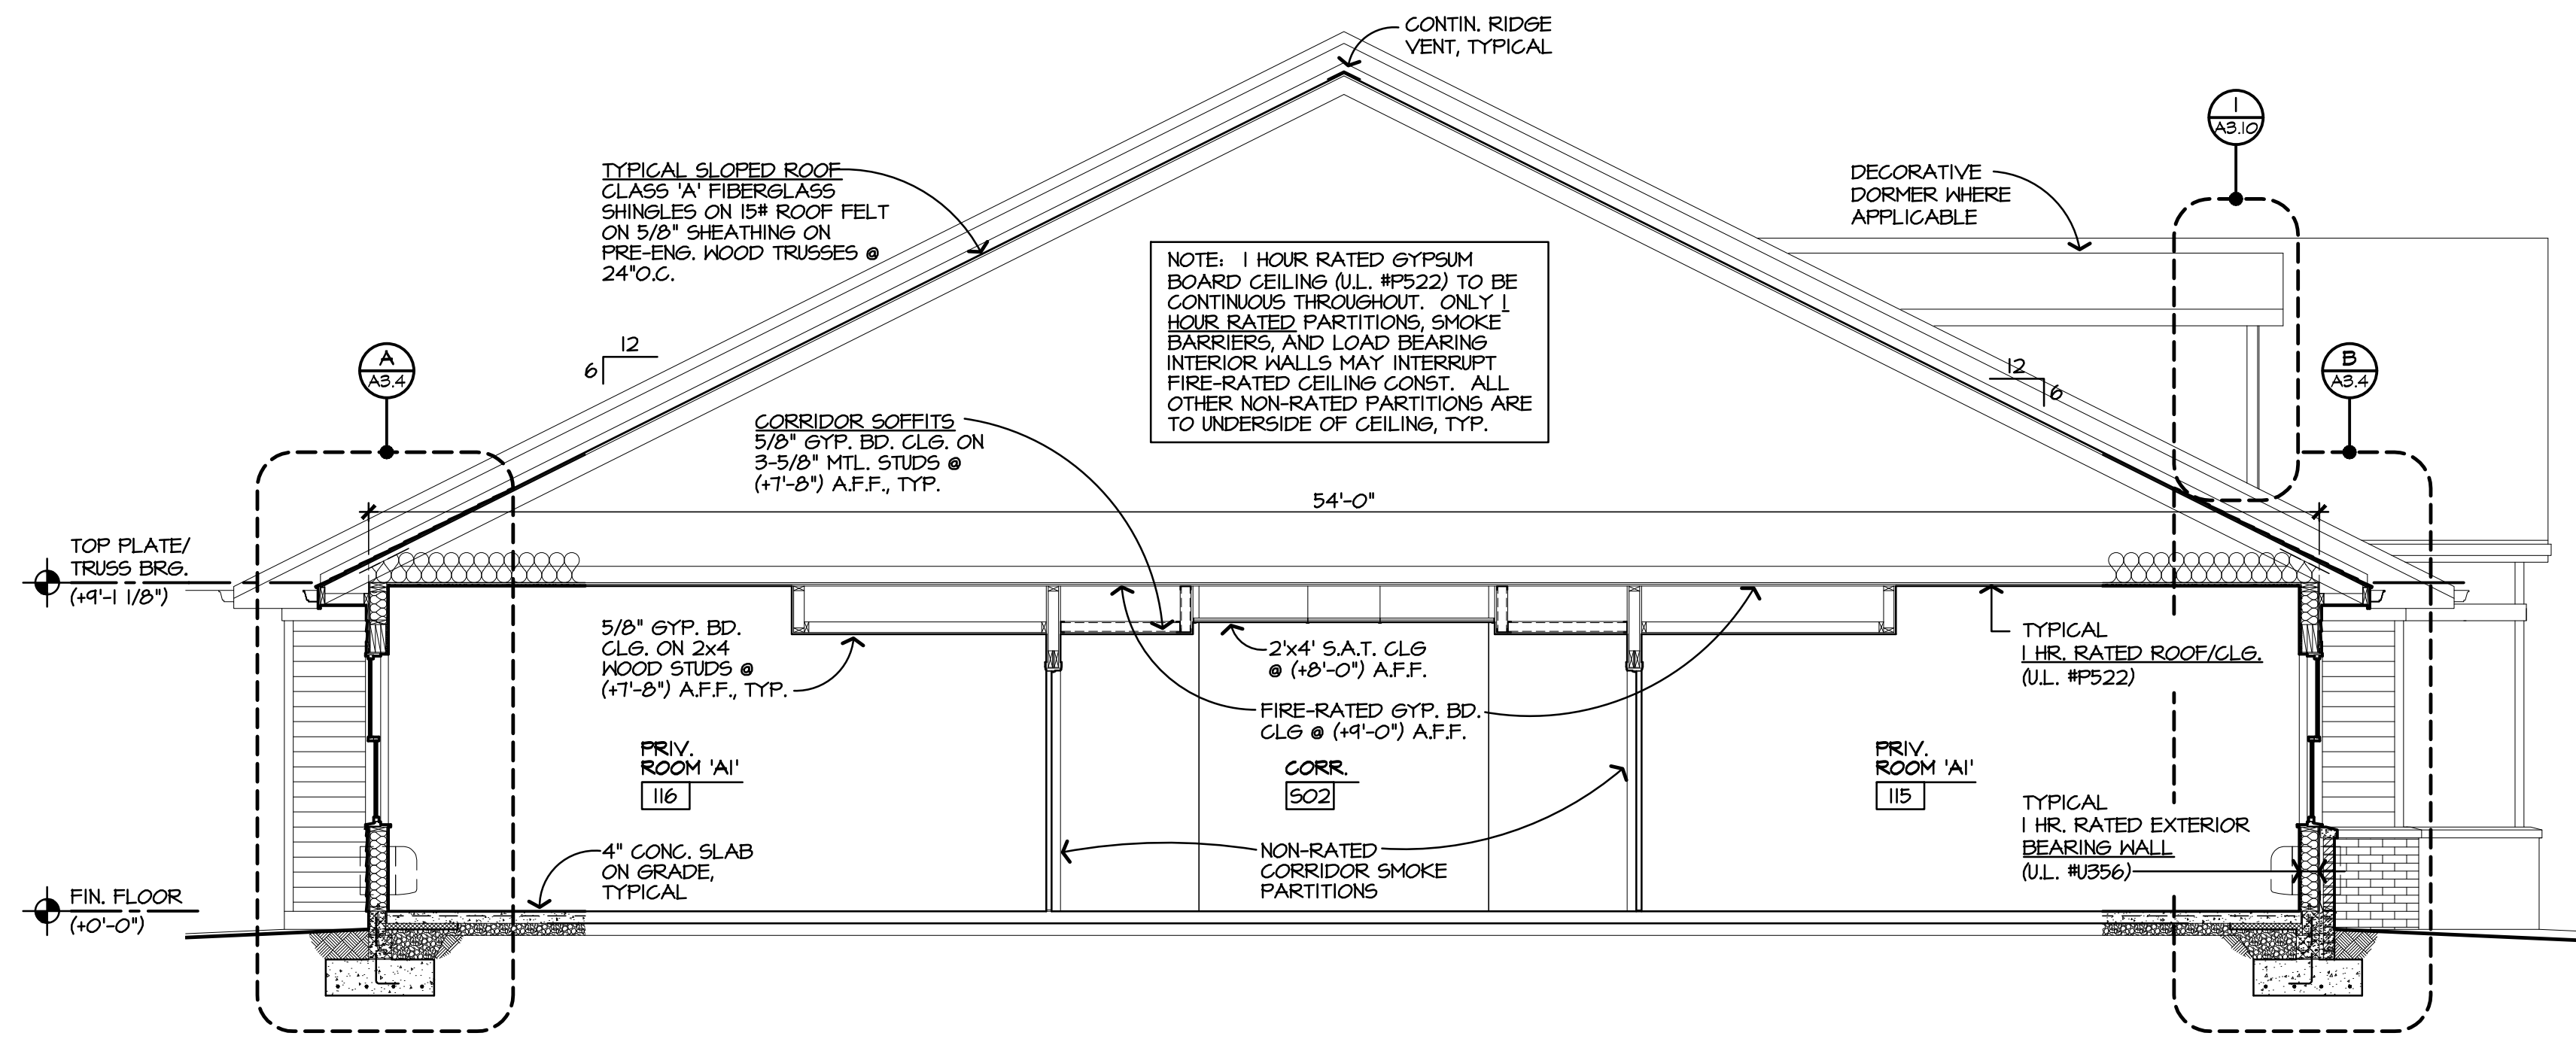


AA BUILDING SECTION
SCALE: 1/4" = 1'-0"

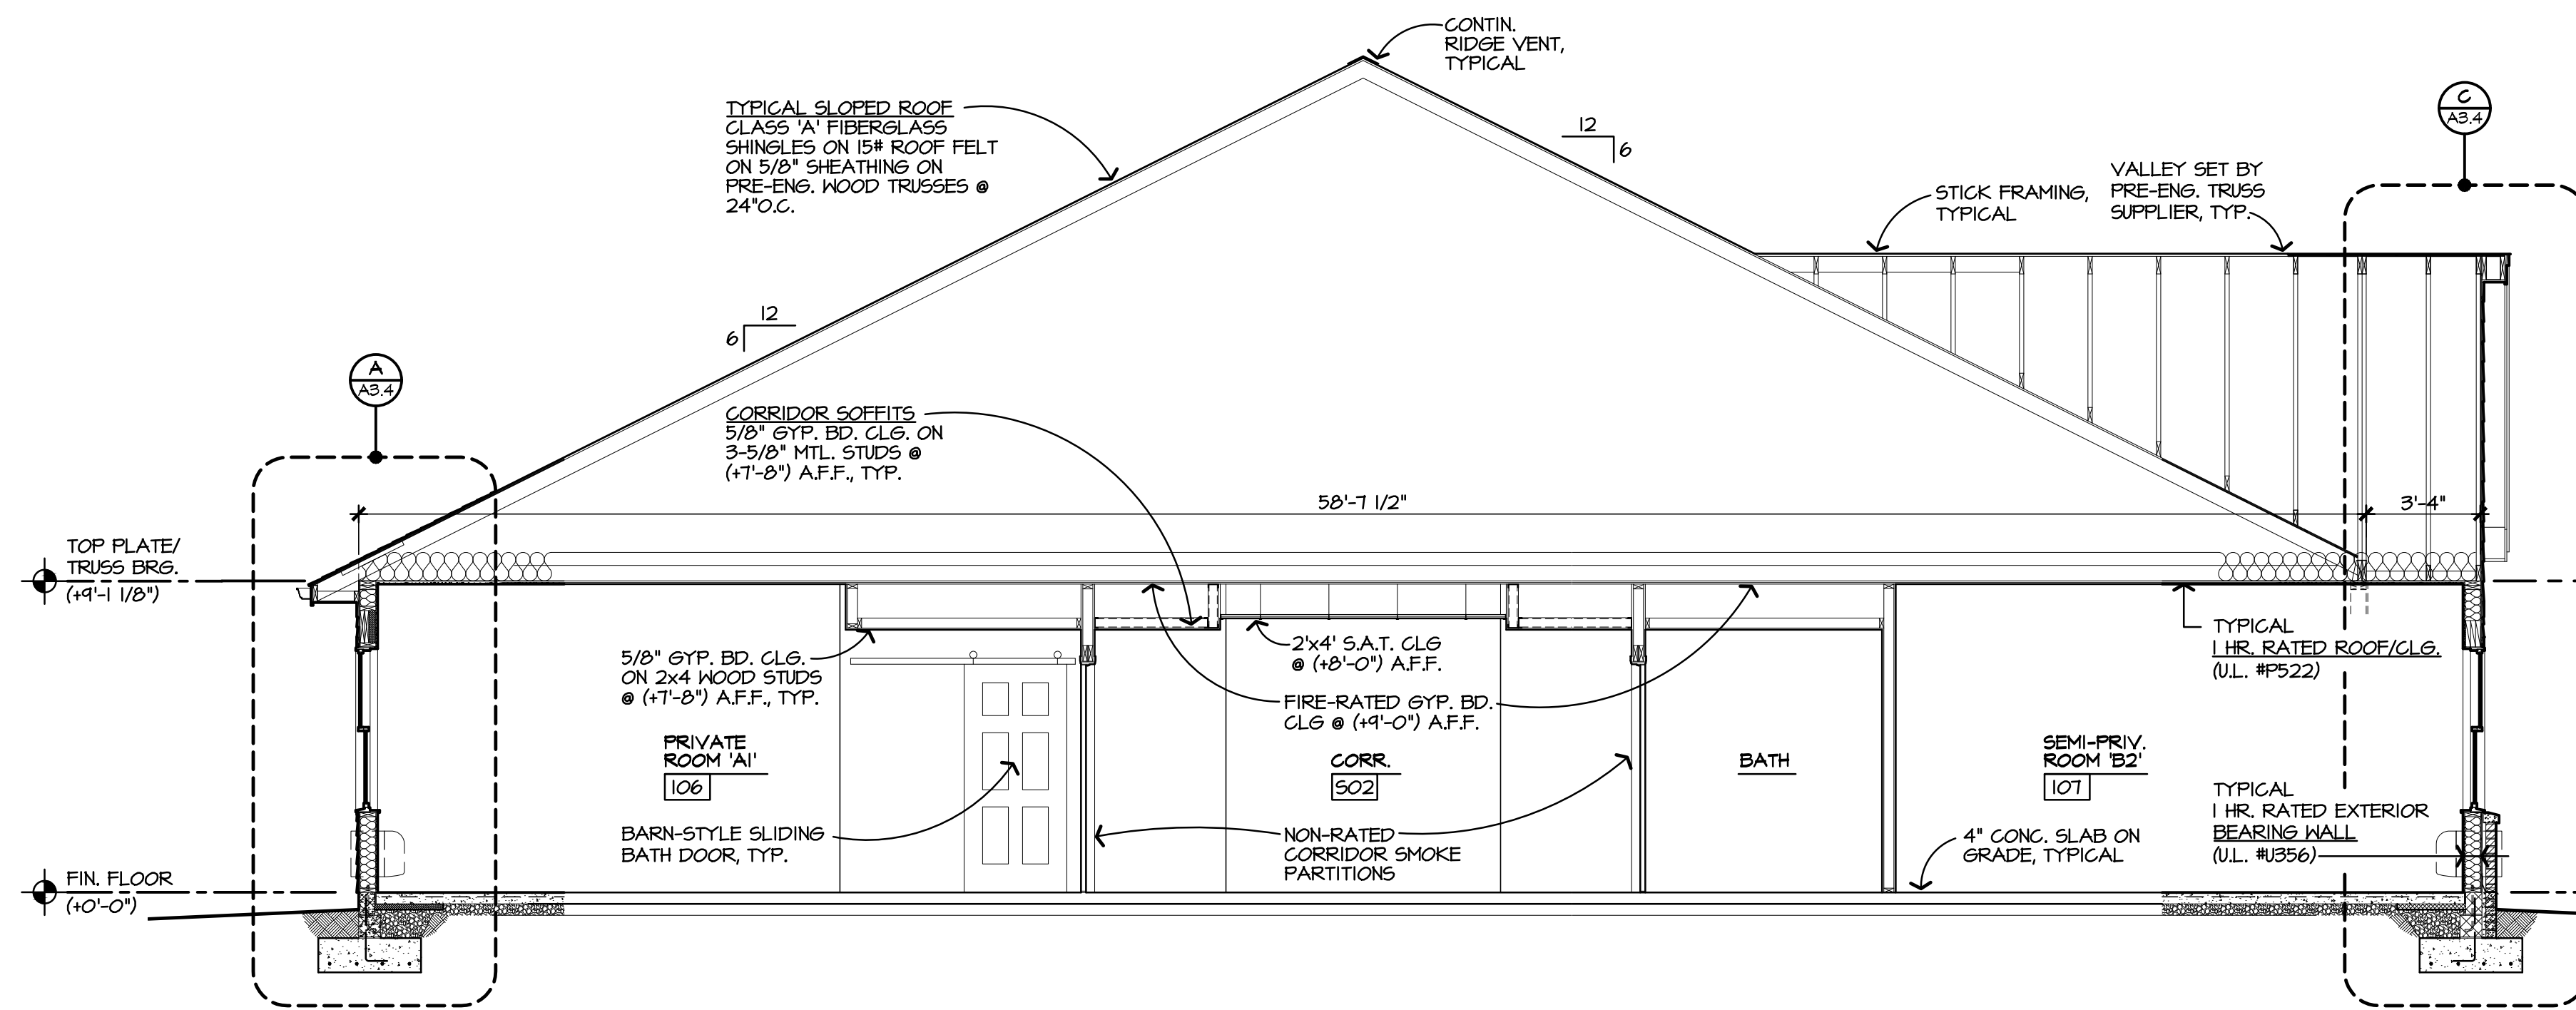


BB BUILDING SECTION
SCALE: 1/4" = 1'-0"

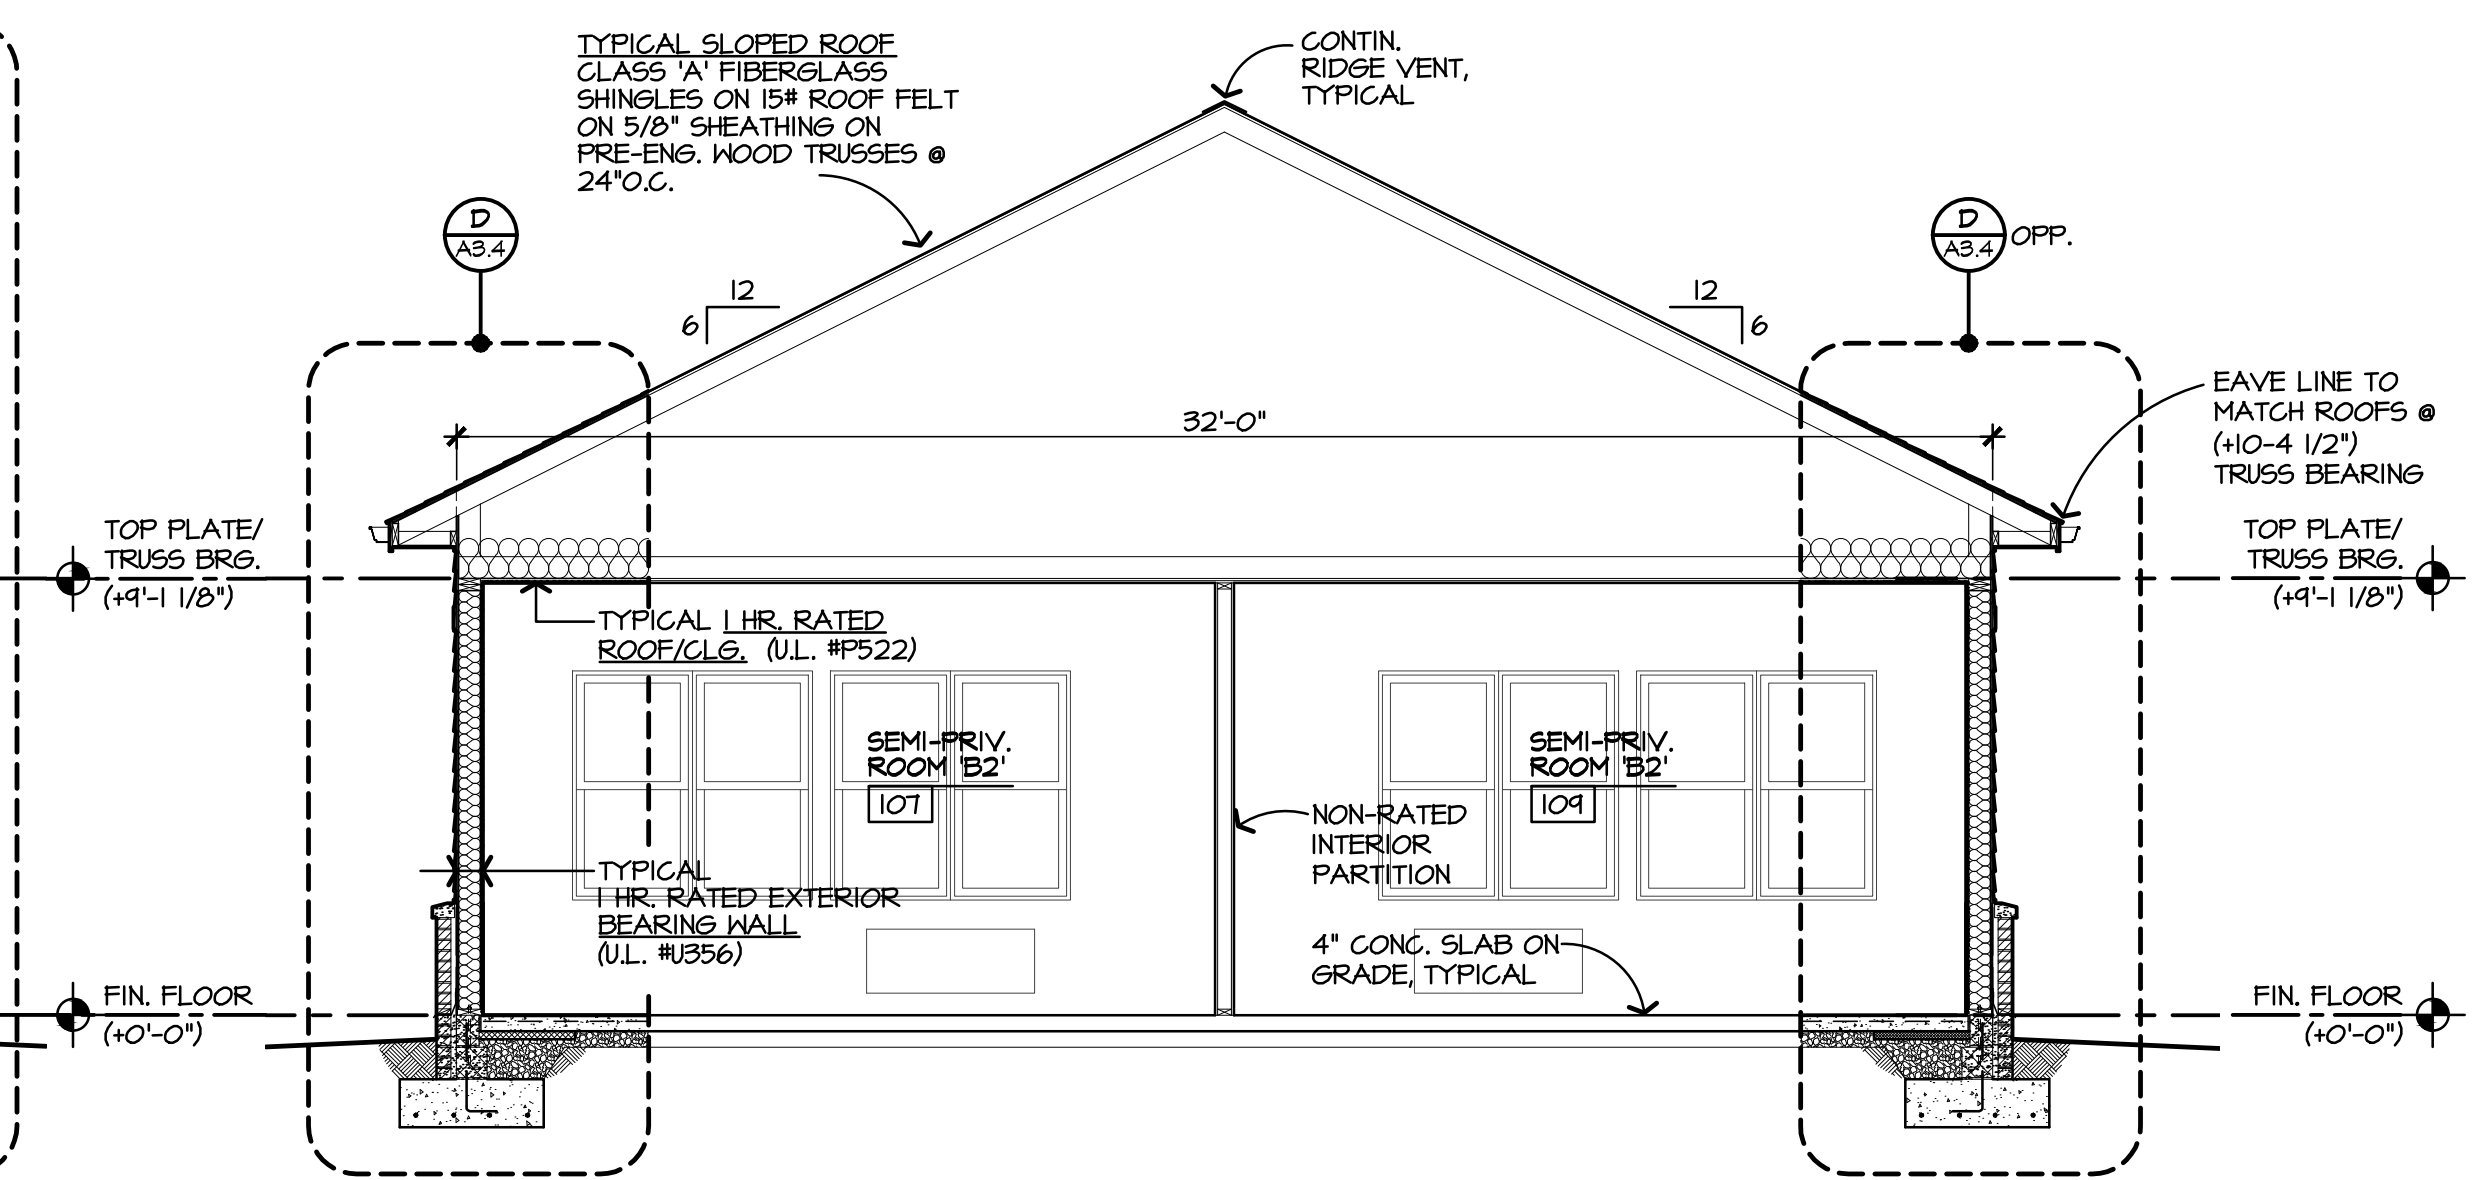

CC BUILDING SECTION
SCALE: 1/4" = 1'-0"

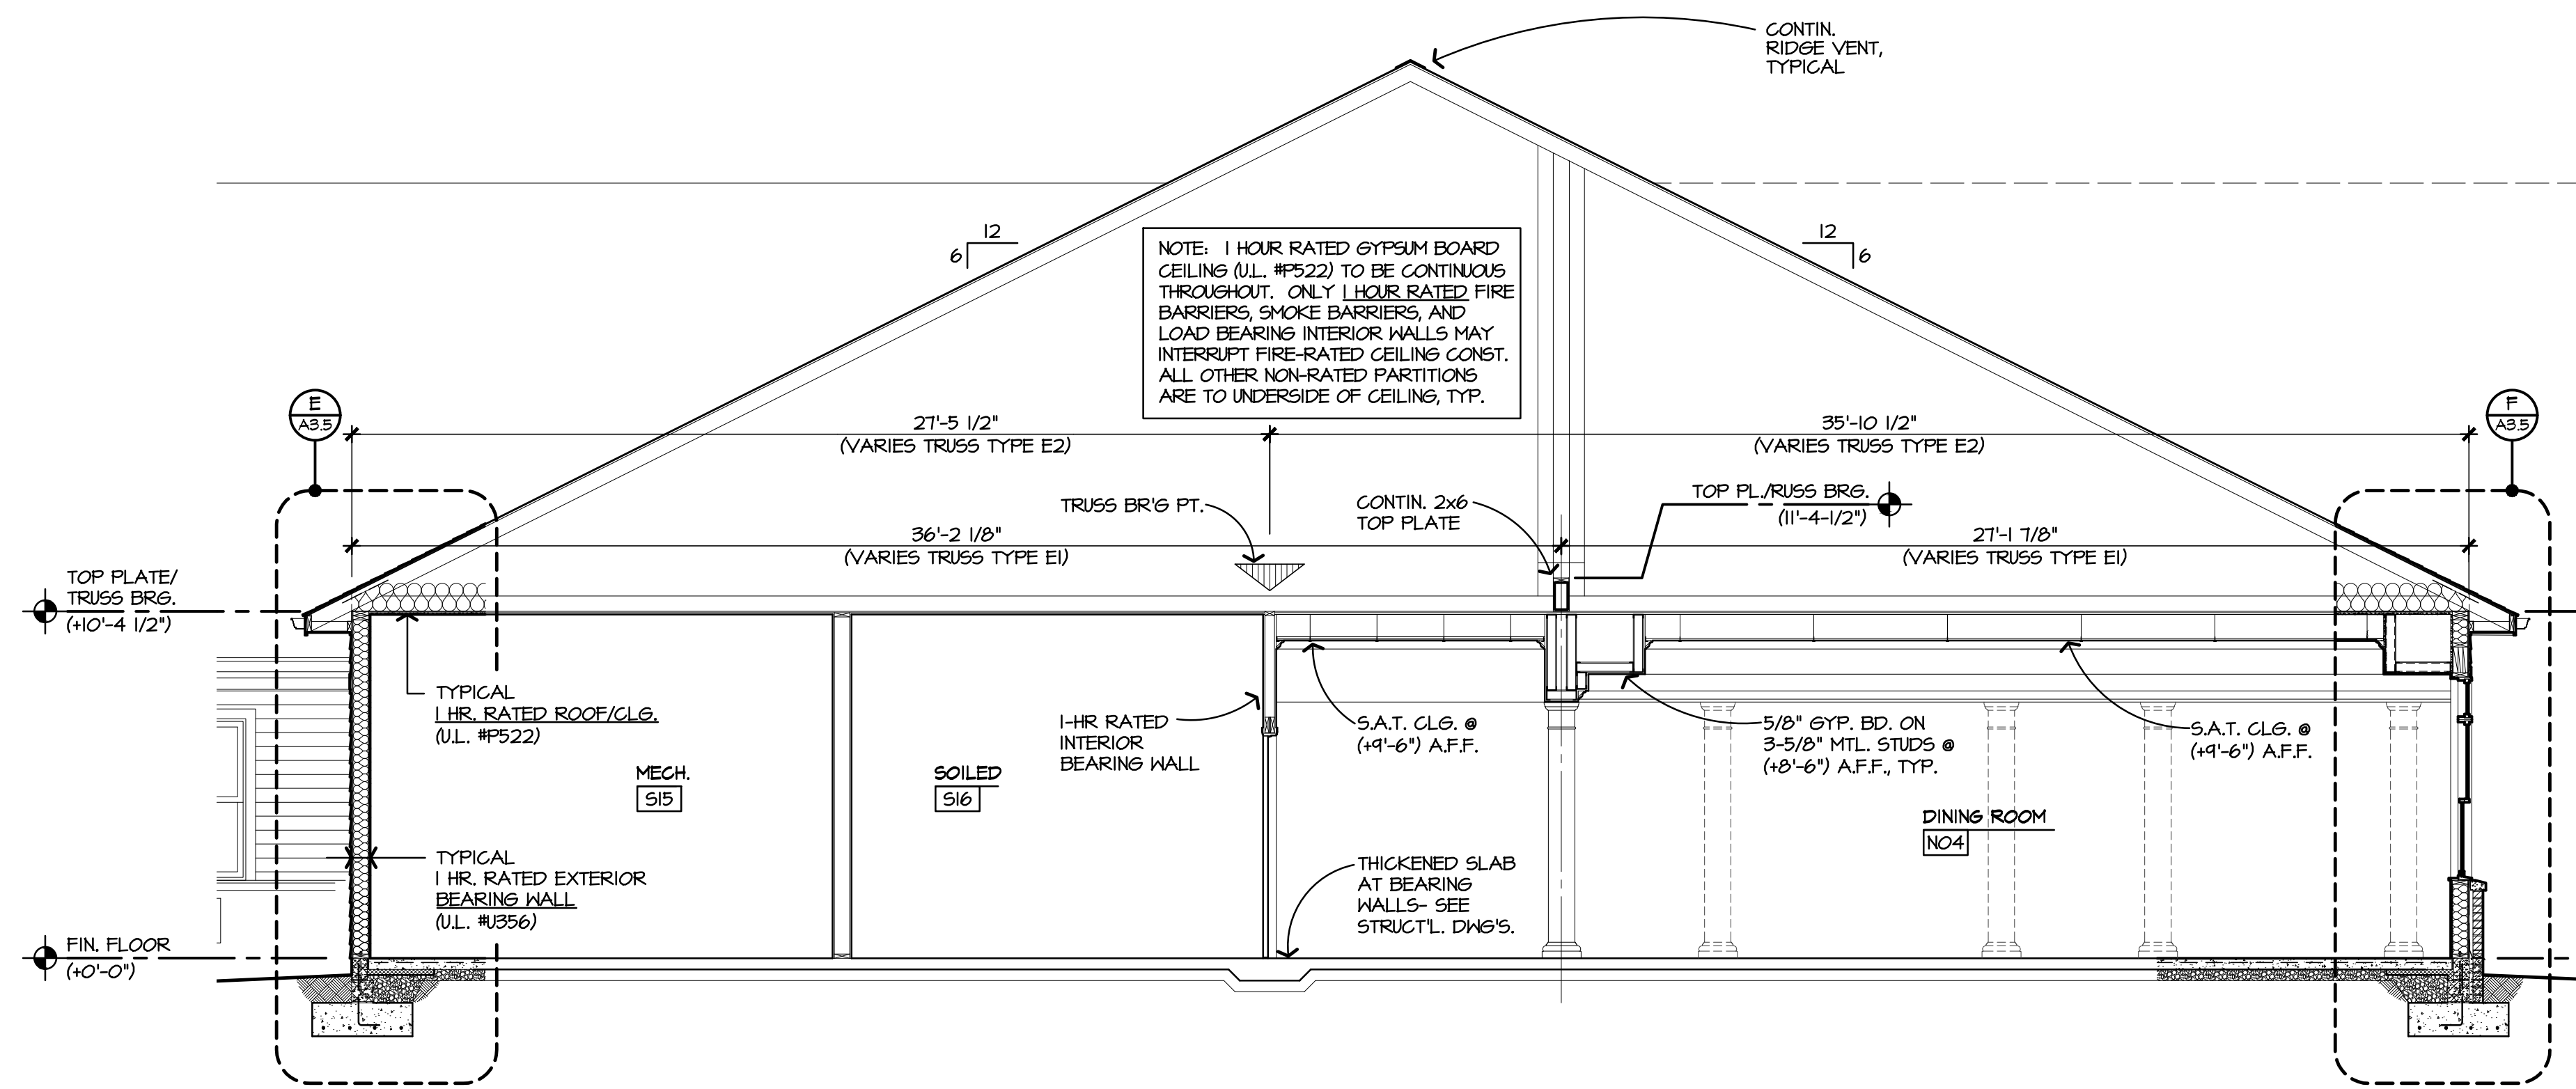

DD BUILDING SECTION
A3.1 SCALE: 1/4" = 1'-0"

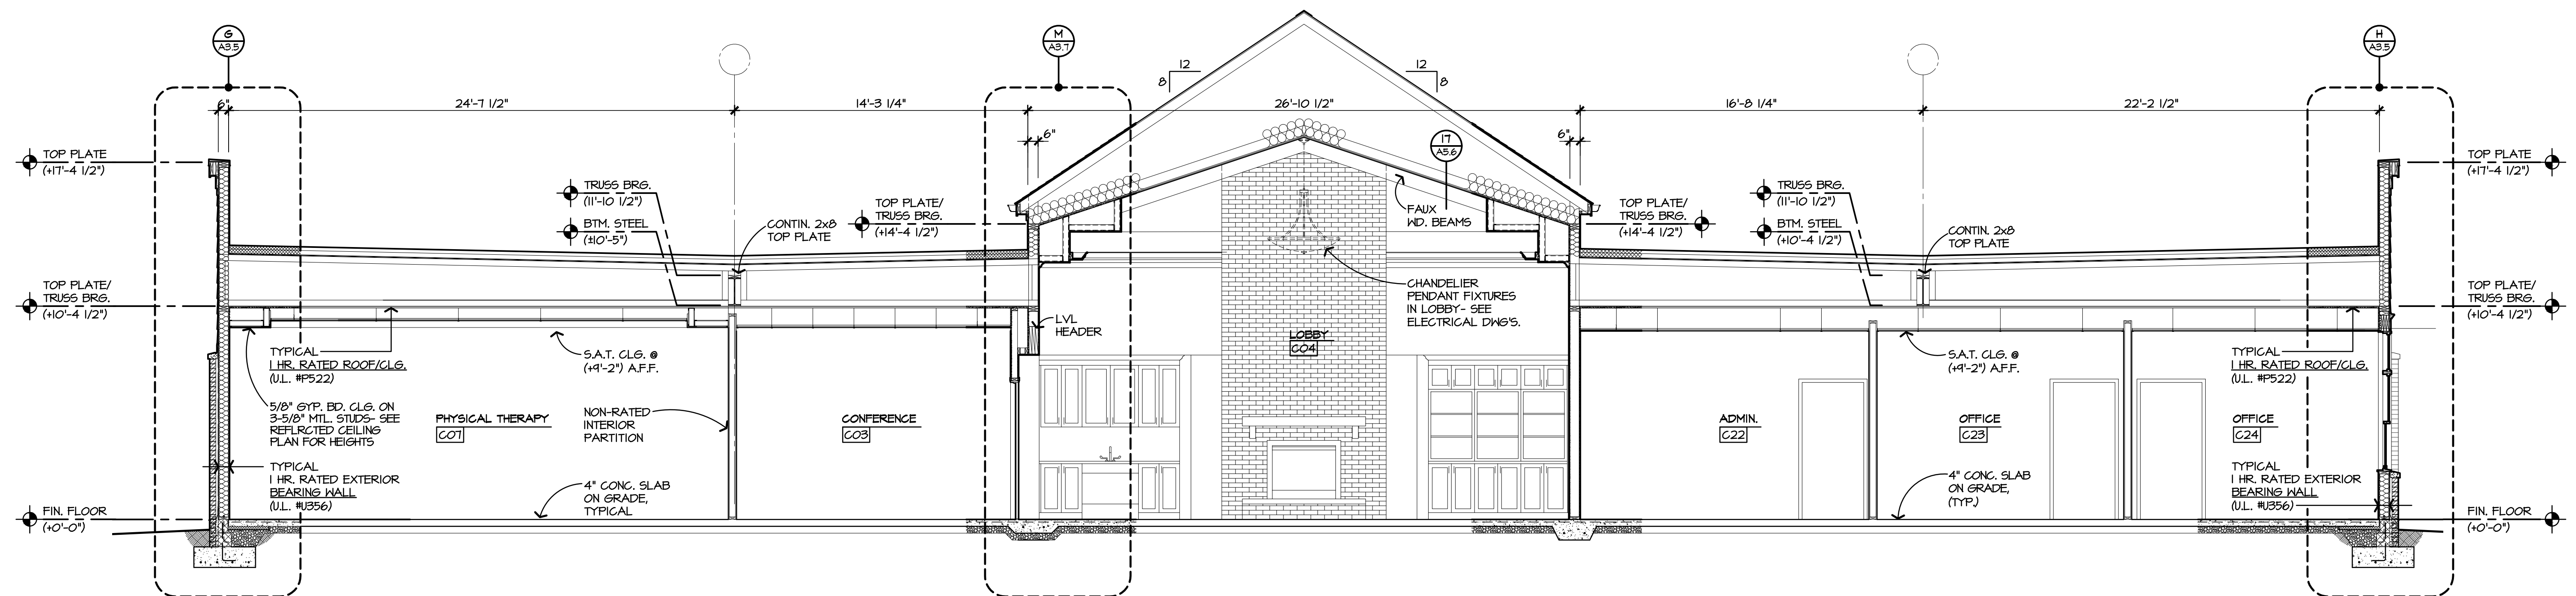

EE BUILDING SECTION
A3.1 SCALE: 1/4" = 1'-0"




DENNETT'S CREEK
HEALTH & REHABILITATION CENTER
1931/1975 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA







DRAWING NAME
BUILDING
SECTIONS

SCA PROJECT NO.
24.061

A3.2

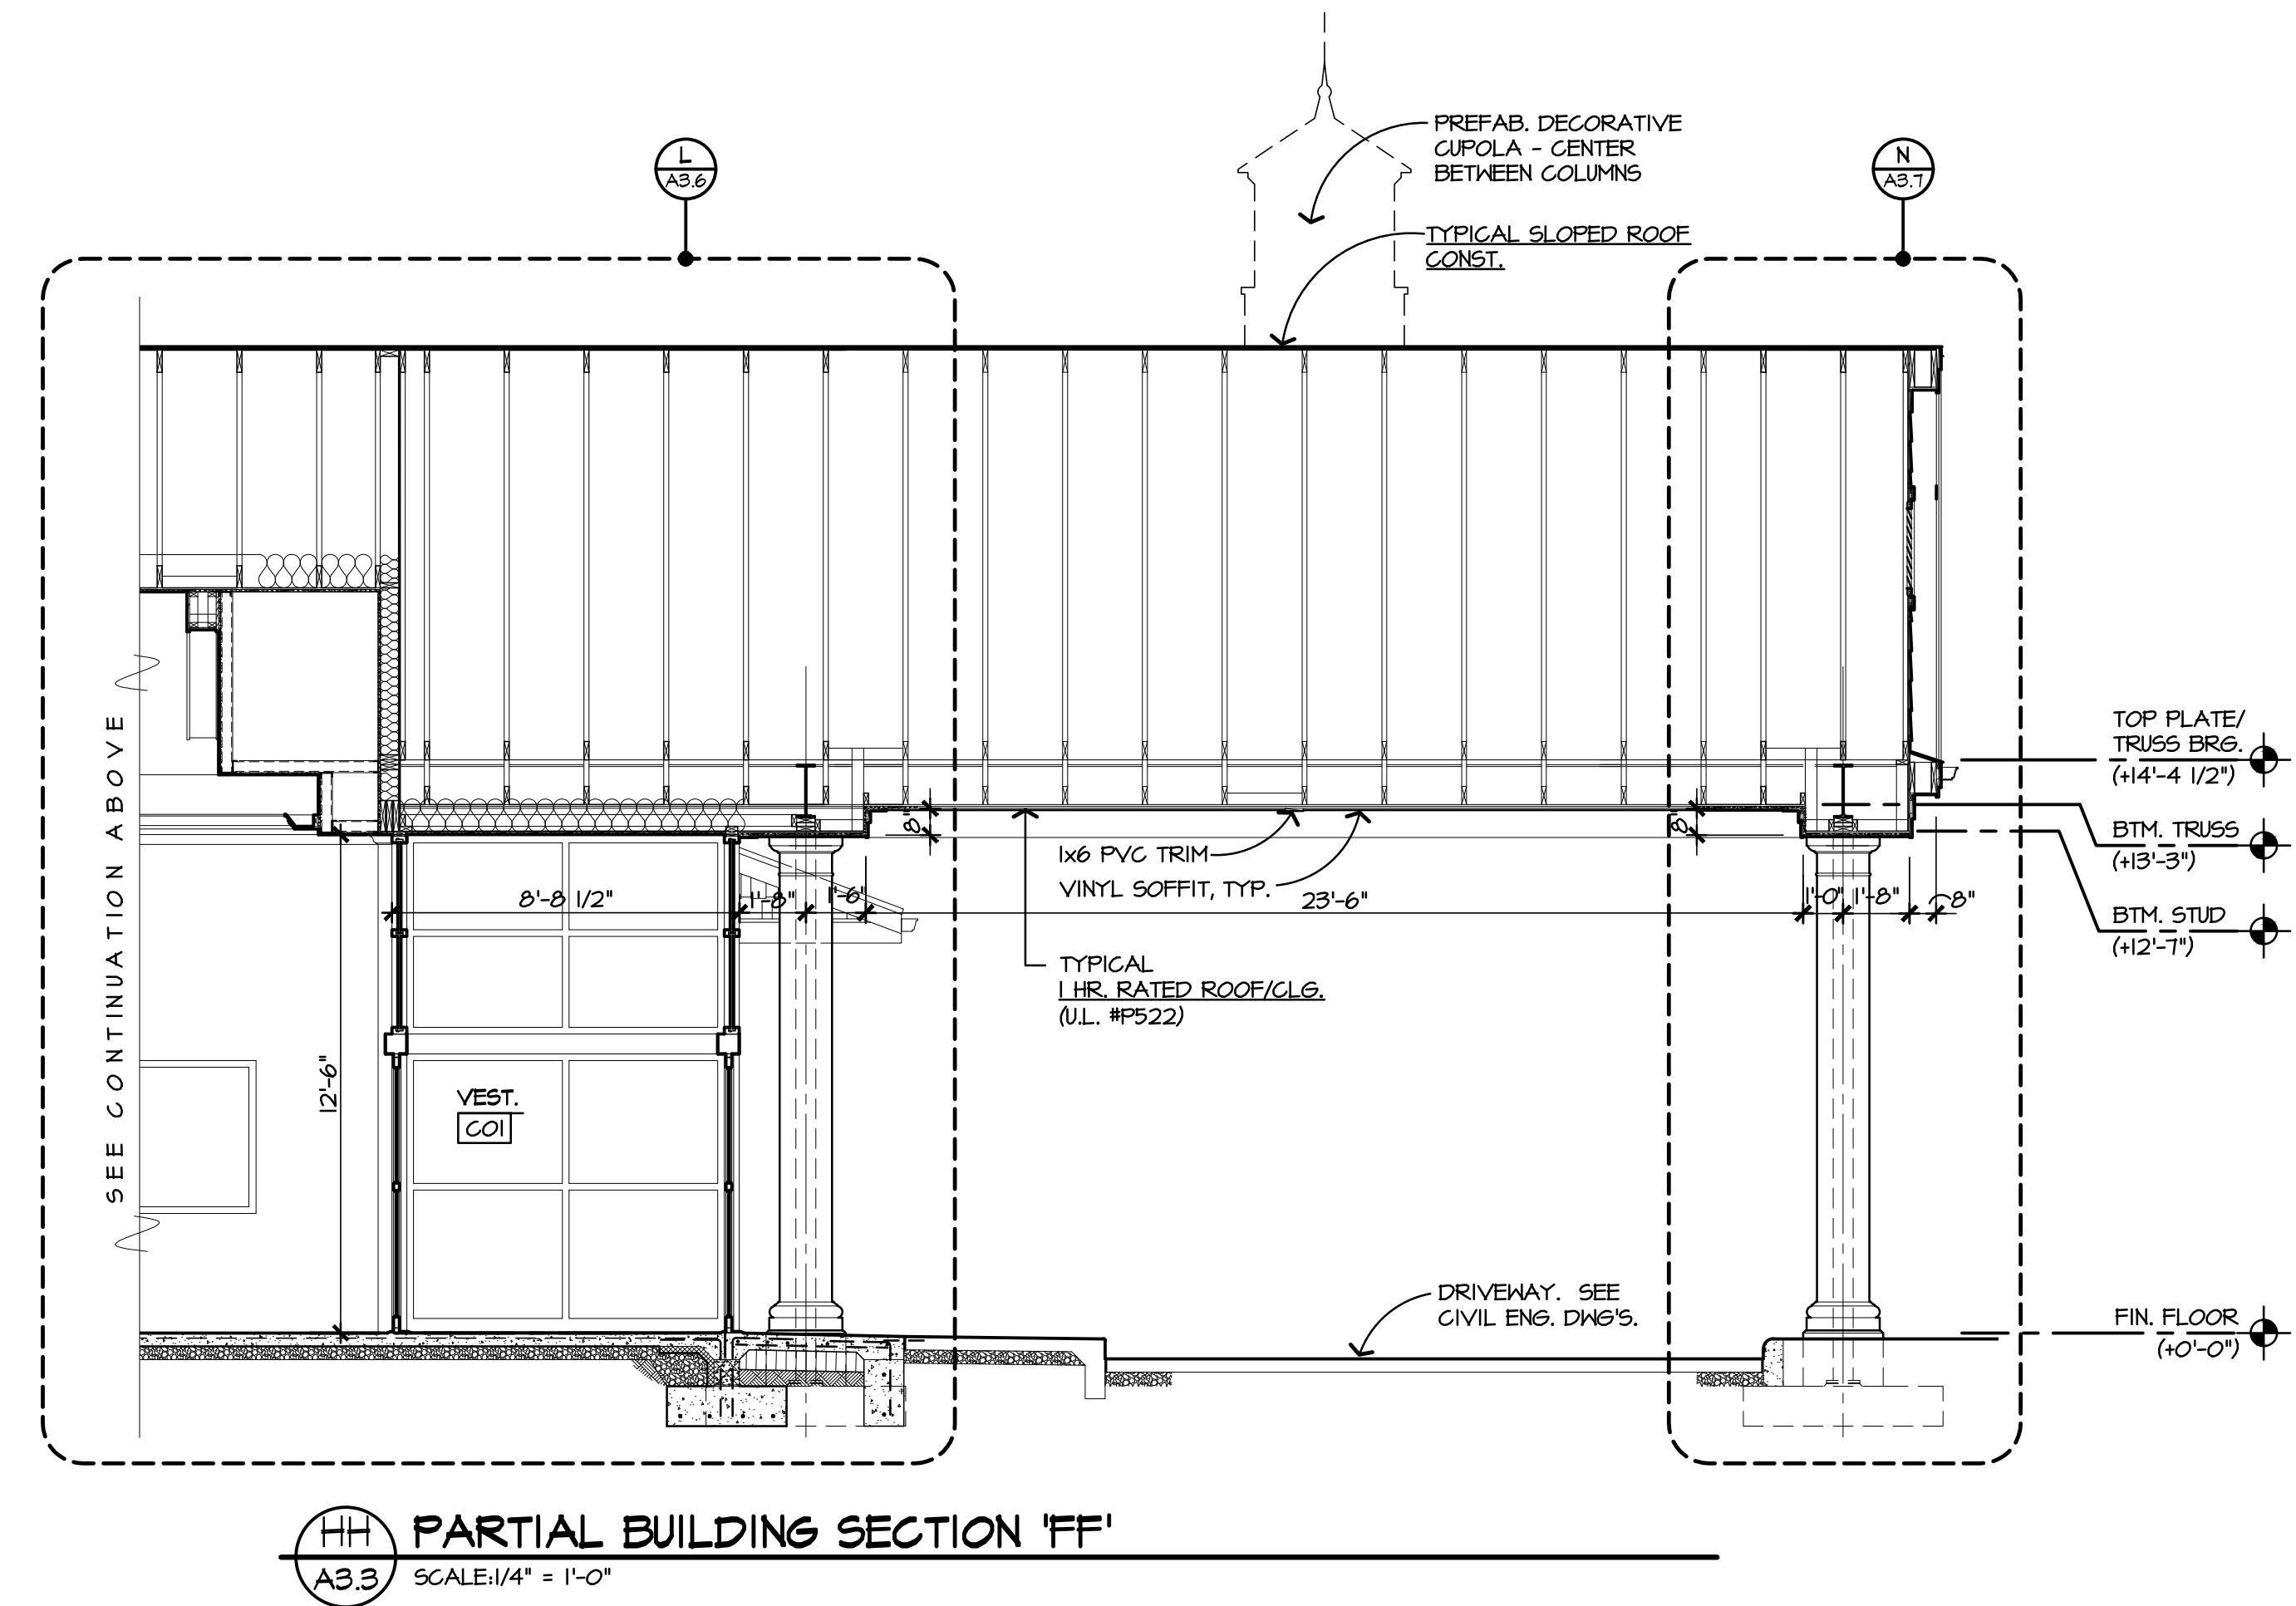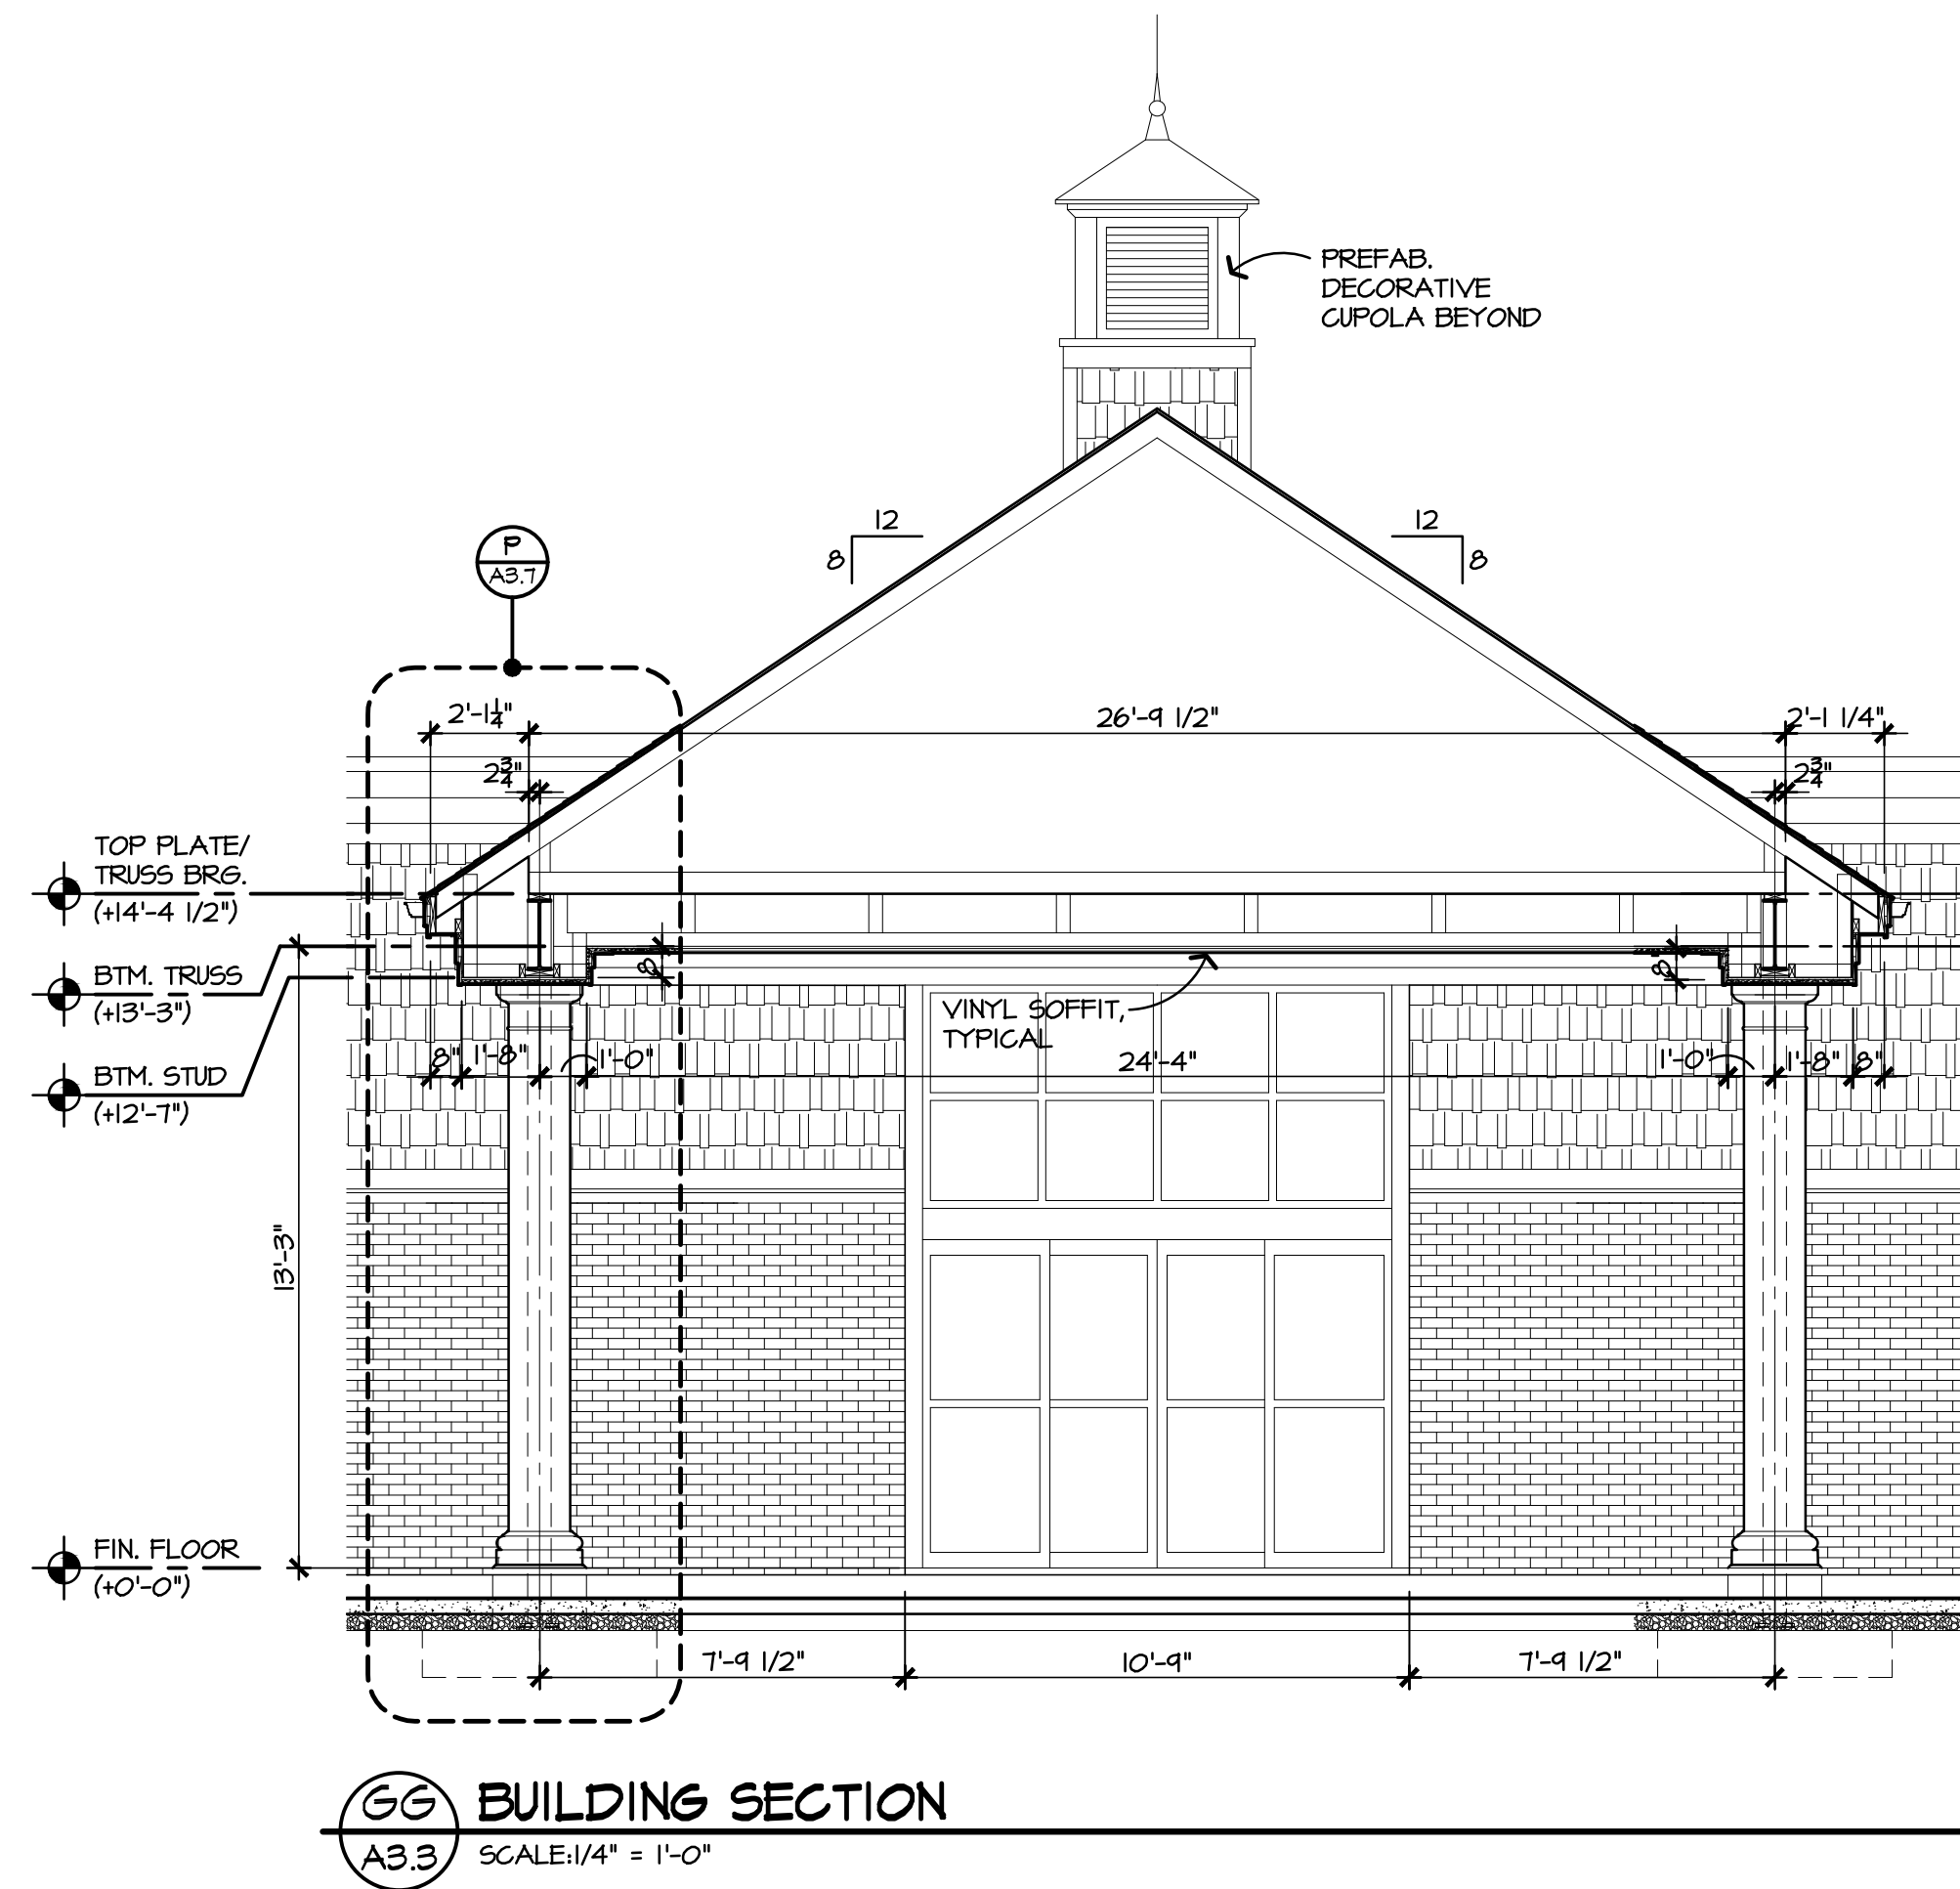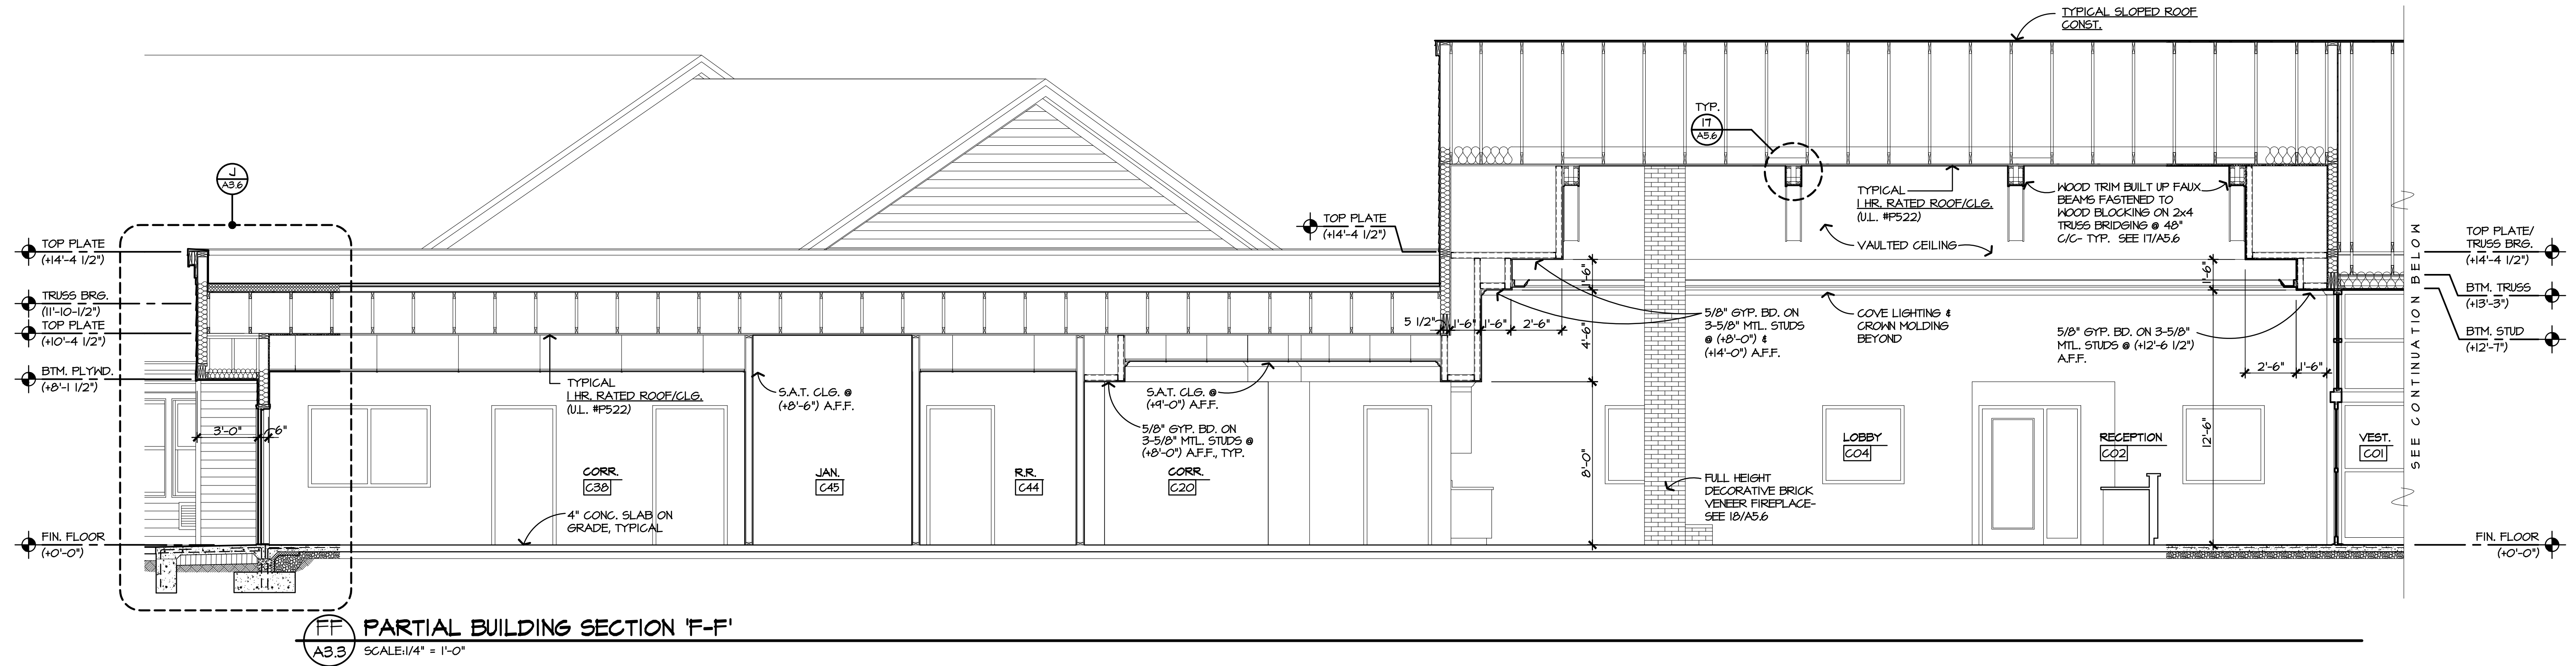

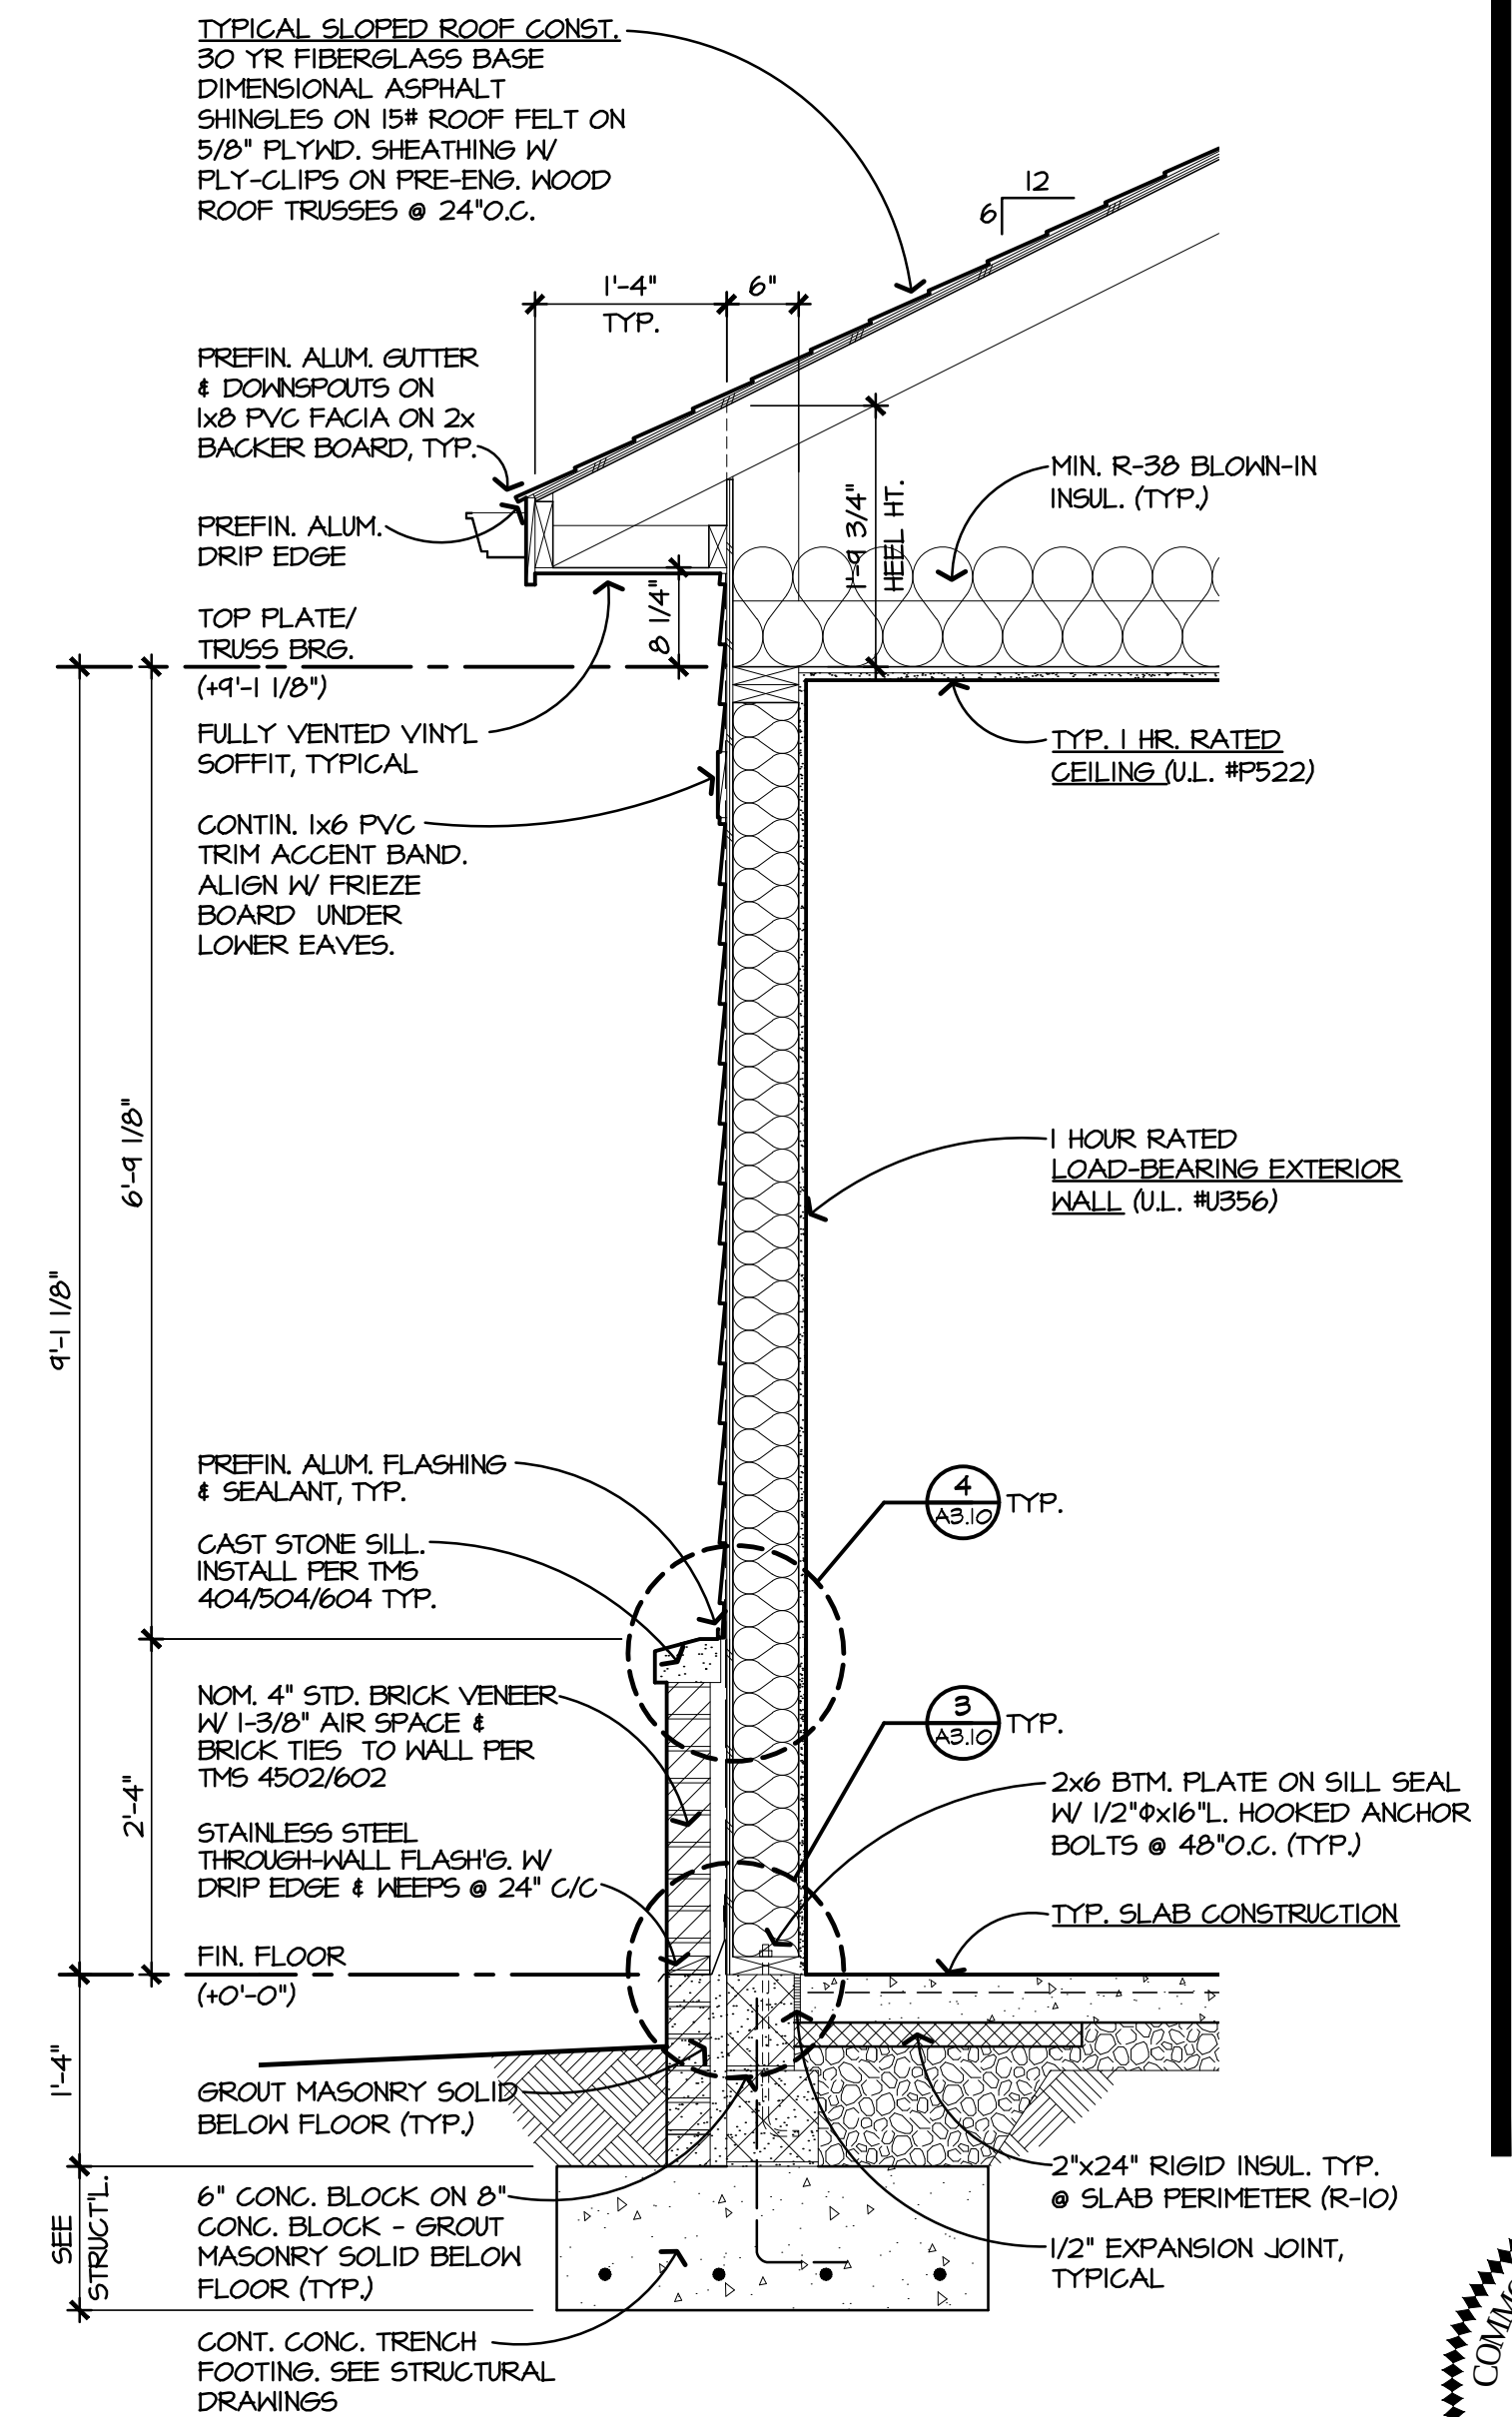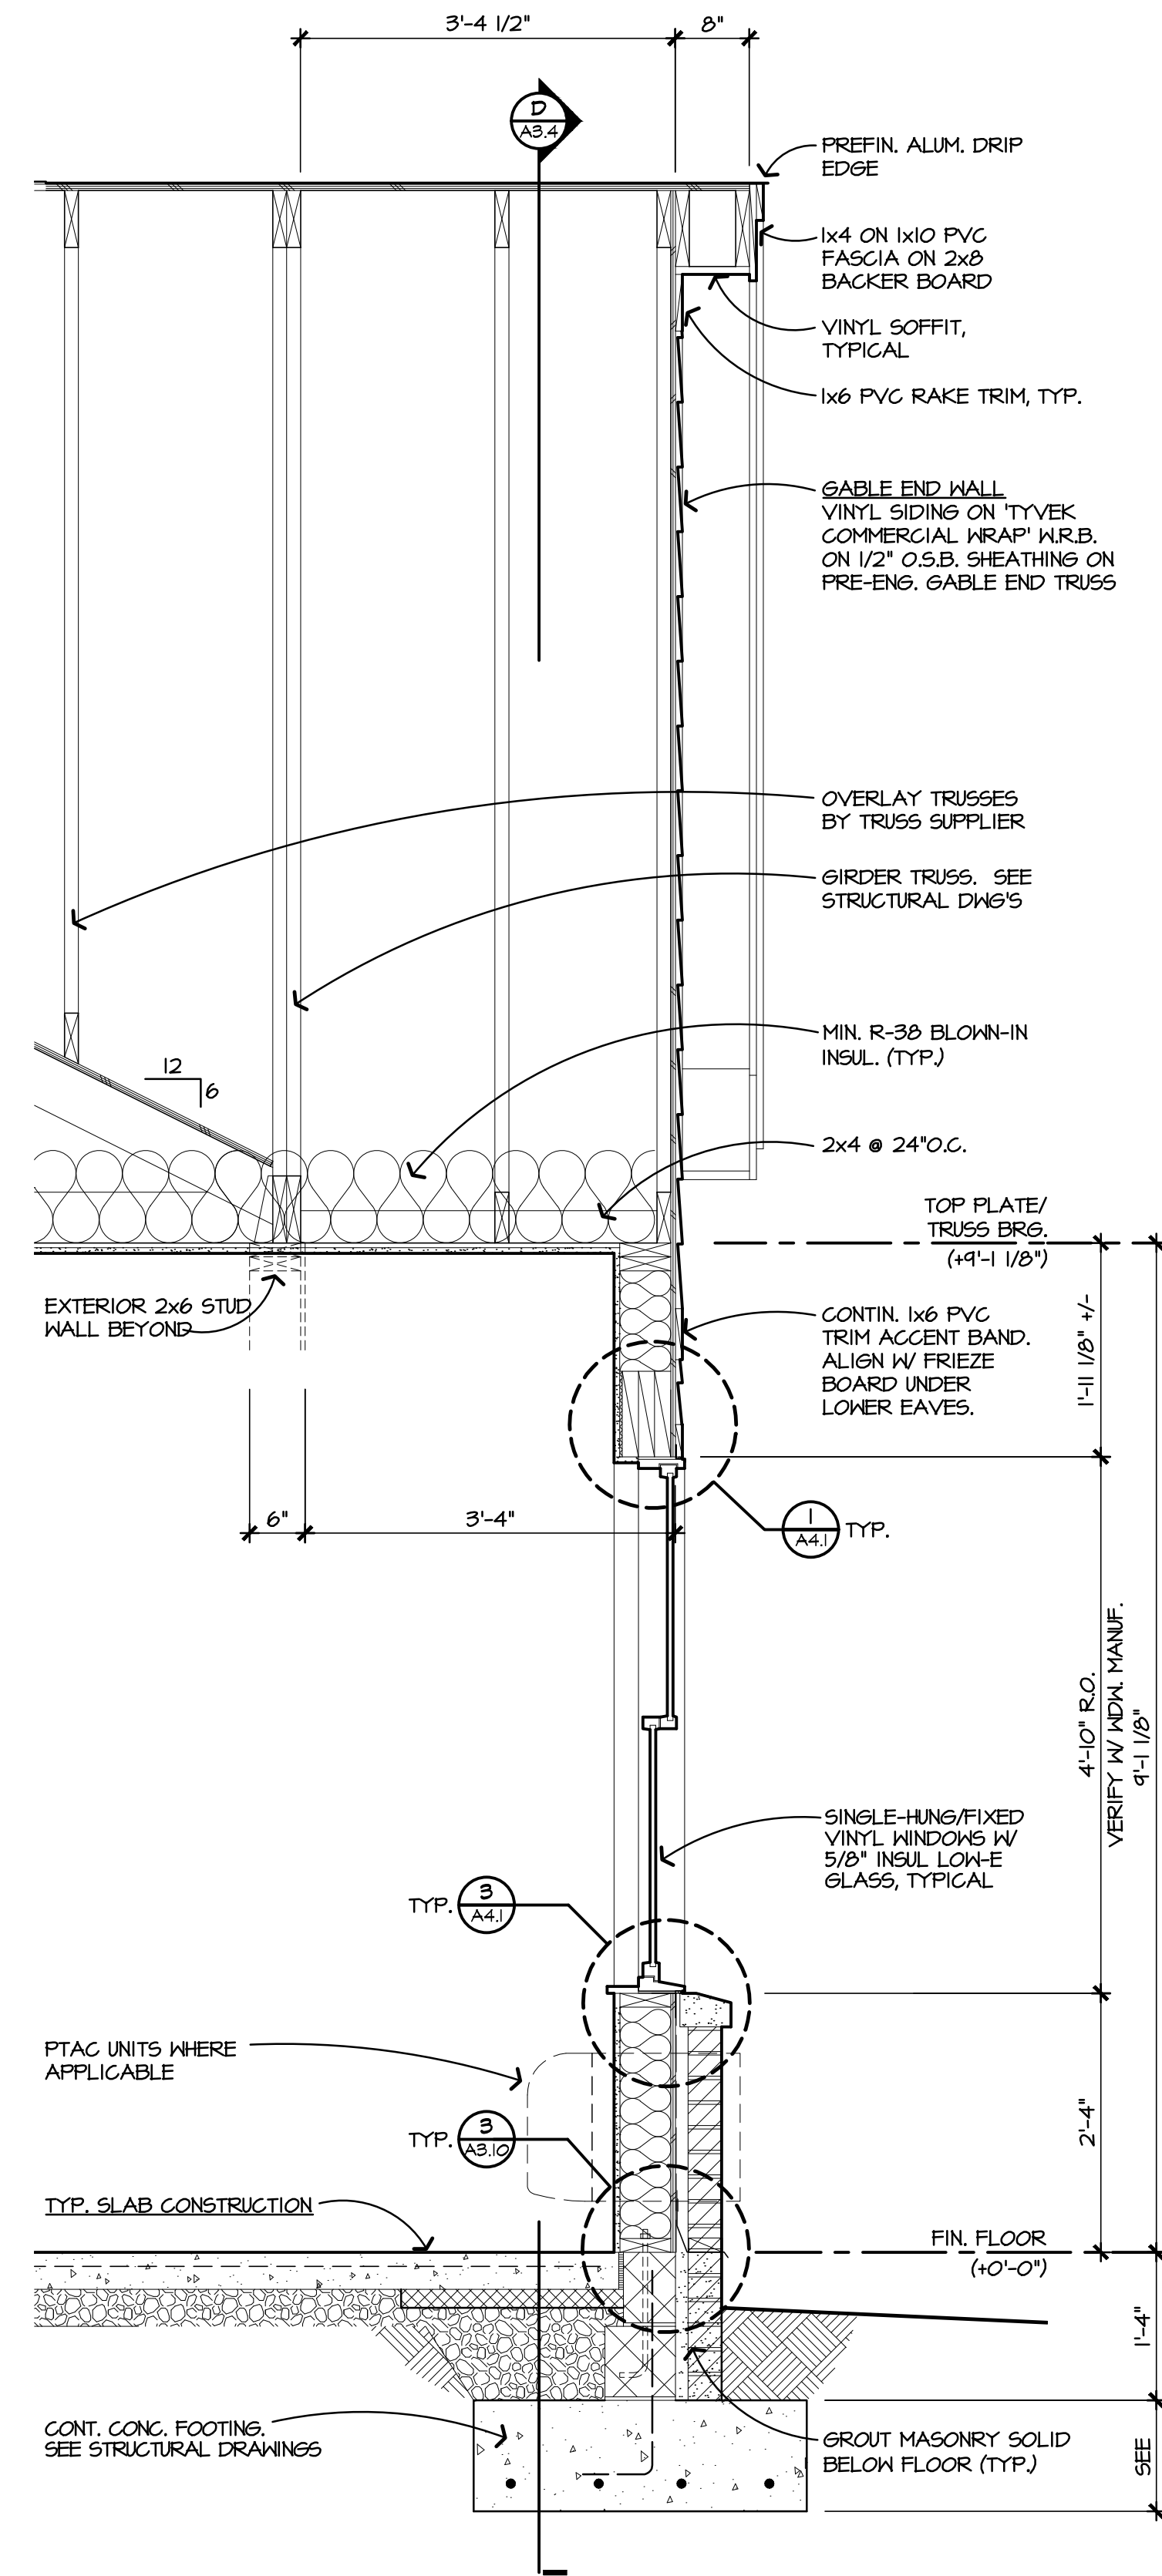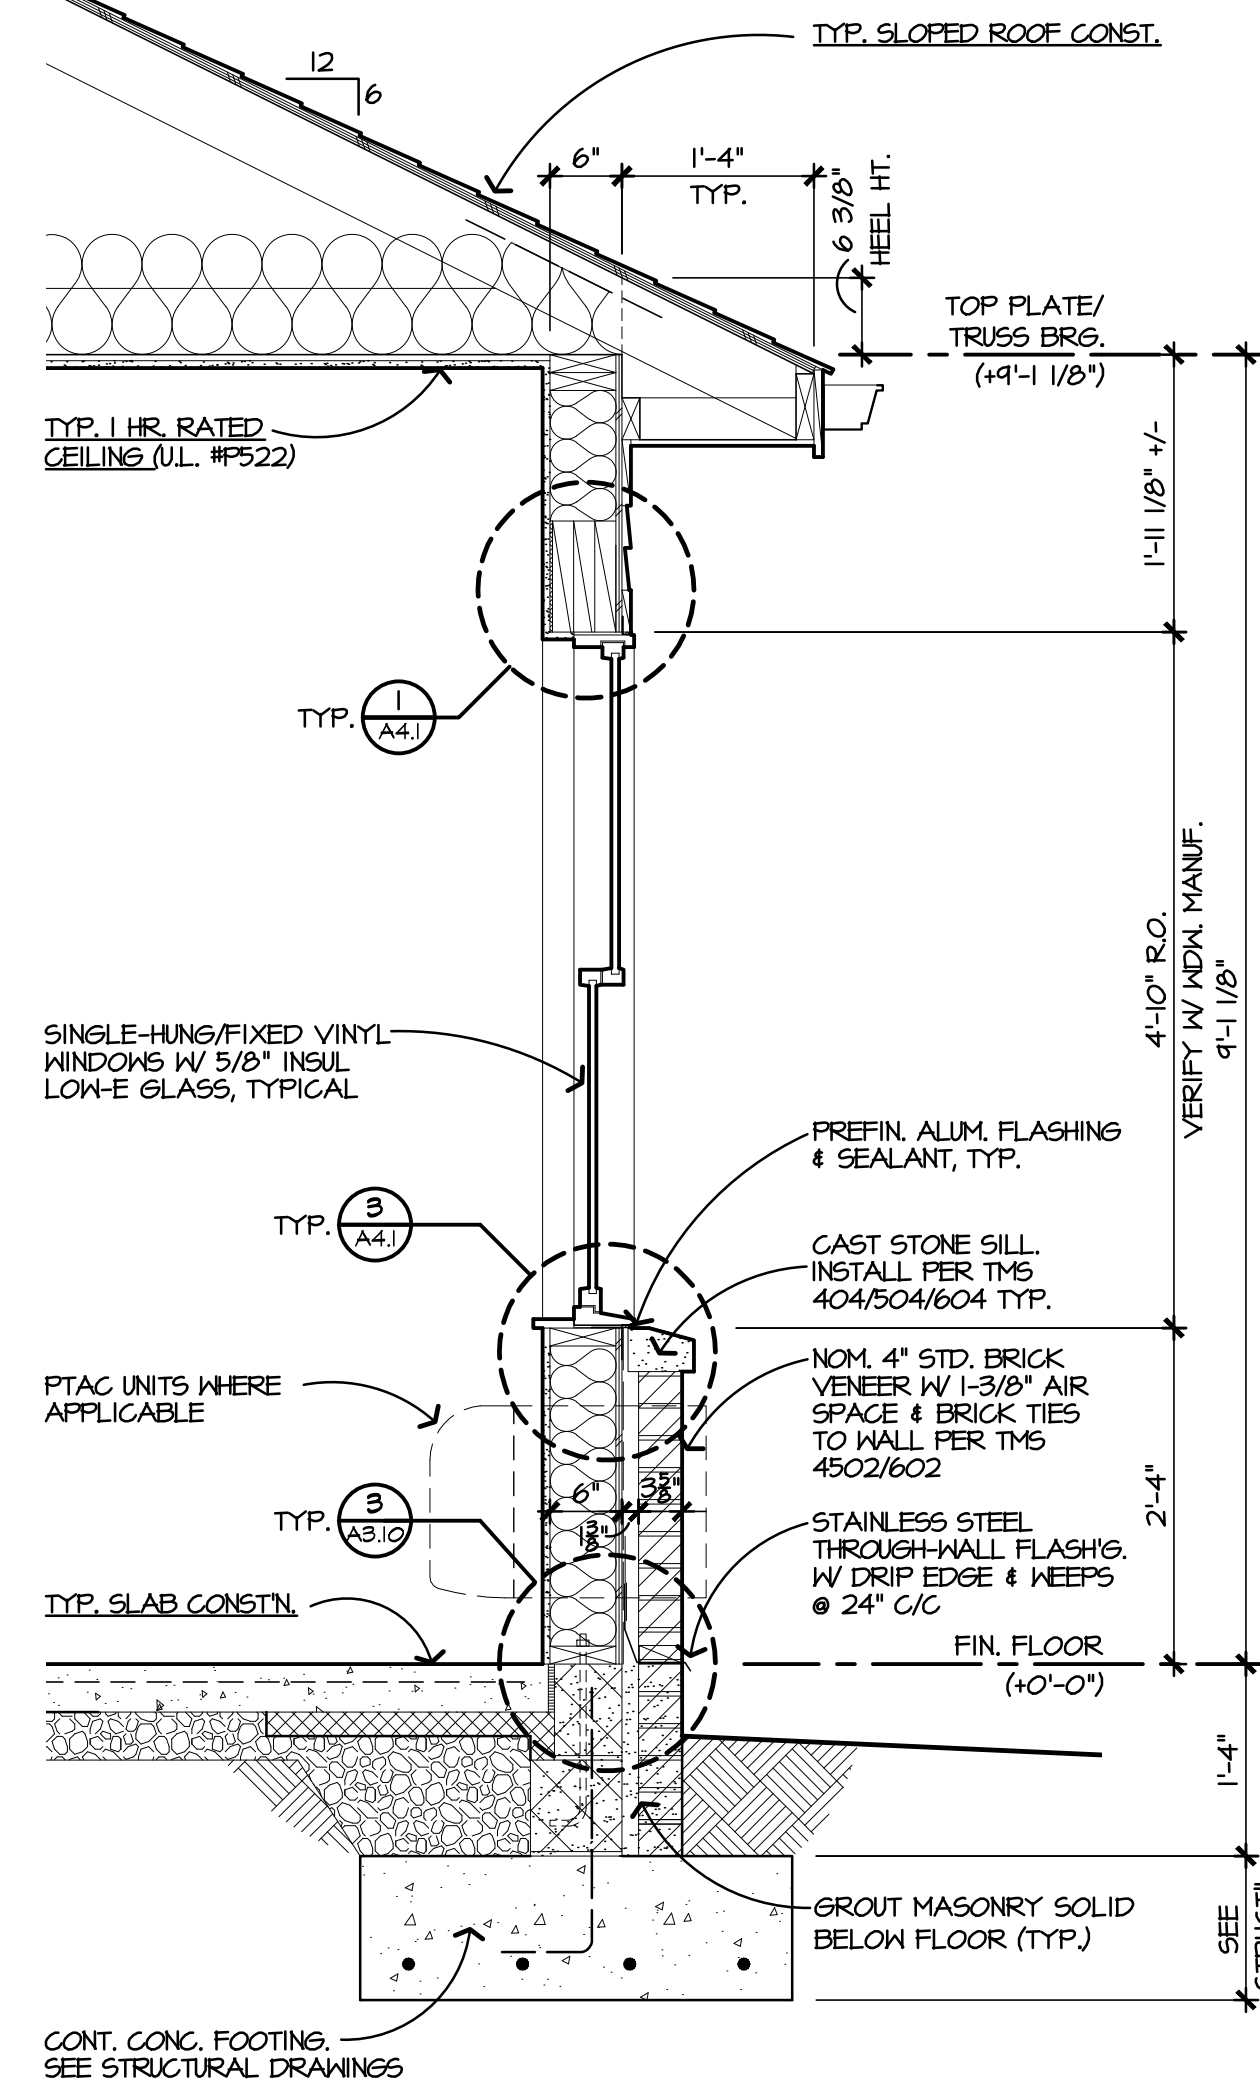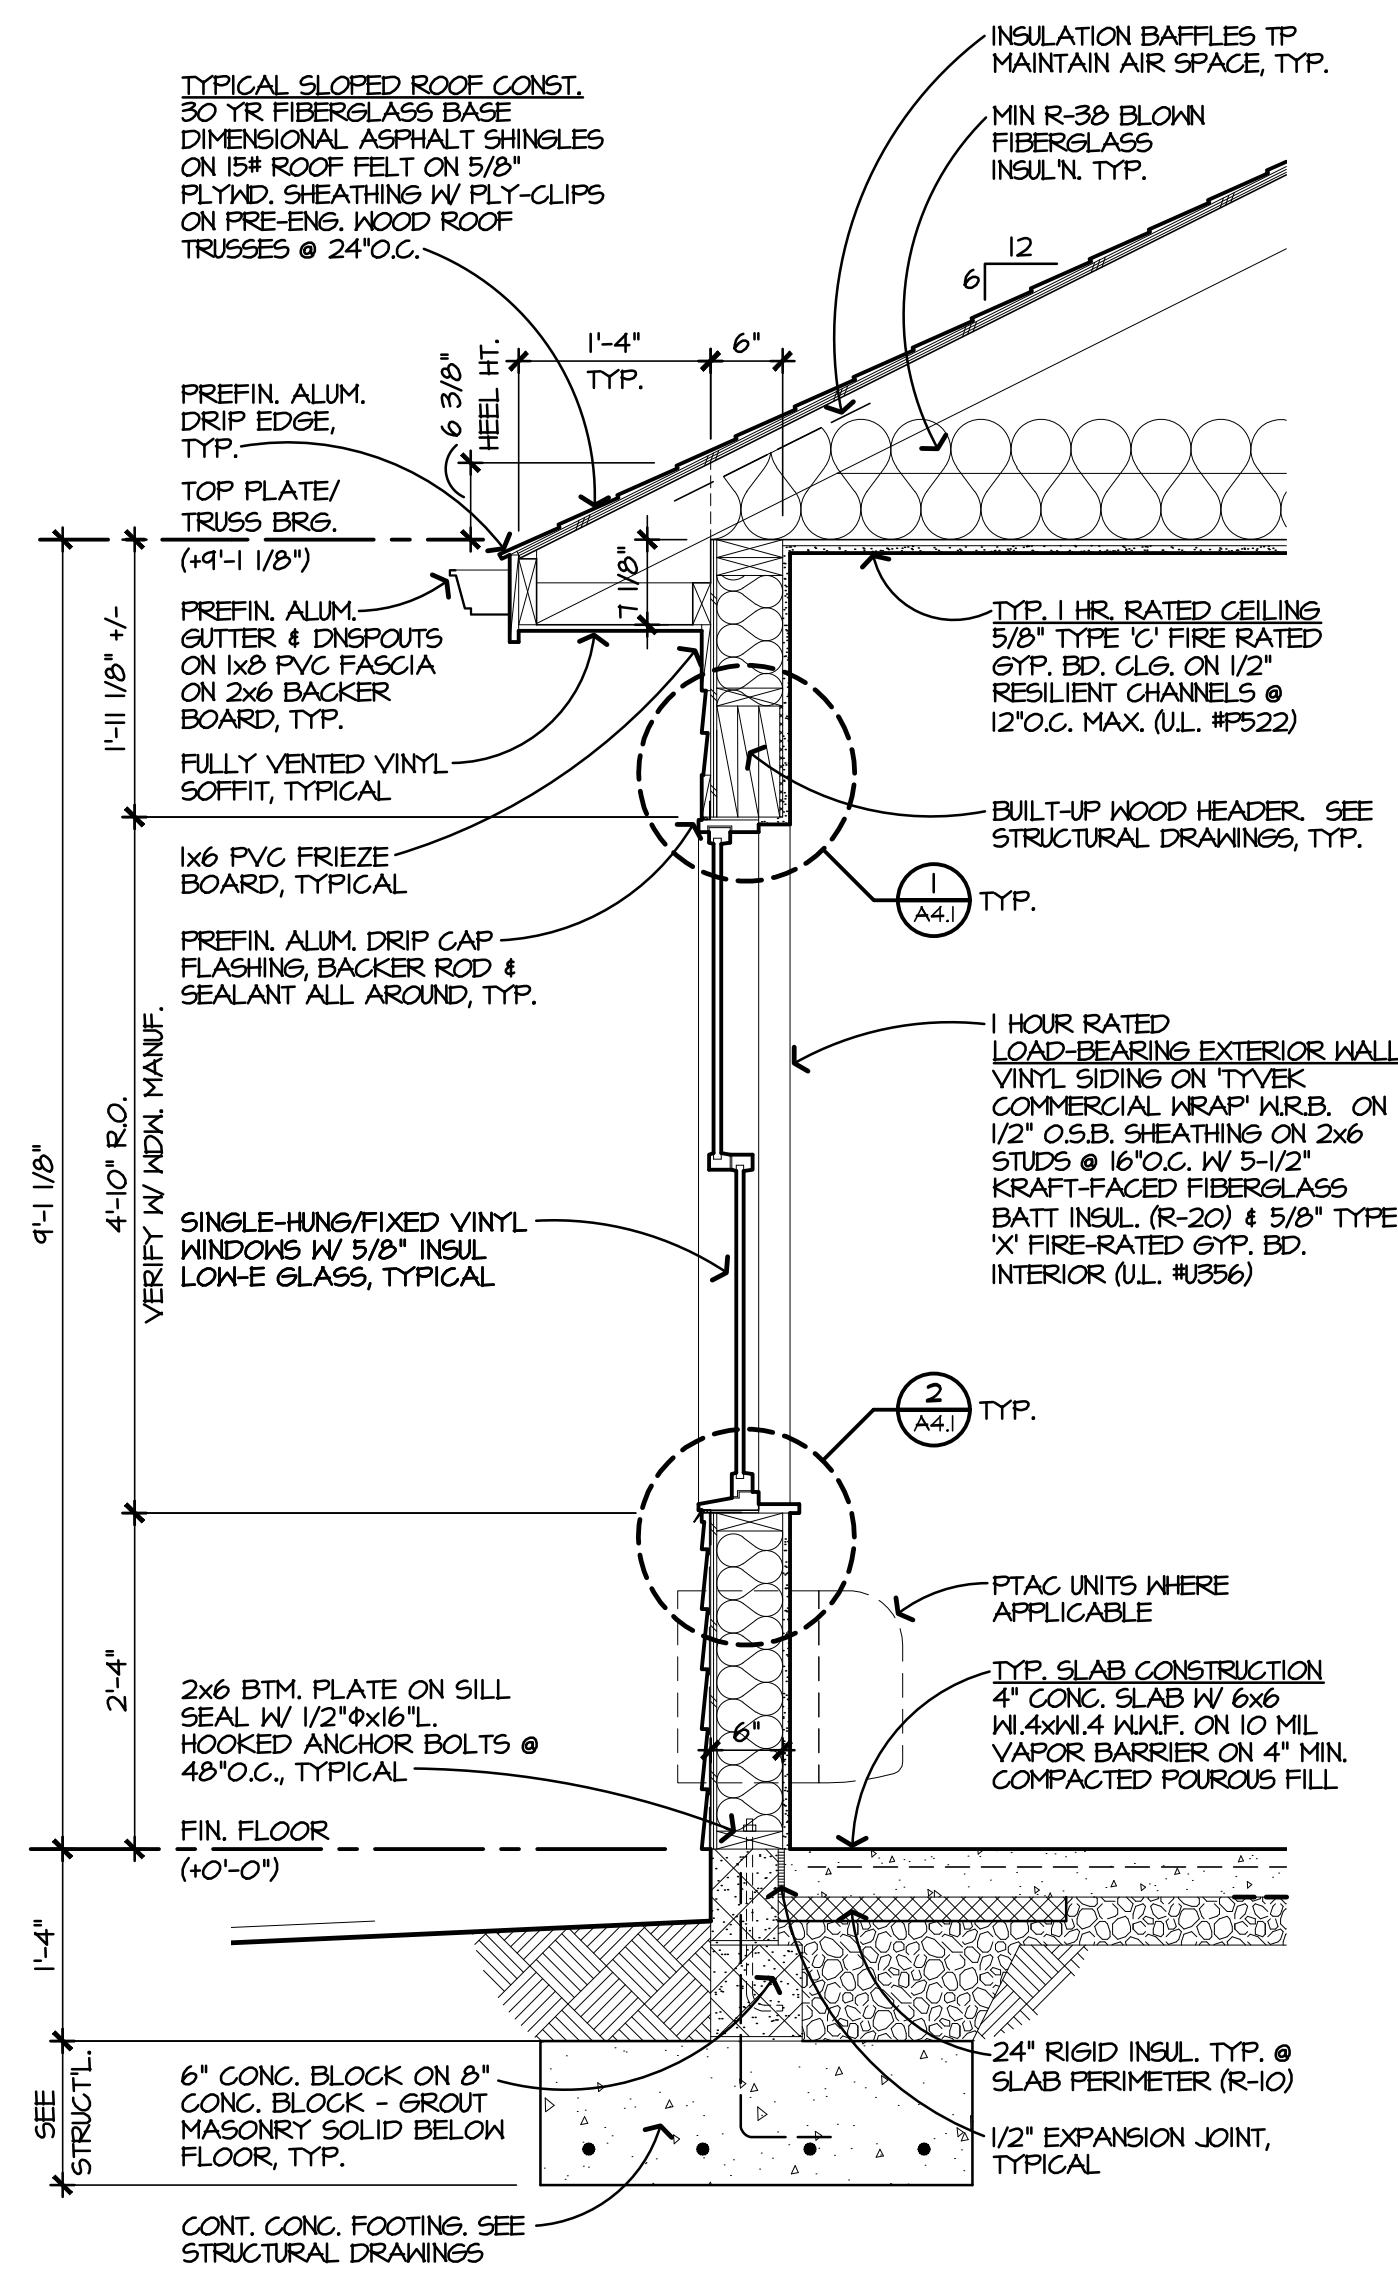



DATE: 06.19.26


DENNETTS CREEK
HEALTH & REHABILITATION CENTER
1931/1975 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA






DRAWING NAME
WALL
SECTIONS

SCA PROJECT NO.
24.061

A3.5

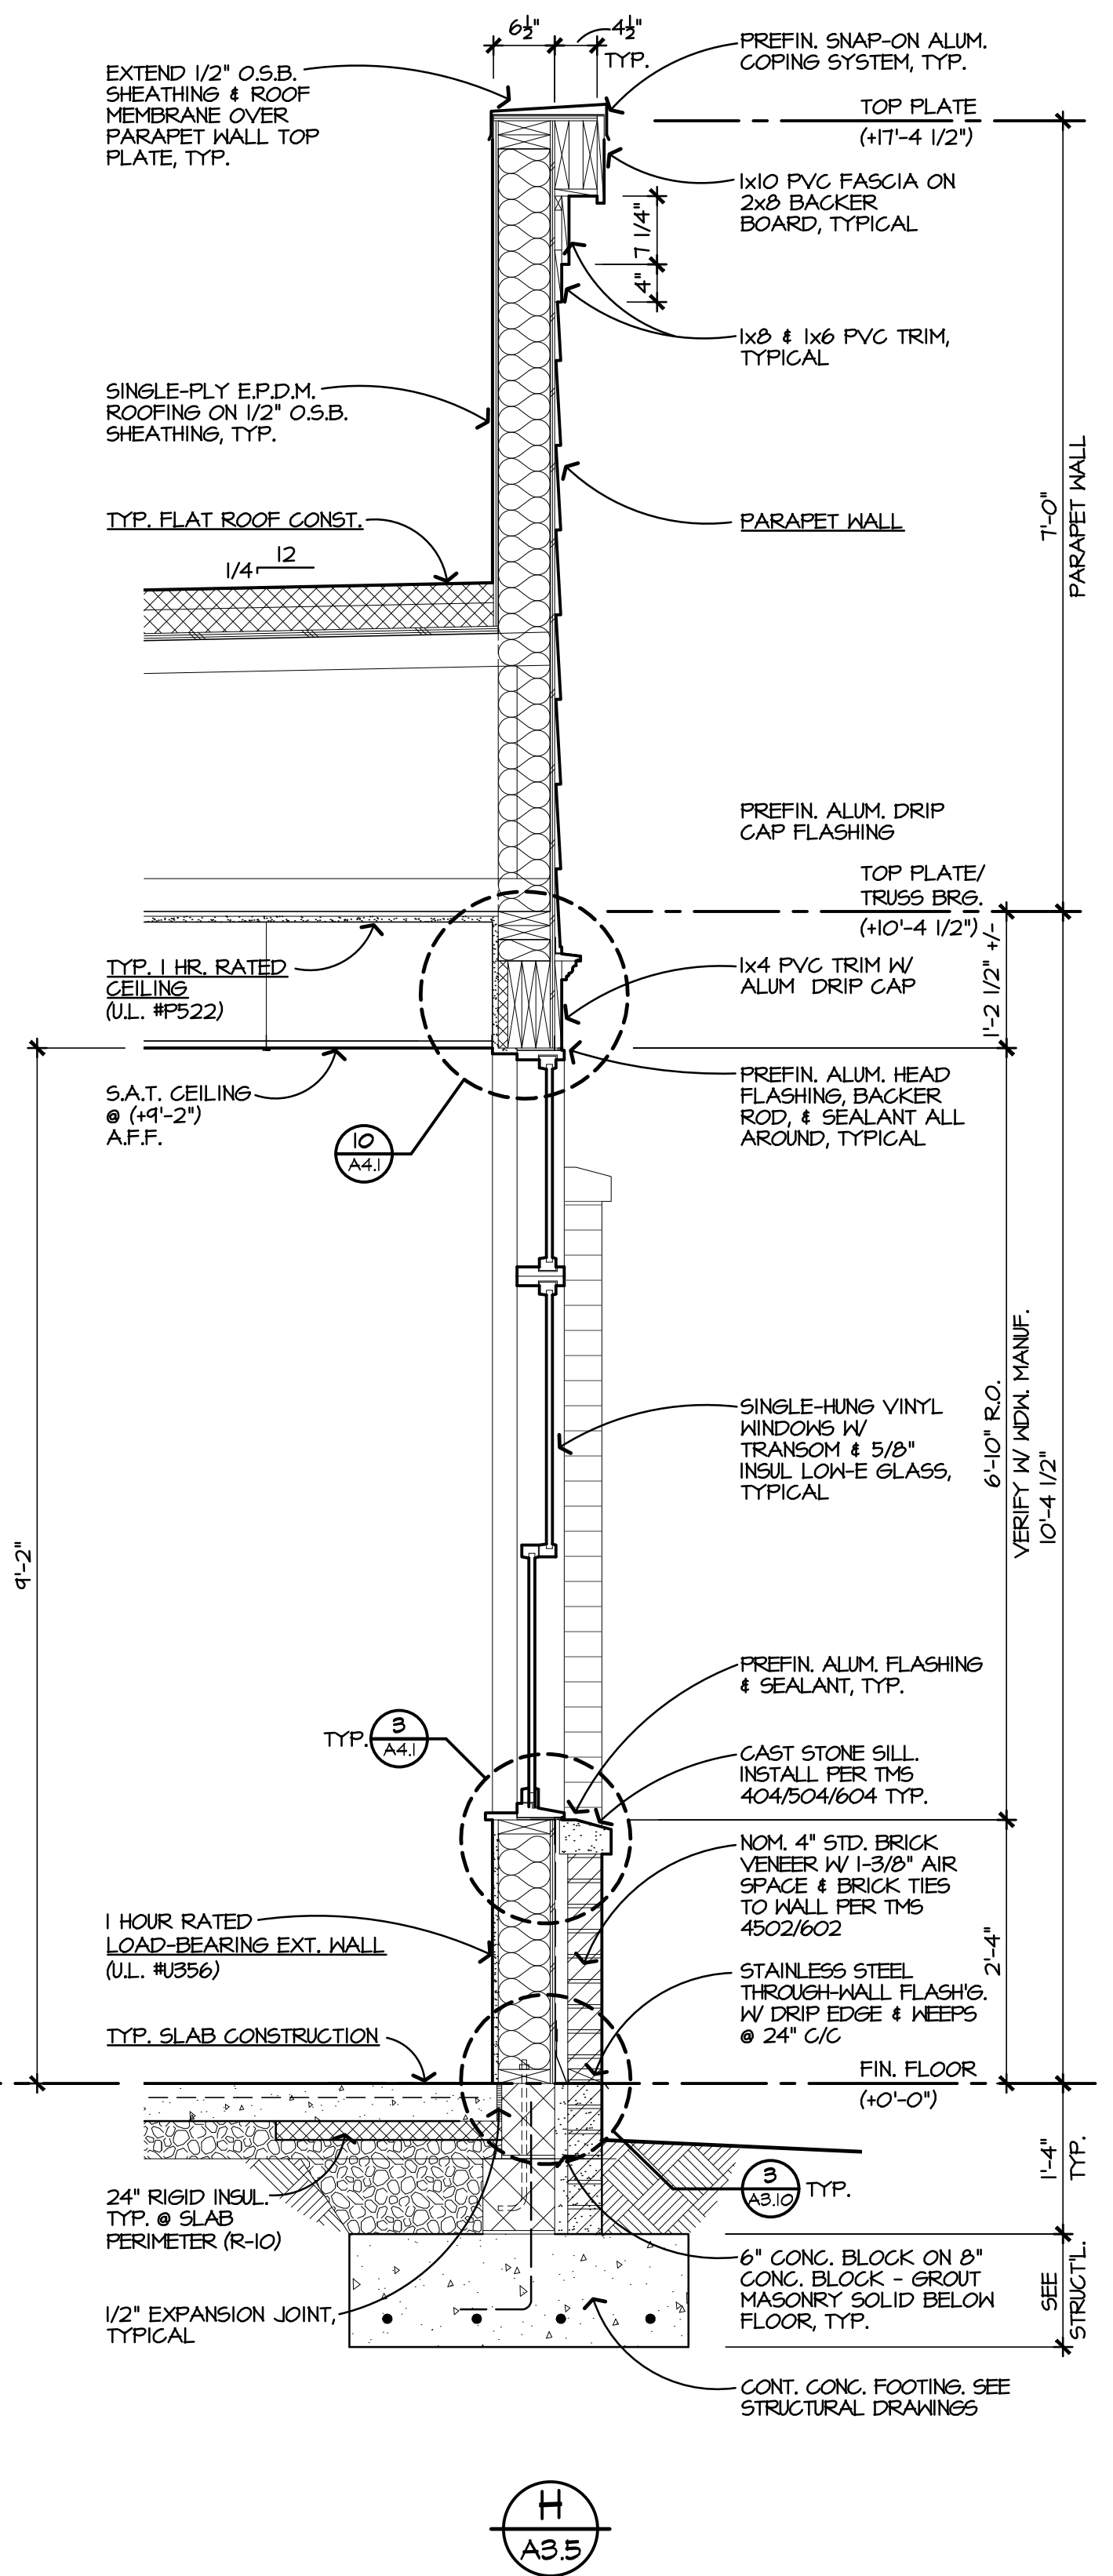

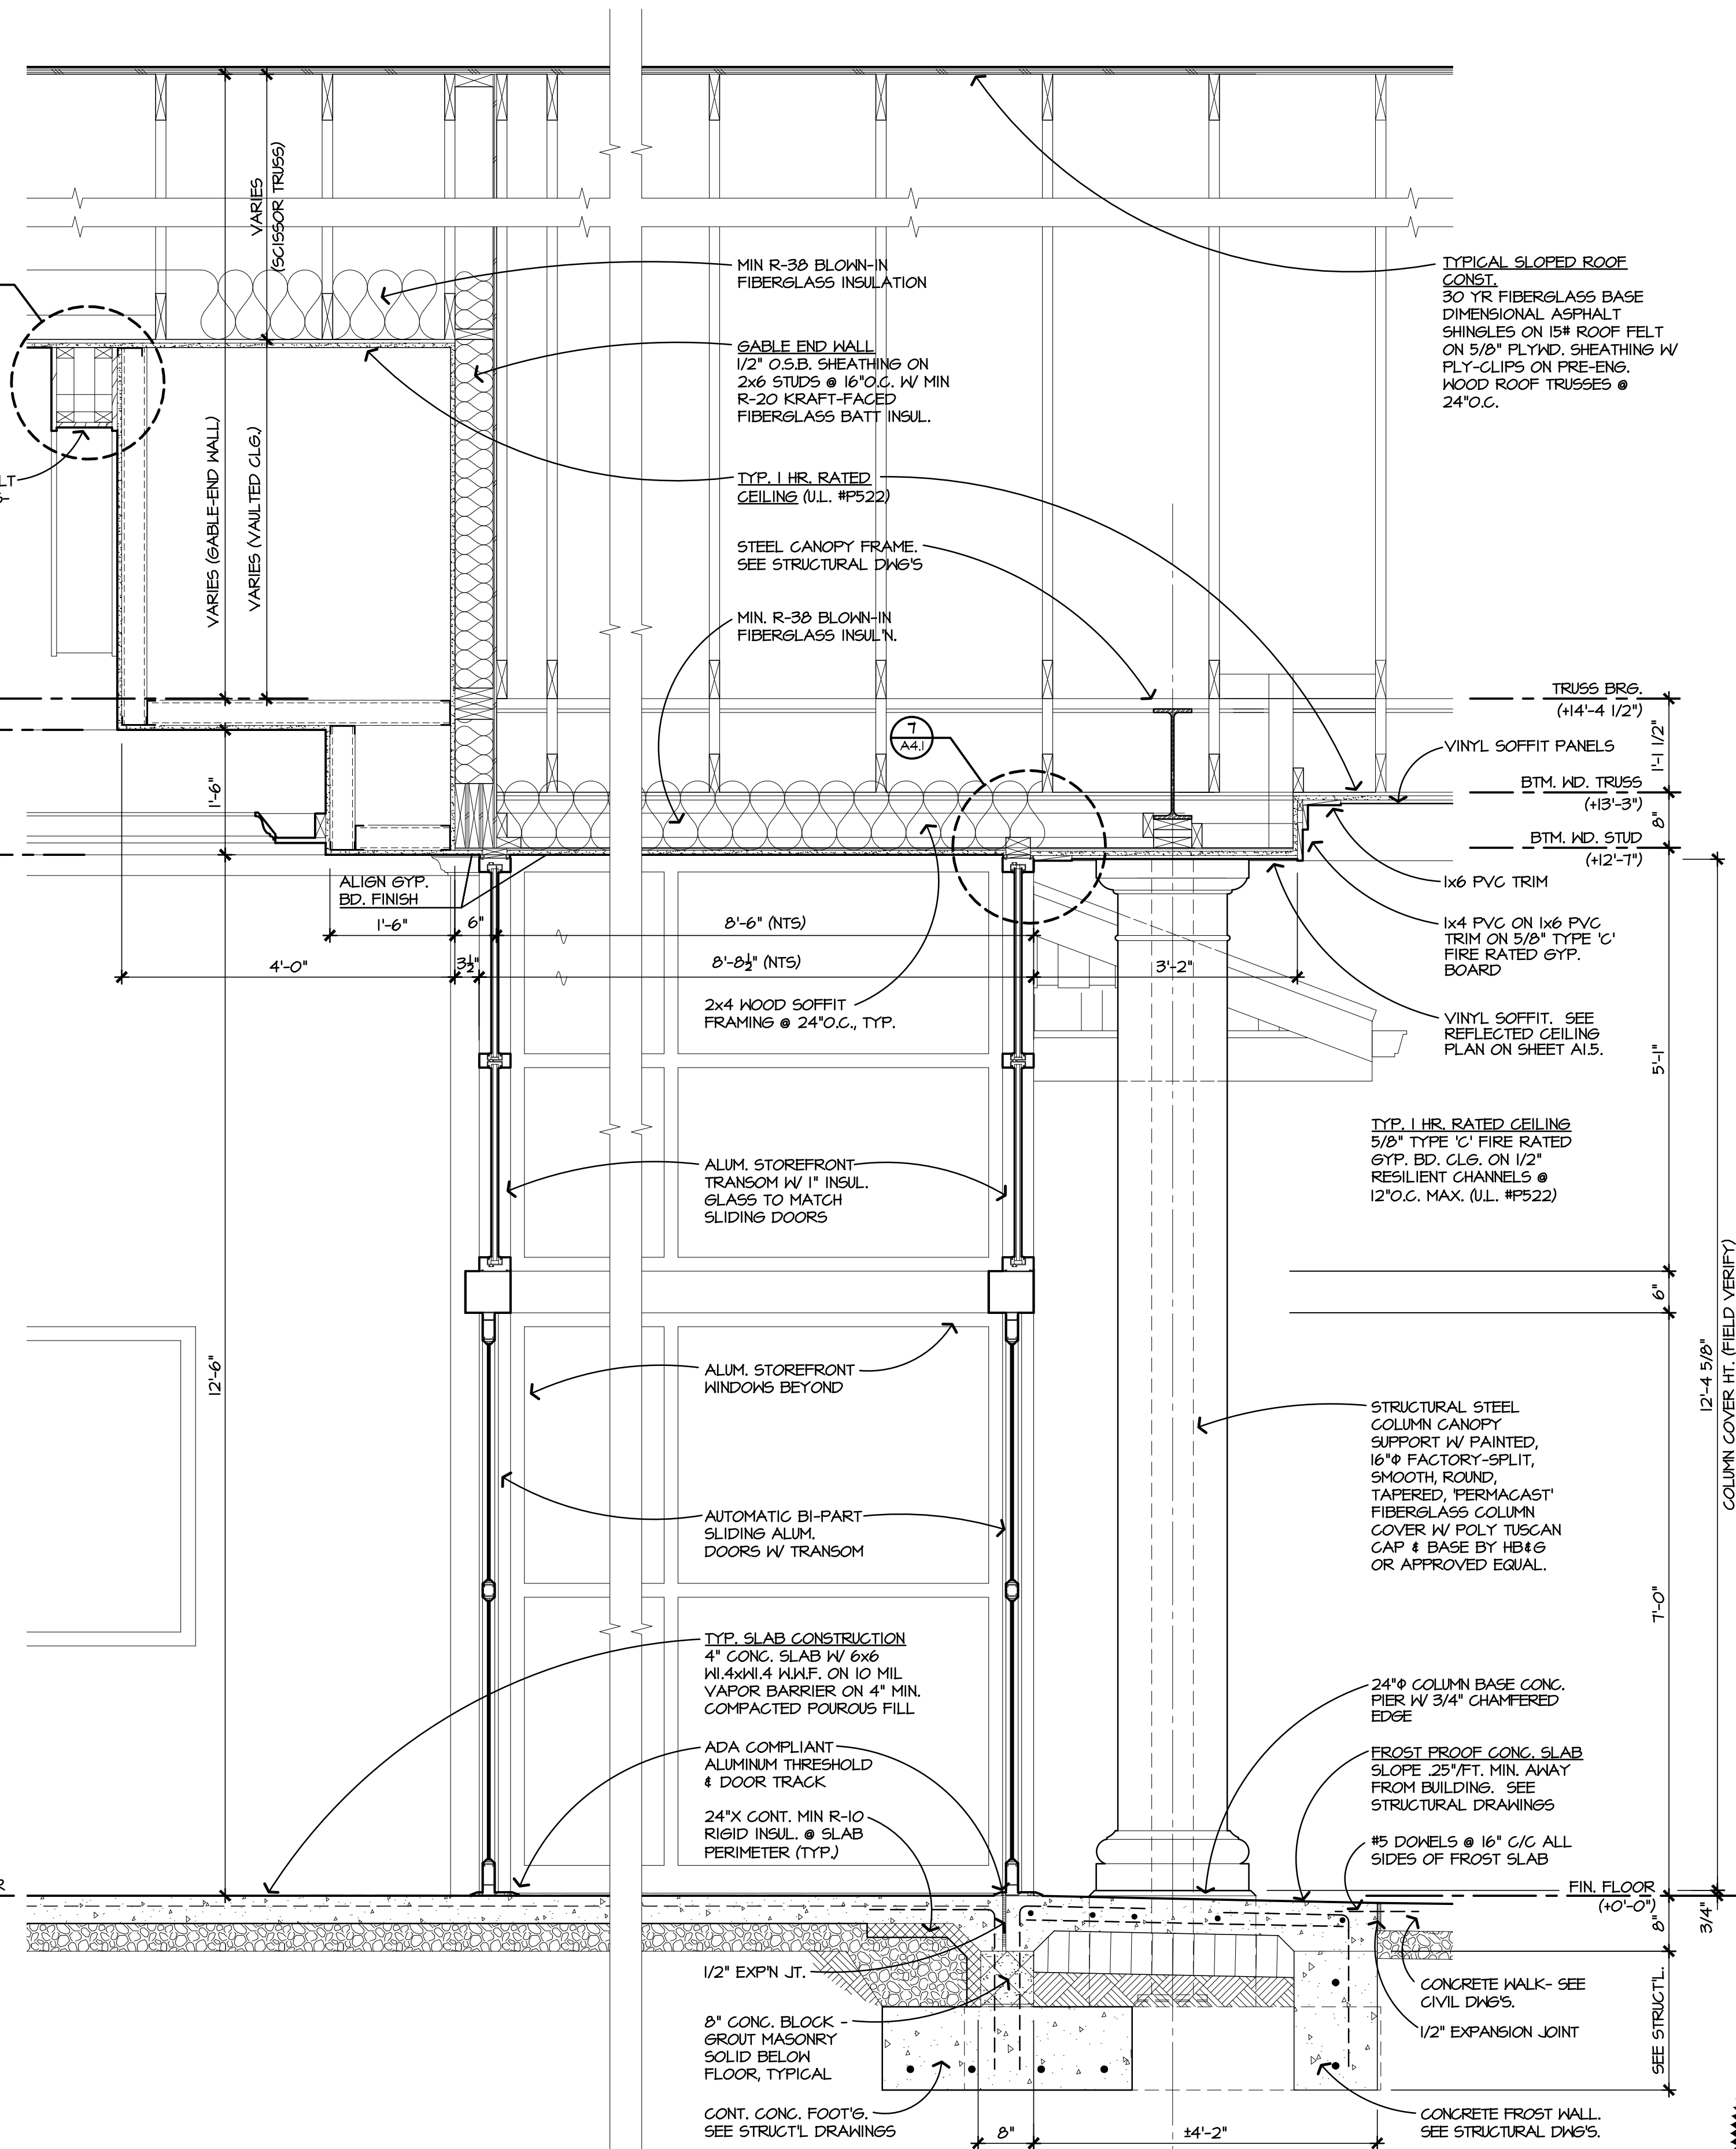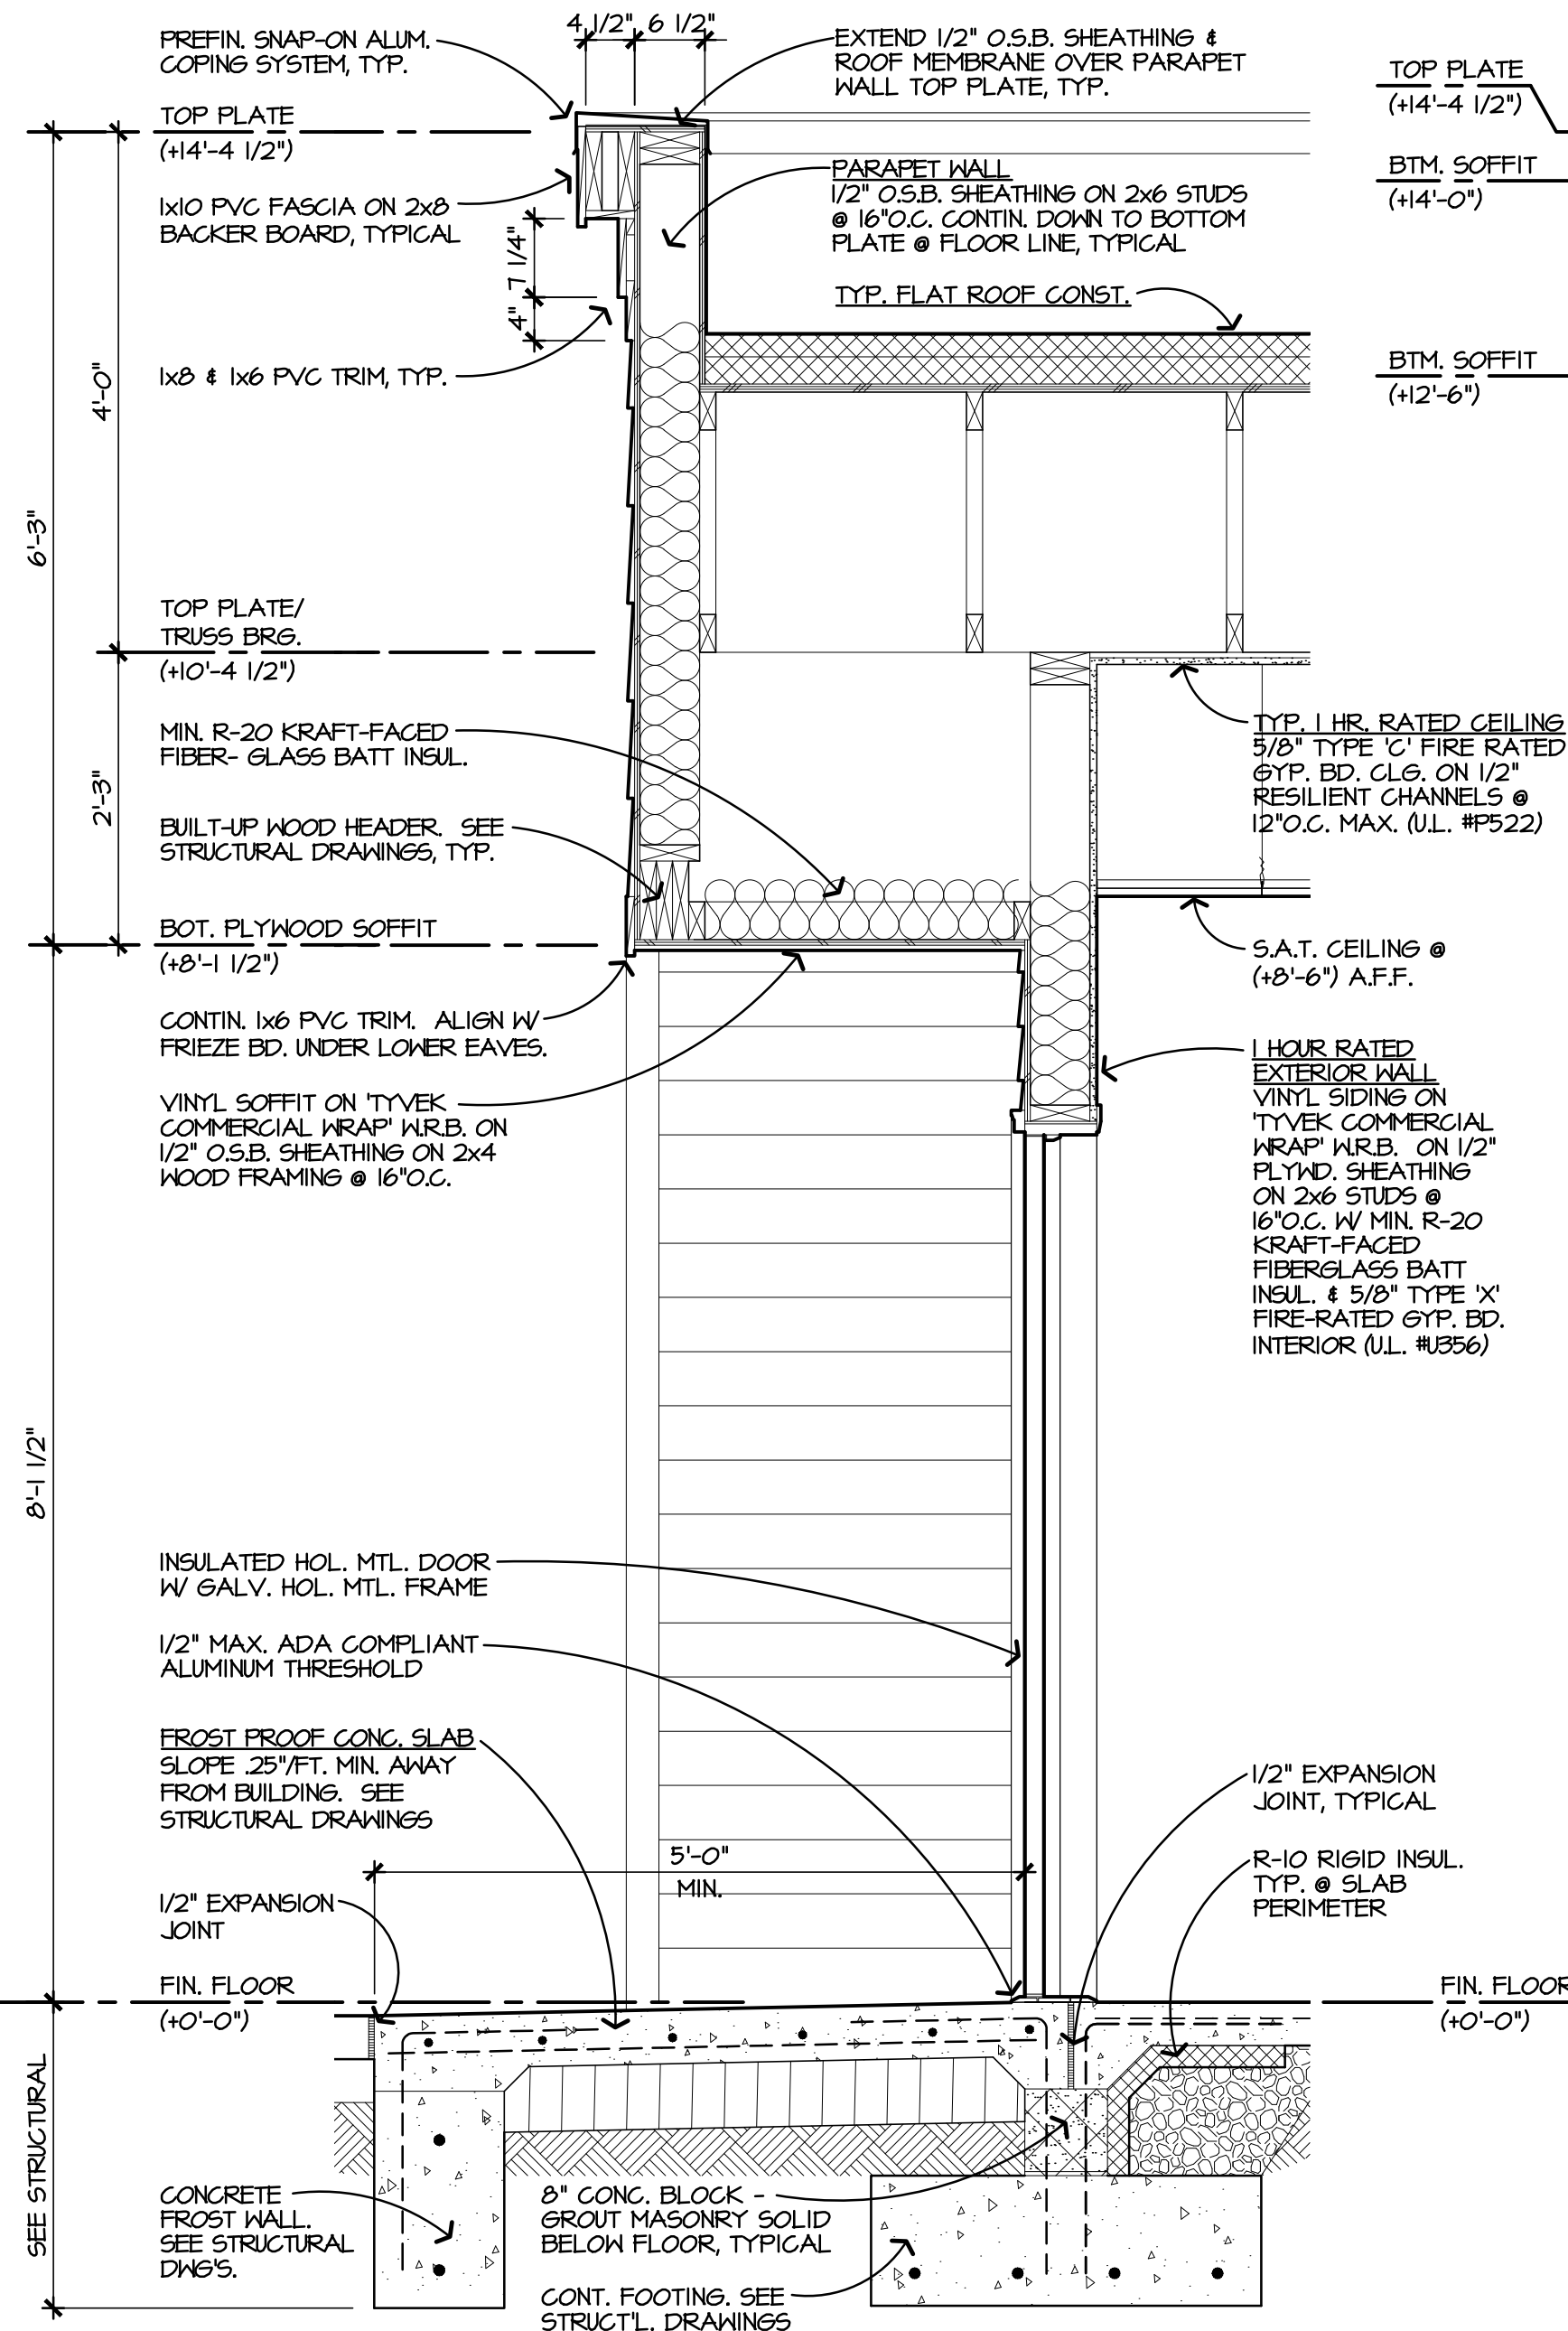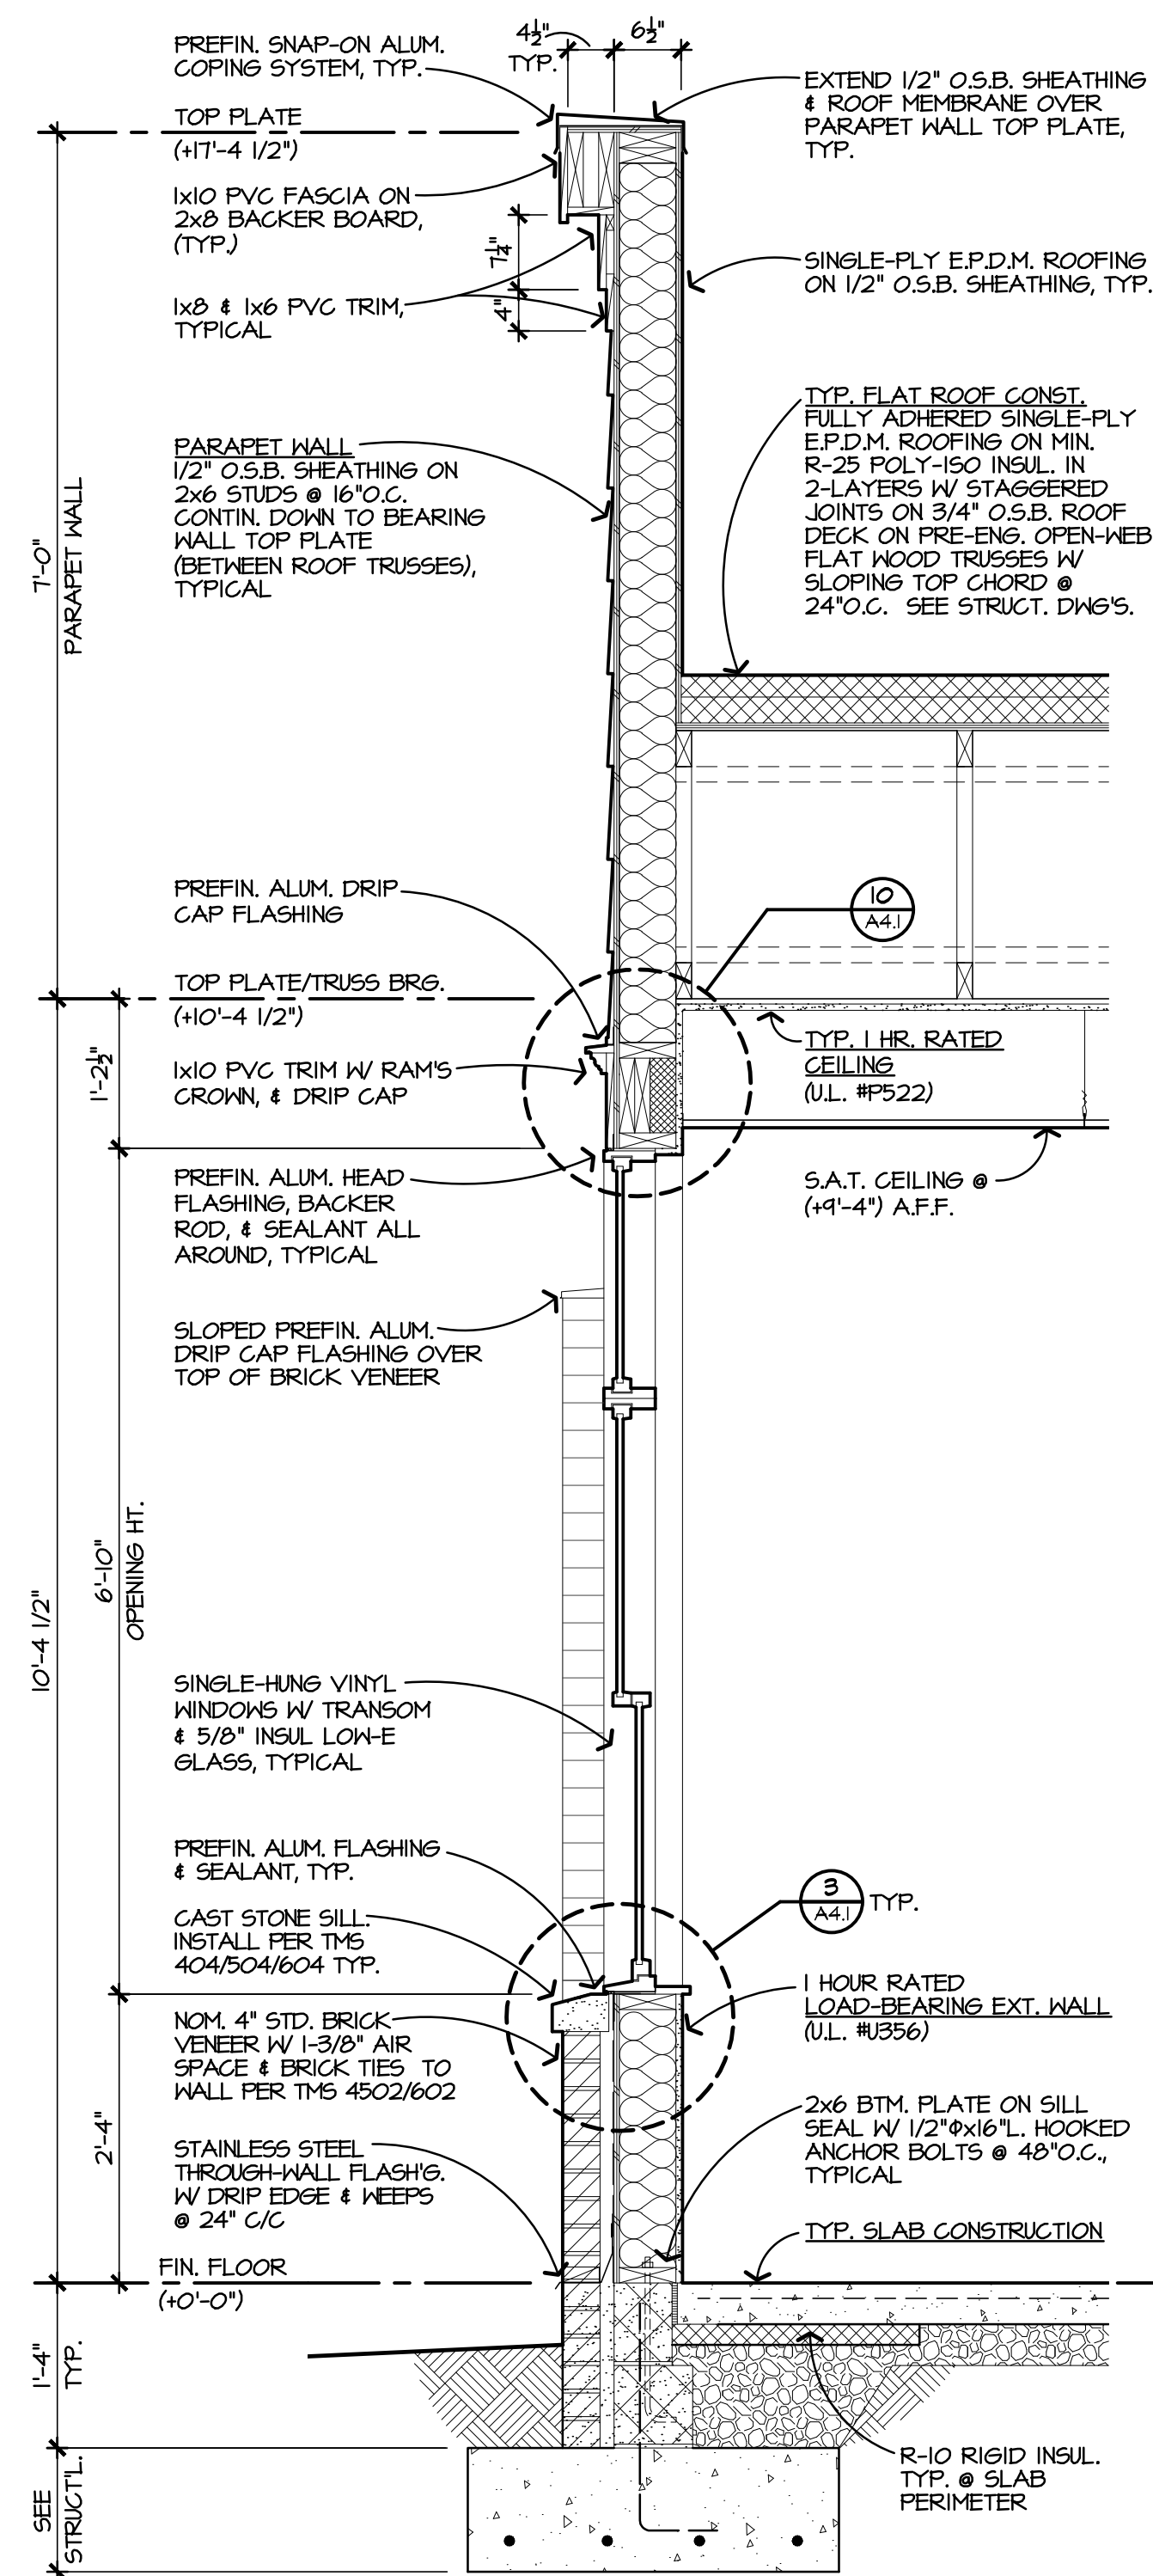

WALL SECTIONS

SCALE: 3/4" = 1'-0"



DATE:
PERMIT SUBMISSION:
06/19/26




BENNETT'S CREEK
HEALTH & REHABILITATION CENTER
193/1975 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA



DRAWING NAME
WALL
SECTIONS

DSCA PROJECT NO.
24.061

A3.7

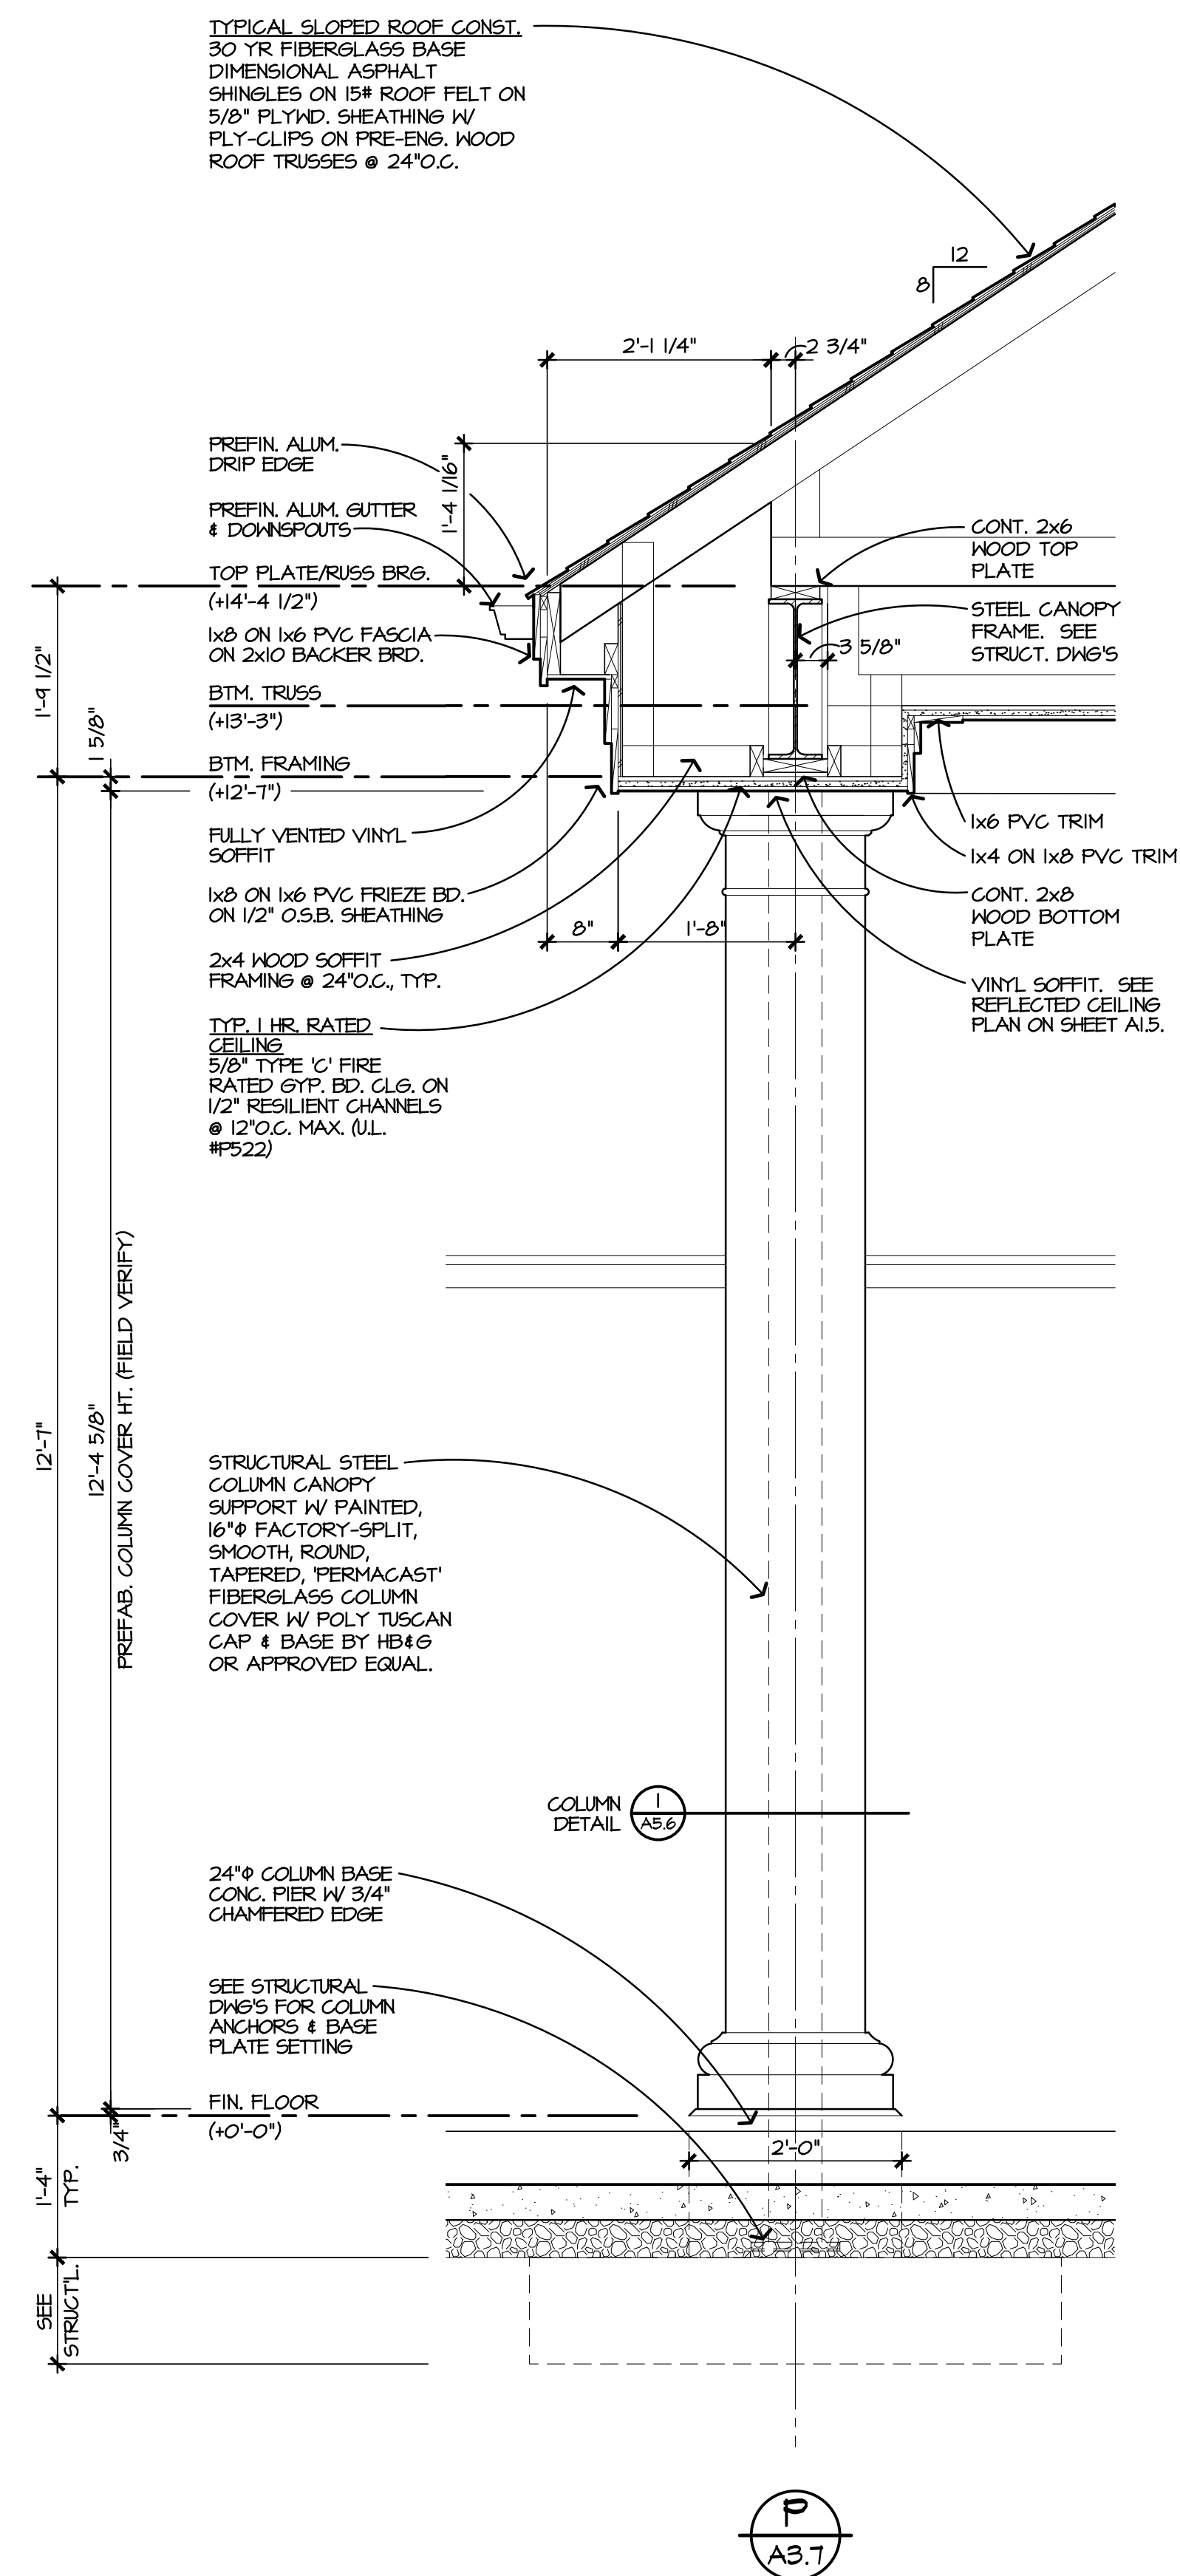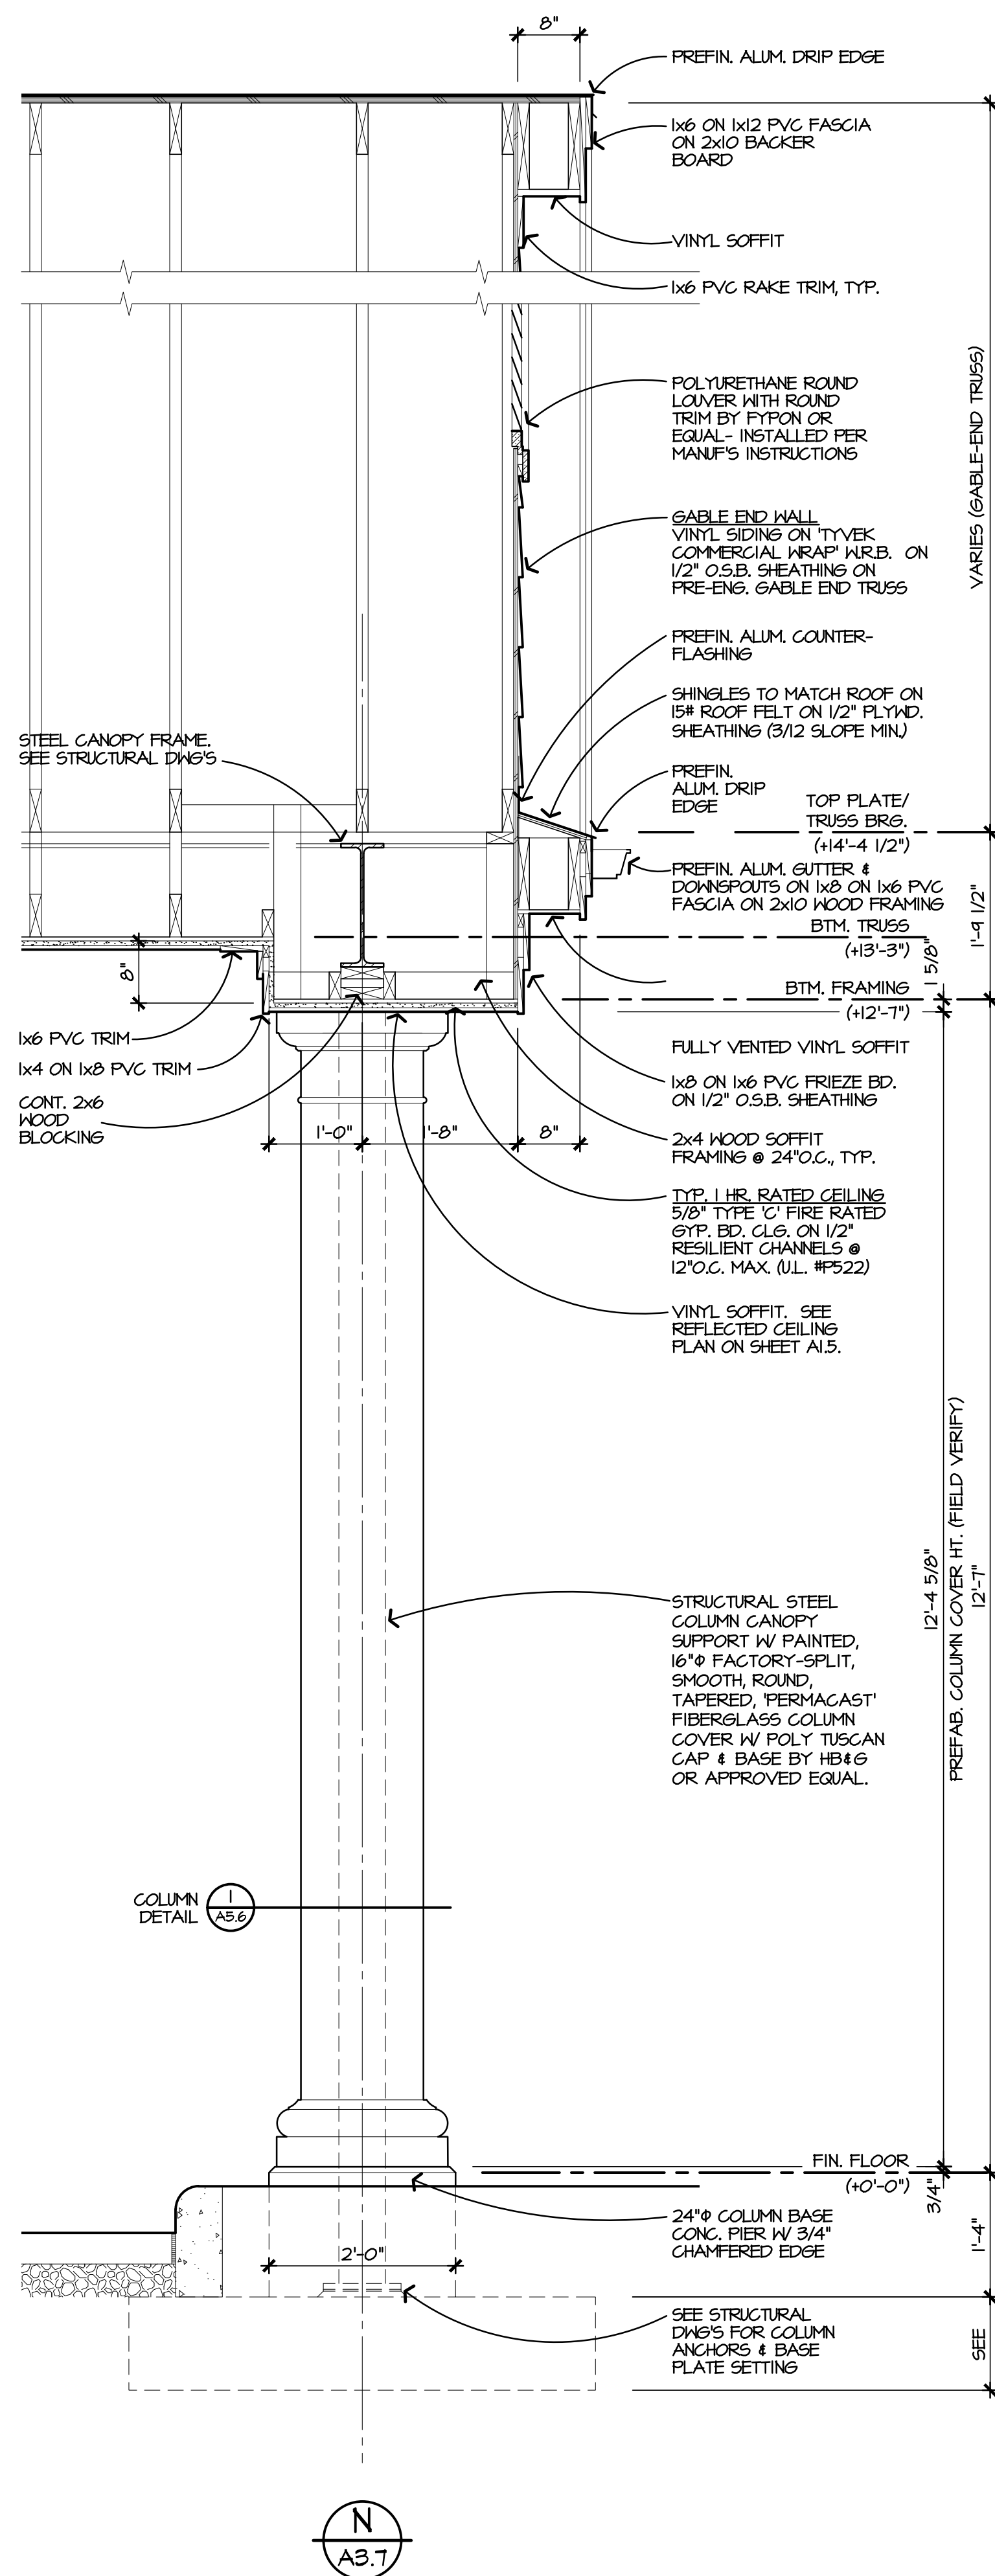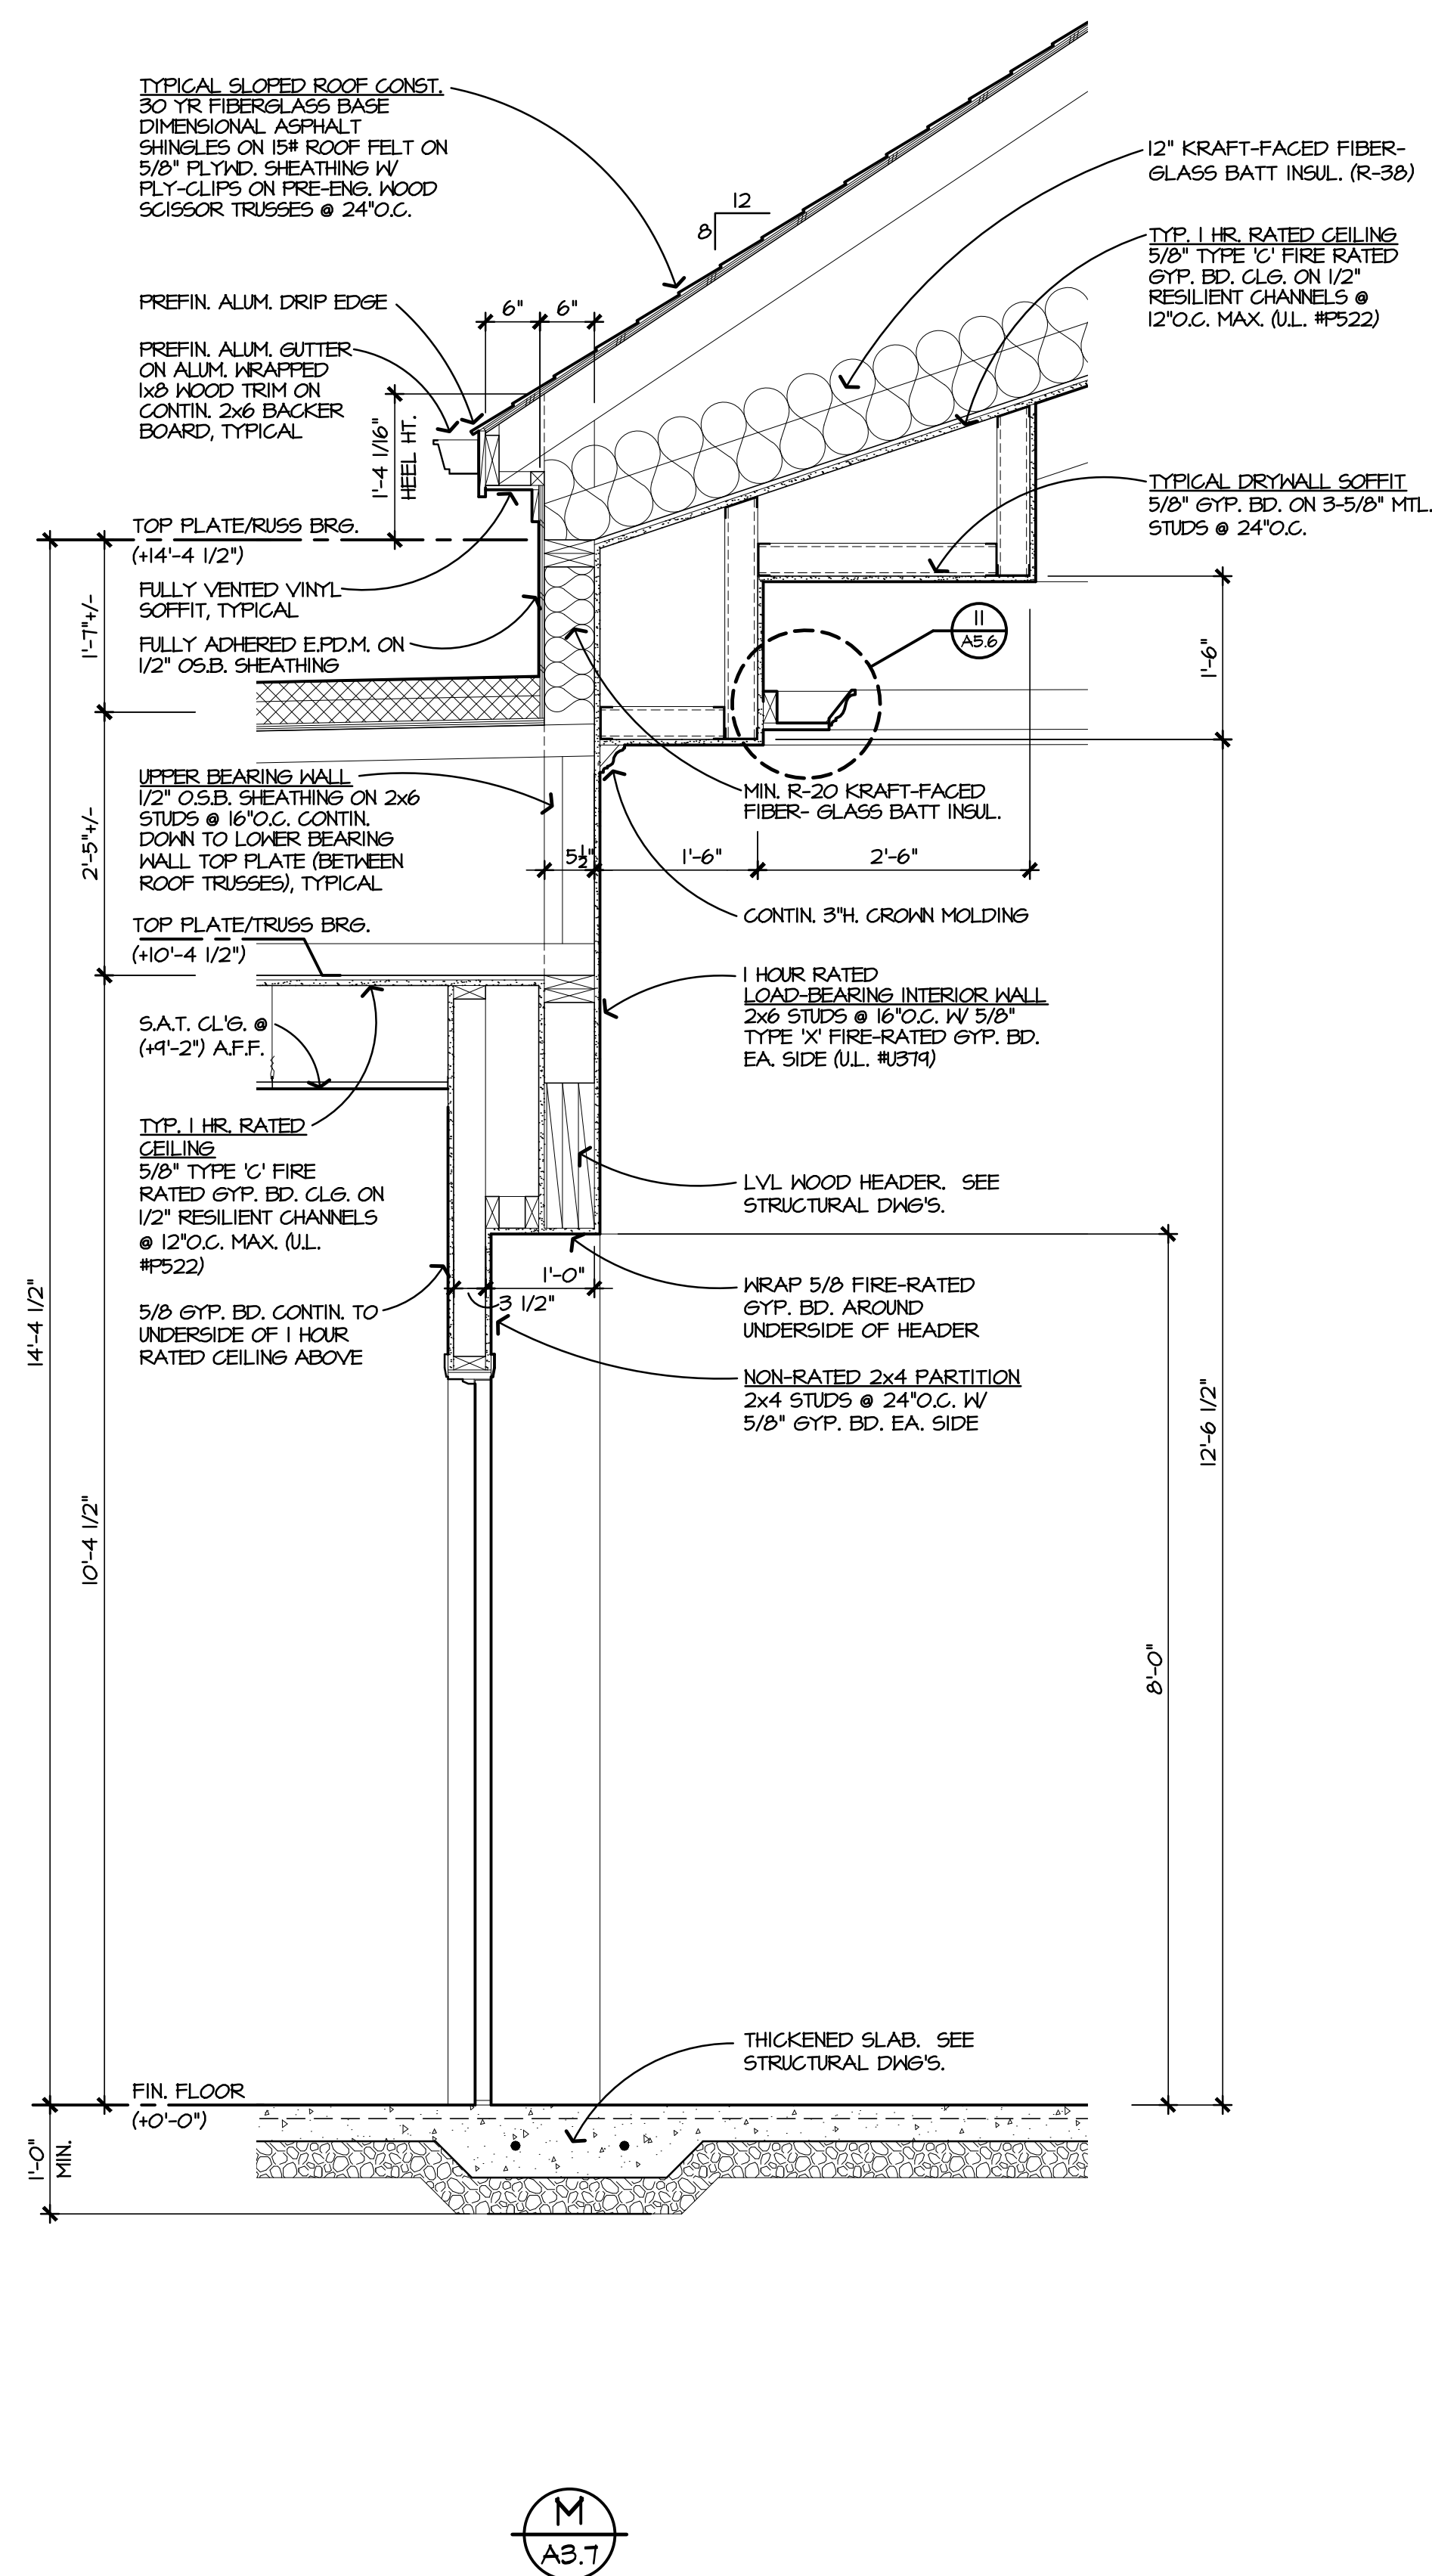


WALL SECTIONS



SCALE: 3/4" = 1'-0"




DATE:
PERMIT SUBMISSION:
06.19.26



SCALE: 3/4" = 1'-0"




DENNETTS CREEK
HEALTH & REHABILITATION CENTER
1931/1975 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA

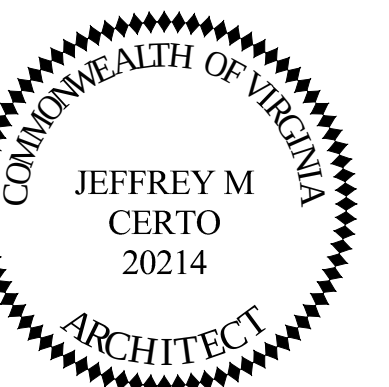

DRAWING NAME
WALL
SECTIONS

SCA PROJECT NO.
24.061

A3.8

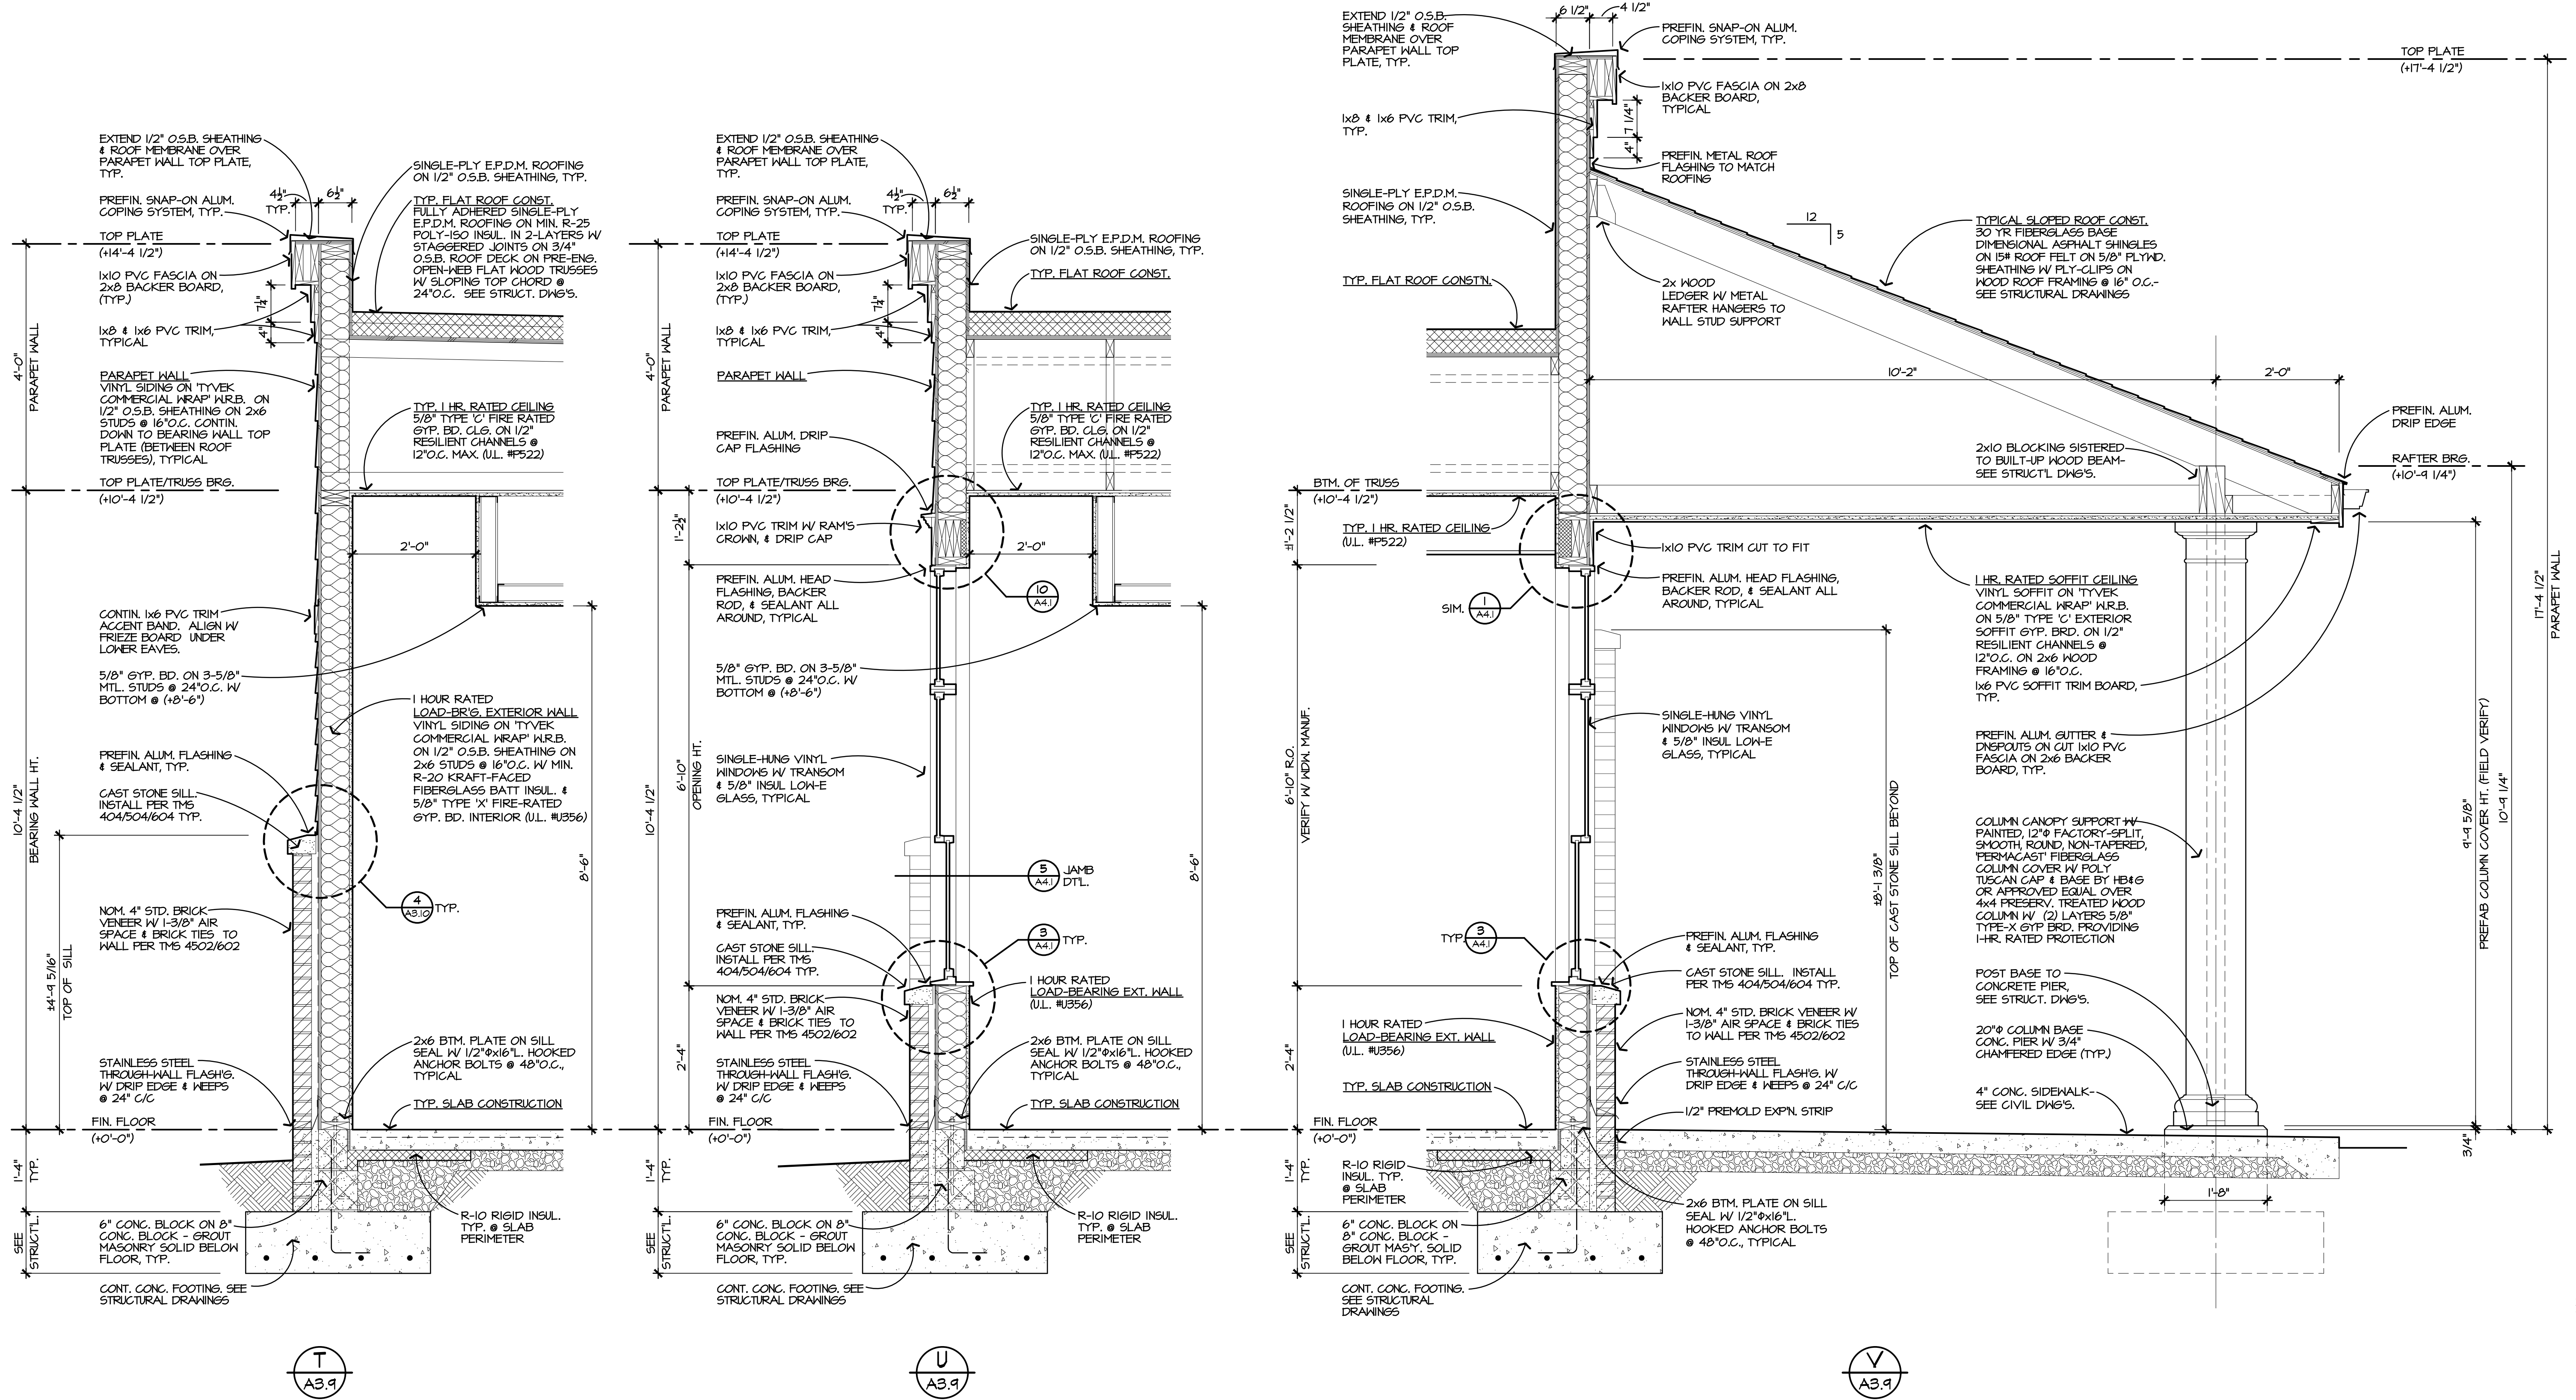

WALL SECTIONS

SCALE: 3/4" = 1'-0"


BENNETT'S CREEK
HEALTH & REHABILITATION CENTER
193/1975 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA




DRAWING NAME
WALL
SECTIONS

DSCA PROJECT NO.
24.061


A3.9

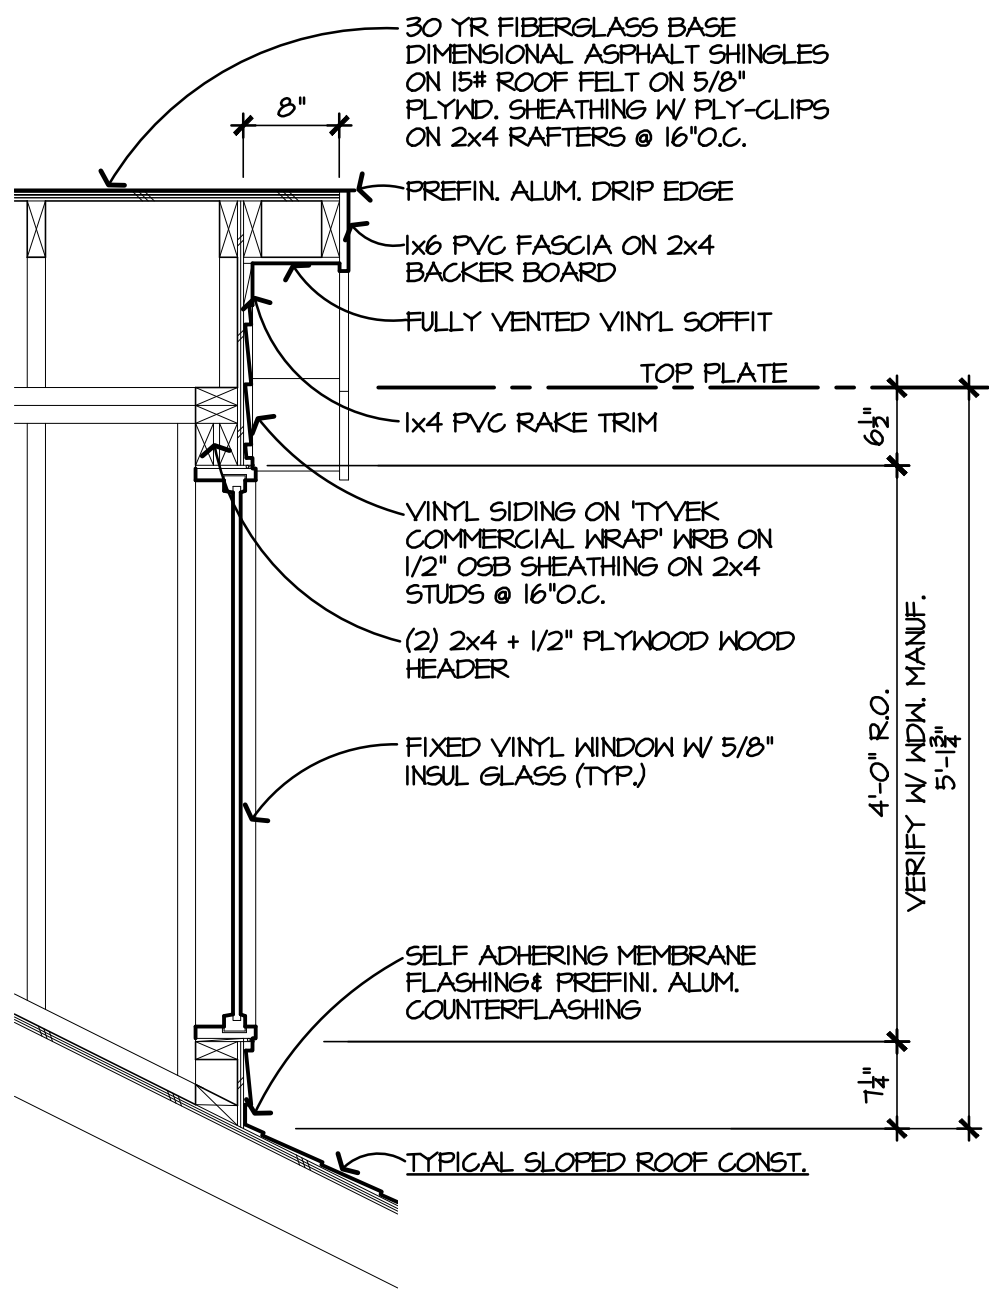


1 DORMER SECTION
A3.10 SCALE: 3/4" = 1'-0"

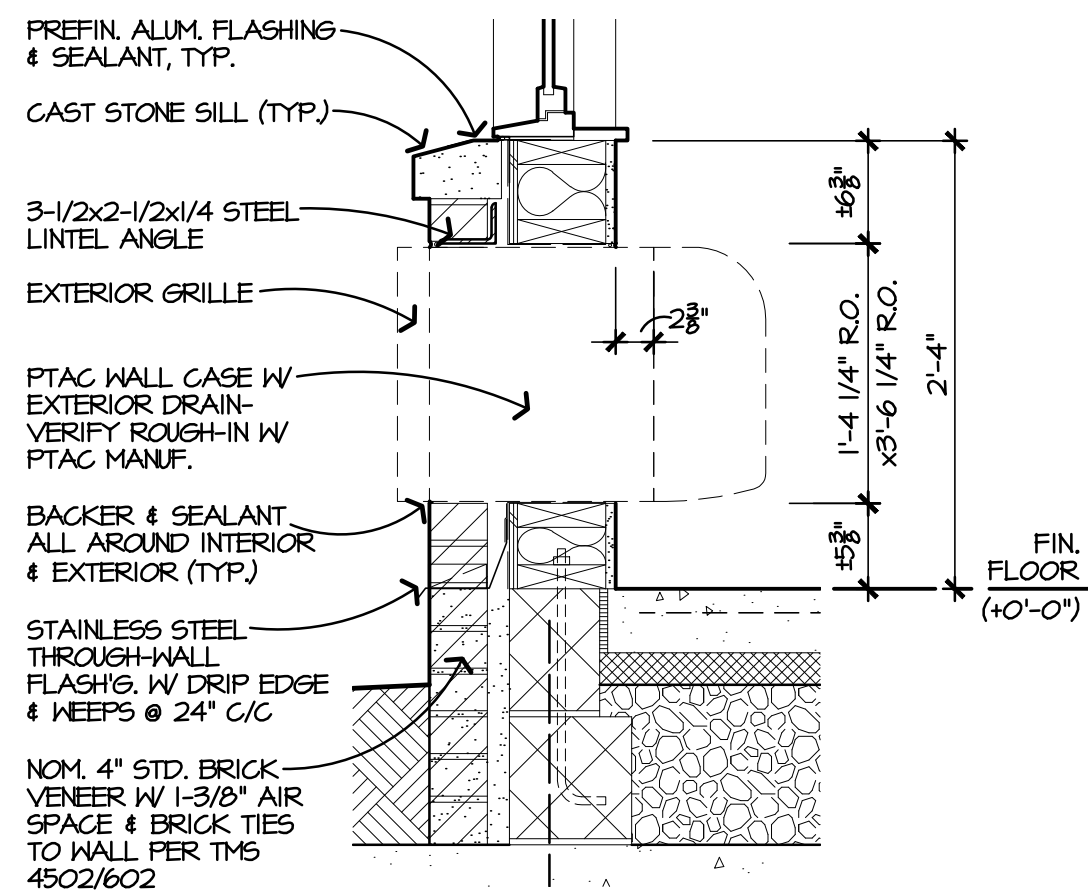


2 PTAC UNIT DETAIL
A3.10 SCALE: 1" = 1'-0"

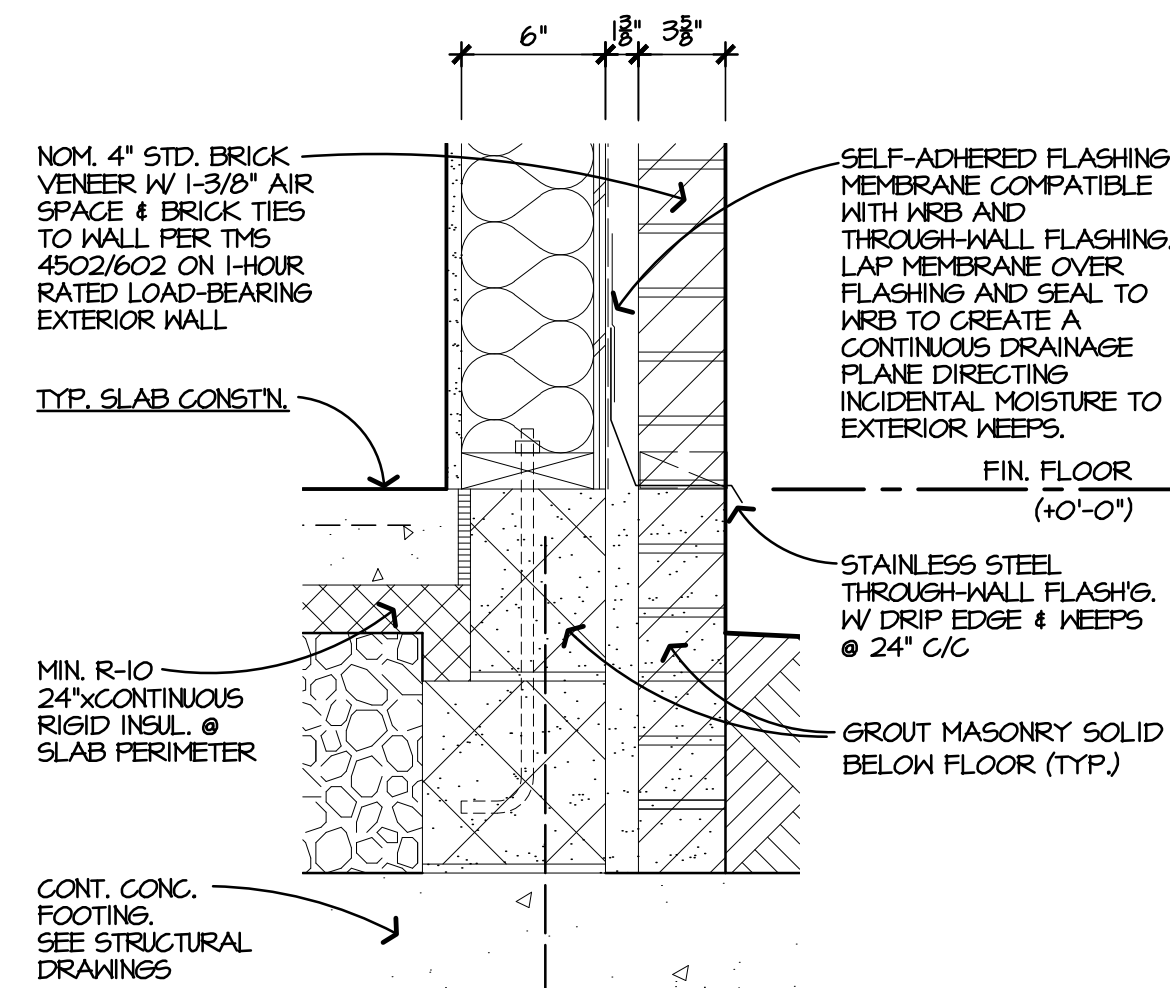


3 WALL DETAIL
A3.10 SCALE: 1-1/2" = 1'-0"

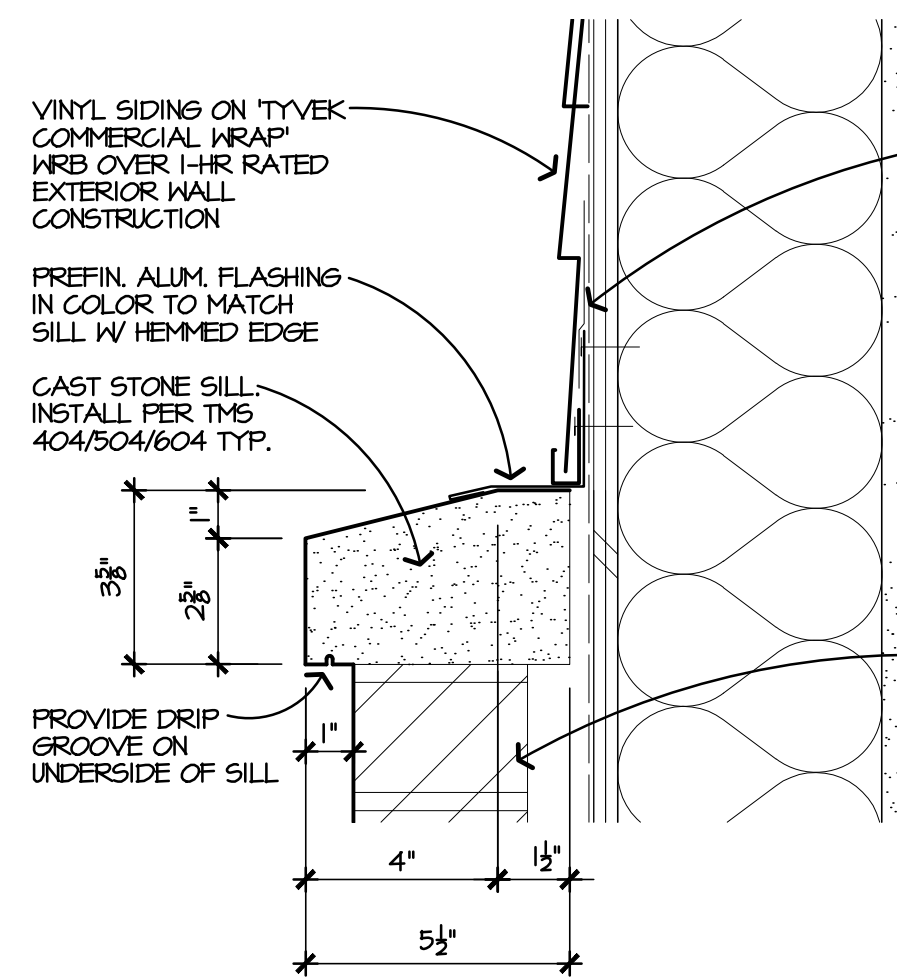


4 TYP. CAST STONE SILL DETAIL
A3.10 SCALE: 3/4" = 1'-0"

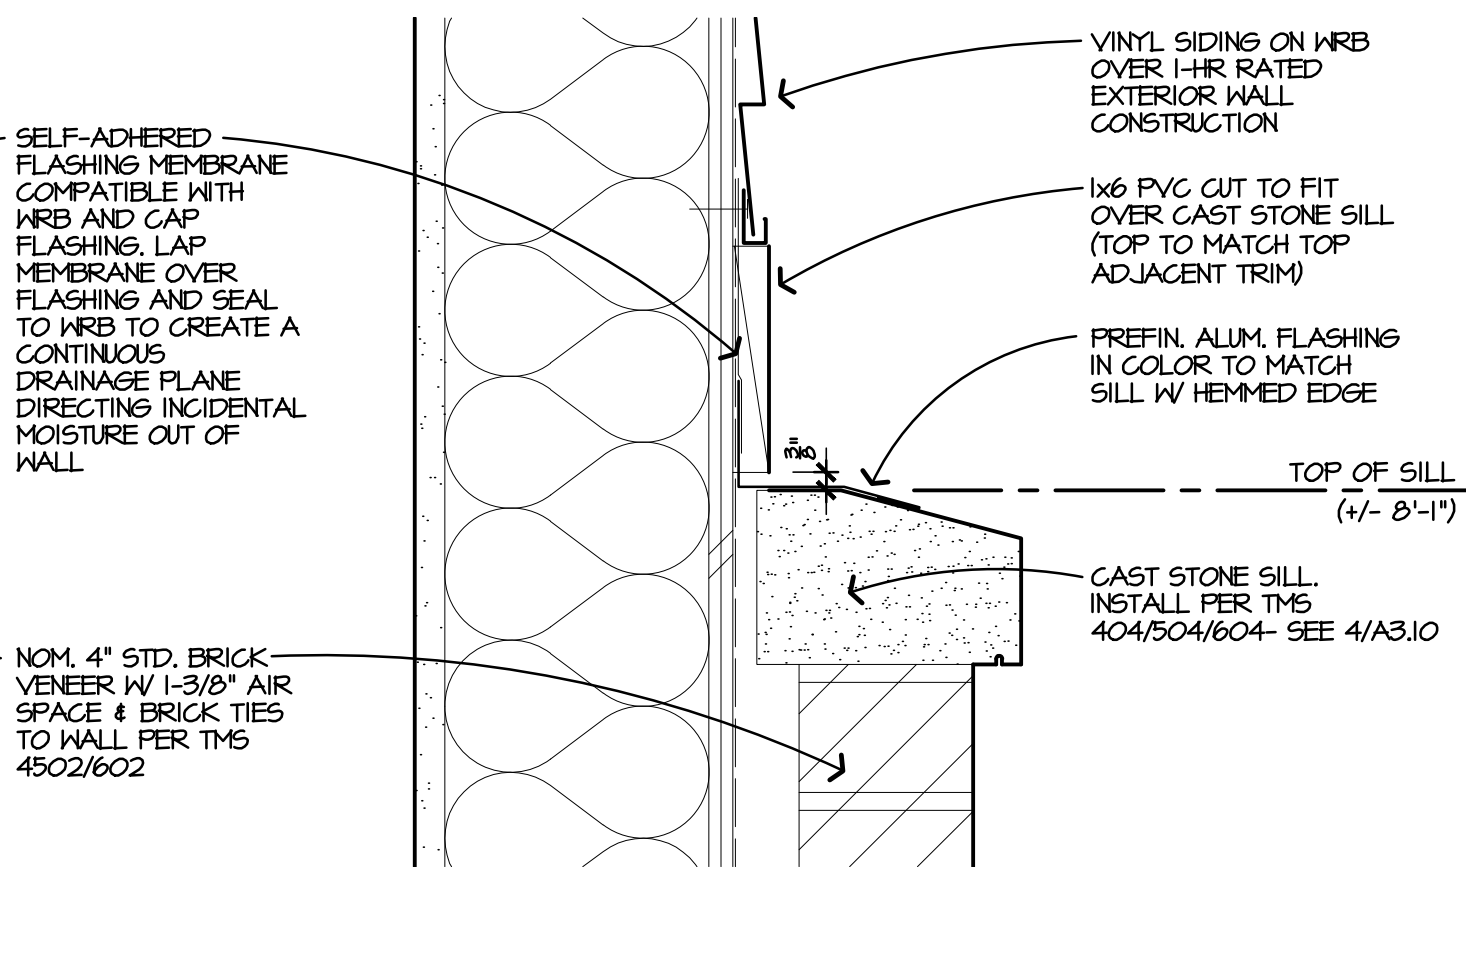

5 SILL/TRIM DETAIL
A3.10 SCALE: 3/4" = 1'-0"

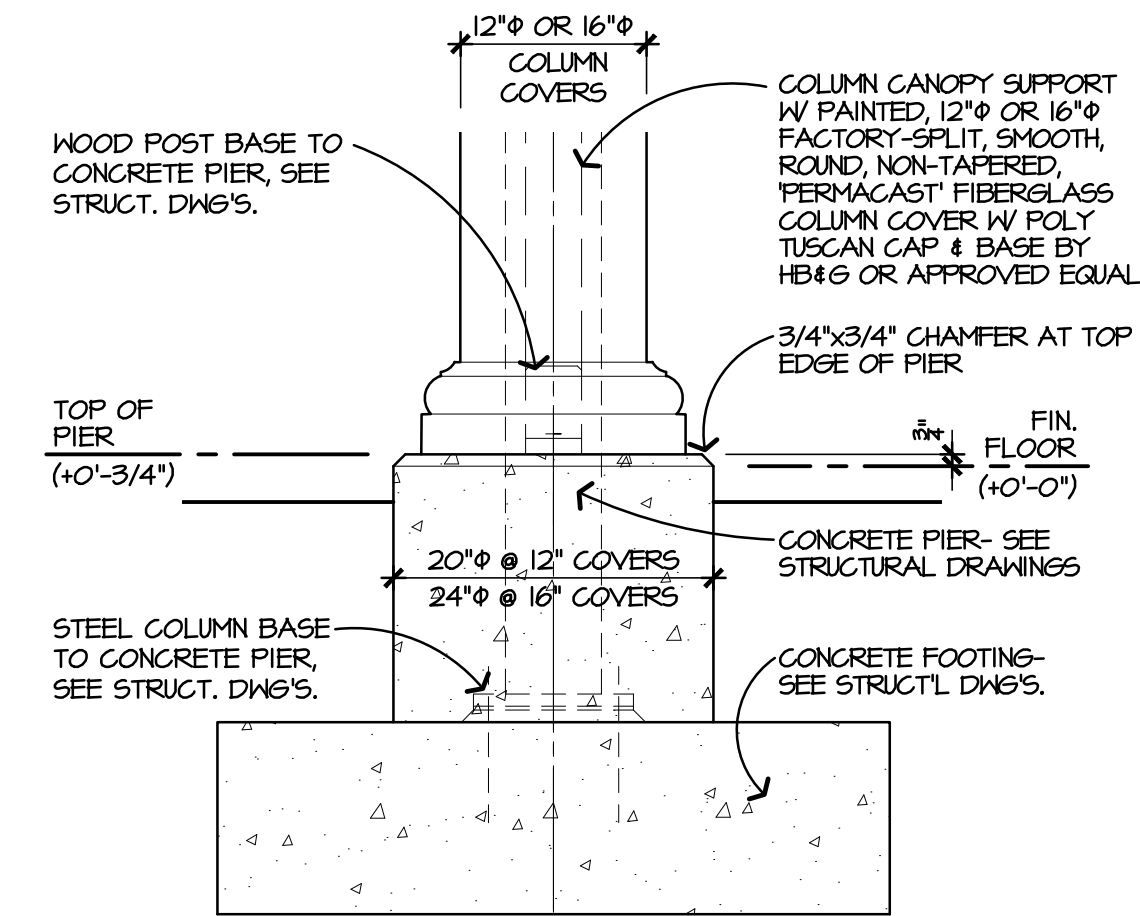


6 COLUMN BASE DETAIL
A3.10 SCALE: 1" = 1'-0"

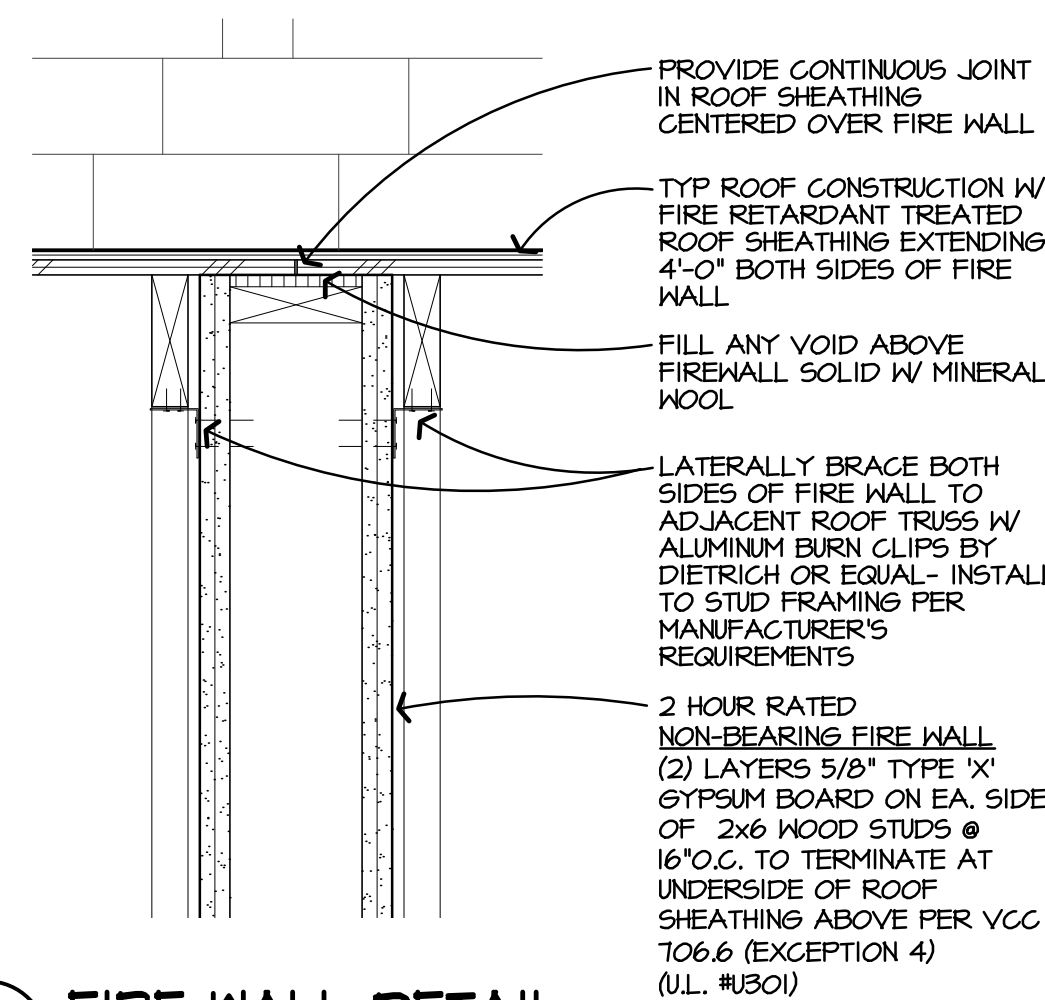

7 FIRE WALL DETAIL
A3.10 SCALE: 1" = 1'-0"

WALL DETAILS

SCALE: A5 SHOWN

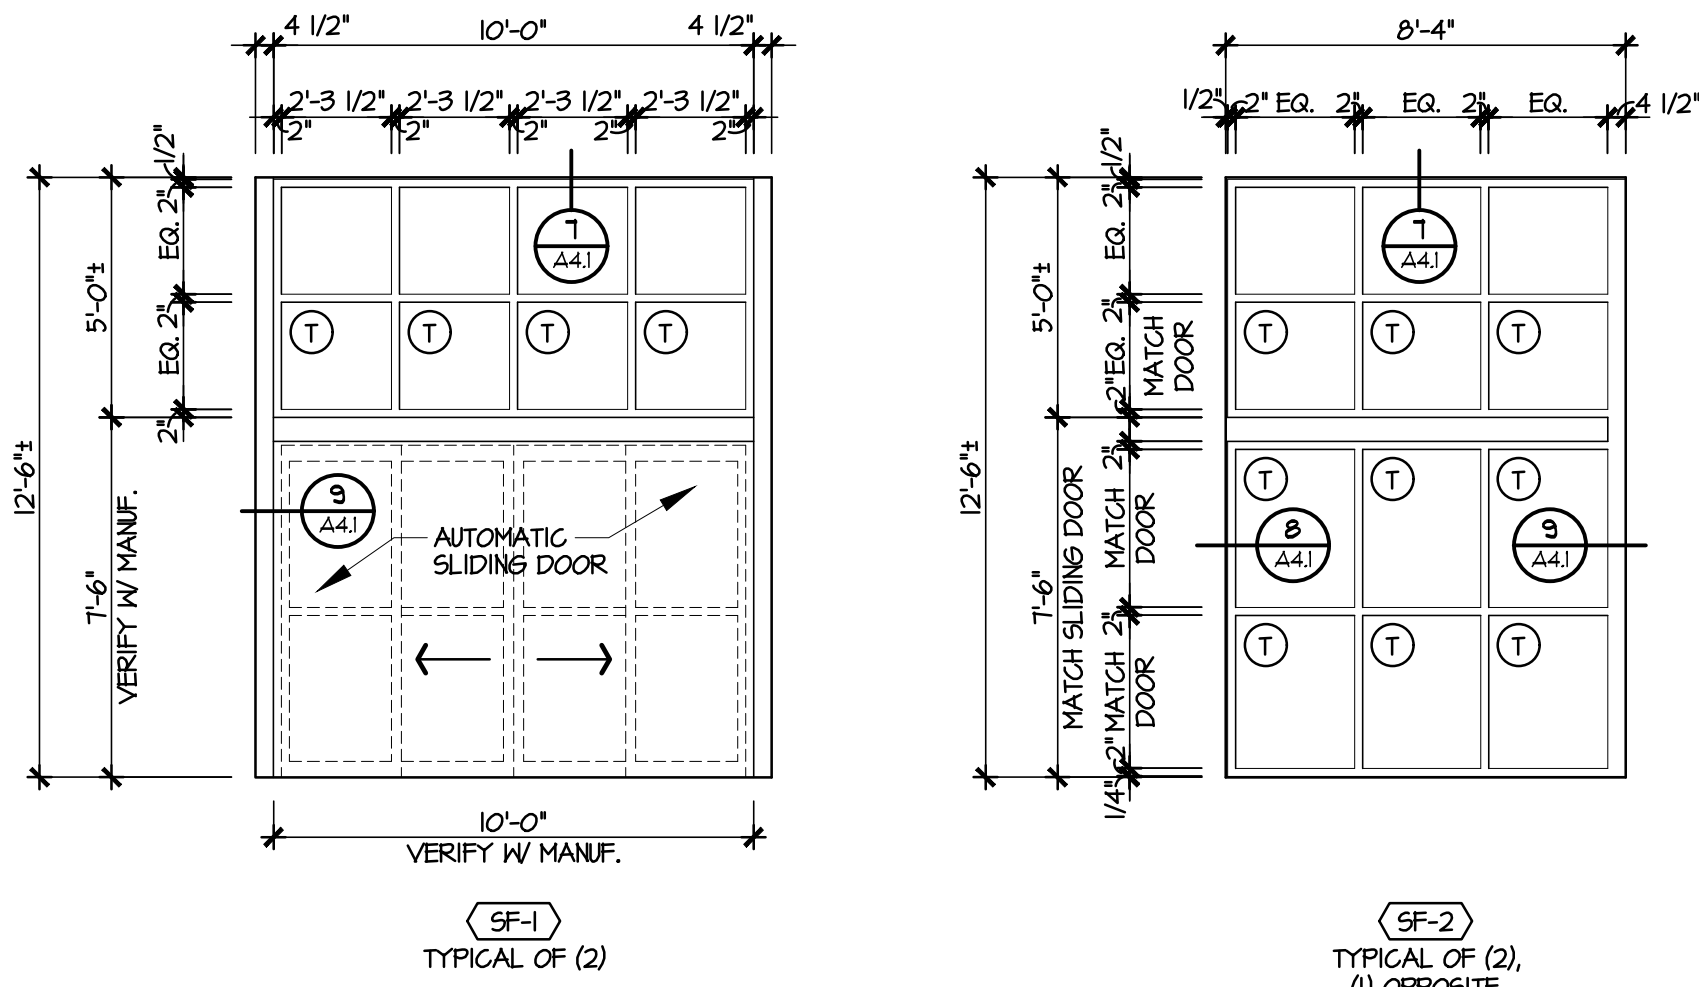

ALUMINUM STOREFRONT WINDOW ELEVATIONS


SCALE: 1/4" = 1'-0"

ALUMINUM STOREFRONT WINDOW SPECIFICATIONS

1. * (SF-X) * DENOTES EXTERIOR ALUMINUM STOREFRONT WINDOWS. EXTERIOR FRAMING TO BE CENTER GLAZED THERMALLY BROKEN ALUM. STOREFRONT WINDOW FRAMING (4-1/2" OVERALL SYSTEM DEPTH). KAWNEER TRIFAB V6 451T OR APPROVED EQUAL. FRAMING FINISH TO BE SELECTED.
2. INTERIOR FRAMING (VESTIBULE) TO BE CENTER GLAZED ALUMINUM STOREFRONT WINDOW FRAMING (4-1/2" OVERALL SYSTEM DEPTH). KAWNEER TRIFAB 451 OR APPROVED EQUAL. FRAMING FINISH TO BE SELECTED.
3. AUTOMATIC SLIDING DOORS TO MATCH STOREFRONT WINDOW FRAMING FINISH. BESAM MODEL #5L500 OVERHEAD CONCEALED FULL BREAKOUT NARROW STILE BI-PART SLIDING DOOR SYSTEM OR EQUAL W/ 1" INSUL. TEMPERED GLASS (BOTH SIDELITES & ACTIVE LEAVES).
4. TYPICAL EXTERIOR GLAZING SHALL BE NOMINAL 1" INSULATED LOW E GLASS CONSISTING OF (1) LAYER 1/4" CLEAR OUTBOARD, 1/2" AIR SPACE, & (1) LAYER 1/4" CLEAR INBOARD GLASS.
5. TYPICAL INTERIOR GLAZING SHALL BE MINIMUM 1/4" CLEAR TEMPERED SAFETY GLASS- VERIFY GLASS THICKNESS WITH MANUFACTURER FOR PROPOSED CONDITIONS.
6. * (T) * INDICATES TEMPERED GLASS
7. WINDOW MANUFACTURER SHALL PROVIDE THE ENGINEERING SERVICES OF A REGISTERED PROFESSIONAL ENGINEER FOR THE COMPLETE WINDOW SYSTEM INCLUDING SPECIAL CONDITIONS.
8. CONTRACTOR TO SUBMIT DETAILED SHOP DRAWINGS TO ARCHITECT FOR REVIEW & APPROVAL.


VINYL WINDOW SPECIFICATIONS

- SINGLE HUNG / ANNING / FIXED UNITS**
EXTRUDED VINYL FRAME W/ 3/4" LOW E INSULATED GLASS, NAILING FIN, STANDARD LATCH HARDWARE, & FIBERGLASS SCREENS. 1500 SERIES VINYL COLLECTION BY FLY GEM OR APPROVED EQUAL. COLOR: WHITE. VERIFY ALL ROUGH OPENINGS W/ MANUFACTURER. AT RESIDENT ROOM WINDOWS, PROVIDE WINDOW HARDWARE & OPERATION AS REQUIRED SUCH THAT MINIMUM EGRESS OPENING SIZE OF 20"x24" IS PROVIDED.
- PATIO DOORS**
ALUMINUM CLAD WOOD OUT-SHING PATIO DOOR W/ MATCHING FIXED PANEL & TRANSOMS, PREFIN. PAINTED WOOD INTERIOR, 3/4" TEMPERED LOW E INSULATED GLASS, 1/2" MAX. ADA COMPLIANT SILL, & STD. HARDWARE BY FLY GEM OR APPROVED EQUAL. COLOR: WHITE. VERIFY ROUGH OPENING W/ MANUFACTURER.

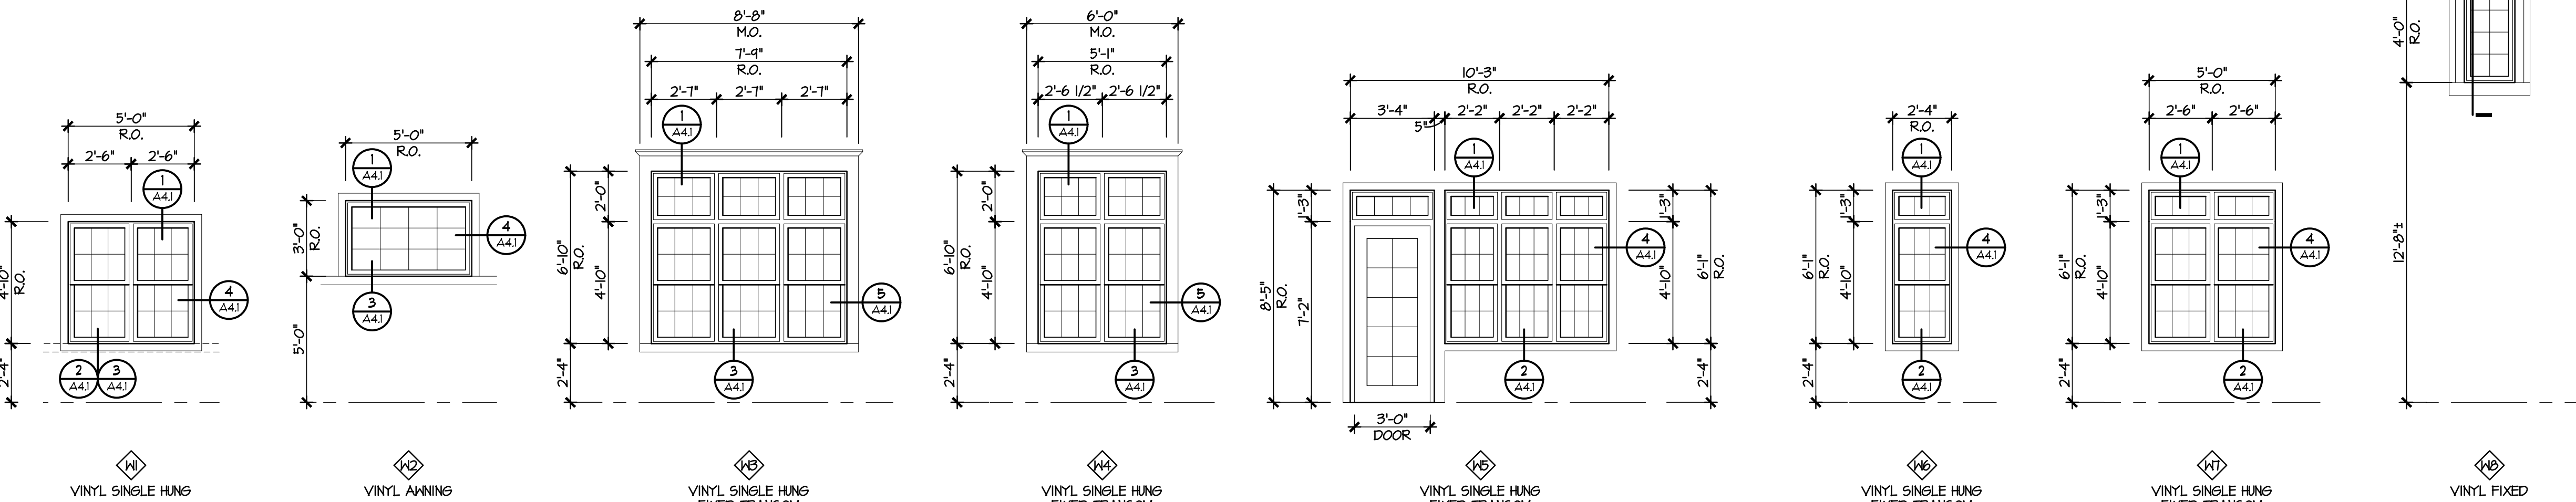


EXTERIOR VINYL WINDOW ELEVATIONS

SCALE: 1/4" = 1'-0"

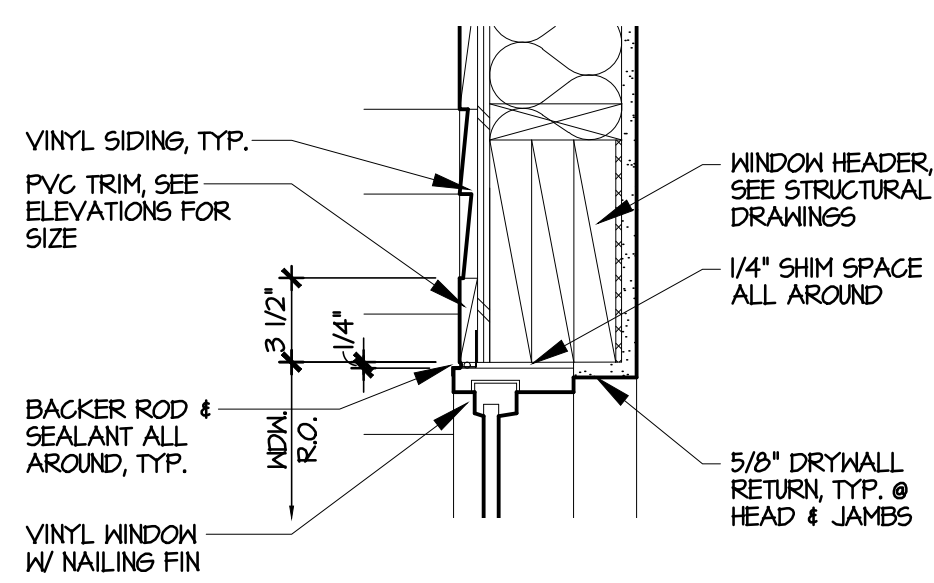


1 WINDOW HEAD

A4.1 SCALE: 1-1/2" = 1'-0"

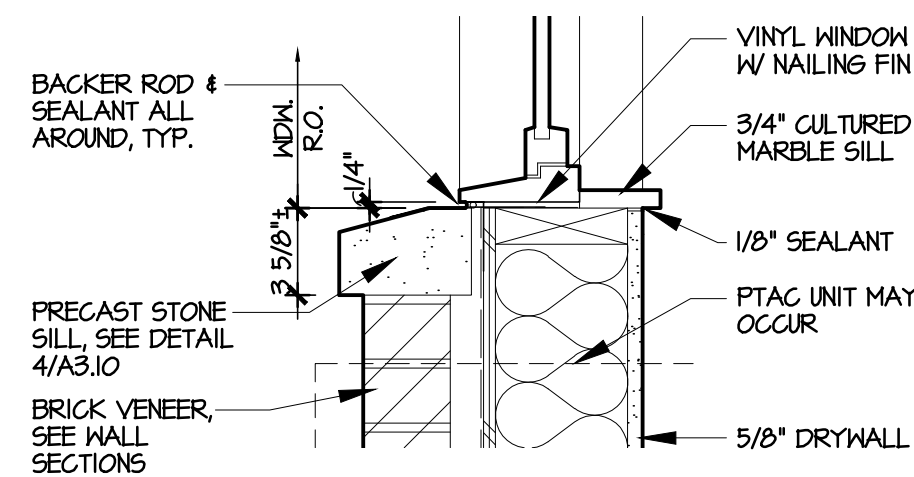


3 WINDOW SILL

A4.1 SCALE: 1-1/2" = 1'-0"

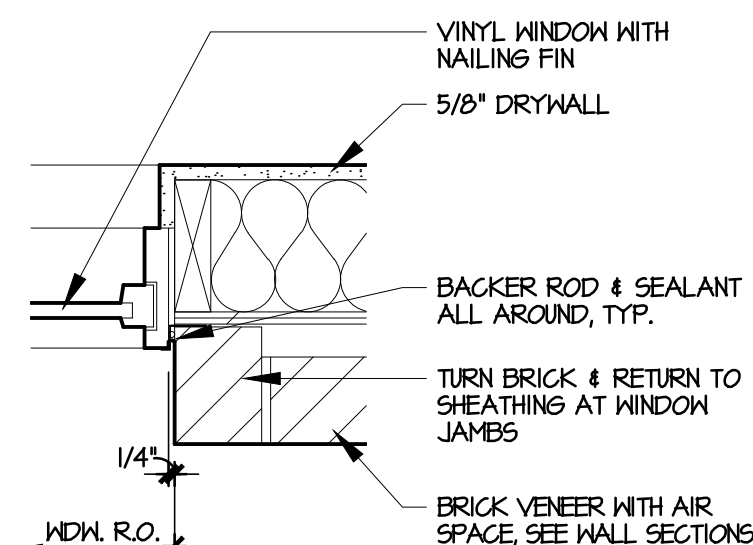


5 WINDOW JAMB

A4.1 SCALE: 1-1/2" = 1'-0"

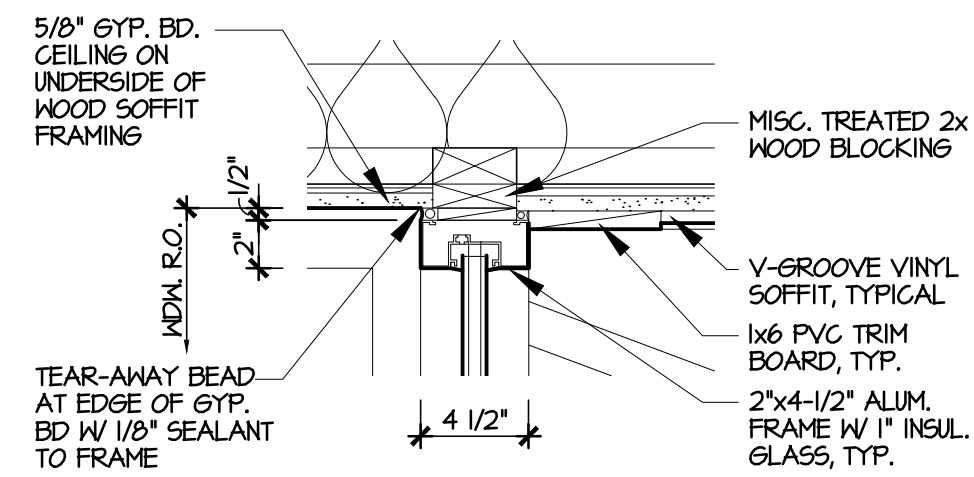


7 VESTIBULE HEAD

A4.1 SCALE: 1-1/2" = 1'-0"

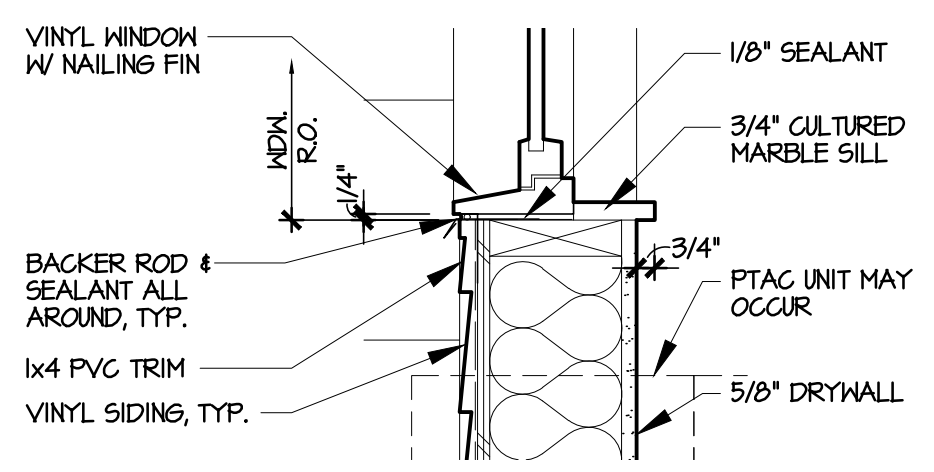


2 WINDOW SILL

A4.1 SCALE: 1-1/2" = 1'-0"

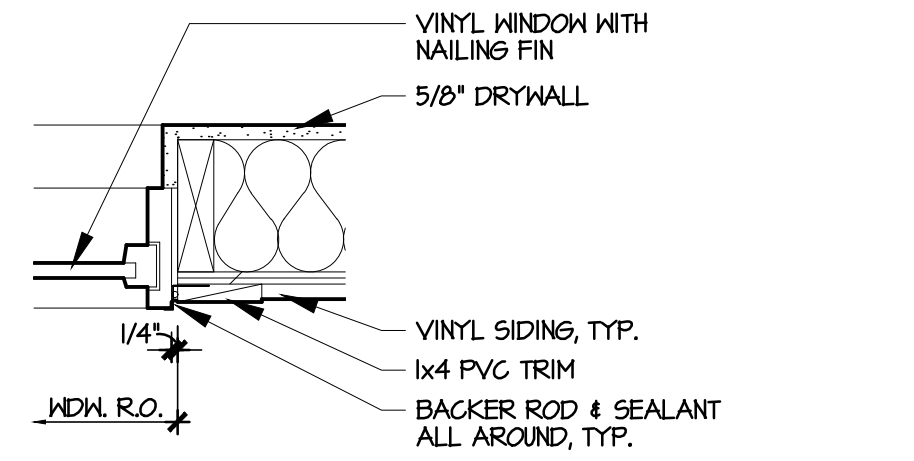


4 WINDOW JAMB

A4.1 SCALE: 1-1/2" = 1'-0"

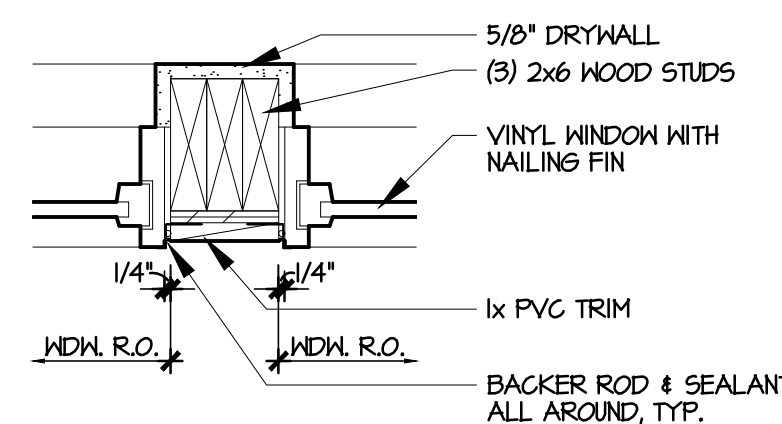


6 WINDOW JAMB

A4.1 SCALE: 1-1/2" = 1'-0"

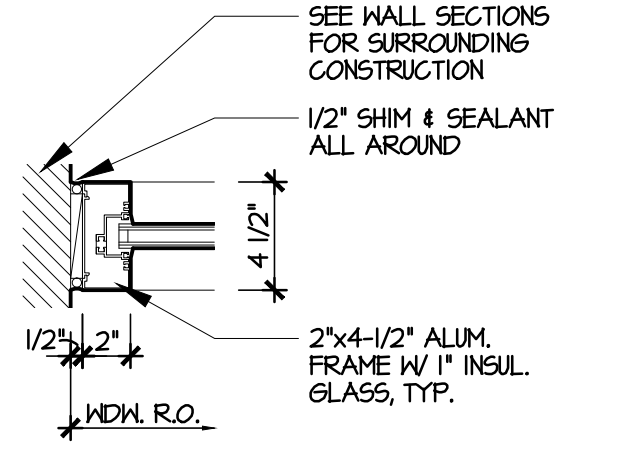


8 VESTIBULE JAMB

A4.1 SCALE: 1-1/2" = 1'-0"

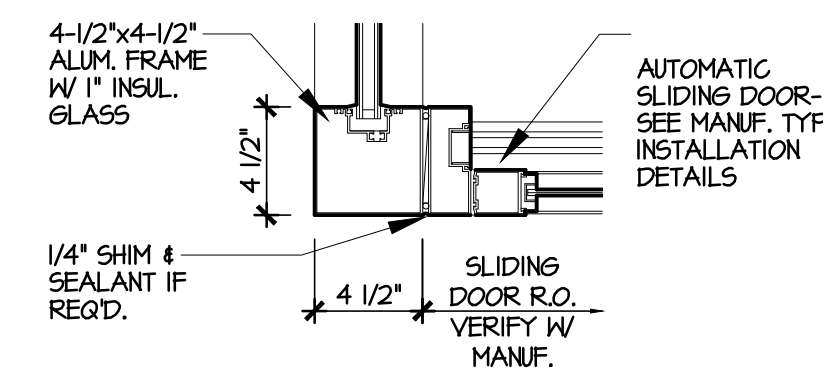


9 VESTIBULE CORNER

A4.1 SCALE: 1-1/2" = 1'-0"

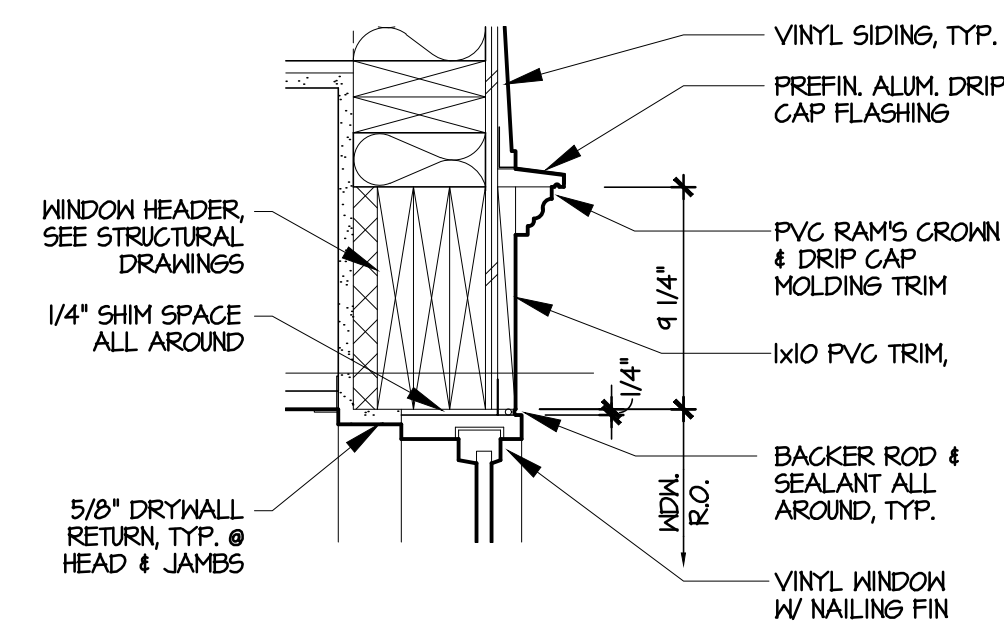


10 WINDOW HEAD


A4.1 SCALE: 1-1/2" = 1'-0"

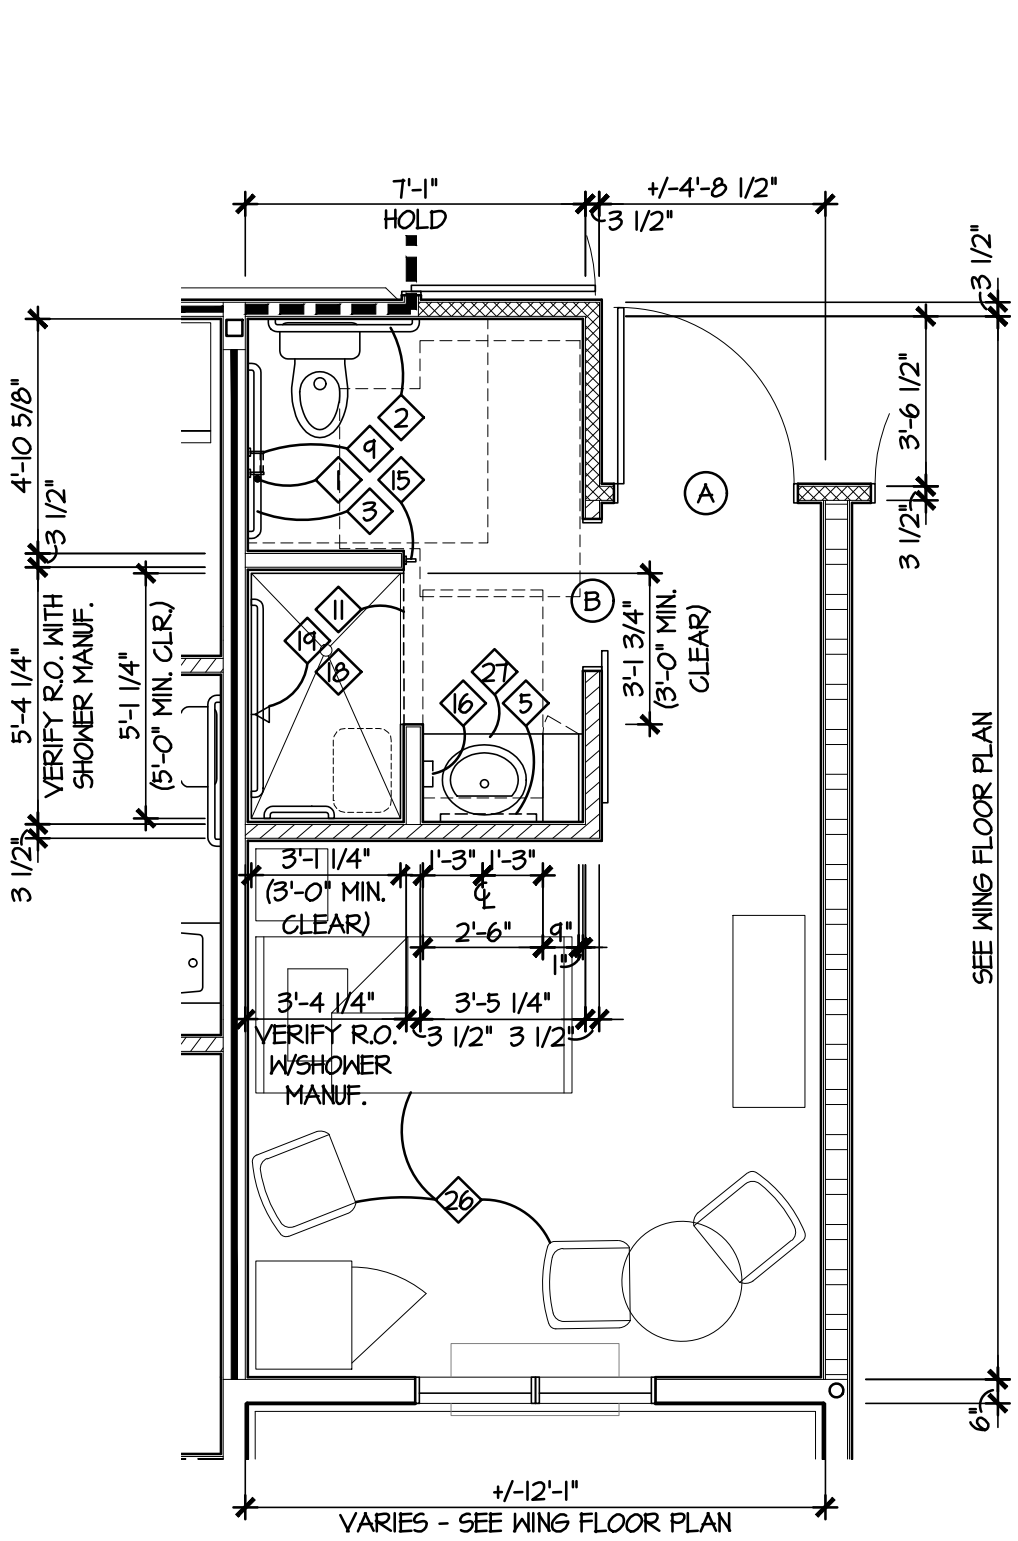


A PRIVATE ROOMS 'A1' & 'A2'
SCALE: 1/4"=1'-0"

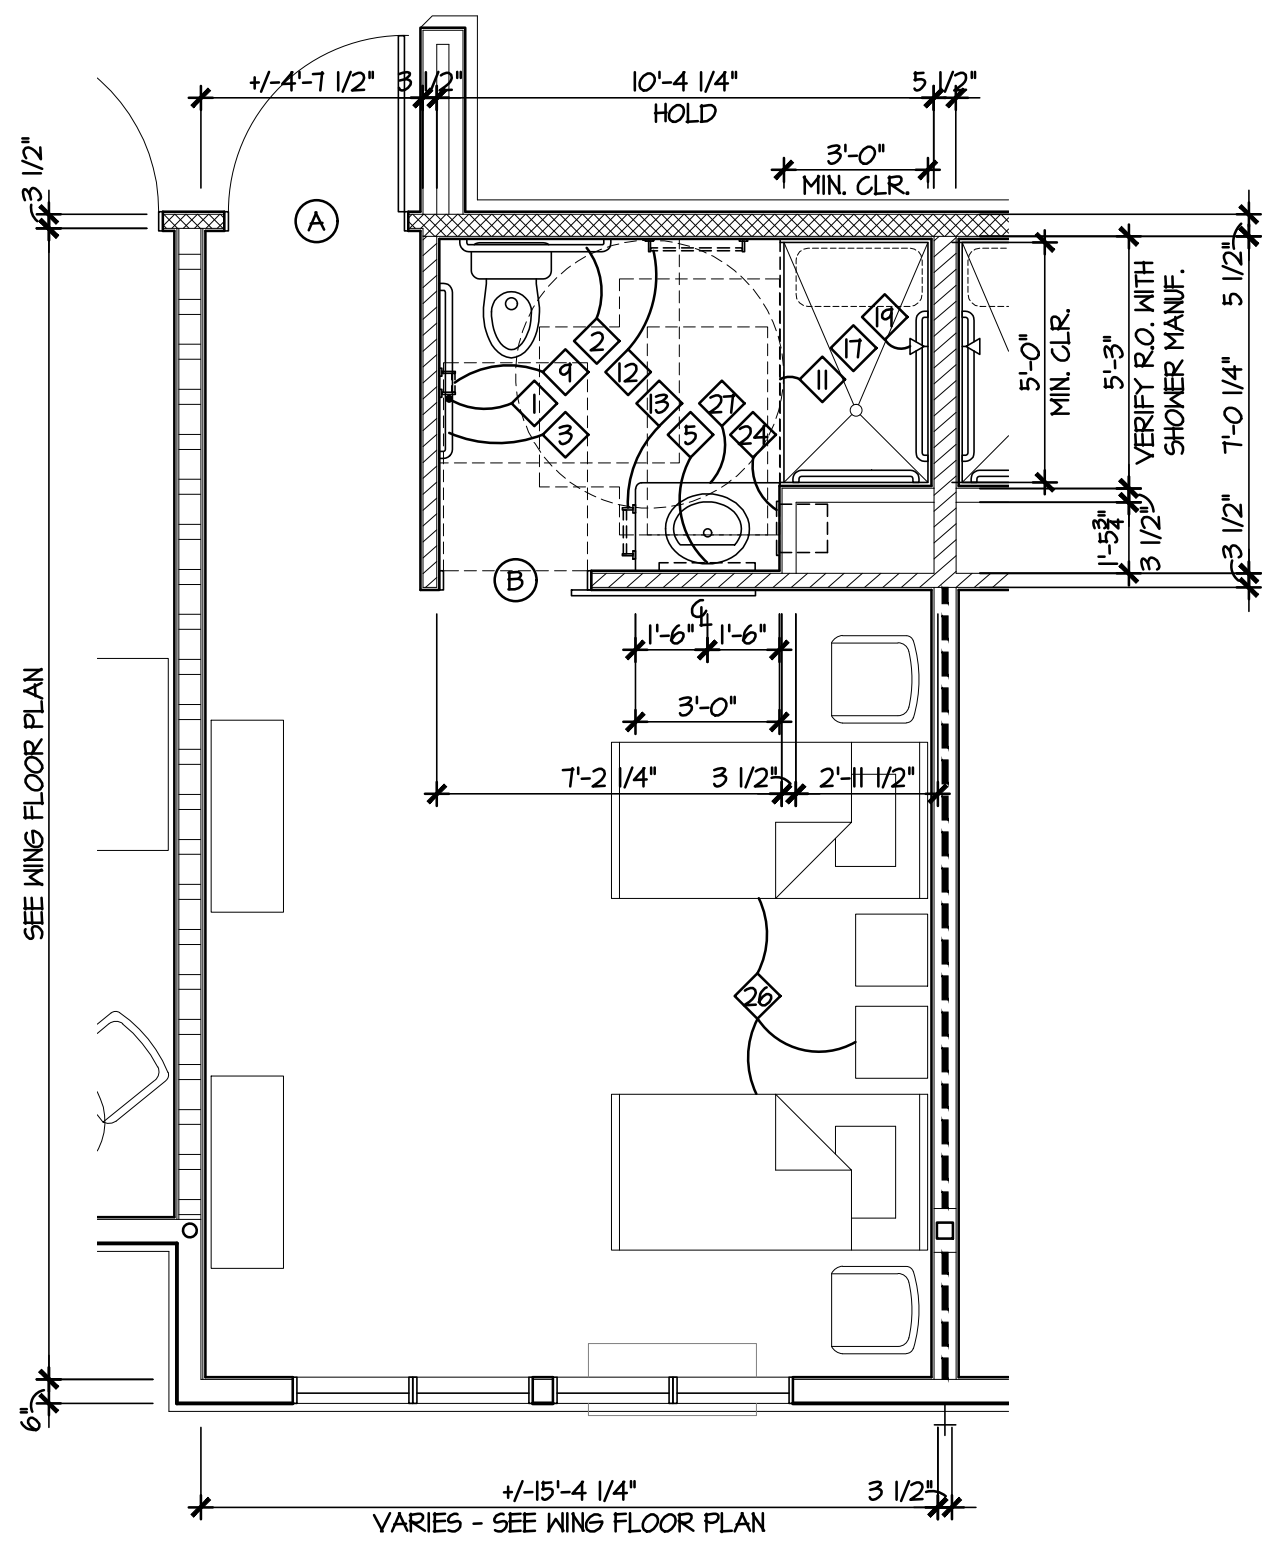


B SEMI-PRIVATE ROOMS 'B1' & 'B2'
SCALE: 1/4"=1'-0"

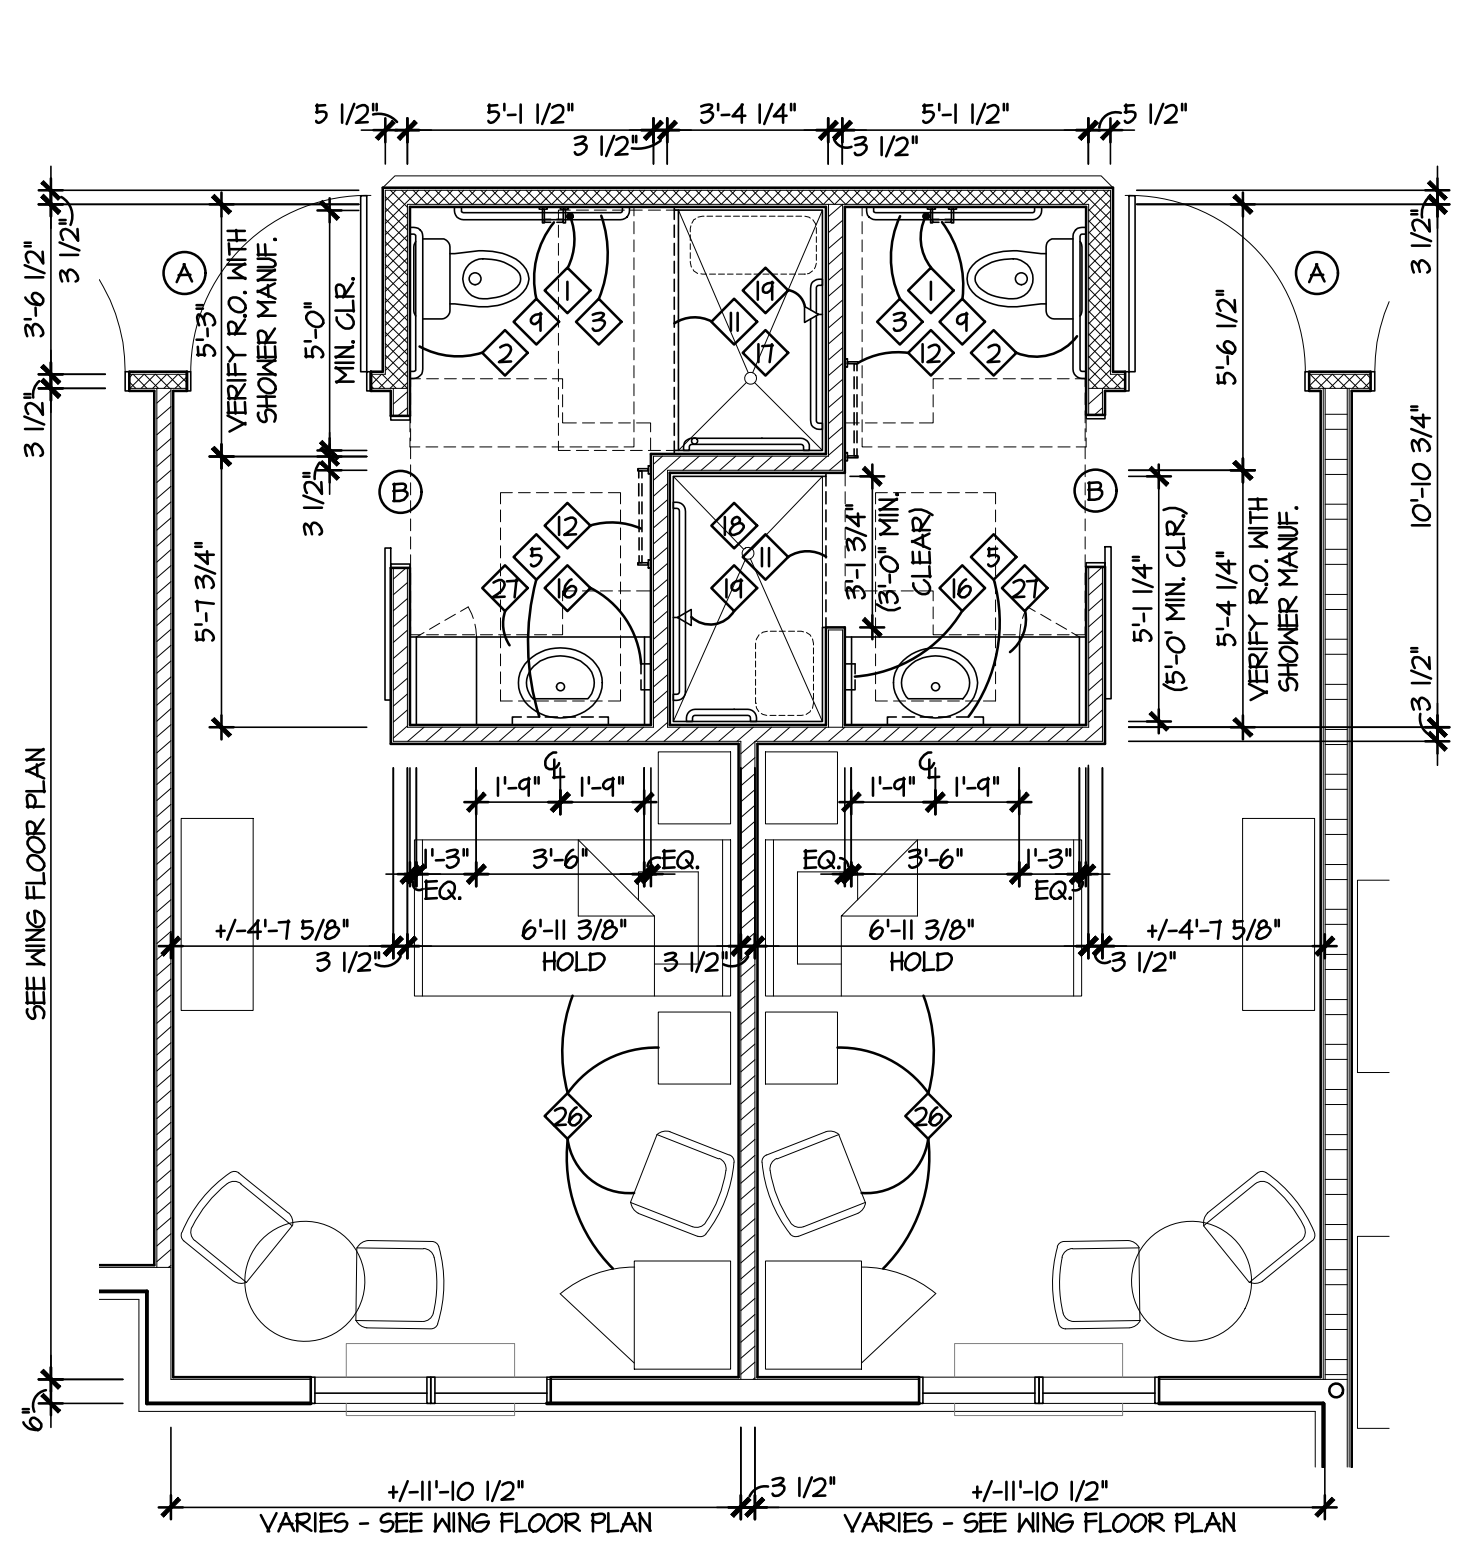


C PRIVATE ROOMS 'C1' & 'C2'
SCALE: 1/4"=1'-0"

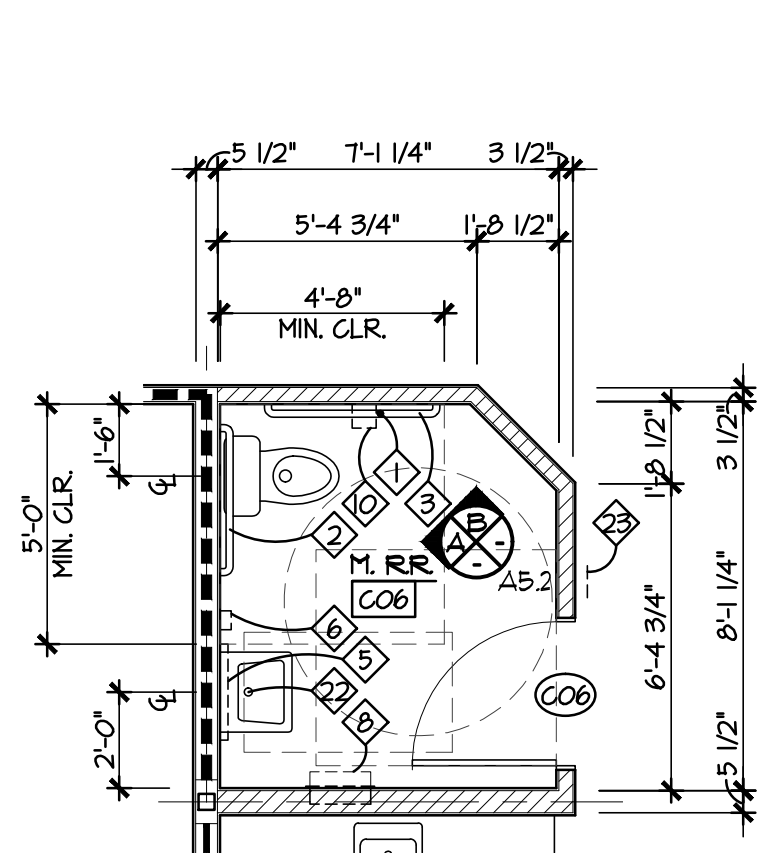


D WOMEN'S R.R.
SCALE: 1/4"=1'-0"

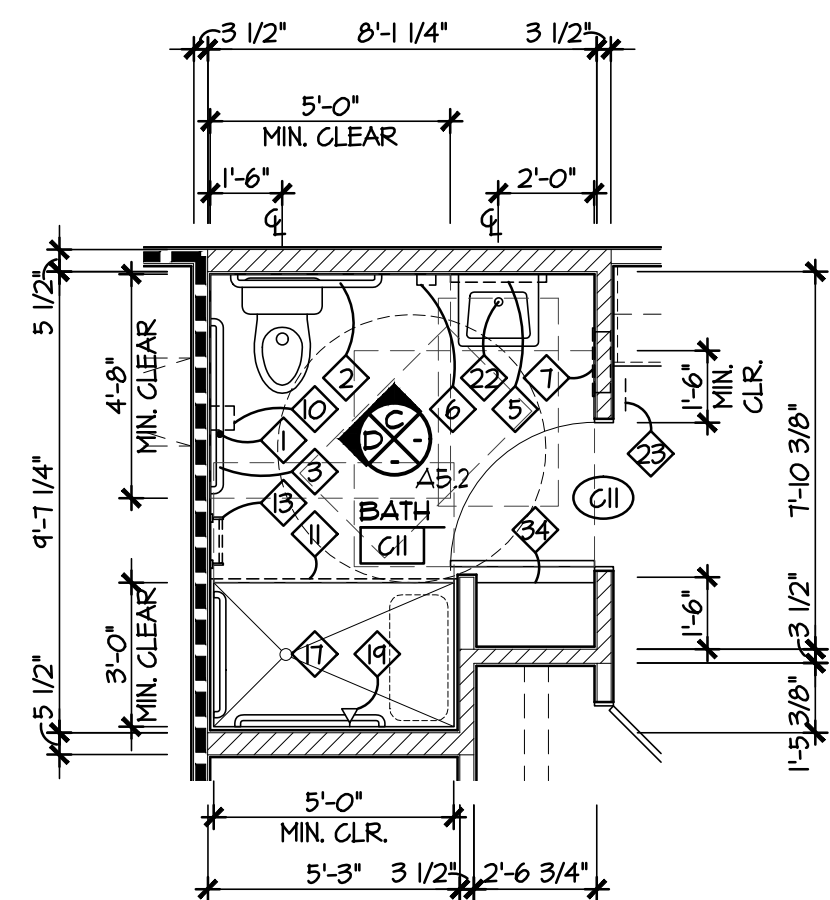


E RESTROOM #101
SCALE: 1/4"=1'-0"

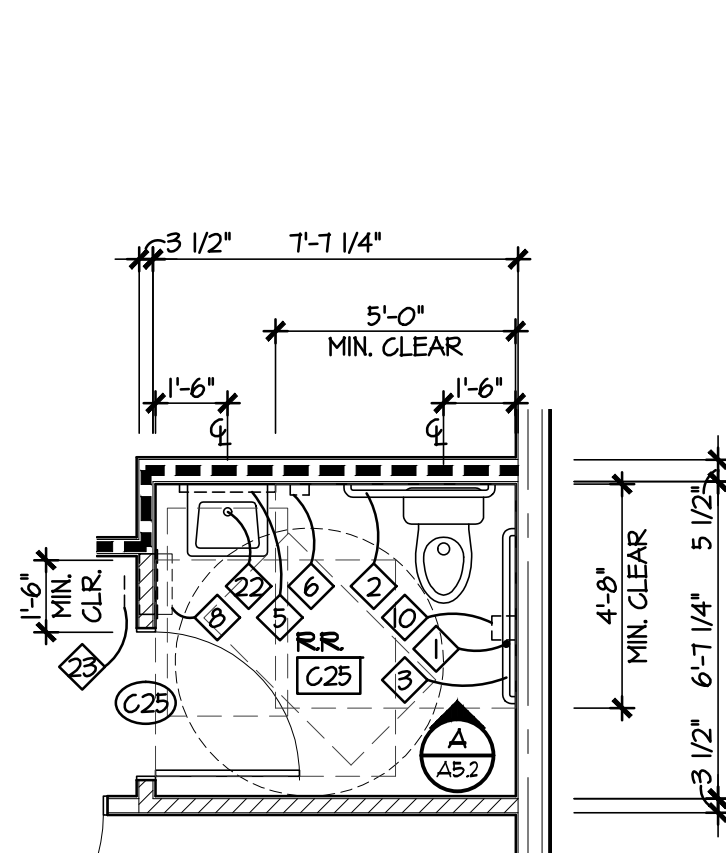


F RESTROOM #102
SCALE: 1/4"=1'-0"

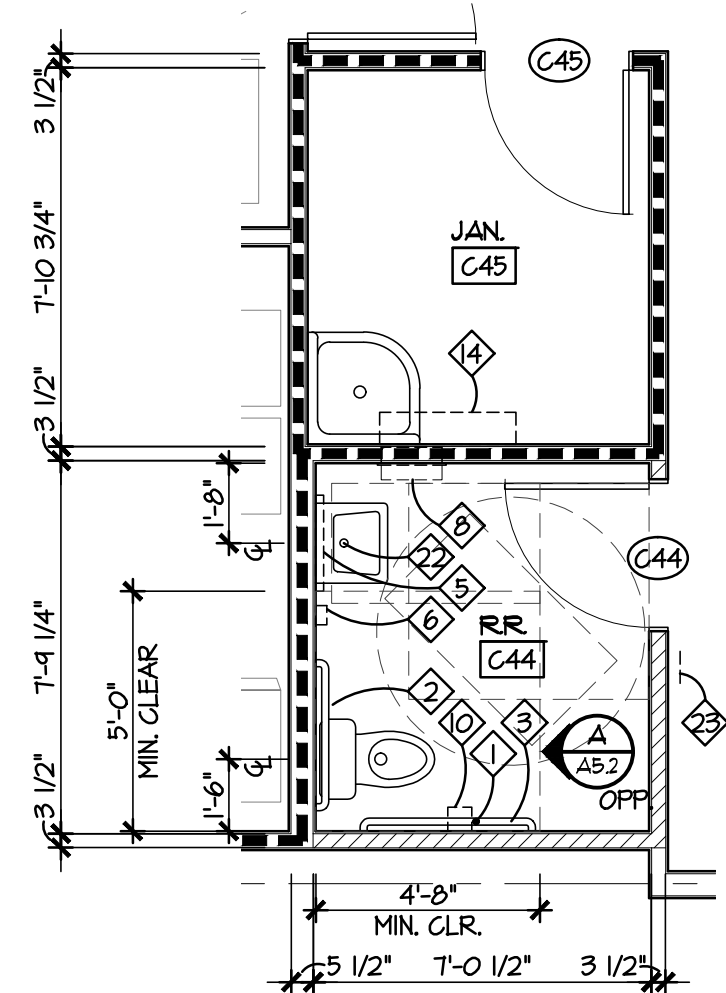

G RESTROOM #103
SCALE: 1/4"=1'-0"

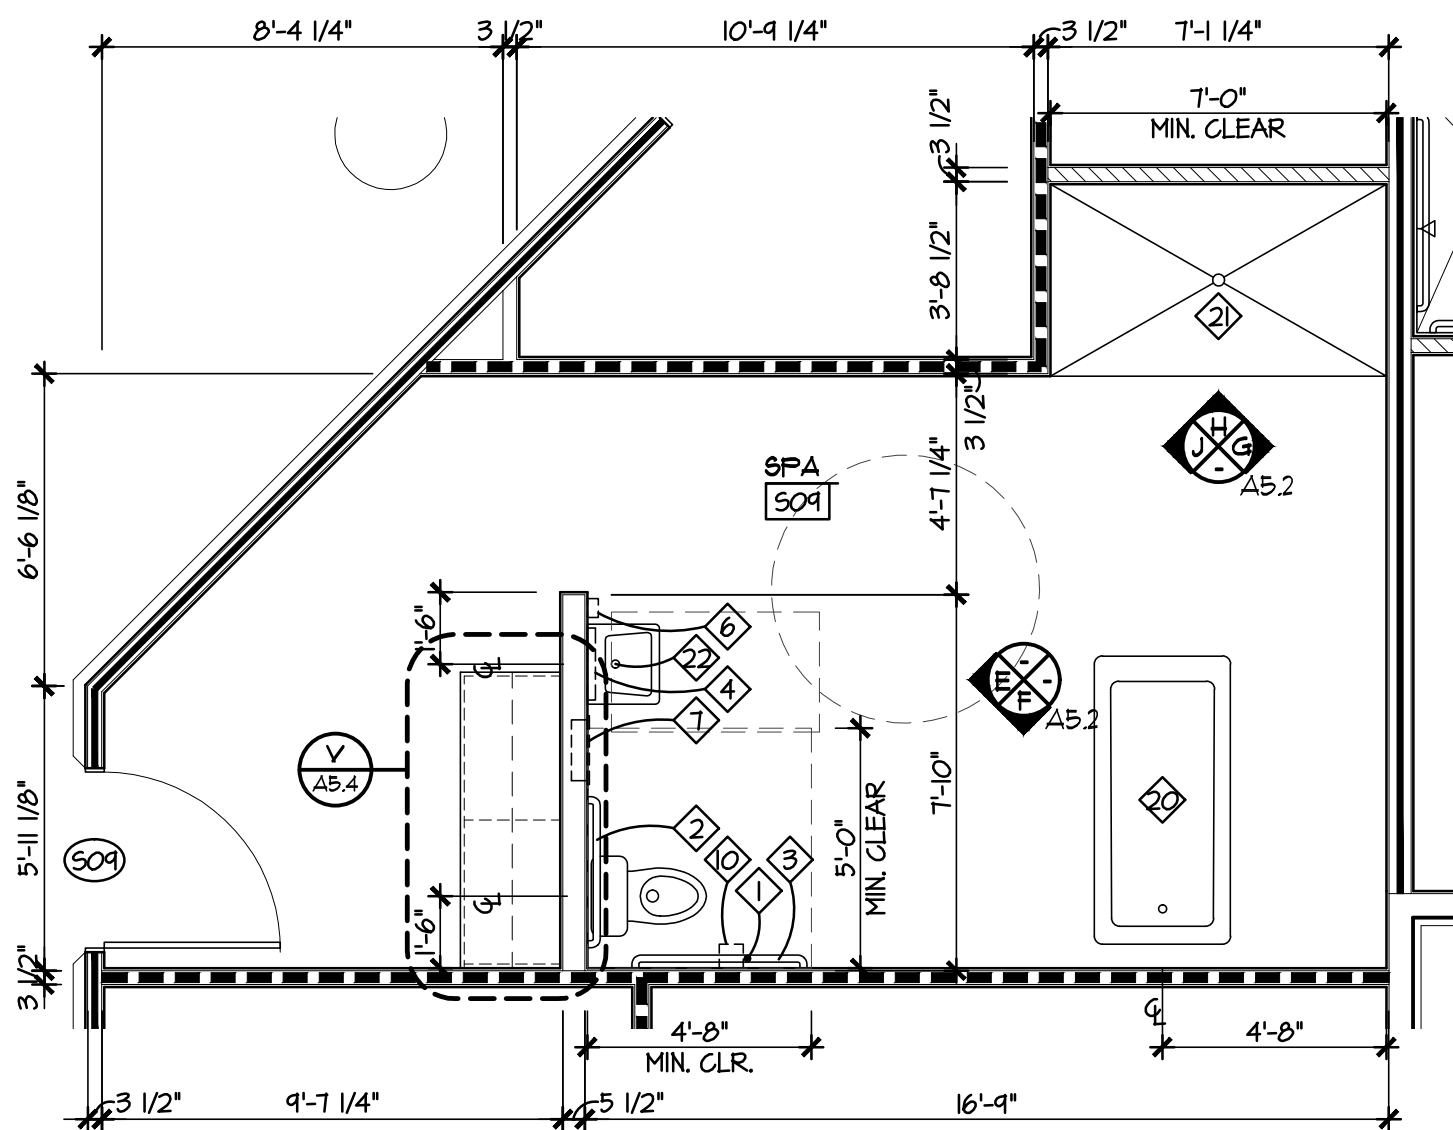

H RESTROOM #104
SCALE: 1/4"=1'-0"

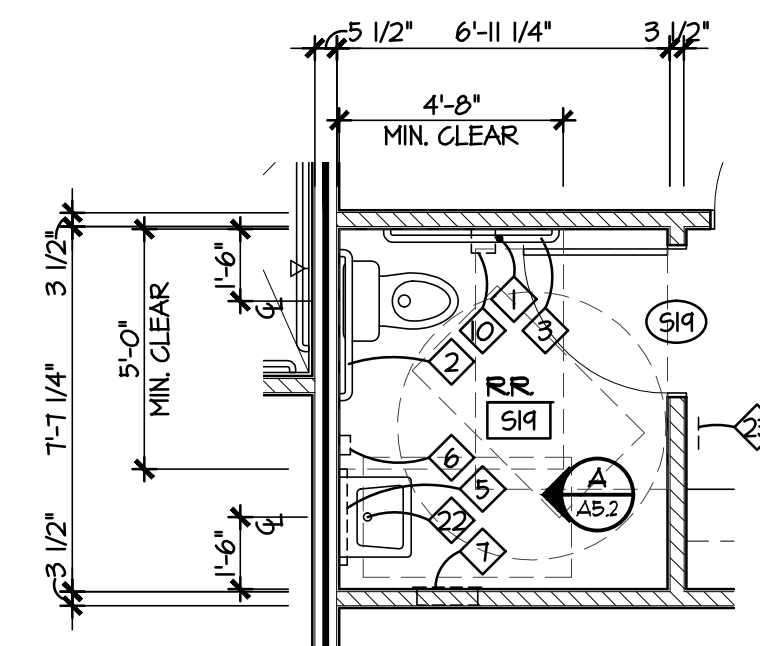


J RESTROOM #105
SCALE: 1/4"=1'-0"

ENLARGED RESTROOM PLANS

SCALE: 1/4"=1'-0"

KEYNOTE LEGEND

- NOTES:
- ALL TOILET ACCESSORIES INDICATED BY MODEL NUMBER "XXXX" TO BE STAINLESS STEEL. W/ SATIN FINISH, MANUFACTURED BY BOBRICK OR APPROVED EQUAL UNLESS NOTED OTHERWISE.
 - ALL TOILET ROOM ACCESSORIES TO BE INSTALLED PER MANUFACTURER'S RECOMMENDED DETAILS AND IN CONFORMANCE W/ ALL ADA/ADAAG & ICC IT11 GUIDELINE REQUIREMENTS.
 - GENERAL CONTRACTOR TO PROVIDE BLOCKING IN WALLS AS REQUIRED FOR ACCESSORY INSTALLATION.
- BOBRICK #B-5806x18 WALL MOUNTED 1-1/4" DIA. 18" L. GRAB BAR MOUNTED VERTICALLY
 - BOBRICK #B-5806x36 WALL MOUNTED 1-1/4" DIA. 36" L. GRAB BAR
 - BOBRICK #B-5806x42 WALL MOUNTED 1-1/4" DIA. 42" L. GRAB BAR
 - BOBRICK #B-165 1836 18" W. x 36" H. STAINLESS STEEL FRAMED MIRROR
 - BOBRICK #B-165 2436 24" W. x 36" H. STAINLESS STEEL FRAMED MIRROR
 - BOBRICK #B-2111 SURFACE MOUNTED SOAP DISPENSER
 - BOBRICK #B-3440 RECESSED PAPER TOWEL DISPENSER / WASTE RECEPT., 600 C-FOLD OR 800 MULTIFOLD TOWEL CAPACITY, 6 GAL. WASTE
 - BOBRICK #B-3444 RECESSED PAPER TOWEL DISPENSER / WASTE RECEPT., 600 C-FOLD OR 800 MULTIFOLD TOWEL CAPACITY, 12 GAL. WASTE
 - BOBRICK #B-6851 SURFACE MOUNTED TOILET TISSUE DISPENSER
 - BOBRICK #B-2888 SURFACE MOUNTED MULTI-ROLL TOILET TISSUE DISPENSER
 - BOBRICK #B-207x60 SHOWER CURTAIN ROD W/ CONCEALED MOUNTING, ONLY PROVIDE IF NOT INCLUDED BY SHOWER MANUFACTURER - VERIFY WITH OWNER
 - DELTA #T54240 SURFACE MOUNTED 24" L. TOWEL BAR, INSTALL WITH TOP AT +48" A.F.F.
 - DELTA #T5412 SURFACE MOUNTED 12" L. TOWEL BAR, INSTALL ON SIDE OF VANITY OR WITH TOP @ +48" A.F.F.
 - BOBRICK #B-234x34 SHELF W/ MOP & BROOM HOLDERS AND HOOKS
 - DELTA #T4235 ROBE HOOK, INSTALL AT +48" A.F.F.
 - DELTA #T54460 TOWEL RING, VERIFY MOUNTING HEIGHT W/ OWNER
 - 60"x36" WHITE SINGLE PIECE ADA COMPLIANT STANDARD ROLL-IN FIBERGLASS SHOWER BY BEST BATH OR APPROVED EQUAL. PROVIDE FACTORY INSTALLED HORIZONTAL AND VERTICAL GRAB BARS, FOLD DOWN SEAT, RECESSED SOAP DISH, AND MAX. 1/2"H. THRESHOLD - SEE TYPICAL ADA INSTALLATION DETAILS ON DRAWING A5.2.
 - 60"x36" WHITE SINGLE PIECE ADA COMPLIANT ALTERNATE ROLL-IN FIBERGLASS SHOWER BY BEST BATH OR APPROVED EQUAL. PROVIDE FACTORY INSTALLED HORIZONTAL AND VERTICAL GRAB BARS, FOLD DOWN SEAT, RECESSED SOAP DISH, AND MAX. 1/2"H. THRESHOLD - SEE TYPICAL ADA INSTALLATION DETAILS ON DRAWING A5.2.
 - HANDHELD SHOWER ON SLIDE BAR & SHOWER CONTROLS - SEE ADA INSTALLATION DETAILS THIS SHEET & PLUMBING DWGS. FOR MORE INFORMATION
 - WHIRLPOOL BATH UNIT, SEE PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION
 - 4"X4" L. CERAMIC TILE SHOWER BASE & WALLS, SEE SPA ELEVATIONS ON DRAWING A5.2
 - PROVIDE MOLDED INSULATION PIPE COVER AT EXPOSED LAVATORY PLUMBING
 - PROVIDE WALL MOUNTED SIGNAGE FOR ACCESSIBLE RESTROOMS PER VCC 111.2 & ADAAG 4.30.
 - RECESSED MILLWORK W/ SHELVES, SEE DETAIL 4/A5.2
 - KITCHEN EQUIPMENT, FINAL DRAWINGS TO BE SUBMITTED SEPARATELY
 - FURNISHINGS & EQUIPMENT PER OWNER, TYPICAL
 - ROOF DRAIN ABOVE, SEE ROOF PLAN ON DRAWING A0.3 & PLUMBING DRAWINGS
 - DOOR CONTROL, KEYPAD OR PUSH PLATE
 - 1 HOUR RATED 22"x36" ATTIC ACCESS PANEL BY NYSTROM OR EQUAL
 - 1 HOUR RATED 30"x36" ROOF HATCH, SEE DETAIL 16/A5.6
 - 6" H. CONCRETE HOUSEKEEPING PAD
 - HANDRAIL, TYPICAL IN 8'-0" RESIDENTIAL CORRIDORS - SEE DETAIL 15/A5.6
 - 10"x8" x 1'-8" H. DECORATIVE COLUMN W/ CAP AND BASE - SEE DETAIL 8/A5.6
 - (5) 16" D. ADJUST. SHELVES IN RECESSED STANDARDS, 3/4" PART. BD. W/ PLASTIC LAMINATE FINISH
 - (5) 24" D. EPOXY COATED WIRE SHELVING ON HEAVY DUTY BRACKETS, MOUNT AT #18" O.C.
 - (5) 16" D. EPOXY COATED WIRE SHELVING ON HEAVY DUTY BRACKETS, MOUNT AT #18" O.C.
 - ONE-SIDED FIREPLACE W/ HEARTH, SEE DETAIL 17/A5.6
 - SHEAR WALL, SEE STRUCTURAL DRAWINGS
 - HOSE BIB, SEE PLUMBING DRAWINGS
 - NEW DOWNSPOUT, SEE PLUMBING DRAWINGS
 - NEW CONCRETE PATIO - SEE CIVIL DRAWINGS
 - 6" HIGH VINYL FENCE, STYLE AND COLOR TO BE SELECTED
 - 36" WIDE VINYL FENCE GATE W/ ELECTRONIC ACCESS CONTROL - CONNECT TO FIRE ALARM SYSTEM FOR FAIL-SAFE EGRESS FUNCTION



DSC
ARCHITECTS
401 FRONT STREET
BEREA, OHIO 44017
PHONE: 440.835.3957
mail@dscarchitects.com

DATE:
PERMIT SUBMISSION:
06.14.26


BENNETT'S CREEK
HEALTH & REHABILITATION CENTER
1931/1915 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA




DRAWING NAME
ENLARGED
PLANS &
DETAILS

DSCA PROJECT NO.
24061



A5.1

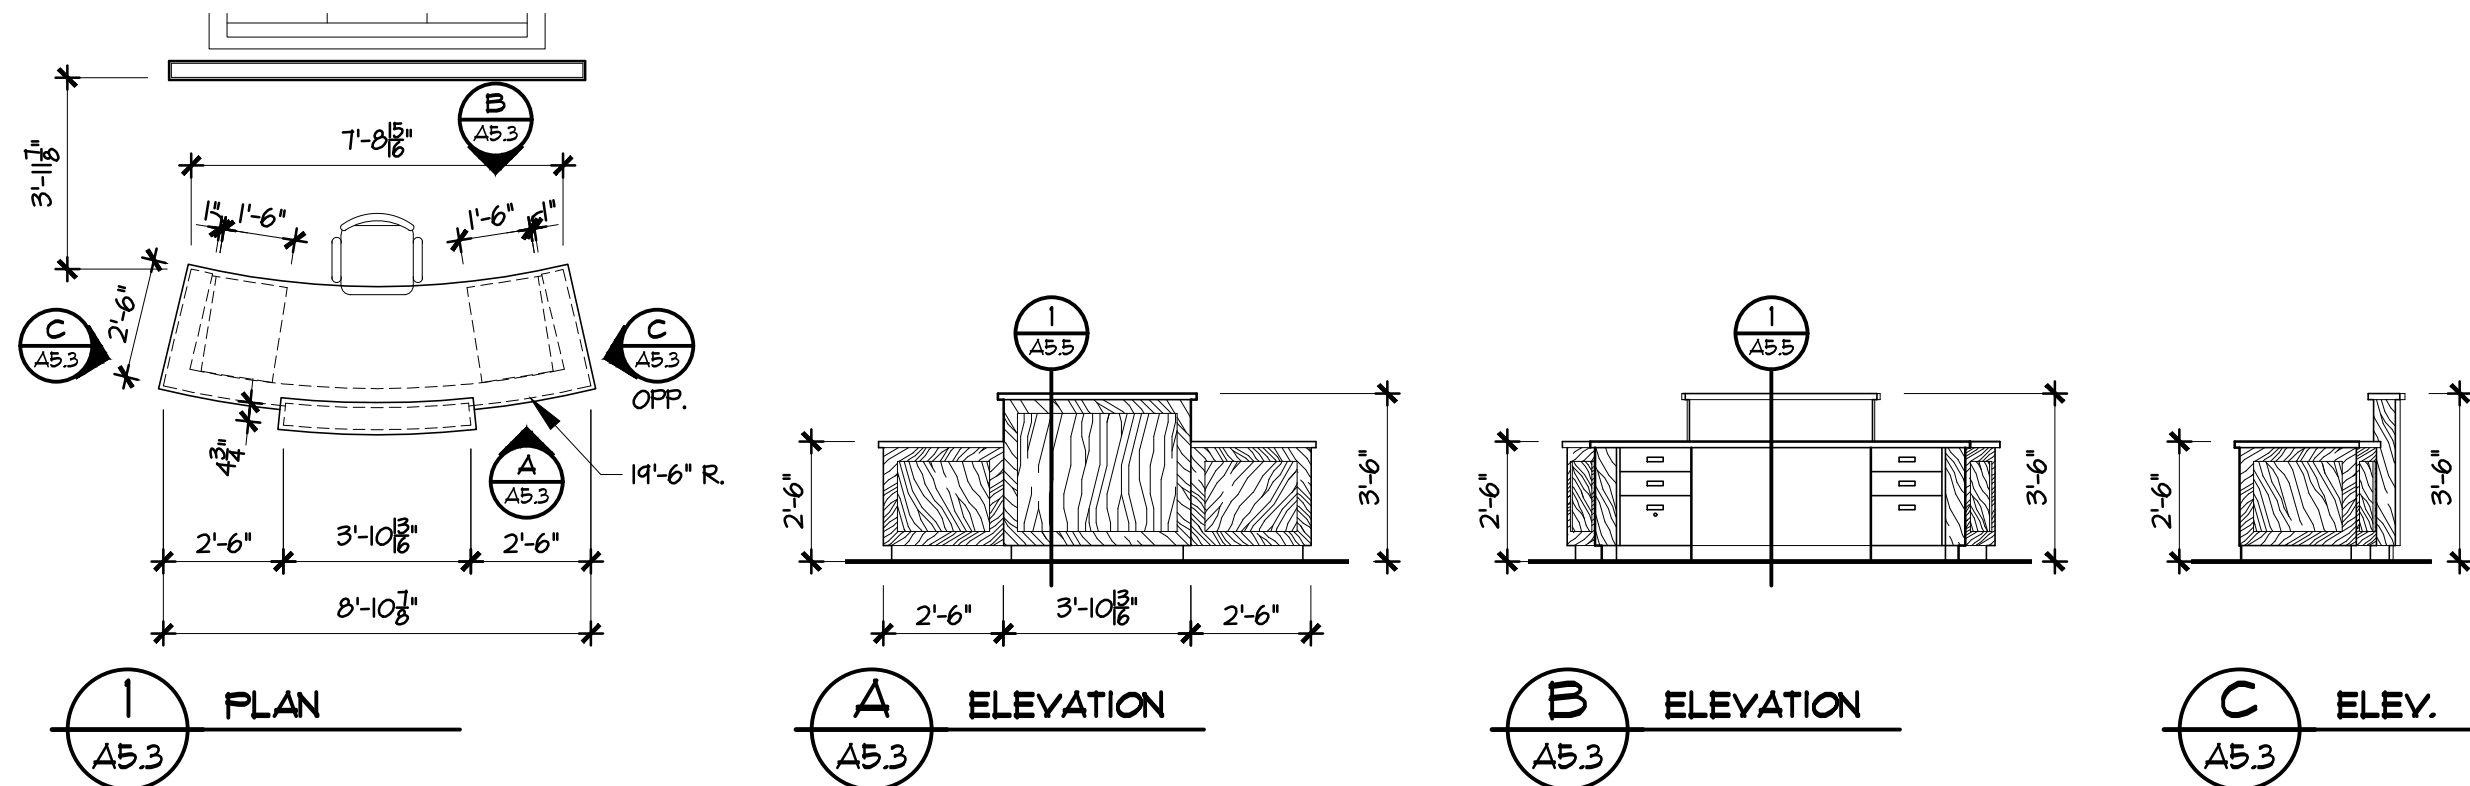


RECEPTION *C02
SCALE: 1/4"=1'-0"

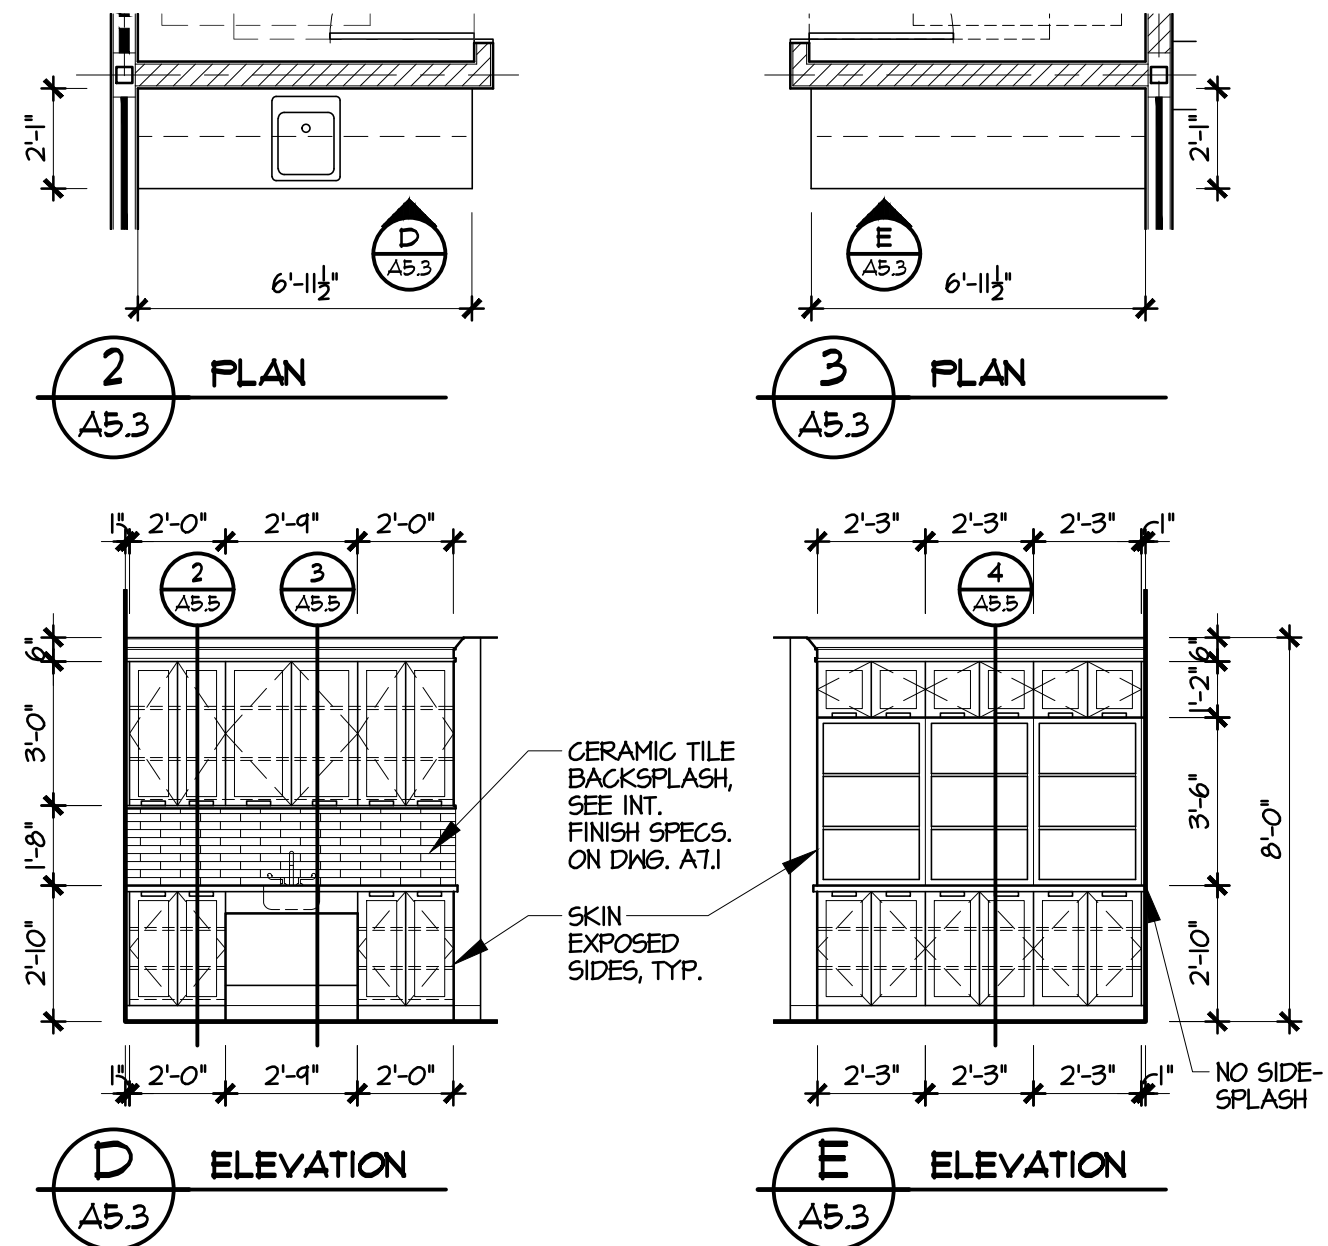


LOBBY *C04
SCALE: 1/4"=1'-0"

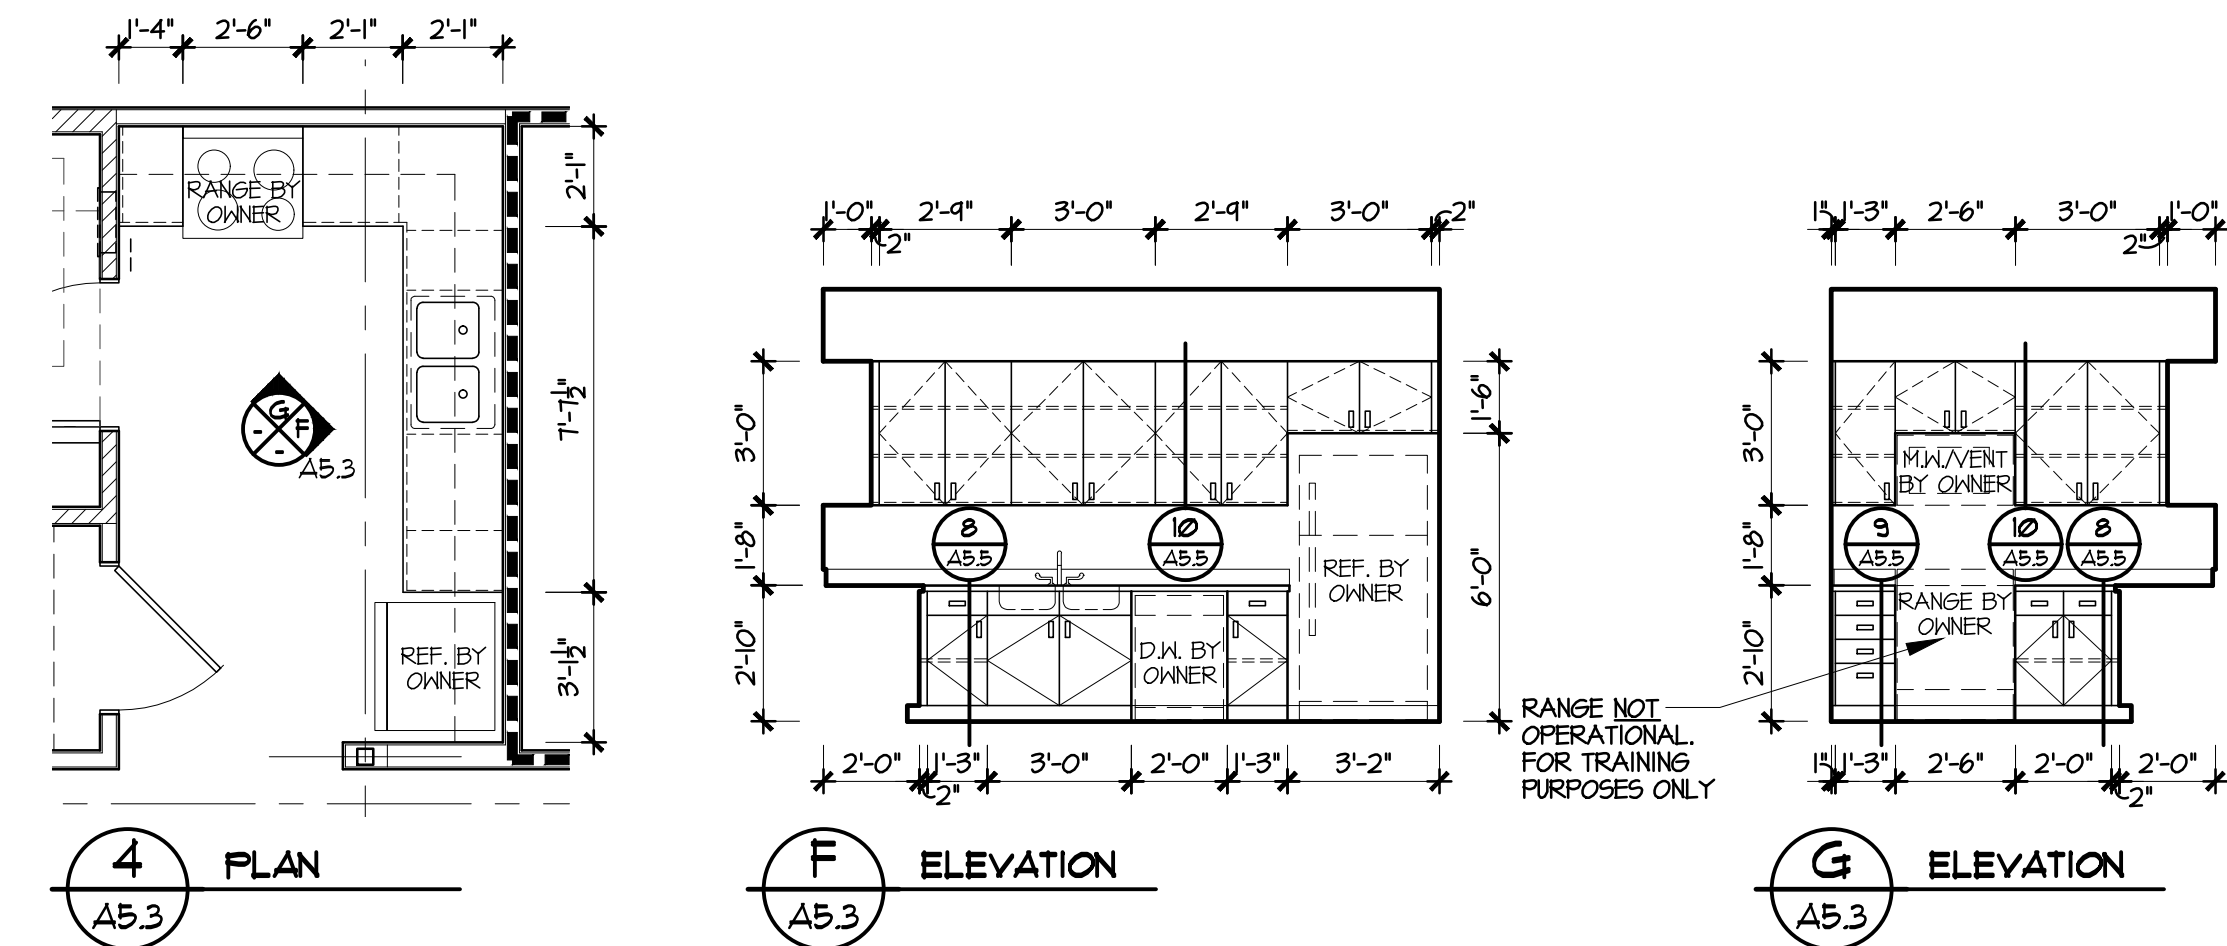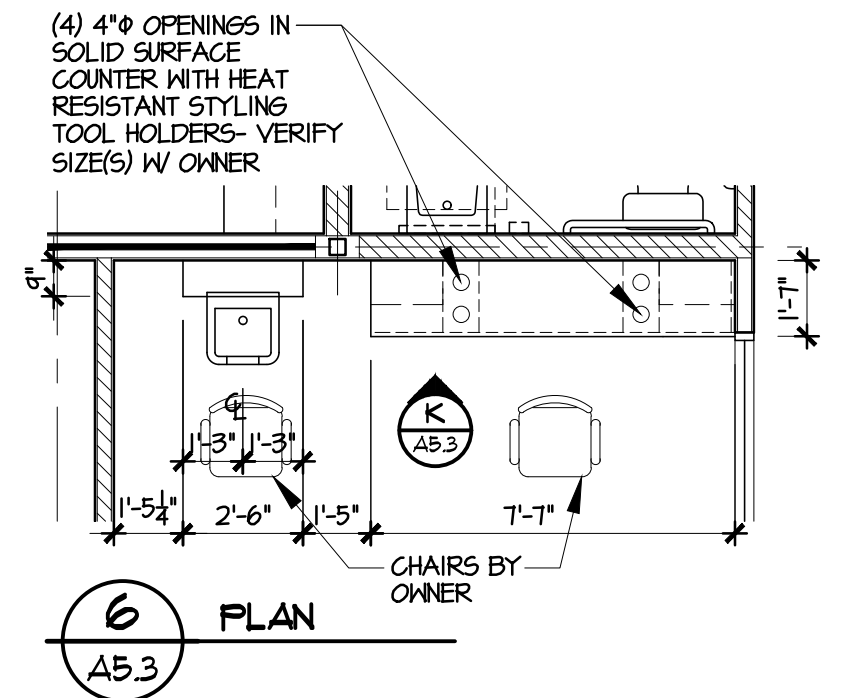


KITCHENETTE *C09
SCALE: 1/4"=1'-0"

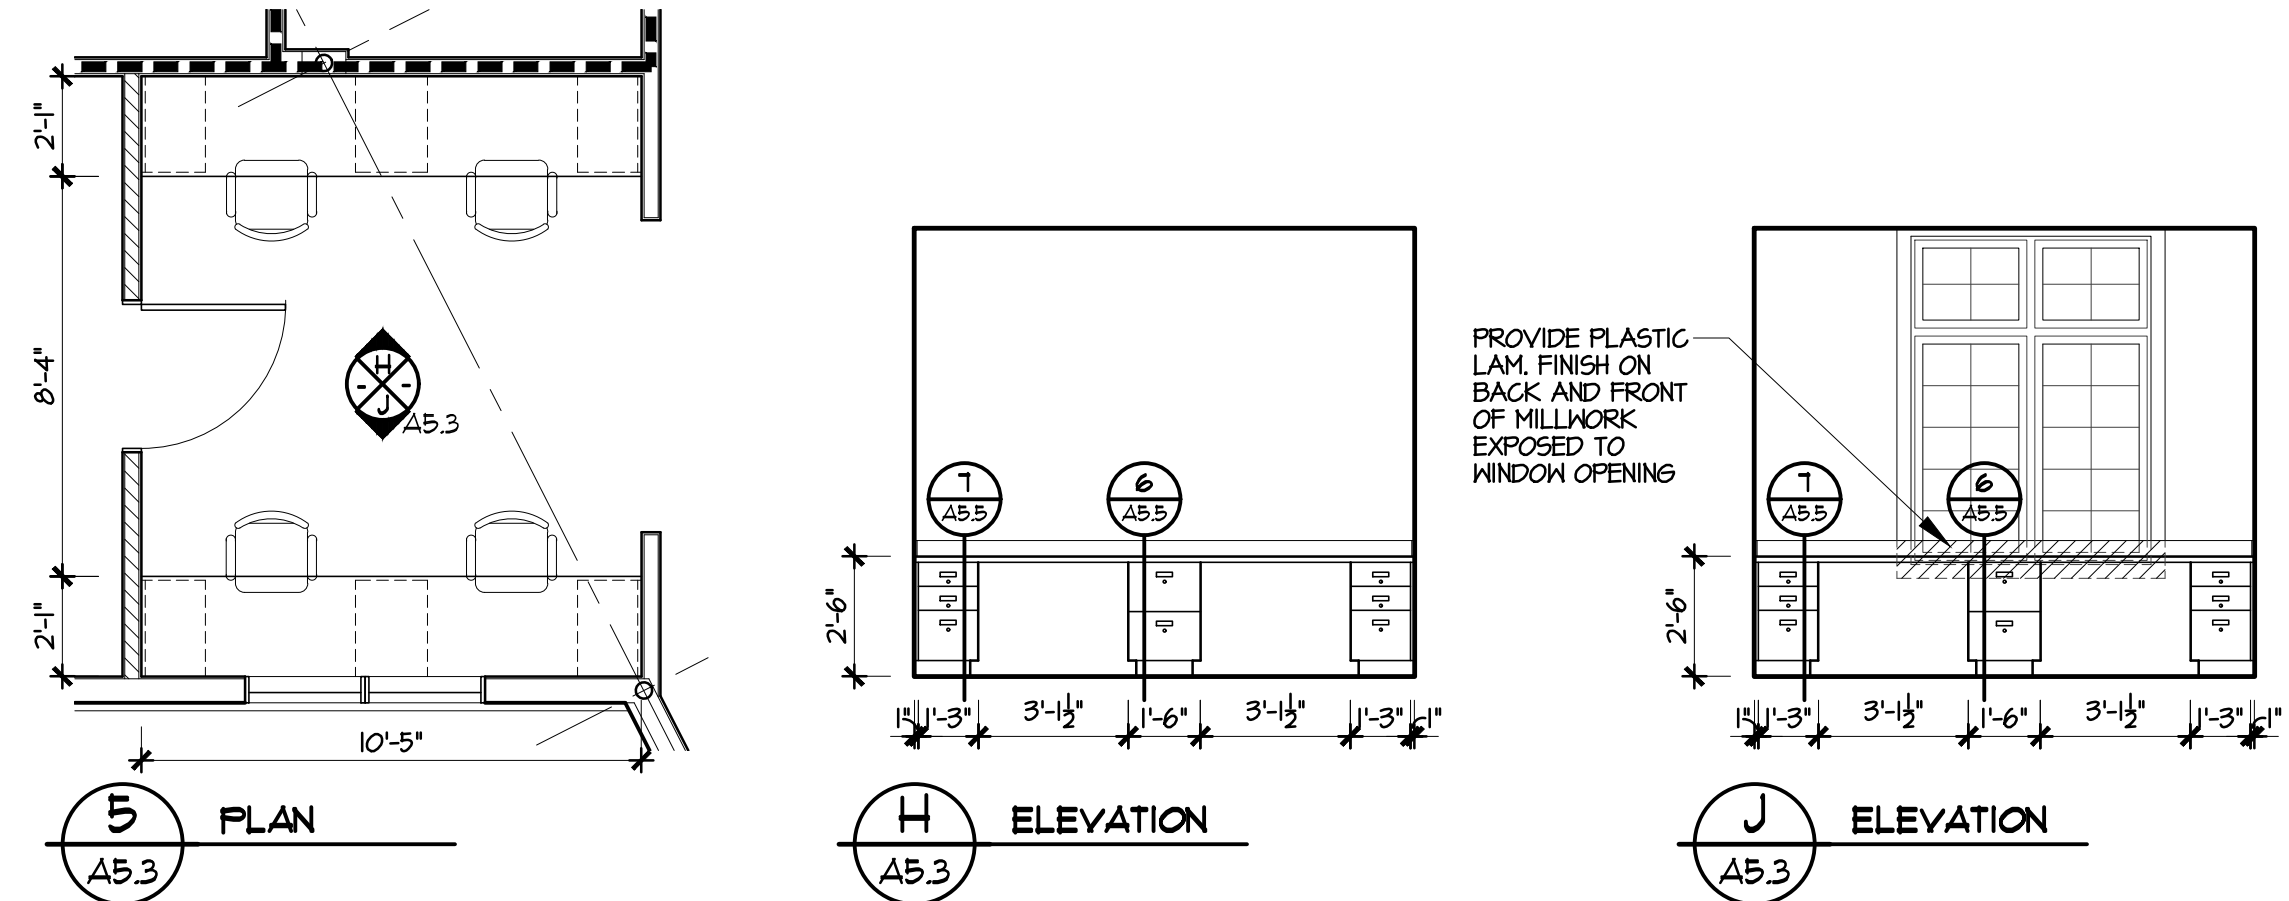

OFFICE *C14
SCALE: 1/4"=1'-0"

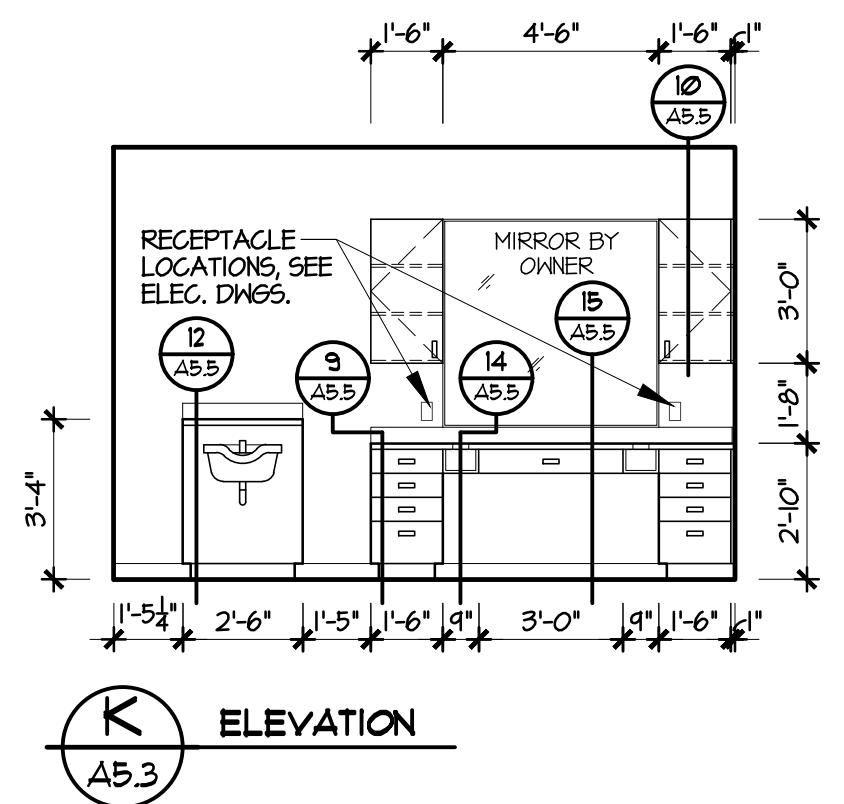


SALON *C30
SCALE: 1/4"=1'-0"

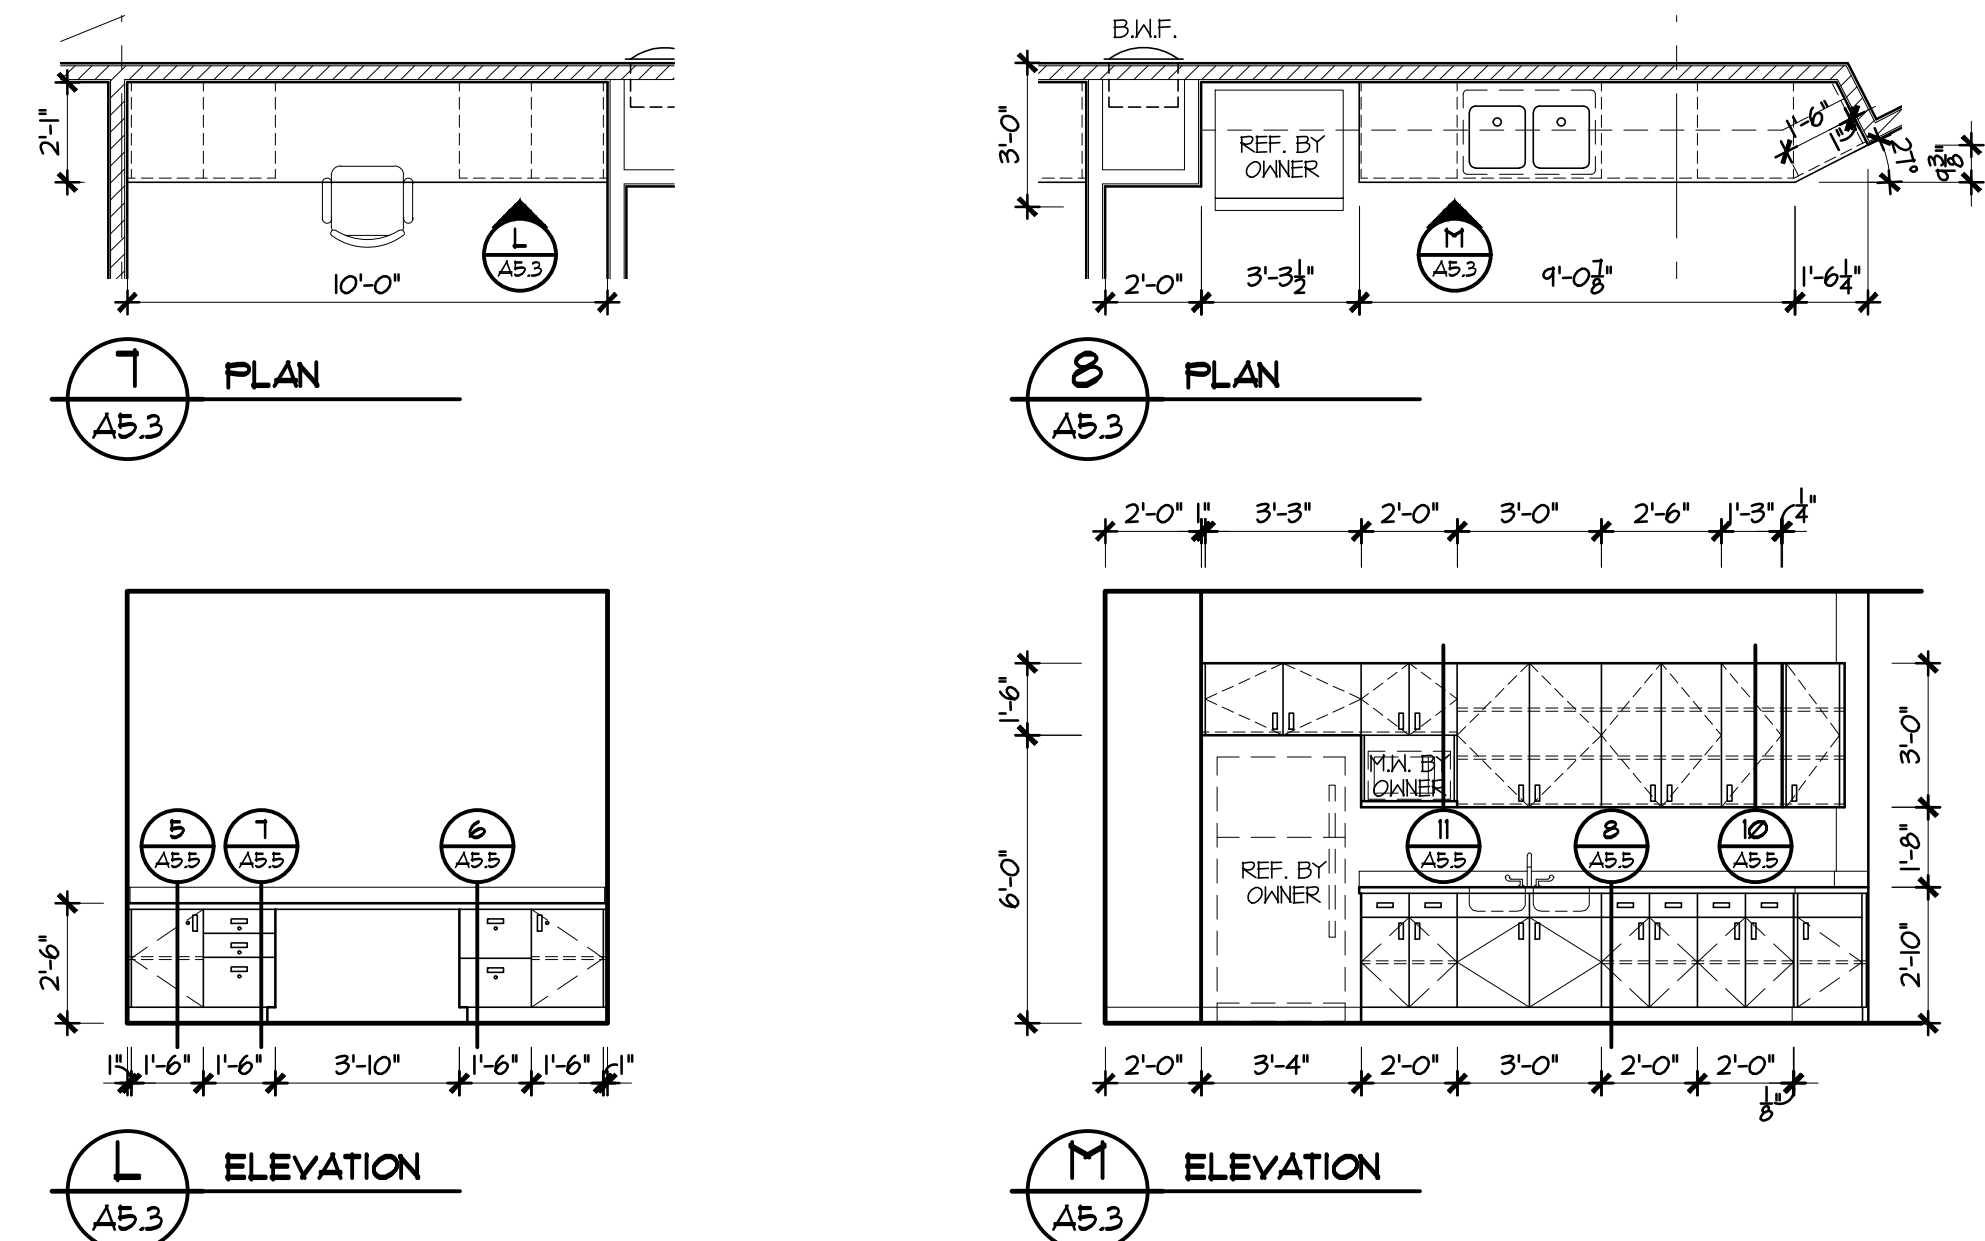

OFFICE *C31
SCALE: 1/4"=1'-0"

ACTIVITY *C32
SCALE: 1/4"=1'-0"

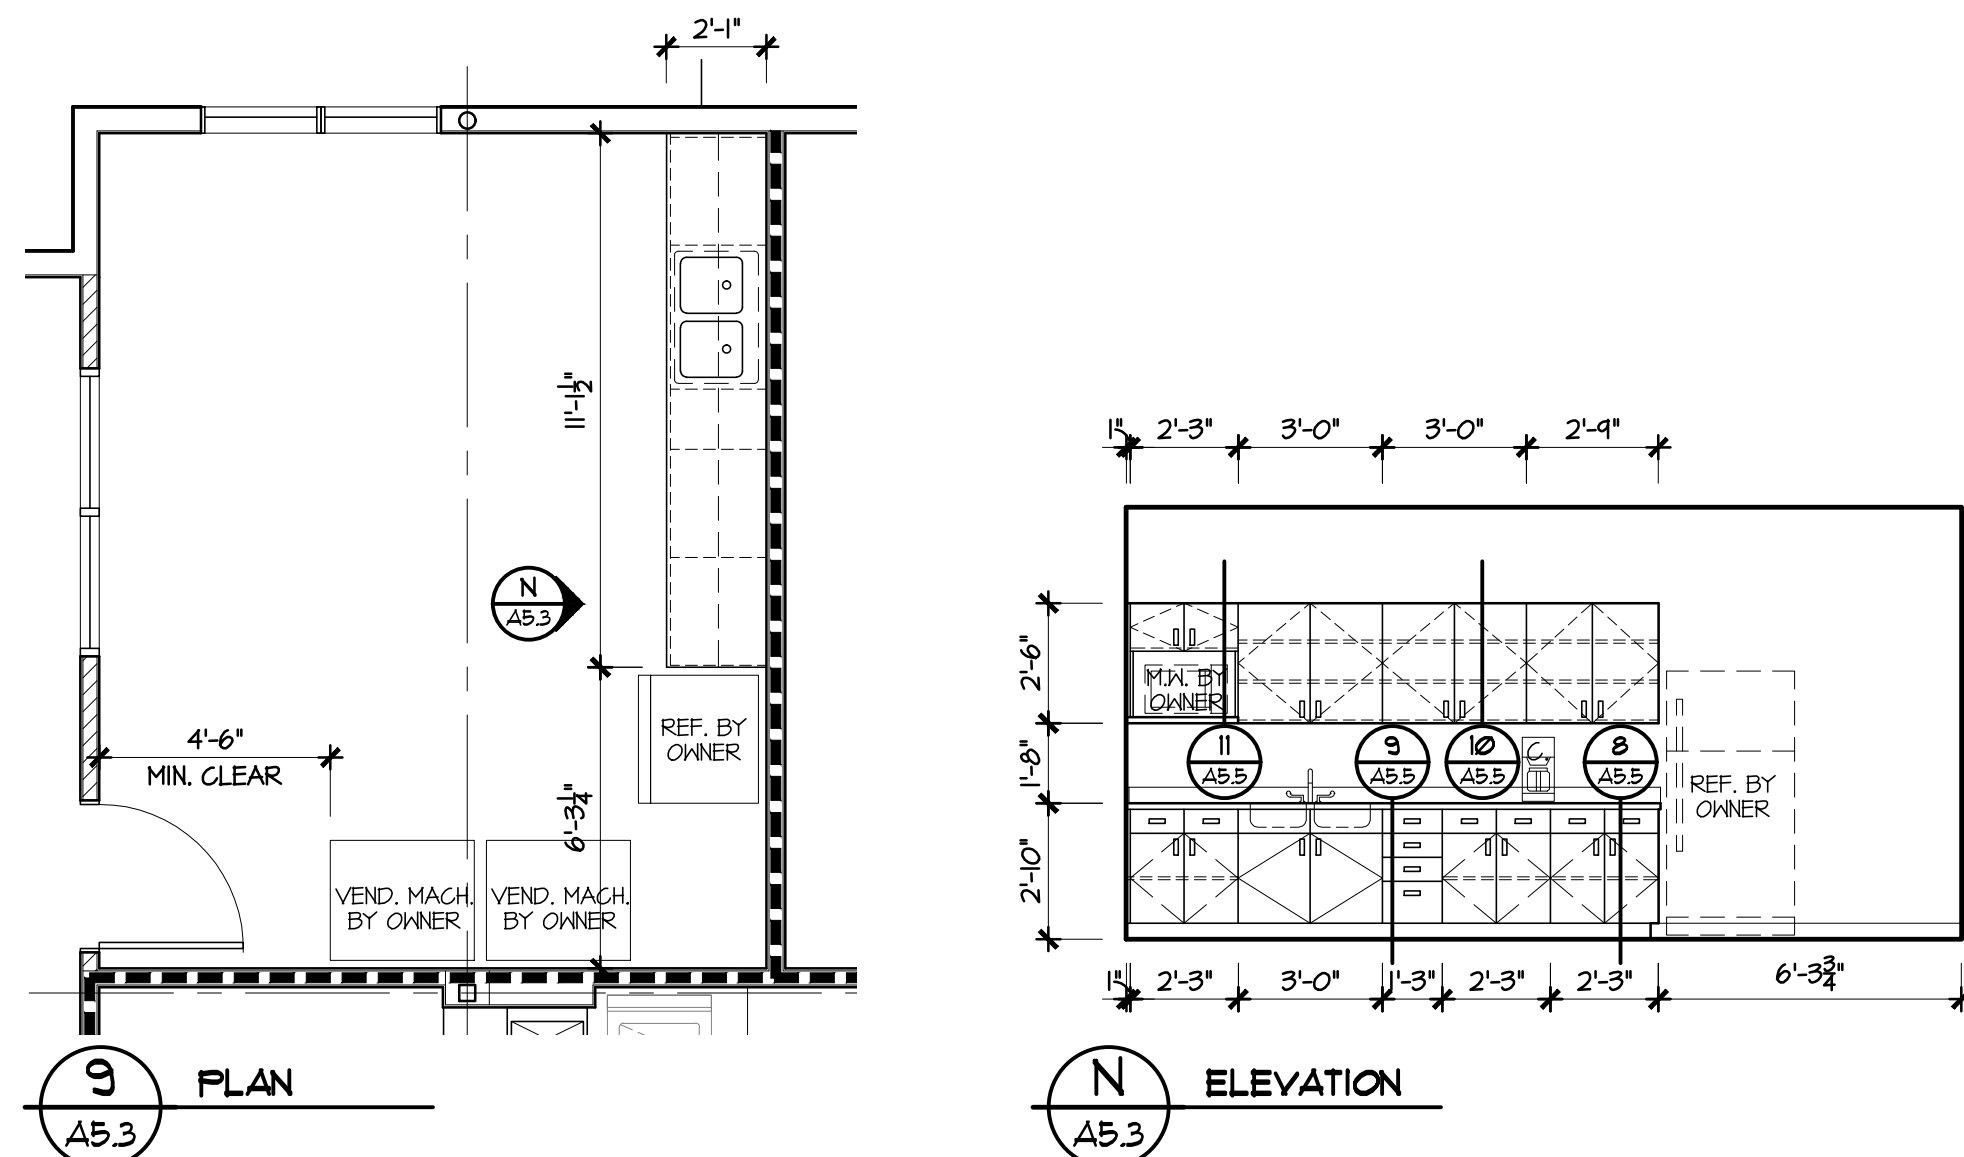

LOUNGE *C31
SCALE: 1/4"=1'-0"



DATE:
PERMIT SUBMISSION:
06.19.26

BENNETT'S CREEK
HEALTH & REHABILITATION CENTER
1931/1915 BRIDGE ROAD (HIGHWAY 17)
SUFFOLK, VIRGINIA












DRAWING NAME
MILLWORK
PLANS &
ELEVATIONS

DSCA PROJECT NO.
24061


DSCA PROJECT NO.
24.061

A5.4

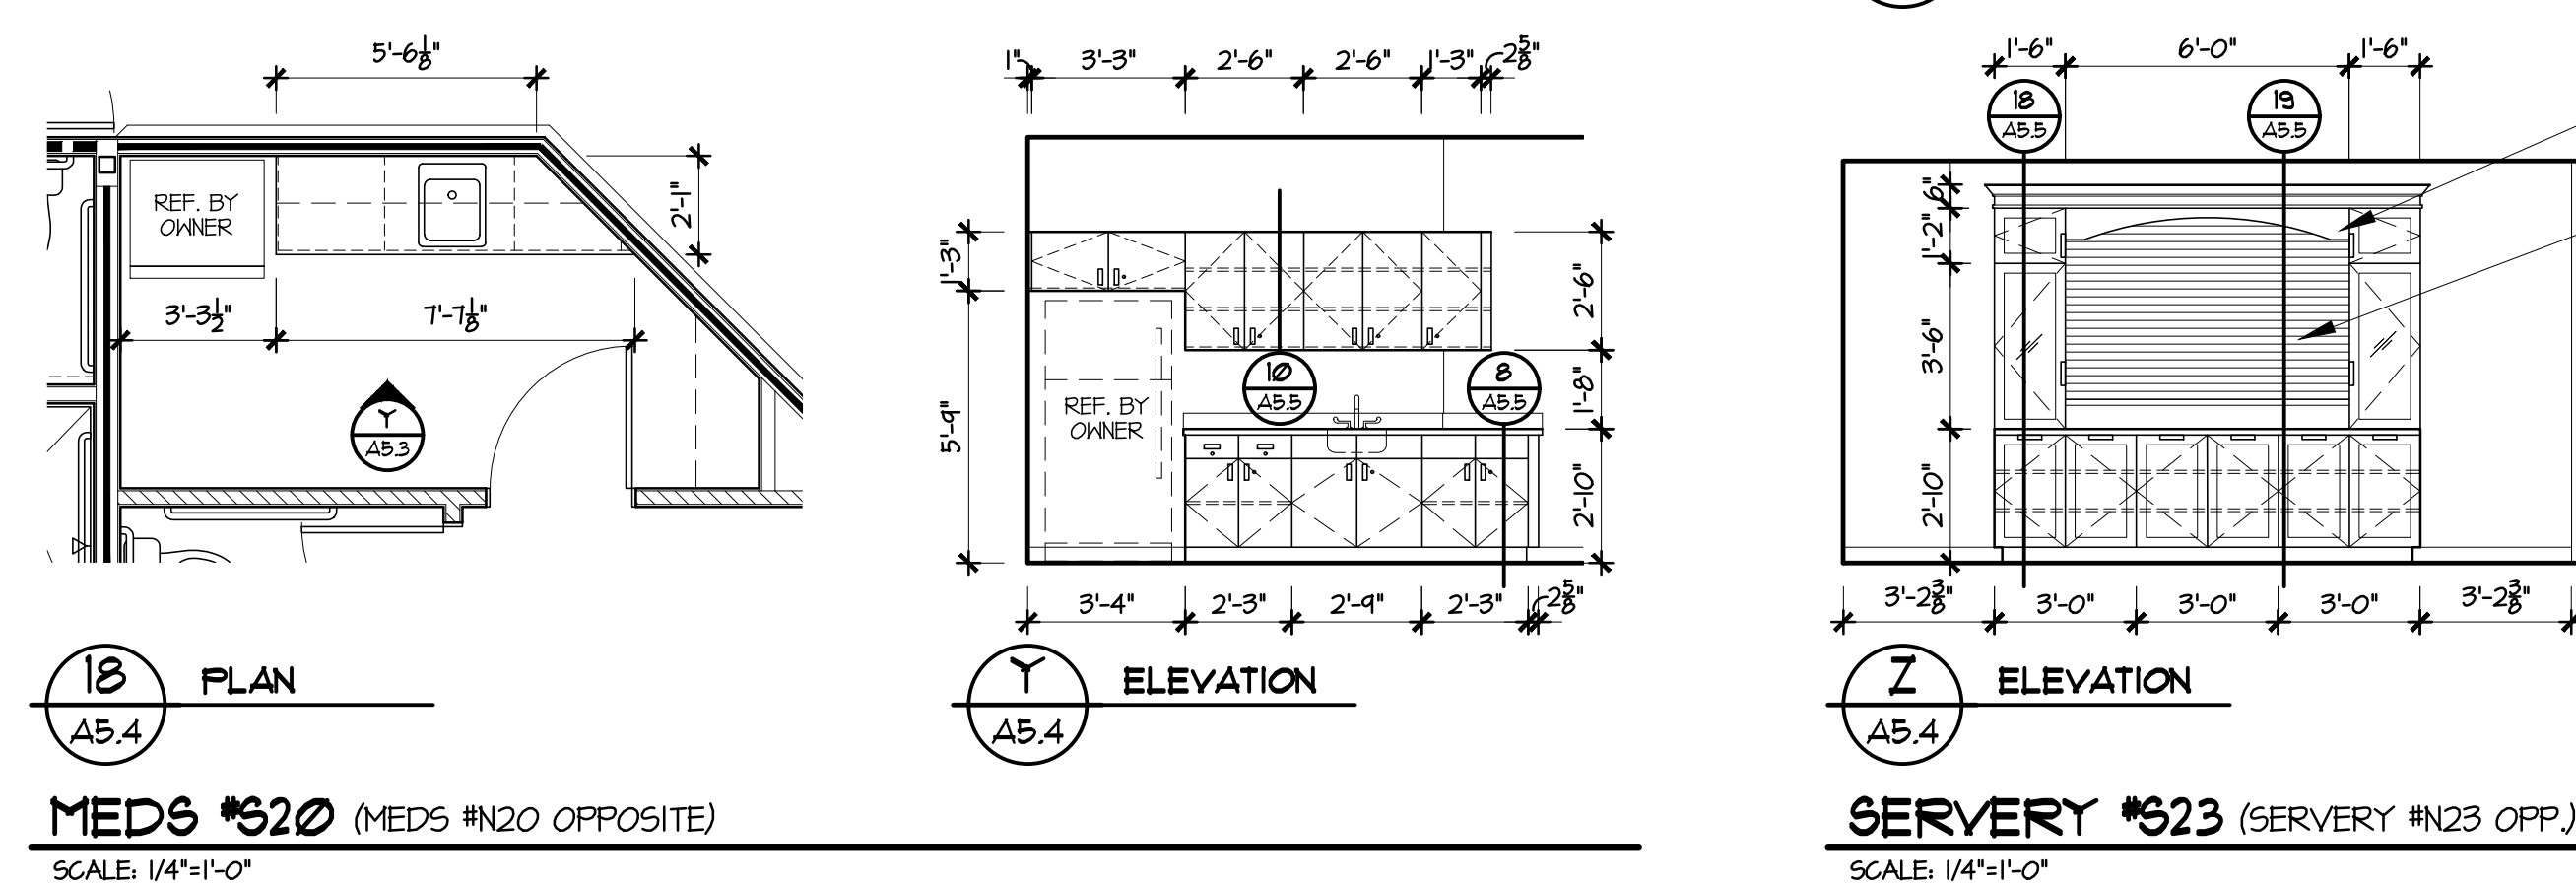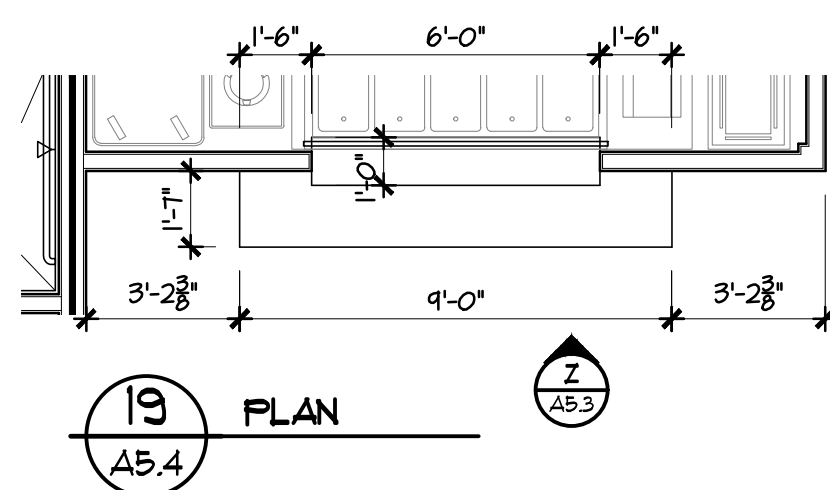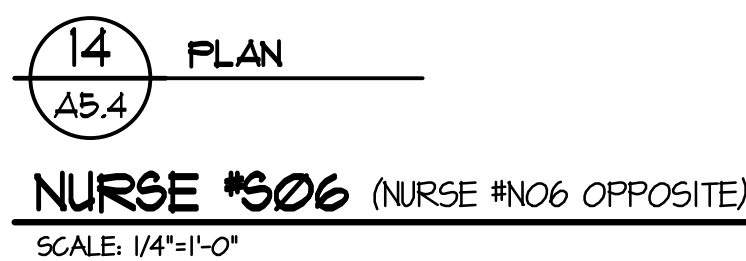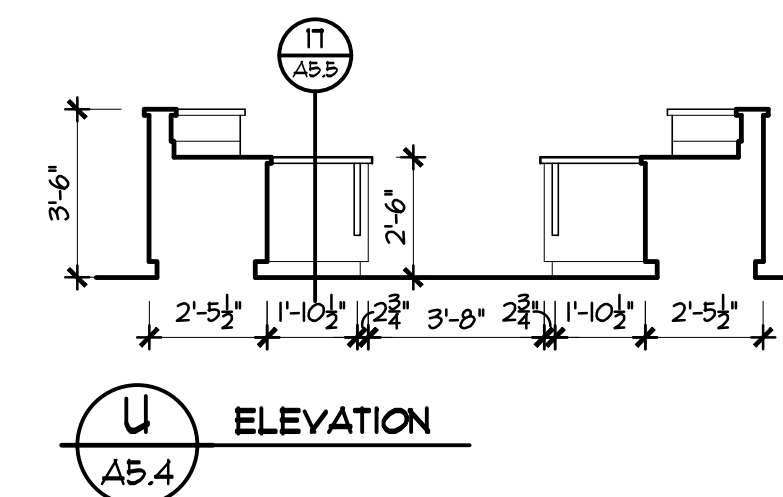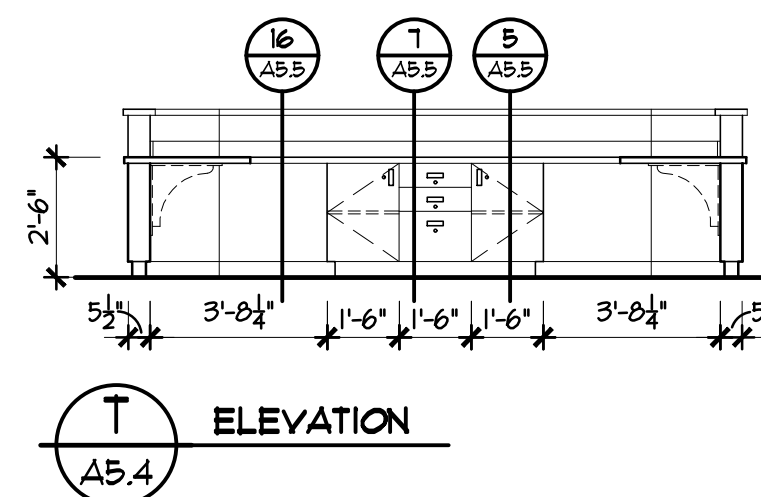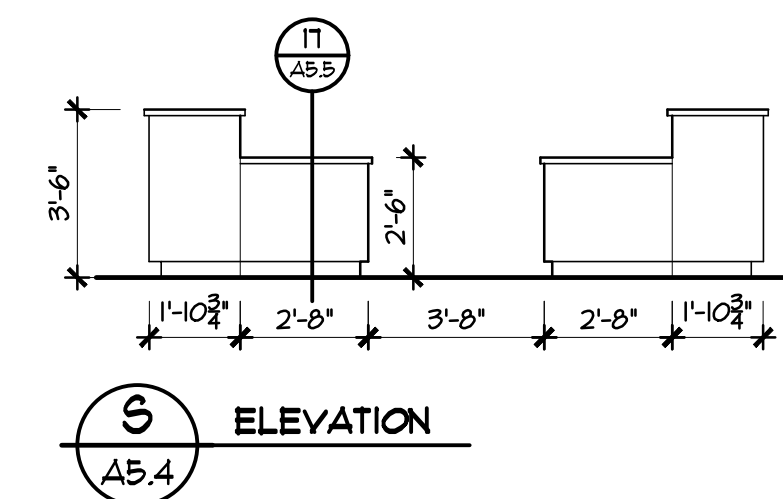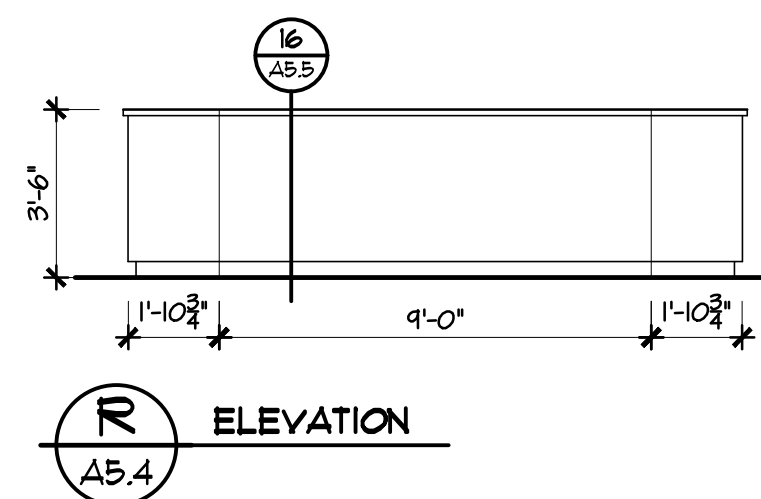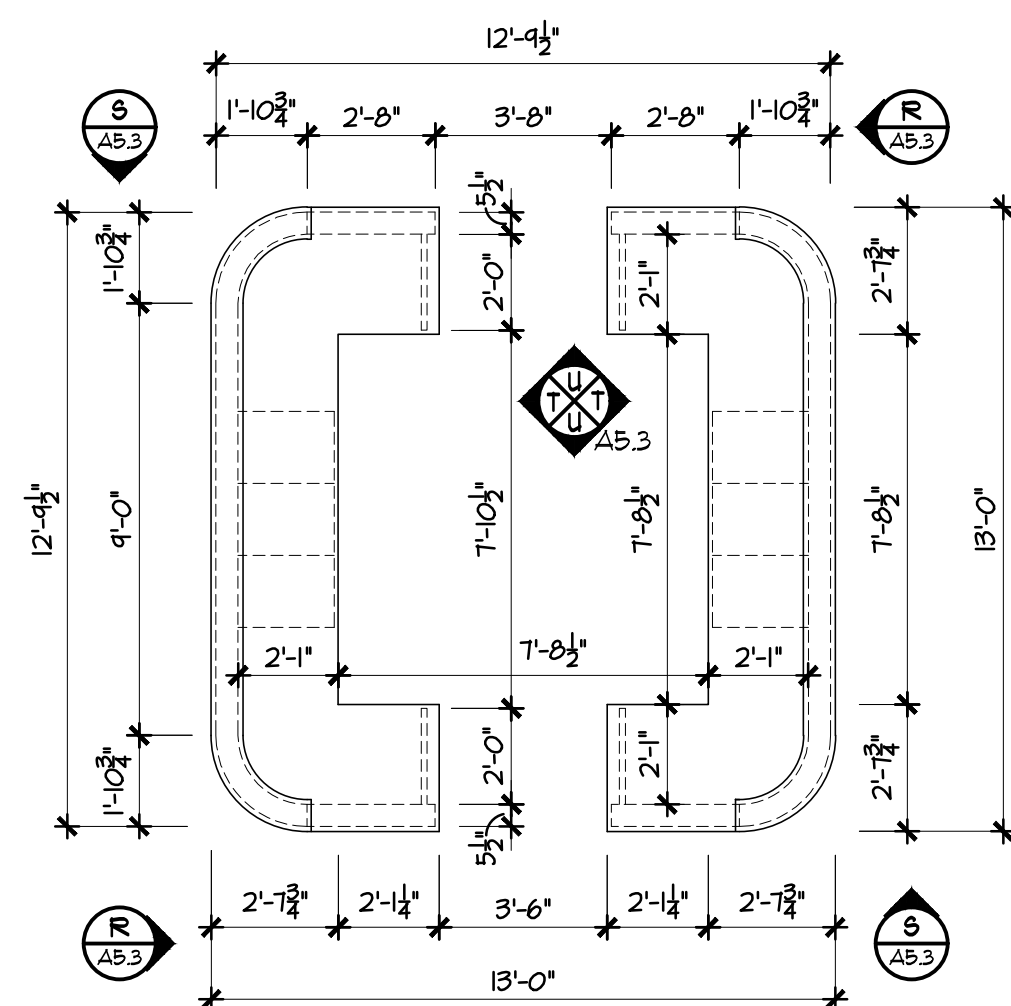


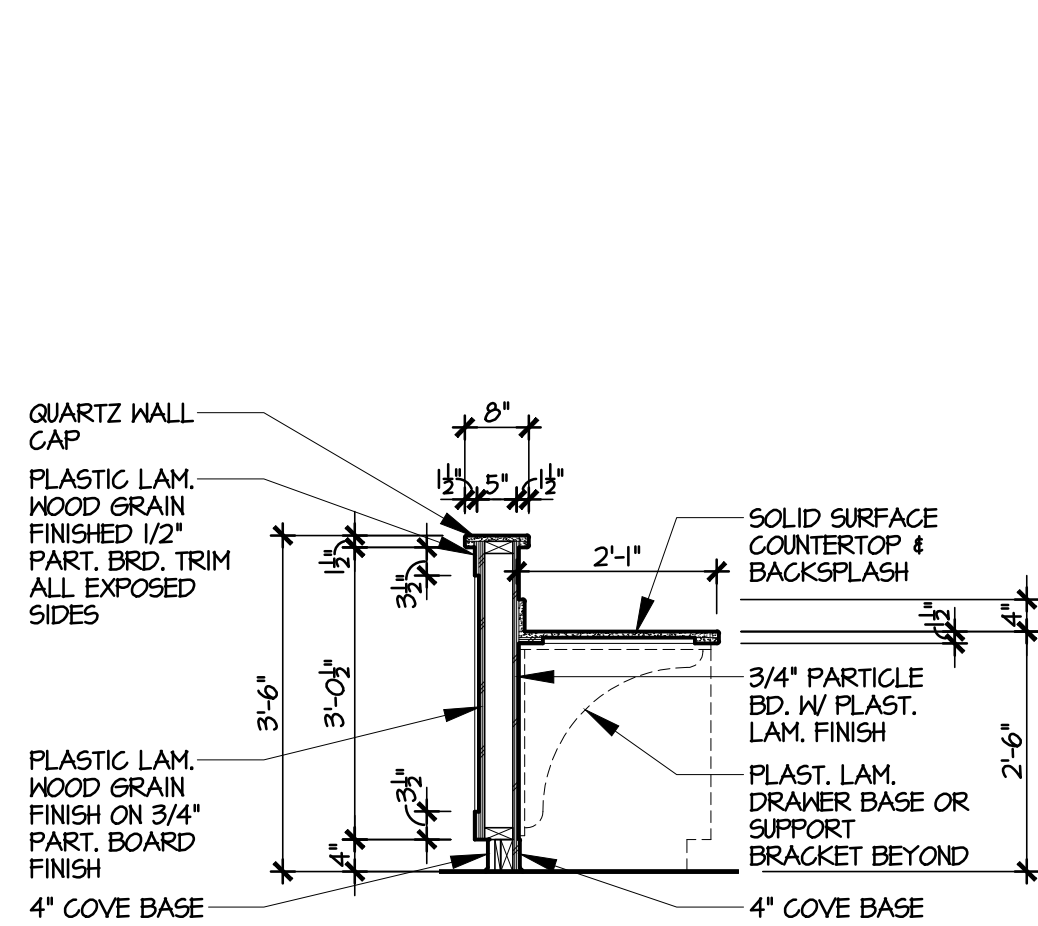


1
RECEPTION DESK
CABINET SECTION
SCALE: 1/2"=1'-0"

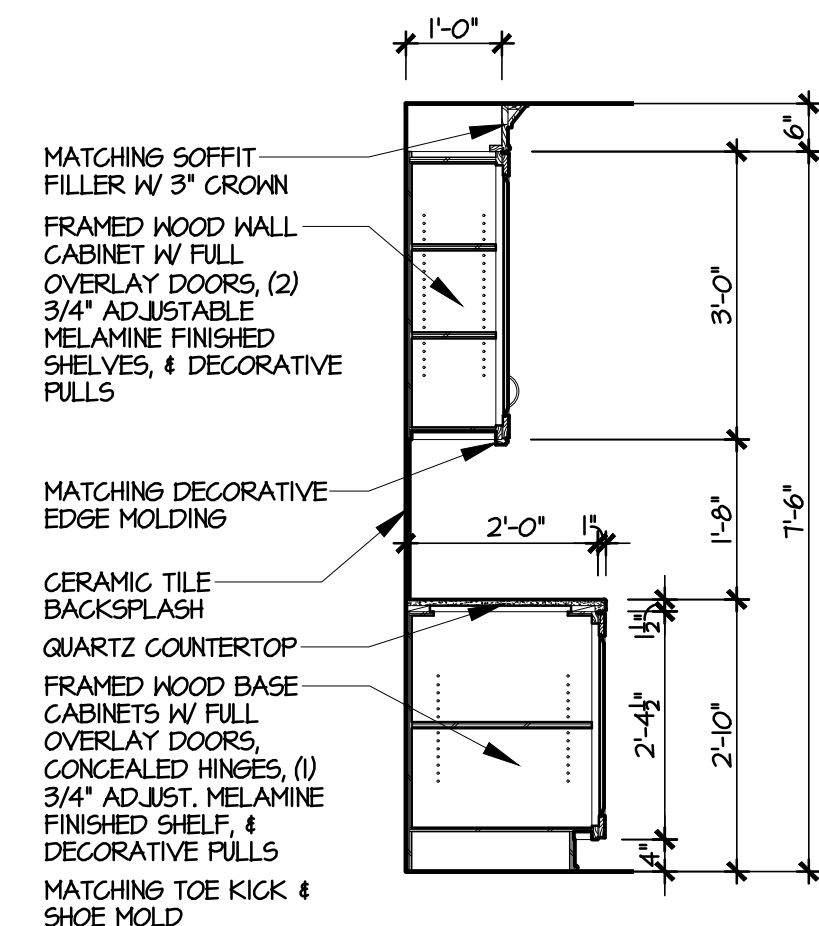


2
FULL OVERLAY LOBBY
CABINET SECTION
SCALE: 1/2"=1'-0"

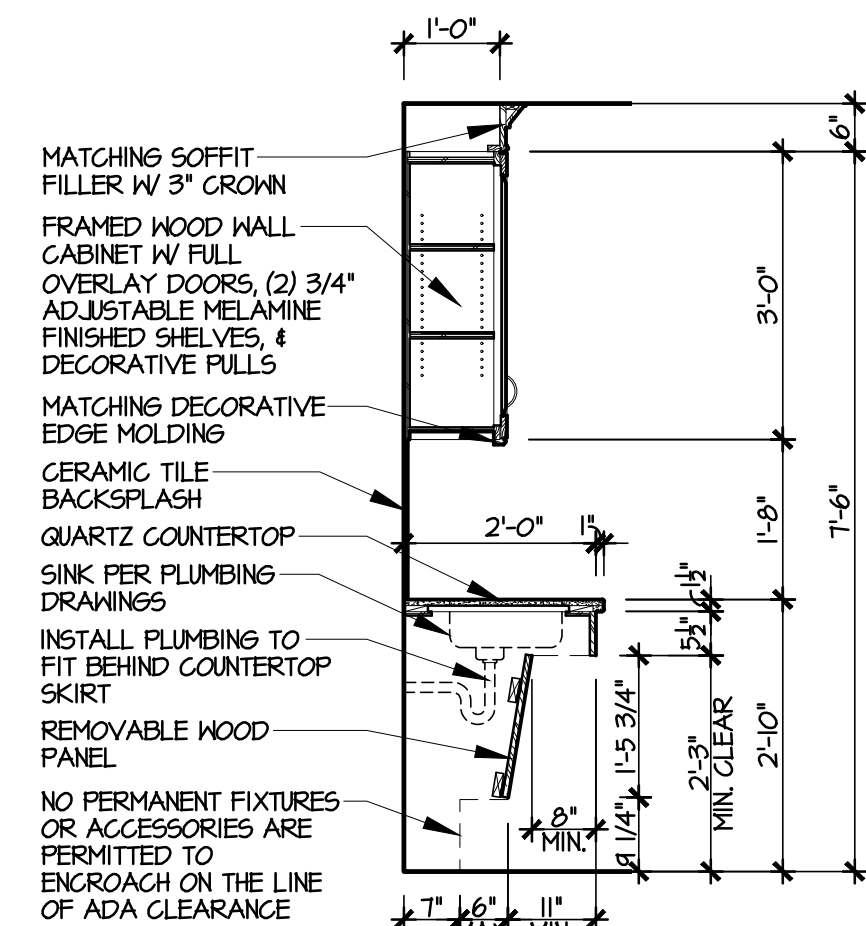


3
FULL OVERLAY LOBBY
CABINET SECTION
SCALE: 1/2"=1'-0"

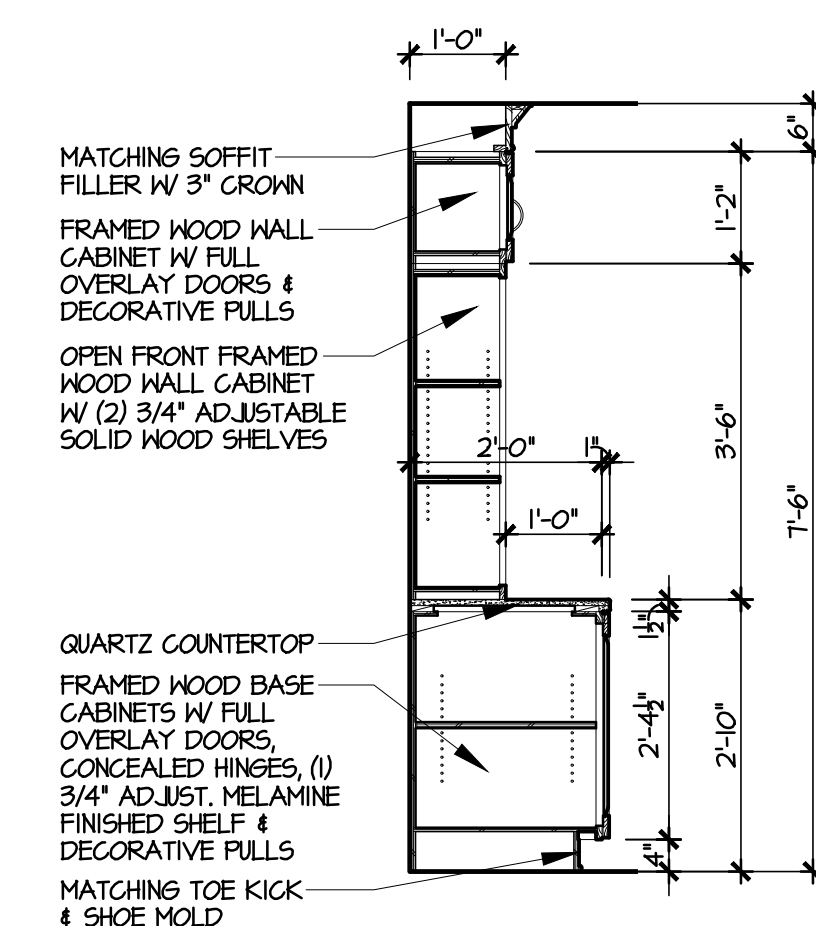


4
FULL OVERLAY LOBBY
CABINET SECTION
SCALE: 1/2"=1'-0"

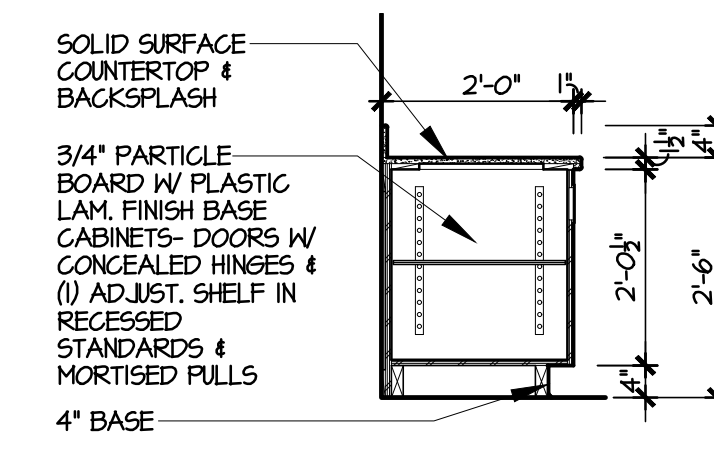


5
BASE
CABINET SECTION
SCALE: 1/2"=1'-0"

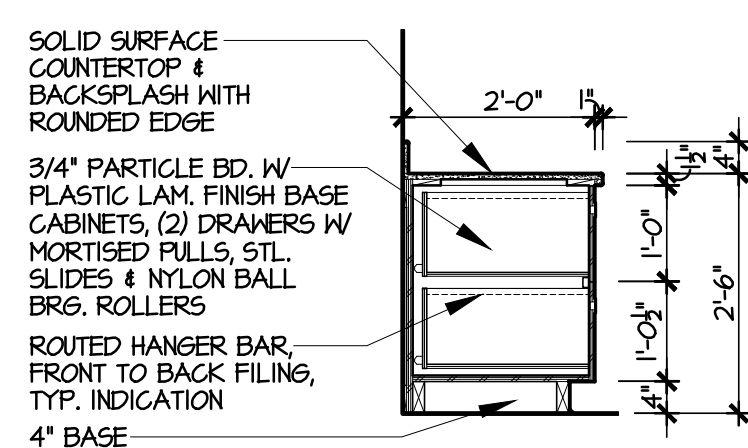


6
CABINET SECTION
SCALE: 1/2"=1'-0"

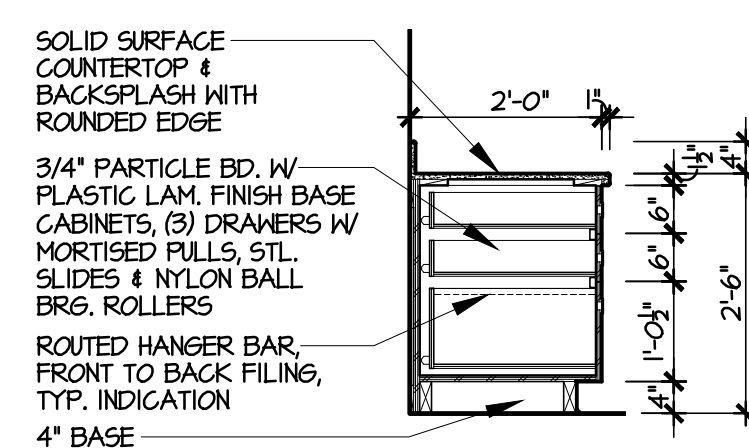


7
BASE
CABINET SECTION
SCALE: 1/2"=1'-0"

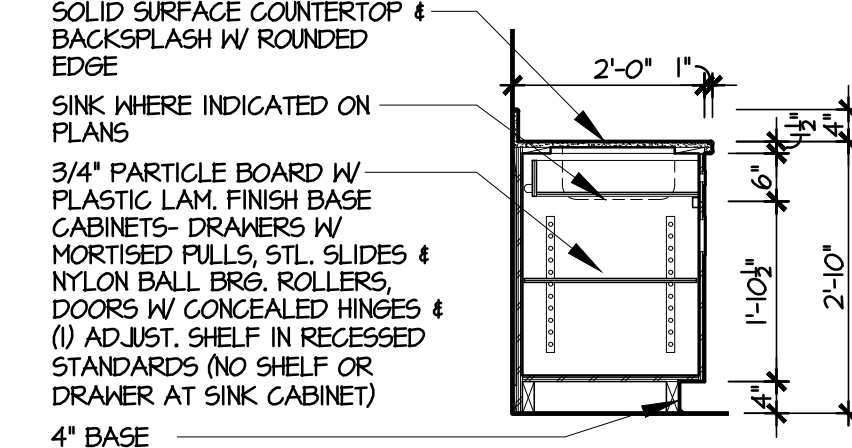


8
BASE
CABINET SECTION
SCALE: 1/2"=1'-0"

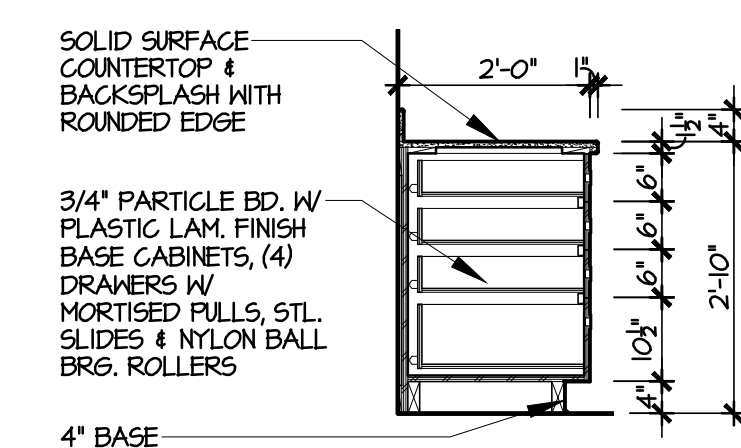


9
BASE
CABINET SECTION
SCALE: 1/2"=1'-0"

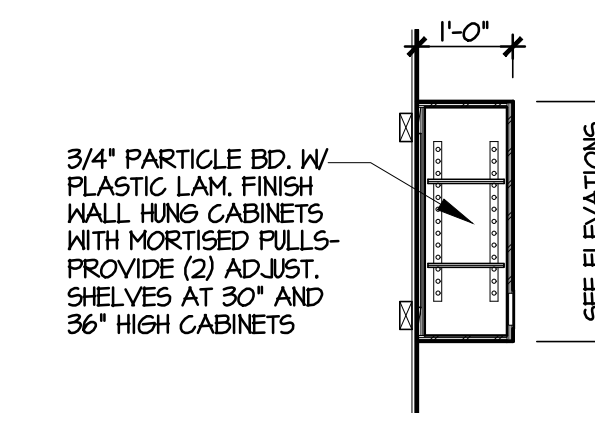


10
UPPER
CABINET SECTION
SCALE: 1/2"=1'-0"

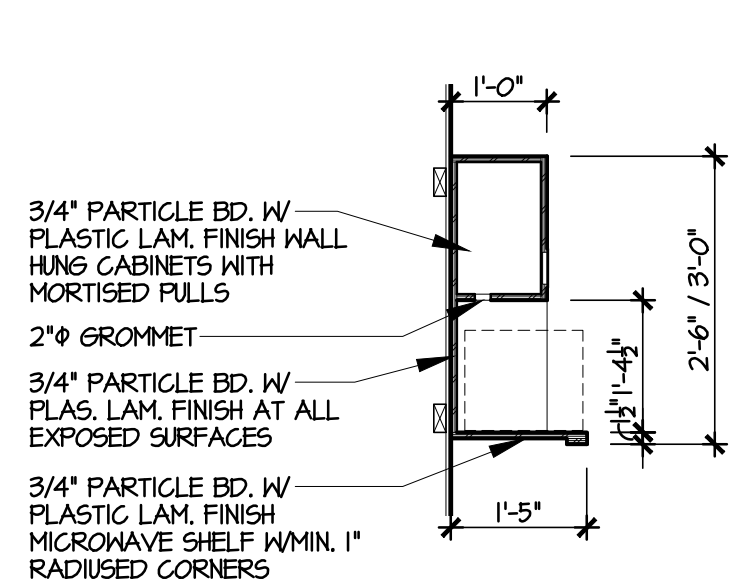


11
UPPER
CABINET SECTION
SCALE: 1/2"=1'-0"

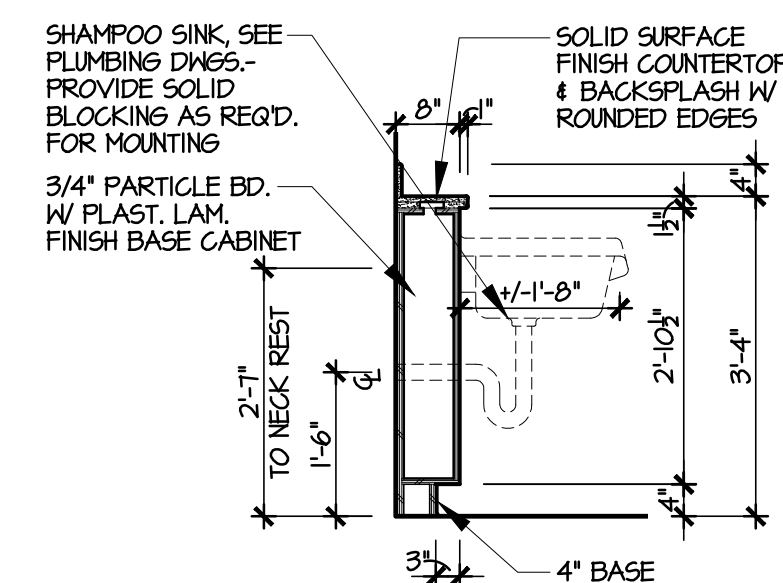


12
SALON
CABINET SECTION
SCALE: 1/2"=1'-0"

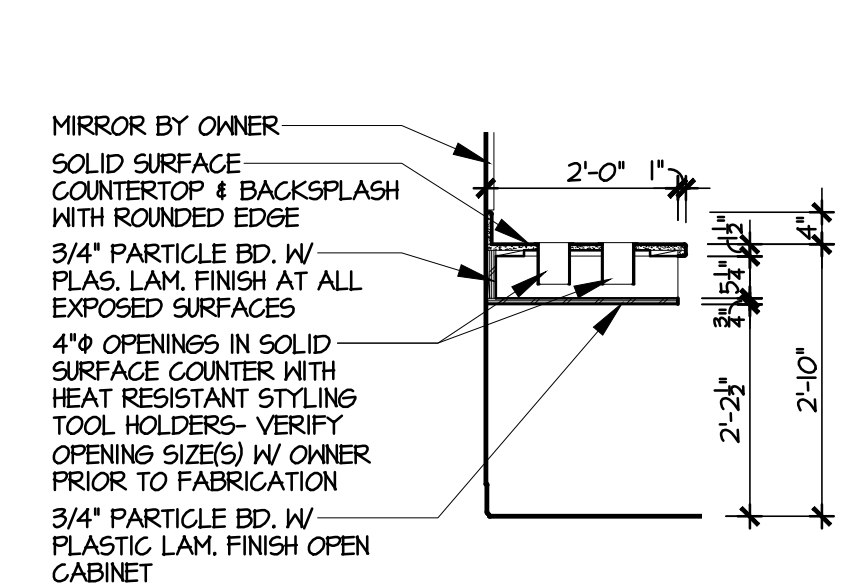


14
SALON
CABINET SECTION
SCALE: 1/2"=1'-0"

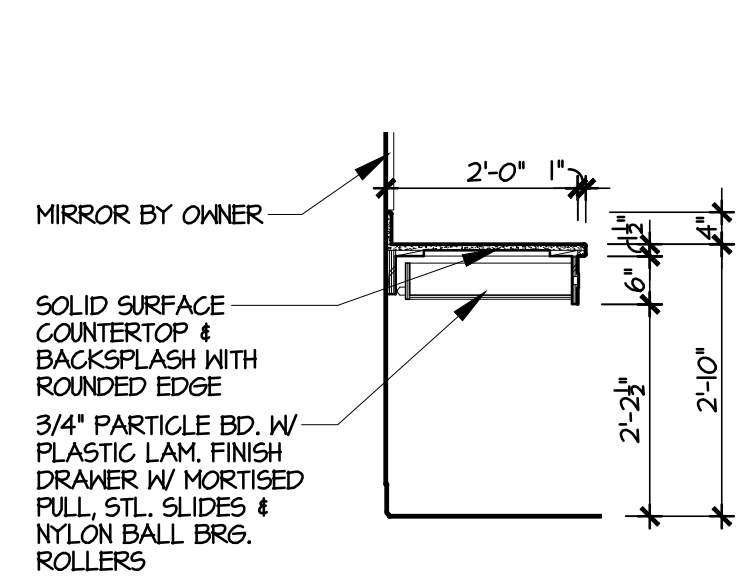


15
SALON
CABINET SECTION
SCALE: 1/2"=1'-0"

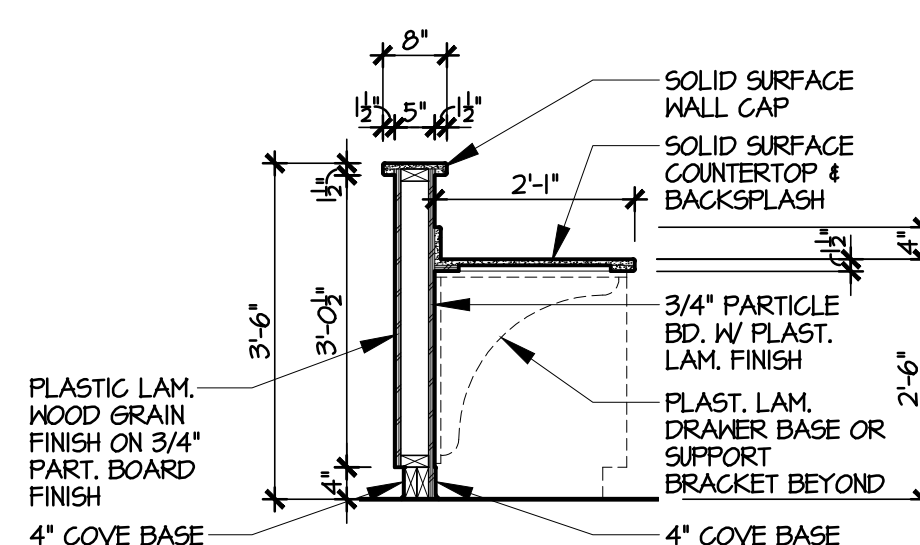


16
NURSE STATION
CABINET SECTION
SCALE: 1/2"=1'-0"

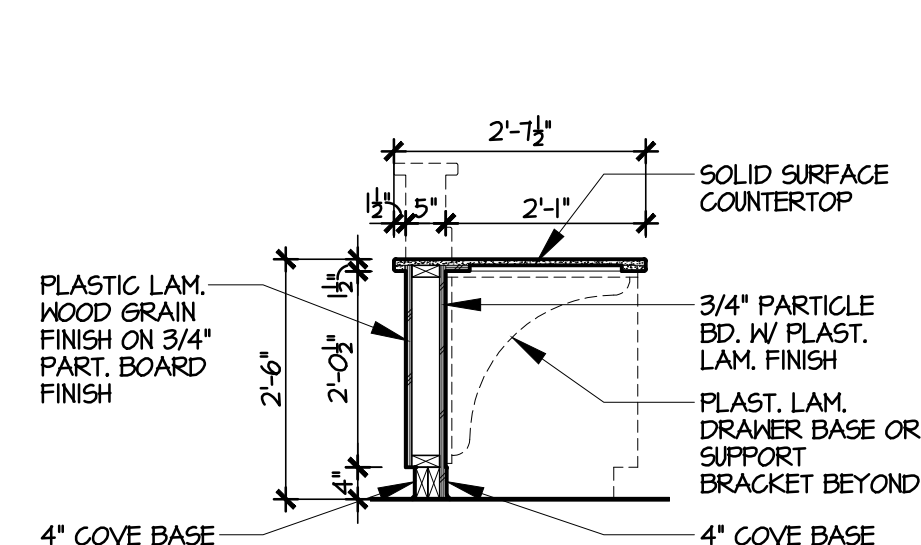

17
NURSE STATION
CABINET SECTION
SCALE: 1/2"=1'-0"

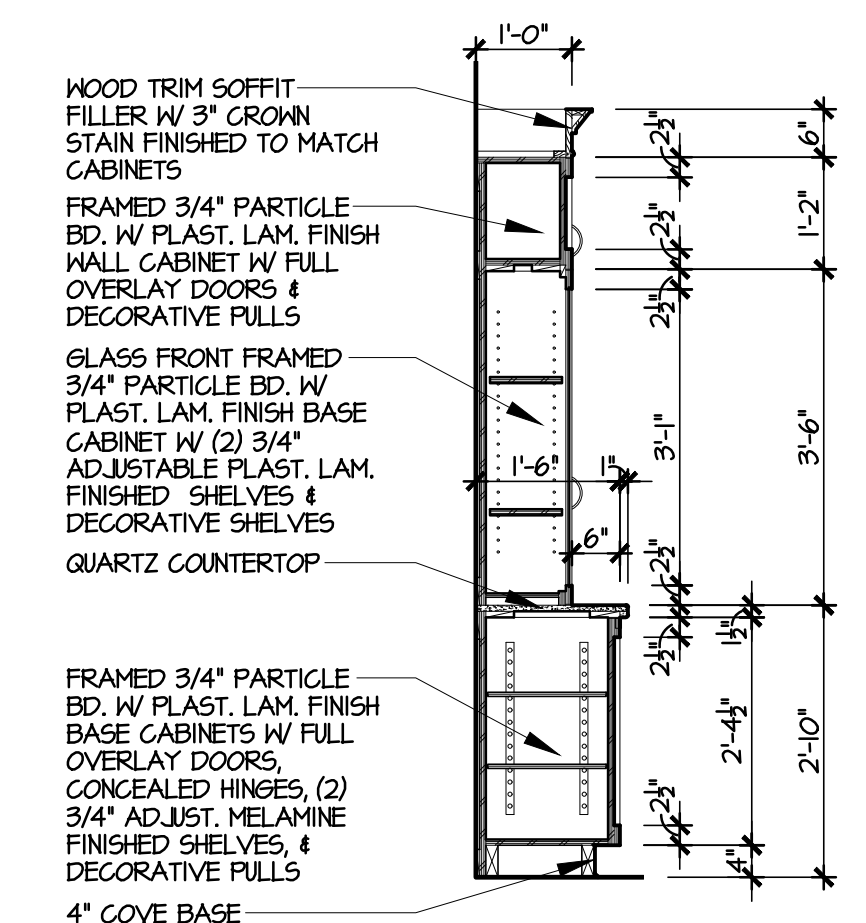









18
SERVERY
CABINET SECTION
SCALE: 1/2"=1'-0"

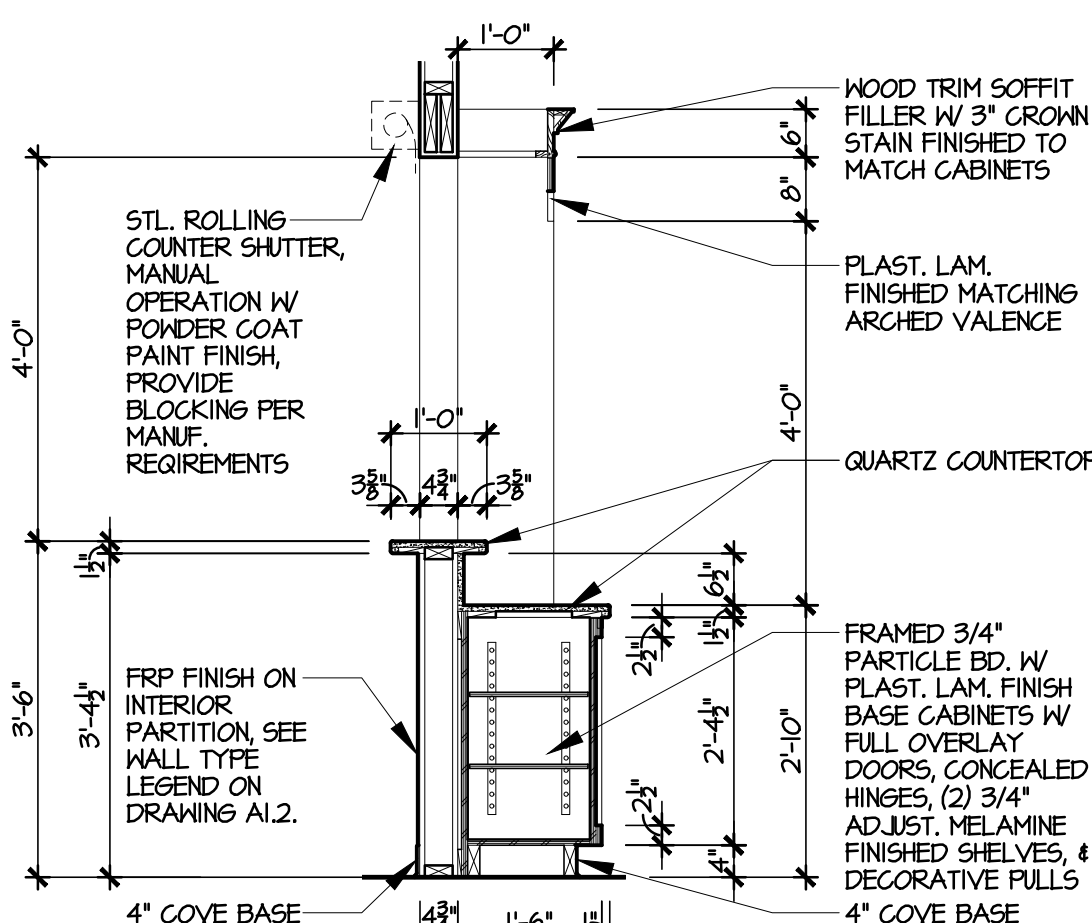

19
SERVERY
CABINET SECTION
SCALE: 1/2"=1'-0"

CASEWORK NOTES




- CONTRACTOR TO FIELD VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO CABINET CONSTRUCTION.
- PROVIDE MOISTURE RESISTANT PARTICLE BOARD (MR) AT ALL COUNTERTOPS WITH SINKS/LAYS.
- LOBBY #C04 TO BE FRAMED WOOD CABINETS. WOOD SPECIES/FINISH AS SELECTED BY OWNER.
- PLASTIC LAMINATE FINISHES TO BE HILSONART, NEVAMAR, FORMICA, PIONITE OR EQUAL. SEE INTERIOR FINISH SPECIFICATIONS ON DWG. A1.1.
- CONSTRUCTION OF SHOP FABRICATED CABINETS TO BE PLASTIC LAMINATE FINISH ON HIGH DENSITY 3/4" PARTICLE BOARD WITH BALANCED CONSTRUCTION BOTH SIDES AND EDGES.
 - DOOR HINGES: CONCEALED FLUSH OVERLAY
 - DOOR/DRAWER EDGES: SQUARE EDGE P. LAM. TO MATCH EXT.
 - FULL STYLE: RECESSED MORTISED PULLS TYP., DECORATIVE MORTISED PULLS AT LOBBY #C04 AND DINING #522 & N22
 - DRAWER SLIDES: SIDE MOUNT DRAWER
 - BOX FINISH: MELAMINE/PLASTIC EDGES
 - OPEN INTERIOR: PLASTIC LAMINATE FINISH
 - CLOSED INTERIOR: MELAMINE WITH MATCHING BACK
 - EXPOSED SIDE: PLASTIC LAMINATE FINISH TOP/BOTTOM
 - EXTERIOR: PLASTIC LAMINATE FINISH
 - SHELF EDGE: EDGES FINISHED WITH STANDARD PLASTIC EDGE
 - TOE BASE: 3" FRONT / 2" SIDE RECESS KICK FOR BASE
 - LOCKS: REAR SURFACE MOUNT BRASS CYLINDER LOCKS WITH THROWN PLATES & KEYS IN FINISH TO MATCH PULLS- VERIFY QUANTITY AND LOCATION WITH OWNER.
 - BEVELED EDGE AT ALL OUTSIDE CORNERS
 - PROVIDE SILENCERS ON ALL CABINETS AND DOORS.
- CONTRACTOR TO SUBMIT SHOP DRAWINGS TO ARCHITECT FOR APPROVAL PRIOR TO CABINET CONSTRUCTION.
- ALL APPLIANCES TO BE SUPPLIED BY OWNER AND ALL FIXTURES TO BE PROVIDED BY CONTRACTOR, TYPICAL, UNLESS NOTED OTHERWISE- VERIFY WITH OWNER.
- VERIFY CLEARANCE REQUIREMENTS FOR ANY APPLIANCES /PLUMBING/EQUIPMENT W/ MANUFACTURERS REQUIREMENTS.
- G.G. TO PROVIDE ALL CONCEALED WOOD BLOCKING NECESSARY FOR MILLWORK INSTALLATION. COORDINATE LOCATIONS W/ MILLWORK CONTRACTOR.
- ALL SOLID SURFACE COUNTERTOPS TO HAVE ROUNDED/BULLNOSE EDGES, INCLUDING BACKSPASHES AND SIDESPLASHES. PROVIDE 1/2" MIN. RADIUS ON OUTSIDE CORNERS OF ALL COUNTERTOPS.

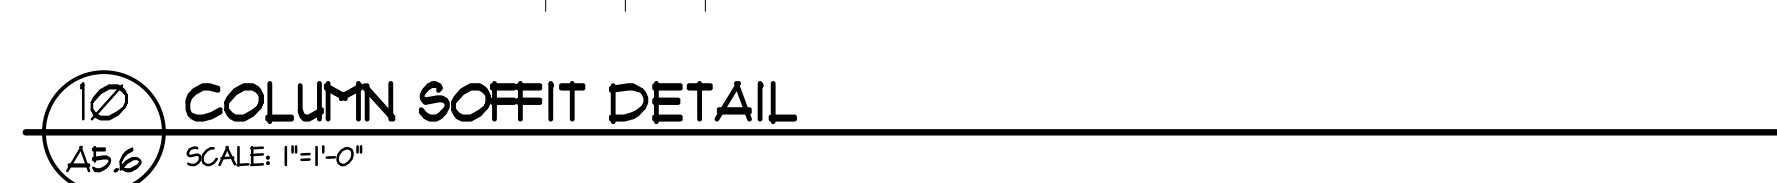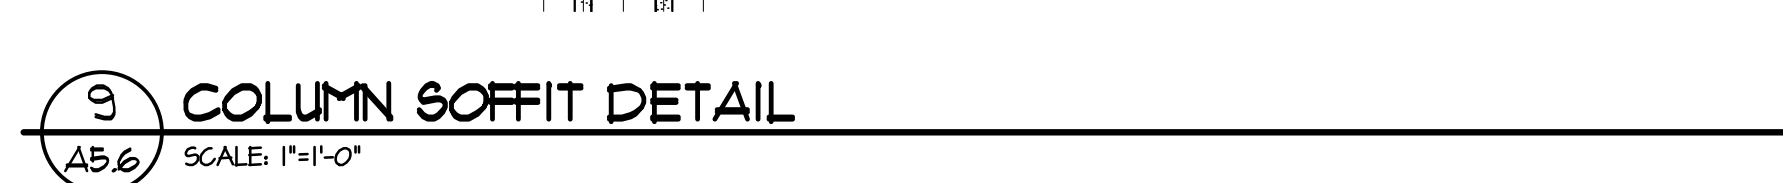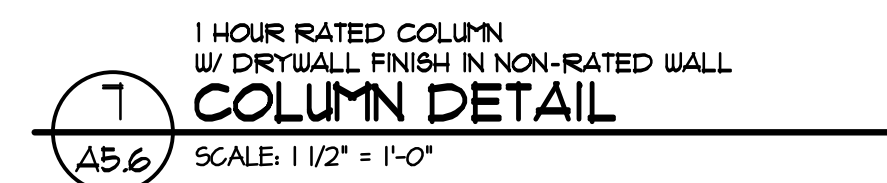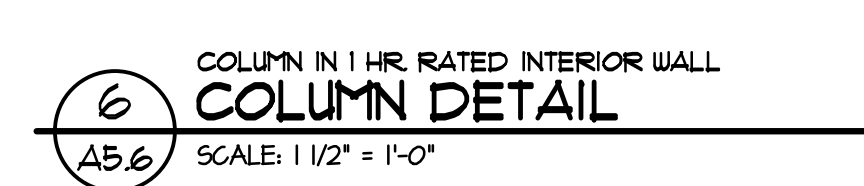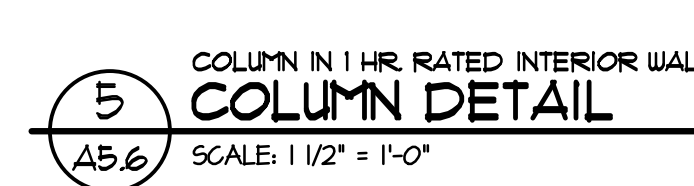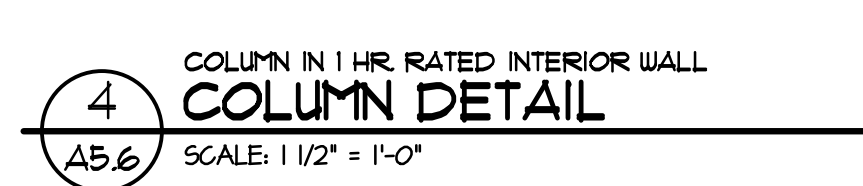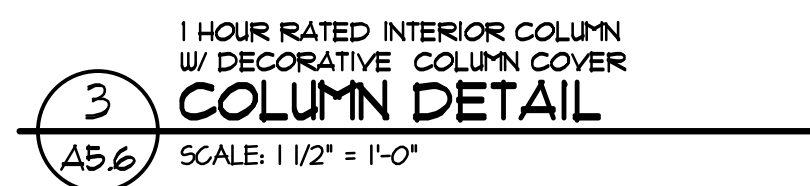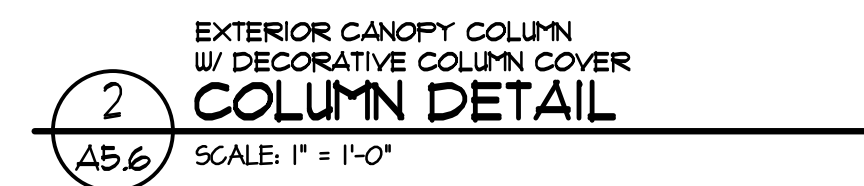


12
A5.6

SOFFIT DETAIL

SCALE: 1"=1'-0"

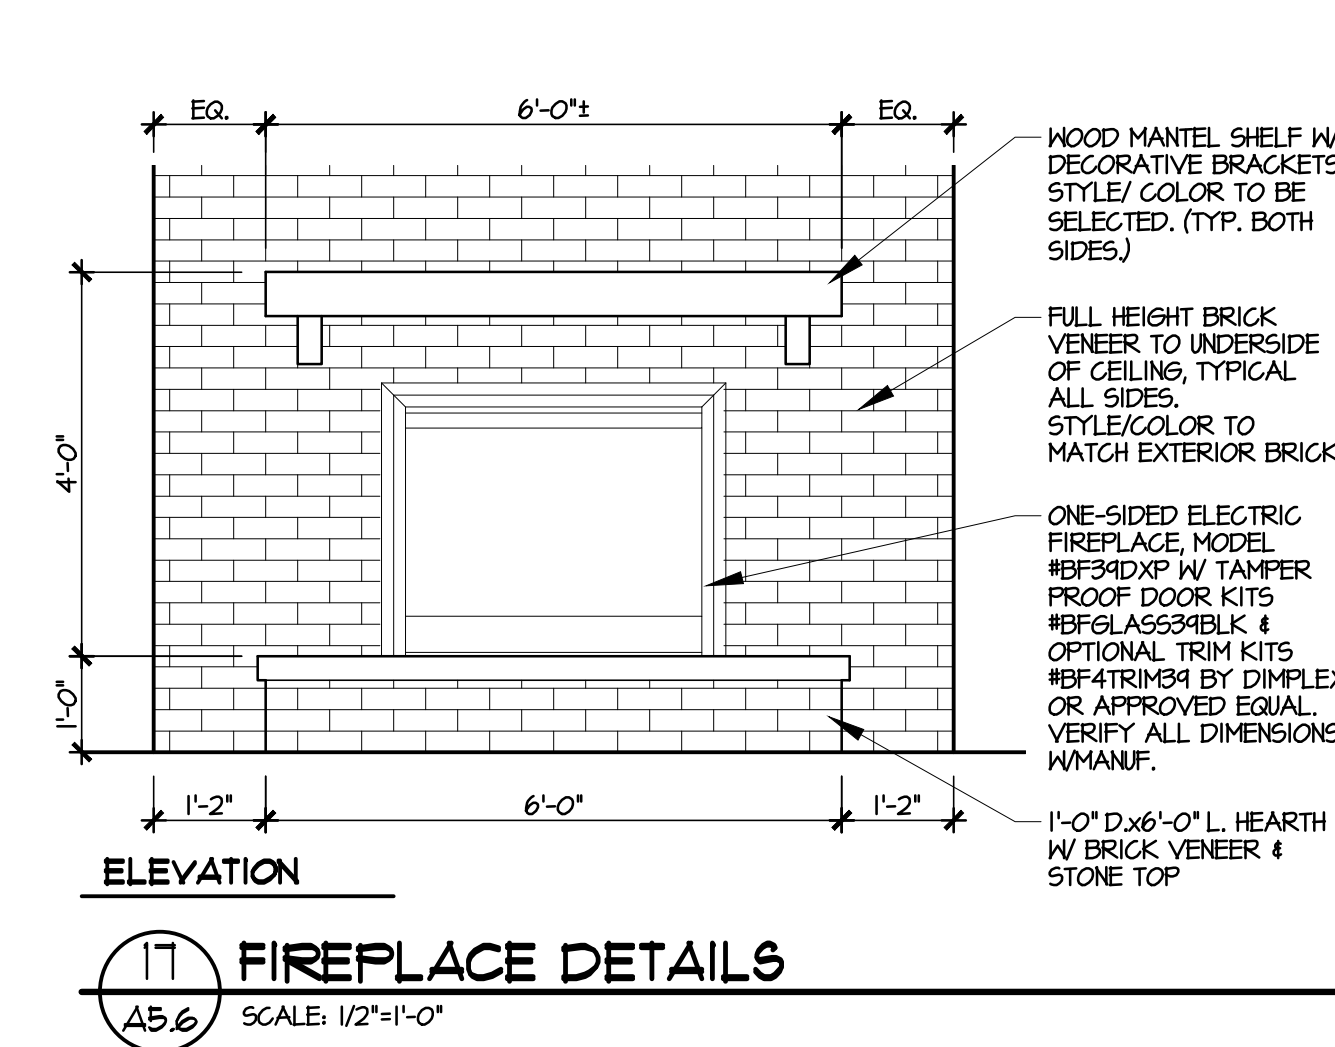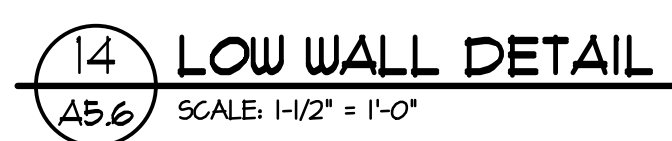


DOOR SCHEDULE											
	NO.	TO / FROM	DOOR SIZE	TYPE	JAMB	MATERIAL	FRAME	GLASS	RATING	HQNE	REMARKS
BUILDING - CENTER	C01	EXTERIOR / VESTIBULE	10'-0"x7'-0"	A	-	ALUM./GL.	ALUM.	FULL	-	(1)	FULL GLASS AUTOMATIC SLIDING DOORS
	C02	VESTIBULE / RECEPTION	10'-0"x7'-0"	A	-	ALUM./GL.	ALUM.	FULL	-	(1)	FULL GLASS AUTOMATIC SLIDING DOORS
	C03	CONFERENCE / RECEPTION	P.R. 3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	FULL	-	(14)	
	-	-	-	-	-	-	-	-	-		
	C05	W. RESTROOM / LOBBY	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(8)	UNDERCUT DOOR 3/4"
	C06	M. RESTROOM / LOBBY	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(8)	UNDERCUT DOOR 3/4"
	C07	PHYSICAL THERAPY / LOBBY	PR. 3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	FULL	-	(14)	SEE DWG. A6.2 FOR SIDELITES (BL-3)
	C08	STORAGE / PHYS. THERAPY	PR. 3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(10)	1-HR RATED ROOM ENCLOSURE
	-	-	-	-	-	-	-	-	-		
	C10	CLOSET / KITCHENETTE	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(5)	
	C11	BATH / KITCHENETTE	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(7)	UNDERCUT DOOR 3/4"
	C12	CLOSET / PHYSICAL THERAPY	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(5)	
	-	-	-	-	-	-	-	-	-		
	-	-	-	-	-	-	-	-	-		
	C15	OFFICE / OFFICE	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	-	-	-	-	-	-	-	-	-		
	C17	STORAGE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(10)	1-HR RATED ROOM ENCLOSURE
	C18	MAINTENANCE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(16)	1-HR RATED ROOM ENCLOSURE
	C19	CORRIDOR / CORRIDOR	PR. 3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(15)	
	C20	CORRIDOR / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(6)	
	C21	CORRIDOR / RECEPTION	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	FULL	-	(6)	SEE DWG. A6.2 FOR SIDELITES (BL-2)
	C22	ADMIN. OFFICE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C23	OFFICE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C24	OFFICE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C25	RESTROOM / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(8)	UNDERCUT DOOR 3/4"
	C26	OFFICE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C27	OFFICE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C28	OFFICE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C29	OFFICE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C30	SALON / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	FULL	-	(6)	
	C31	OFFICE / ACTIVITY	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30	-	(5)	
	C32	ACTIVITY / CORRIDOR	P.R. 3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	FULL	-	(14)	SEE DWG. A6.2 FOR SIDELITES (BL-5)
	C33	STORAGE / ACTIVITY	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(5)	1-HR RATED ROOM ENCLOSURE
	C34	WATER / STORAGE	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(16)	1-HR RATED ROOM ENCLOSURE
	C35	EXTERIOR / CORRIDOR	3'-8"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	C36	ELECTRICAL / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(6)	1-HR RATED ROOM ENCLOSURE
	C36a	EXTERIOR / ELECTRICAL	3'-0"x7'-0"	C	1	HOL. MTL.	HOL. MTL.	-	45 MIN.	(14)	1-HR RATED ROOM ENCLOSURE, INSULATED
	C37	LOUNGE / CORRIDOR	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	-	(12)	
	C38	EXTERIOR / CORRIDOR	4'-0"x7'-0"	C	1	HOL. MTL.	HOL. MTL.	-	-	(4)	INSULATED
	C39	LAUNDRY / CORRIDOR	3'-6"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(13)	1-HR RATED ROOM ENCLOSURE
	C39a	LAUNDRY / LAUNDRY	3'-6"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	-	(13)	
	C40	LAUNDRY / CORRIDOR	3'-6"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(13)	1-HR RATED ROOM ENCLOSURE
	C41	LINEN / LAUNDRY	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	-	(11)	
	C42	MAINTENANCE / LINEN	2'-6"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	-	(13)	
	C43	STORAGE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(5)	
	C44	RESTROOM / CORRIDOR	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	-	(7)	UNDERCUT DOOR 3/4"
	C45	JANITOR / CORRIDOR	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(9)	1-HR RATED ROOM ENCLOSURE / 16x12 LOUVER W/ FUSIBLE LINK
	C46	HAZARDOUS MAT. / CORRIDOR	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(16)	1-HR RATED ROOM ENCLOSURE
	C47	FIRE PUMP / CORRIDOR	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(16)	1-HR RATED ROOM ENCLOSURE
	C48	STORAGE / CORRIDOR	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(6)	1-HR RATED ROOM ENCLOSURE
	C49	OXYGEN / CORRIDOR	4'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(6)	1-HR RATED ROOM ENCLOSURE
	C50	OFFICE / KITCHEN	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	6x30	-	(5)	
	-	-	-	-	-	-	-	-	-		
	C52	KITCHEN / CORRIDOR	3'-6"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(13)	1-HR RATED ROOM ENCLOSURE
	C53	KITCHEN / CORRIDOR	3'-6"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(13)	1-HR RATED ROOM ENCLOSURE
	C54	DRY STORAGE / KITCHEN	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	-	(13)	

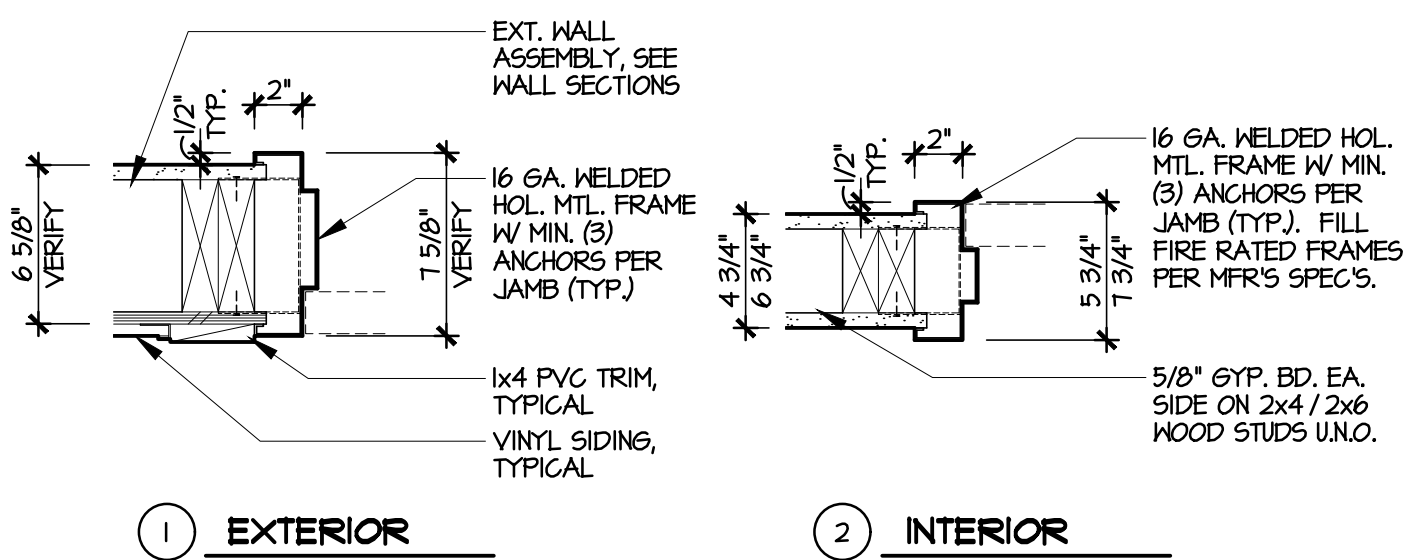

TYPICAL
DOOR JAMBS TYPES
SCALE: 1 1/2" = 1'-0"

DOOR SCHEDULE											
	NO.	TO / FROM	DOOR SIZE	TYPE	JAMB	MATERIAL	FRAME	GLASS	RATING	HQNE	REMARKS
BUILDING - SOUTH WING	S01	EXTERIOR / CORRIDOR	3'-8"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	S02	CORRIDOR / CORRIDOR	P.R. 3'-10"x7'-6"	D	2	S.G. LAM.	HOL. MTL.	3x33" FG	90 MIN.	(3A)	SMOKE TIGHT W/ FIRE GLASS LITES
	-	-	-	-	-	-	-	-	-		
	S04	EXTERIOR / CORRIDOR	3'-8"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	S05	EXTERIOR / LOUNGE	3'-0"x7'-0"	G	-	FIBERGLASS	COMPOSITE	FULL	-	(18)	COMPATIBLE W/ WINDOW FRAMING
	S06	CORRIDOR / CORRIDOR	P.R. 3'-10"x7'-6"	E	2	S.G. LAM.	HOL. MTL.	3x33"	20 MIN.	(3)	SMOKE TIGHT
	S07	I.T. / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(17)	16"x12" LOUVERED VENT W/ FUSIBLE LINK
	S08	STORAGE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(10)	
	S09	SPA / CORRIDOR	3'-8"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(7)	
	S10	SUPPLY / LINEN	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(6)	
	S11	LINEN / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(6)	
	S12	EXTERIOR / CORRIDOR	3'-8"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	-	-	-	-	-	-	-	-	-		
	S14	SOILED UTILITY / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(6)	
	S15	MECHANICAL / SOILED UTILITY	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(16)	
	S16	CHARTS / OFFICE	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(4)	
	S17	OFFICE / WORK	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30"	-	(5)	
	-	-	-	-	-	-	-	-	-		
	S19	RESTROOM / WORK	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(7)	UNDERCUT DOOR 3/4"
	S20	MEDS / WORK	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(17)	KEYED DIFFERENT, NO MASTER
	S21	CORRIDOR / CORRIDOR	P.R. 3'-10"x7'-6"	D	2	S.G. LAM.	HOL. MTL.	3x33"	20 MIN.	(3)	SMOKE TIGHT
	S22	EXTERIOR / DINING	3'-0"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	S23	SERVERY / DINING	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(4)	KICK DOWN HOLD-OPEN
BUILDING - NORTH WING	N01	CORRIDOR / CORRIDOR	P.R. 3'-10"x7'-6"	D	2	HOL. MTL.	HOL. MTL.	3x33"	20 MIN.	(2)	INSULATED
	N02	-	-	-	-	-	-	-	-	(3A)	SMOKE TIGHT W/ FIRE GLASS LITES
	N03	EXTERIOR / CORRIDOR	3'-8"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-		
	N04	EXTERIOR / LOUNGE	3'-0"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	-	-	-	-	-	-	-	-	-	(18)	COMPATIBLE W/ WINDOW FRAMING
	N06	CORRIDOR / CORRIDOR	P.R. 3'-10"x7'-6"	D	2	HOL. MTL.	HOL. MTL.	3x33"	20 MIN.	(3)	SMOKE TIGHT
	N07	I.T. / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(17)	16"x12" LOUVERED VENT W/ FUSIBLE LINK
	N08	STORAGE / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(10)	
	N09	SPA / CORRIDOR	3'-8"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(7)	
	N10	SUPPLY / MEDS	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(6)	
	N11	LINEN / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(6)	
	N12	EXTERIOR / CORRIDOR	3'-8"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	-	-	-	-	-	-	-	-	-		
	N14	SOILED UTILITY / CORRIDOR	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	45 MIN.	(6)	
	N15	MECHANICAL / SOILED UTILITY	3'-0"x6'-8"	D	2	HOL. MTL.	HOL. MTL.	-	45 MIN.	(16)	
	N16	CHARTS / OFFICE	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(4)	
	N17	OFFICE / WORK	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	6x30"	-	(5)	
	-	-	-	-	-	-	-	-	-		
	N19	RESTROOM / WORK	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(7)	UNDERCUT DOOR 3/4"
	N20	MEDS. / WORK	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(17)	KEYED DIFFERENT, NO MASTER
	N21	CORRIDOR / CORRIDOR	P.R. 3'-10"x7'-6"	D	2	HOL. MTL.	HOL. MTL.	3x33"	20 MIN.	(3)	SMOKE TIGHT
	N22	EXTERIOR / DINING	3'-0"x7'-0"	B	-	ALUM./GL.	ALUM.	FULL	-	(2)	INSULATED
	N23	SERVERY / DINING	3'-0"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-	(4)	KICK DOWN HOLD-OPEN
RES. RM.	A	3'-8"x6'-8"	E	2	S.G. LAM.	HOL. MTL.	-	-		(A)	SMOKE TIGHT, 42" MIN. CLEAR OPENING
	B	3'-0"x6'-10"	E	3	S.G. LAM.	HOL. MTL.	-	-		(B)	SLIDING BARN DOOR- SEE JAMB TYPE-3

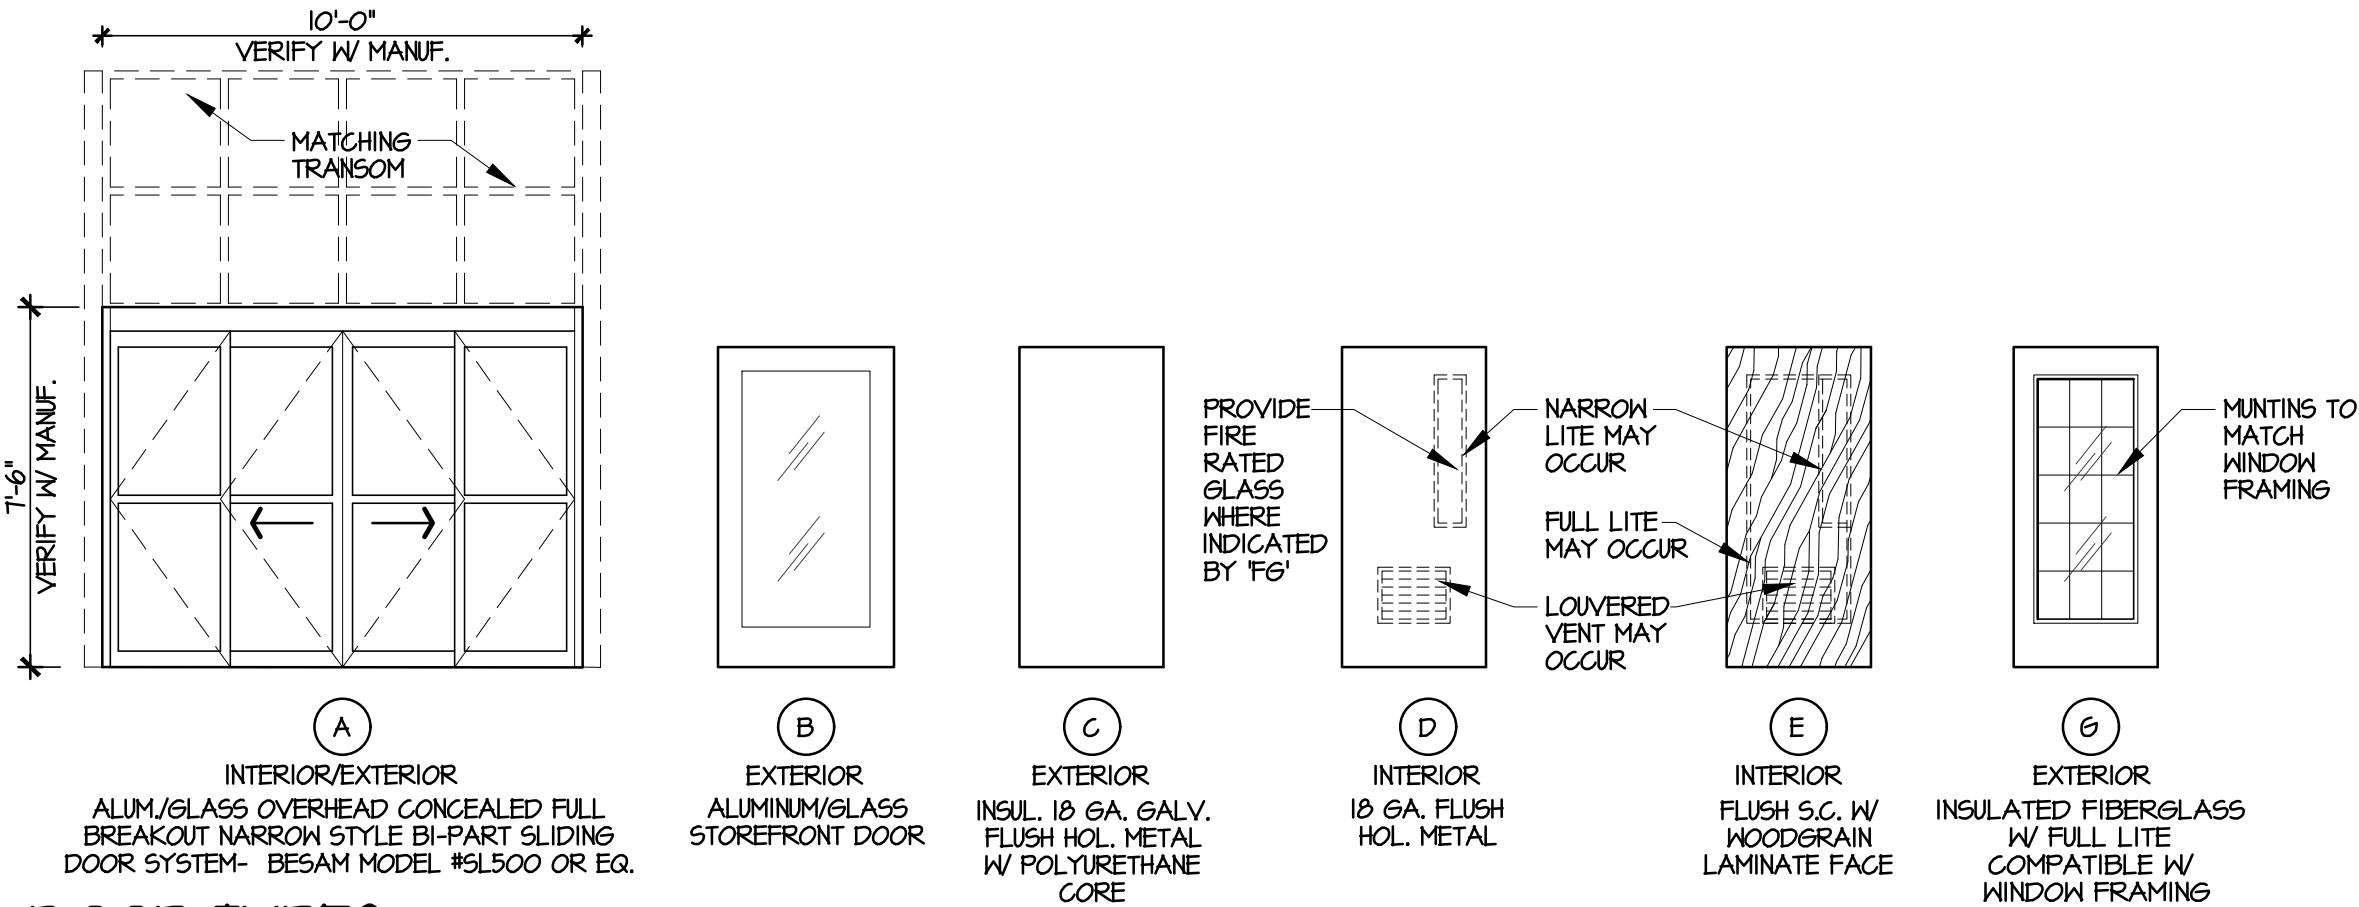

DOOR TYPES
SCALE: 1/4" = 1'-0"

DOOR & HARDWARE NOTES

- CYLINDRICAL LOCKSETS TO BE ANSI/BHMA GRADE 1 SCHLAGE 'ATHENS' ND-SERIES IN SATIN NICKEL FINISH OR APPROVED EQUAL.
- MORTISE LOCKSETS TO BE ANSI/BHMA GRADE 1 SCHLAGE 'ATHENS' L-SERIES IN SATIN NICKEL FINISH OR APPROVED EQUAL.
- ALL HINGE BUTTS TO BE 4-1/2" x 4-1/2" FULL MORTISE, FIVE KNUCKLE, STANDARD WEIGHT, BALL BEARING HINGES W/ FINISH TO MATCH LOCKSETS. PROVIDE 1-1/2 PAIRS FOR DOORS UP TO 3'-0" WIDE & 7'-0" HIGH AND 2 PAIR FOR DOORS THAT ARE GREATER THAN 3'-0" WIDE & 7'-0" HIGH.
- ALL HARDWARE TO COMPLY W/ V.C.G. SECTION 1010.
- ALL DOORS FRAMES TO HAVE RUBBER DOOR SILENCERS.
- ALL EGRESS DOORS SHALL BE READILY OPERABLE FROM EGRESS SIDE WITHOUT THE USE OF KEY OR SPECIAL KNOWLEDGE. EGRESS DOORS WITH ACCESS CONTROL ON EGRESS SIDE TO BE CONNECTED TO FIRE ALARM SYSTEM AND UNLOCK IF FIRE ALARM SYSTEM ACTIVATES.
- GLASS IN DOORS & SIDE LITES TO BE MINIMUM 1/4" TEMPERED SAFETY GLASS.
- ALL HARDWARE AND INSTALLATION TO BE IN COMPLIANCE W/ CURRENT IIC (AIIJ) ACCESSIBILITY REQUIREMENTS WITH APPLICABLE V.C.G. CHAPTER II AMENDMENTS (IF ANY).
- ALL SHING DOORS TO RECEIVE WALL STOPS. IF CONDITIONS DO NOT PERMIT WALL STOP INSTALLATION, PROVIDE FLOOR STOP OR OVERHEAD STOP AS REQUIRED.
- ALL EXTERIOR HOLLOW METAL MAN DOORS TO HAVE TOP DROP CAP.
- COORDINATE ALL ELECTRONIC ACCESS CONTROLLED HARDWARE W/ OWNER'S SECURITY VENDOR.
- ALL EXTERIOR DOORS TO RECEIVE SECURITY CONTACTS/DEVICES AS PROVIDED BY OWNER'S SECURITY VENDOR. COORDINATE DOOR INSTALLATION AS REQUIRED.
- G.C. TO PROVIDE TACTILE, RAISED CHARACTER ACCESSIBLE SIGNAGE AT ALL EXIT DOORS, STAIRS AND REST ROOMS. SIGNAGE TO BE PLASTIC MOLDED IN COLOR TO BE SELECTED W/ CONTRASTING SYMBOLS & LETTERS, SIGNAGE TO BE COMPLIANT WITH ICG ANSI A117.1, AND INSTALLED

HARDWARE SPECIFICATIONS

SURFACE MTD. O.H. CLOSER -	LCN 4040XP OR APPROVED EQUAL
PUSH PLATE -	ROCKWOOD #10RCA OR APPROVED EQUAL. ADHESIVE INSTALLATION - NO EXPOSED FASTENERS, MOUNT W/ TOP @ +42" A.F.F.
KICK PLATE -	36" HIGH x DOOR WIDTH KICKPLATE. FINISH TO MATCH TYP. DOOR HARDWARE.
WALL OR FLOOR STOP -	ROCKWOOD #40B, #442 OR APPROVED EQ.
MAGNETIC LOCK -	'FAIL-SAFE' OVERHEAD ELECTRO-MAGNETIC LOCK. CONNECT FOR RELEASE UPON ACTIVATION OF FIRE ALARM & SPRINKLER SYSTEMS. DOORS TO REMAIN UNLOCKED UNTIL MANUALLY RESET.
ELECTRO-MAGNETIC HOLD-OPEN -	ELECTRO-MAGNETIC HOLD-OPEN. LCN #5EM7830 OR APPROVED EQUAL FOR RELEASE UPON ACTIVATION OF FIRE ALARM & SPRINKLER SYSTEMS
PUSH TO EXIT -	PUSH TO EXIT DEVICE TO RELEASE LOCK
RIM EXIT DEVICE -	PANIC BAR W/ 30 SECOND DELAY
REMOTE DOOR RELEASE -	PUSH BUTTON DOOR RELEASE. LOCATION TO BE DETERMINED BY OWNER. SEE ELEC. DRAWINGS FOR MORE INFORMATION
SLIDING BARN DOOR -	HAGER #9432 STAINLESS STEEL ROUND RAIL TOP-MOUNT HANGER





LOCK FUNCTIONS

PASSAGE LATCHSET
BOTH LEVERS ALWAYS UNLOCKED. INSIDE LEVER IS ALWAYS FREE FOR IMMEDIATE EGRESS.

PRIVACY LOCKSET
PUSH-BUTTON LOCKING. CAN BE UNLOCKED FROM OUTSIDE W/ SMALL SCREWDRIIVER. TURN INSIDE LEVER OR CLOSE DOOR TO RELEASE BUTTON. INSIDE LEVER ALWAYS FREE FOR IMMEDIATE EGRESS.

CLASSROOM LOCKSET
OUTSIDE LEVER IS LOCKED & UNLOCKED BY KEY. INSIDE LEVER IS ALWAYS UNLOCKED & FREE FOR IMMEDIATE EGRESS.

STOREROOM LOCKSET
OUTSIDE LEVER IS FIXED. ENTRANCE IS BY KEY ONLY. INSIDE LEVER IS ALWAYS UNLOCKED & FREE FOR IMMEDIATE EGRESS.

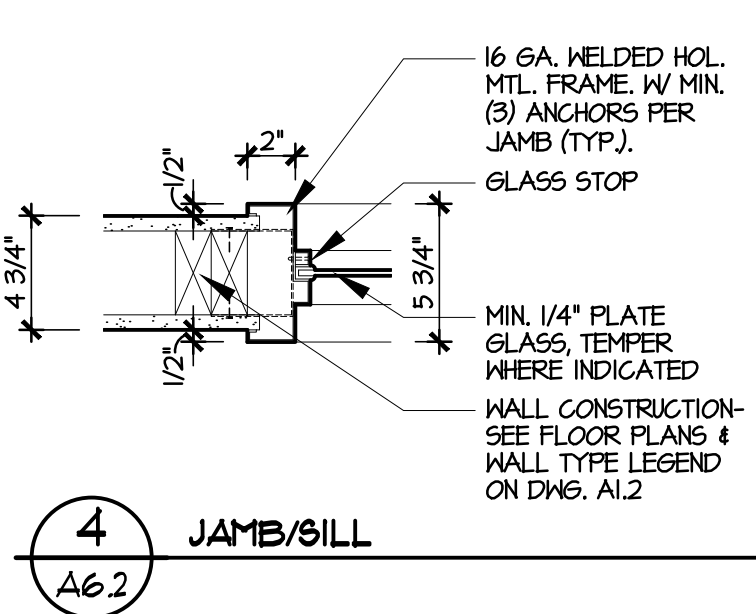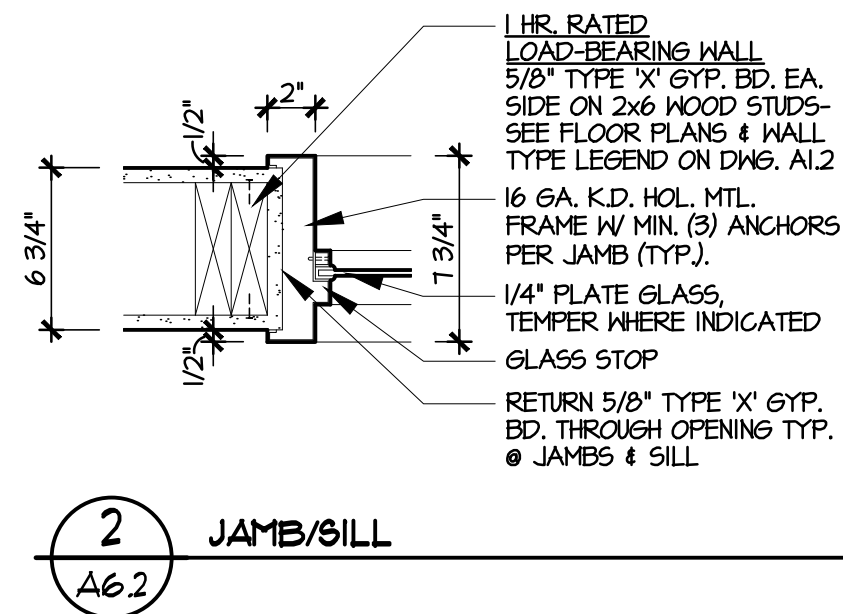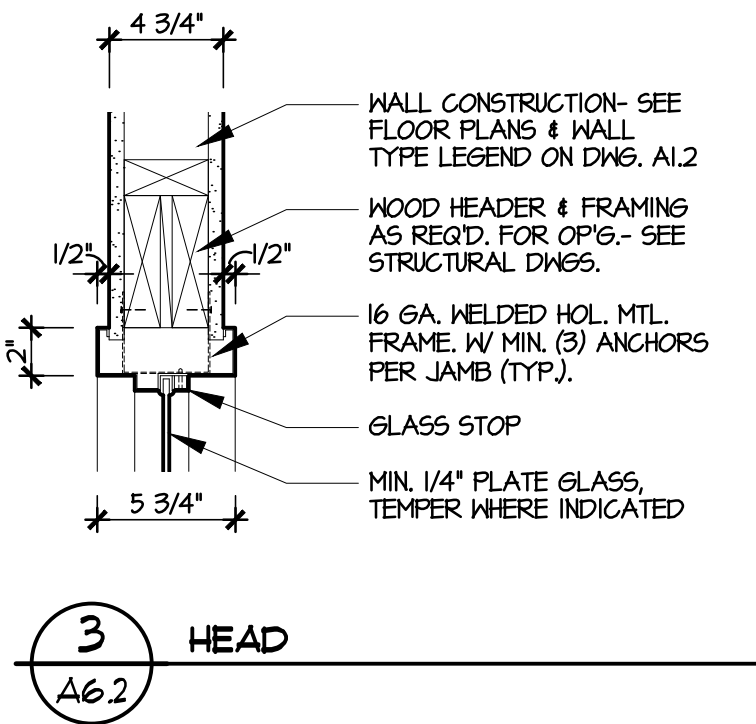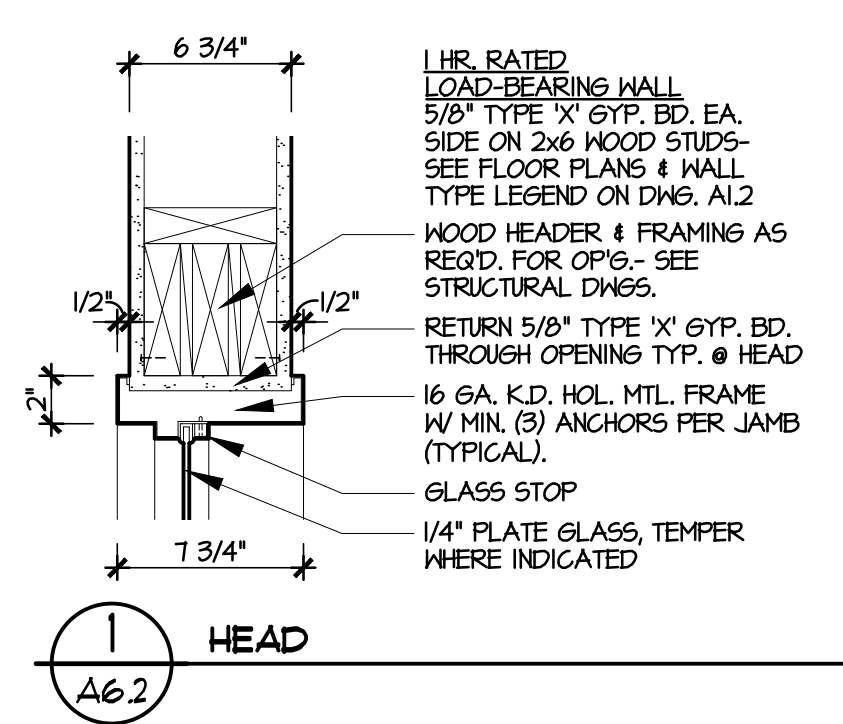


BORROWED LITE NOTES

- BORROWED LITE PANEL DESIGN TO BE THE RESPONSIBILITY OF THE GLASS CONTRACTOR. PANELS TO BE DESIGNED TO ACCOMMODATE INTERIOR LOADING REQUIREMENTS AS INDICATED IN THE V.C.C.
- GLASS CONTRACTOR TO MEASURE ALL FIELD CONDITIONS INCLUDING OPENINGS. IF FIELD CONDITIONS REQUIRE A CHANGE TO LAYOUT INDICATED, SUBMIT LAYOUT TO ARCHITECT FOR APPROVAL.
- HOLLOW METAL FRAMED BORROWED LITES TO BE FACTORY PRIMED AND FINISHED W/ MIN. (2) COATS SEMI-GLOSS FIELD APPLIED PAINT FINISH PER ROOM FINISH LEGEND ON DWG. A1.1.
- VERIFY ALL BORROWED LITE QUANTITIES PRIOR TO FABRICATION.
- * (1) * INDICATES TEMPERED GLASS IN THICKNESS AS REQUIRED FOR STRENGTH DUE TO SIZE; VERIFY W/ GLASS MANUF.

BORROWED LITE DETAILS

SCALE: 1/2"=1'-0"

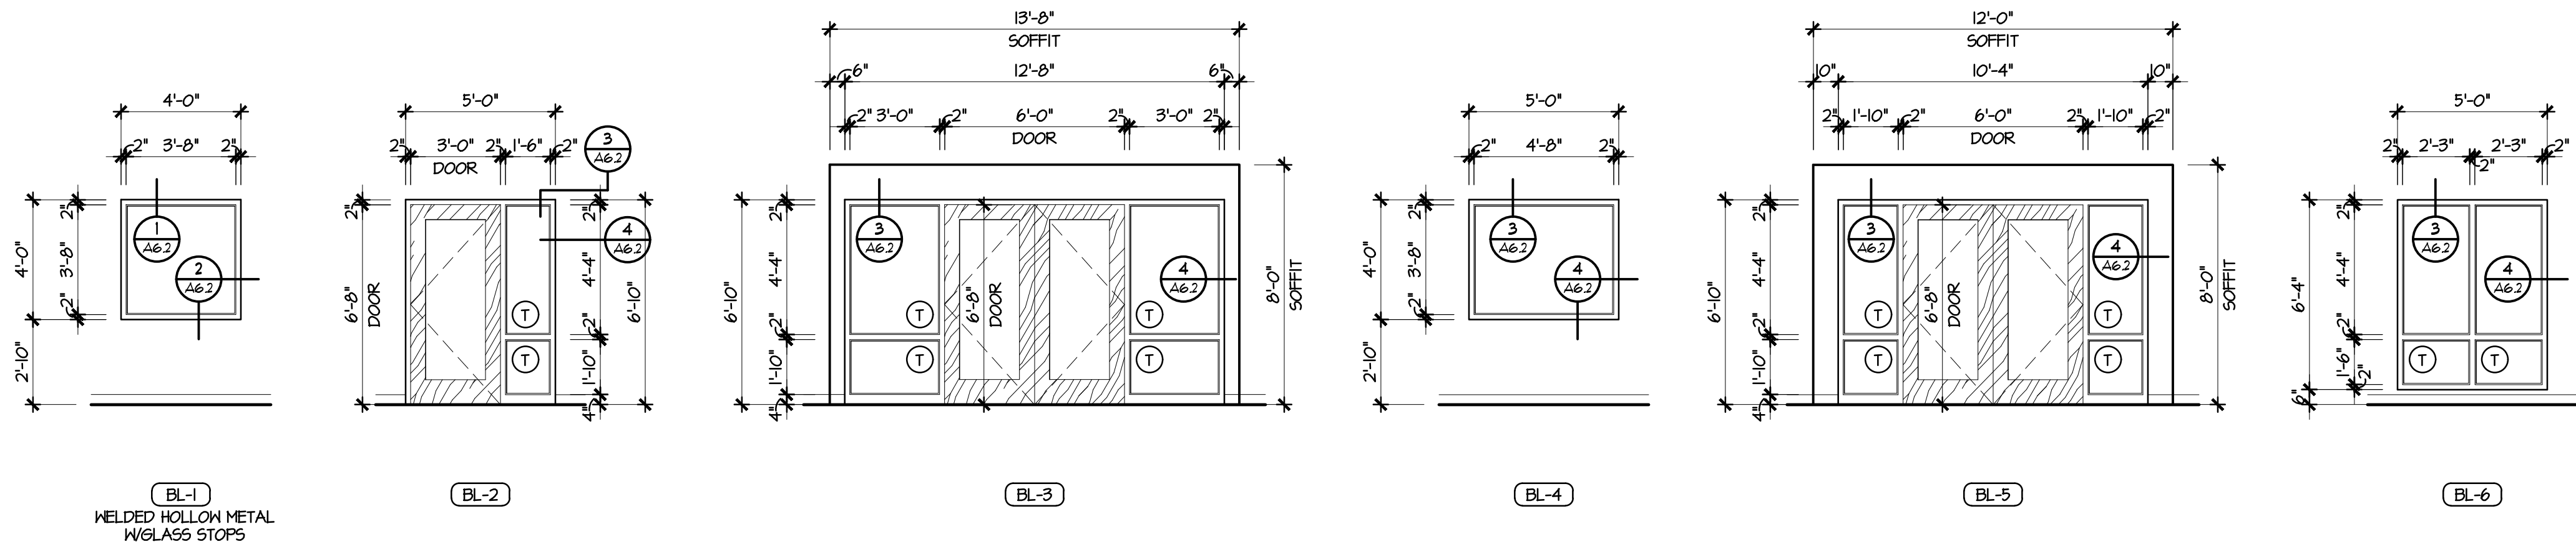

INTERIOR BORROWED LITES

SCALE: 1/4" = 1'-0"

INTERIOR ROOM FINISH SPECS.

FLOOR	
CPT-E	ENTRY CARPET TILE BY INTERFACE, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: TO BE SELECTED.
CPT-1	CARPET TILE BY INTERFACE, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: TO BE SELECTED.
CPT-2	CARPET TILE BY INTERFACE, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: TO BE SELECTED.
LVT-1	LUXURY VINYL PLANK BY KARLDEAN, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: TO BE SELECTED.
LVT-2	LUXURY VINYL PLANK BY KARLDEAN, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: TO BE SELECTED.
LVT-3	LUXURY VINYL PLANK BY KARLDEAN, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: TO BE SELECTED.
LVT-4	LUXURY VINYL PLANK BY KARLDEAN, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: TO BE SELECTED.
VCT	VINYL COMPOSITION TILE BY ARMSTRONGS OR EQUAL, INSTALLATION PER MANUFACTURER'S INSTRUCTIONS. STYLE/COLOR: STANDARD EXCELON IMPERIAL TEXTURE, TO BE SELECTED.
CT-1	CERAMIC TILE, THINSET INSTALLATION BY VIRGINIA TILE OR EQUAL. STYLE/COLOR: TO BE SELECTED. PROVIDE MIN. JOINT WIDTH AS RECOMMENDED BY MANUF. BUT NO GREATER THAN 1/8", W/MAFEI GROUT IN COLOR. TO BE SELECTED.
QT	QUARRY TILE, 6"x6" IN STACKED BOND, INSTALLATION BY VIRGINIA TILE OR EQUAL. STYLE/COLOR: TO BE SELECTED. PROVIDE MIN. JOINT WIDTH AS RECOMMENDED BY MANUF. BUT NO GREATER THAN 3/8", W/MAFEI GROUT IN COLOR. TO BE SELECTED.
CONC	EXPOSED CONCRETE SLAB. SEAL W/ EPOXY DIAMOND CLEAR' CURING & SEALING COMPOUND OR APPROVED EQUAL.
BASE	
RB	4" x 1/8" GAUGE RUBBER COVE BASE BY JOHNSONITE /TARKETT. COLOR: TO BE SELECTED. BID AS ADD ALTERNATE: JOHNSONITE MILLWORK RUBBER BASE IN "REVEAL" PROFILE FOR THE FOLLOWING ROOMS: CONFERENCE #C03, PHYSICAL THERAPY #C01, KITCHEN #C04, OFFICE #K14, SALON #C30, OFFICE #C31, ACTIVITY #C32, & ALL RESIDENT BEDROOMS. COLOR: TO BE SELECTED.
RB-P	JOHNSONITE / TARKETT MILLWORK RUBBER BASE IN "REVEAL" PROFILE. COLOR: TO BE SELECTED.
TB	6" HIGH CERAMIC TILE COVE BASE BY VIRGINIA TILE OR EQUAL - TILE AND GROUT TO MATCH ADJACENT FLOOR TILE. ALIGN GROUT JOINTS WITH FLOOR TILE.
QB	5" HIGH QUARRY TILE COVE BASE BY VIRGINIA TILE OR EQUAL - TILE & GROUT TO MATCH ADJACENT FLOOR TILE. ALIGN GROUT JOINTS WITH FLOOR TILE.
CB	4" HIGH CARPET BASE W/COORDINATING BOUND TOP EDGE TO MATCH ADJACENT CARPET.

WALLS	
P-X	(1) COAT INTERIOR LATEX PRIMER + (2) FINISH COATS, ZERO VOC LATEX EGGSHELL ENAMEL BY SHERWIN WILLIAMS OR EQUAL. COLOR(S) TO BE SELECTED. ASSUME 25% ACCENT WALLS.
PE-X	SINGLE COMPONENT SEMI-GLOSS EPOXY COATING BY SHERWIN WILLIAMS OR EQUAL, INSTALL PER MANUF. DIRECTIONS. COLOR(S) TO BE SELECTED.
BRICK	FULL HEIGHT BRICK VENEER BY HATSONTOWN BRICK OR APPROVED EQUAL, INSTALL PER MANUFACTURER'S RECOMMENDATIONS. COLOR: TO BE SELECTED. MORTAR COLOR: TO BE SELECTED.
CTB	CERAMIC TILE BACKSPLASH FROM TOP OF COUNTER TO UNDERSIDE OF UPPER CABINETS BY VIRGINIA TILE OR EQUAL. STYLE/COLOR: TO BE SELECTED. PROVIDE MIN. JOINT WIDTH AS RECOMMENDED BY MANUF. BUT NO GREATER THAN 1/8", W/MAFEI GROUT IN COLOR. TO BE SELECTED. SEE ENLARGED ELEVATIONS ON DRAWING A5.2.
CTW	CERAMIC TILE WALL FINISH TO MATCH ADJACENT FLOOR TILE & GROUT TO 6'-6" AFF. UNLESS OTHERWISE INDICATED. WAINSCOT GROUT JOINTS TO ALIGN WITH FLOOR GROUT JOINTS. SEE ENLARGED ELEVATIONS ON DRAWING A5.2.
CTF	FULL HEIGHT CERAMIC TILE WALL FINISH TO MATCH ADJACENT FLOOR TILE & GROUT. GROUT JOINTS TO ALIGN WITH FLOOR GROUT JOINTS. SEE ENLARGED ELEVATIONS ON DRAWING A5.2.
FRP	4'-0" HIGH FIBERGLASS REINFORCED POLYESTER PANEL WAINSCOT, .040" THICK BY MARLITE OR EQUAL. PROVIDE PANEL LENGTHS AS REQUIRED FOR VERTICAL SEAMS ONLY. PROVIDE ALL TRIM PIECES AS REQUIRED FOR COMPLETE JOB. COLOR: TO BE SELECTED.
RUP	ROLLED RIGID SHEET, "PALLADIUM" BY INPRO. INSTALL SO THAT THERE ARE NO HORIZONTAL SEAMS & MINIMIZE OR ELIMINATE VERTICAL SEAMS. PROVIDE ALL TRIM PIECES AS REQUIRED FOR COMPLETE JOB. COLOR: TO BE SELECTED. SEE DETAIL 15/A5.6.
VUC	TYPE II VINYL WALL COVERING BY SURFACE MATERIALS OR EQUAL. INSTALL PER MANUFACTURER'S RECOMMENDATIONS, INCLUDING SUBSTRATE PREPARATION. STYLE/COLOR: TO BE SELECTED.

CEILING	
SAT-1	24"x24" SUSPENDED ACOUSTIC CEILING TILE WITH ANGLED REGULAR EDGE IN EXPOSED 15/16" SUSPENSION GRID SYSTEM. "GIRBUS" BY ARMSTRONG OR APPROVED EQUAL.
SAT-2	24"x48" SUSPENDED ACOUSTIC CEILING TILE WITH ANGLED REGULAR EDGE IN EXPOSED 15/16" SUSPENSION GRID SYSTEM. "GIRBUS SECOND LOOK" BY ARMSTRONG OR APPROVED EQUAL.
SAT-3	24"x48"x15/16" EXPOSED TEE SUSPENSION SYSTEM W/ 24"x48"x5/8" SQUARE EDGE LAY-IN MINERAL FIBER CEILING TILE. "CORTEGA" BY ARMSTRONG OR APPROVED EQUAL.
SAT-W	24"x48"x15/16" EXPOSED TEE SUSPENSION SYSTEM W/ 24"x48"x5/8" SQUARE EDGE LAY-IN WASHABLE MINERAL FIBER CEILING TILE. "KITCHEN ZONE" BY ARMSTRONG OR APPROVED EQUAL.
DW	PAINT DRYMALL (2) COATS SHERWIN WILLIAMS LOW VOC LATEX PAINT, FLAT FINISH TYPICAL, SEMI-GLOSS IN RESTROOMS & SFA AREAS. COLOR: SKT006 25T-C1 EXTRA WHITE.
DW-T	KNOCK-DOWN TEXTURED FINISH ON DRYMALL CEILING. PAINT (2) COATS SHERWIN WILLIAMS LOW VOC FLAT LATEX PAINT. COLOR: SKT006 25T-C1 EXTRA WHITE.


MISCELLANEOUS

WOOD DOORS	1-3/4" SOLID CORE LOW PRESSURE DECORATIVE LAMINATE (LPDL) THERMAL FUSED FLUSH DOORS. AGSA ABO'Y 'MAMAM' DOORS OR APPROVED EQUAL. LAMINATE COLOR: TO BE SELECTED.
HOL. MTL DOORS & FRAMES	FACTORY APPLIED PRIMER + (2) FIELD APPLIED FINISH COATS SHERWIN WILLIAM PRO INDUSTRIAL DTM ACRYLIC' SEMI-GLOSS INTERIOR/EXTERIOR PAINT OR APPROVED EQUAL. COLOR: TO BE SELECTED.
FLOOR TRANSITS	LEVEL & FEATHER FLOOR SURFACE AS REQUIRED FOR LEVEL FINISHES & FLOOR FINISH MATERIAL CHANGES. - PROVIDE RESILIENT TRANSITION STRIP AT MEETING OF CARPET / VCT /LVT AND CONCRETE AND AT MEETING OF VCT AND CARPETBY JOHNSONITE /TARKETT OR EQUAL. COLOR: TO BE SELECTED. - PROVIDE CLEAR ANODIZED ALUMINUM 1" TRIM EDGE @ MEETING OF CARPET /VCT /LVT & CERAMIC TILE. - PROVIDE CLEAR ANODIZED ALUMINUM TAPERED TRIM EDGE @ MEETING OF CERAMIC TILE AND CONCRETE. - NO TRANSITION REQUIRED AT MEETING OF CARPET AND 4.5MM / 5MM LVT.
CROWN MOLDING	PROVIDE (1) COAT PRIMER + MINIMUM (1) COAT PAINT OR (1) COAT STAIN, VERIFY WITH OWNER. COLOR: TO BE SELECTED. SUBMIT SAMPLE FOR APPROVAL.
COLUMN COVERS	INTERIOR PAINTED FACTORY-SPLIT SMOOTH 10" ROUND, FIBERGLASS COLUMN COVER. COLOR: WHITE

ROOM FINISH SCHEDULE											
	NO.	ROOM NAME	FLOOR	BASE	WALLS				CEILING	HEIGHT	REMARKS
					NORTH	EAST	SOUTH	WEST			
BUILDING - CENTER	C01	VESTIBULE	CPT-E	-	-	-	-	-	DN	12'-6"	ALUM. STOREFRONT WINDOW SYSTEM
	C02	RECEPTION	LVT-3	RB-P	P-X	P-X	P-X	P-X	DN	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	C03	CONFERENCE	CPT-1	CB	P-X	P-X	P-X	P-X	SAT-1	9'-4"	-
	C04	LOBBY	CPT-1/ LVT-3	RB-P	P-X/ STONE	P-X/ STONE	P-X/ STONE	P-X/CTB STONE	DN	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS CTB AT LOBBY CABINETS, SEE ROOM FINISH PLANS
	C05	WOMEN'S RESTROOM	CT-1	TB	CTF	PE-X	PE-X	PE-X	SAT-2	8'-0"	-
	C06	MEN'S RESTROOM	CT-1	TB	PE-X	PE-X	CTF	PE-X	SAT-2	8'-0"	-
	C07	PHYSICAL THERAPY	LVT-4	RB	P-X	P-X	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	C08	STORAGE	LVT-4	RB	P-X	P-X	P-X	P-X	SAT-3	9'-0"	-
	C09	KITCHENETTE	LVT-4	RB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C10	CLOSET	LVT-4	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	PROVIDE COAT ROD & PLAS. LAM. SHELF
	C11	BATH	LVT-4	RB	PE-X	PE-X	PE-X	PE-X	DN	8'-0"	-
	C12	CLOSET	LVT-4	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	C13	-	-	-	-	-	-	-	-	-	-
	C14	OFFICE	LVT-4	RB	P-X	P-X	P-X	P-X	SAT-2	9'-4"	-
	C15	OFFICE	CPT-2	RB	P-X	P-X	P-X	P-X	SAT-2	9'-4"	-
	C16	-	-	-	-	-	-	-	-	-	-
	C17	STORAGE	VCT	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C18	MAINTENANCE	CONC	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C19	-	-	-	-	-	-	-	-	-	-
	C20	CORRIDOR	LVT-3	RB-P	P-X	P-X	P-X	P-X/ VMC	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS VMC IN ALCOVE ACROSS FROM LOBBY
	C21	CORRIDOR	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-2	8'-6"	-
	C22	ADMIN. OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-4"	-
	C23	OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-4"	-
	C24	OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-4"	-
	C25	RESTROOM	CT-1	TB	PE-X	PE-X	CTF	CTF	SAT-2	8'-0"	-
	C26	OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C27	OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C28	OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C29	OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C30	SALON	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C31	OFFICE	CPT-2	CB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C32	ACTIVITY	LVT-4	RB	P-X	P-X	P-X	P-X/ CTB	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	C33	STORAGE	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	9'-0"	-
	C34	WATER ROOM	CONC	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C35	CORRIDOR	LVT-3	RB-P	P-X	P-X	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	C36	ELECTRICAL	VCT	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C37	LOUNGE	VCT	RB	P-X	P-X	P-X	P-X	SAT-2	9'-0"	-
	C38	CORRIDOR	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	8'-6"	-
	C39	LAUNDRY	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	9'-0"	-
	C40	LAUNDRY	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	9'-0"	-
	C41	LINEN	VCT	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C42	MAINTENANCE	CONC	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C43	STORAGE	VCT	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C44	RESTROOM	CT-1	TB	PE-X	PE-X	CTF	PE-X	SAT-3	8'-0"	-
	C45	JANITOR	QT	QB	FRP	P-X/ FRP	P-X/ FRP	P-X/ FRP	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES FRP TO 4'-0" AFF. W/ P-X ABOVE
	C46	HAZARDOUS	VCT	RB	FRP	FRP	FRP	FRP	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES FULL HEIGHT FRP ALL WALLS
	C47	FIRE PUMP	VCT	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C48	STORAGE	VCT	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C49	OXYGEN	VCT	RB	P-X	P-X	P-X	P-X	DN	10'-3"	CEILING AT BOTTOM OF TRUSSES
	C50	OFFICE	QT	QB	P-X	P-X	P-X	P-X	SAT-3	9'-0"	-
	C51	-	-	-	-	-	-	-	-	-	-
	C52	SCULLERY	QT	QB	FRP	FRP	FRP	FRP	SAT-W	9'-0"	FULL HEIGHT FRP ALL WALLS
	C53	KITCHEN	QT	QB	FRP	FRP	FRP	FRP	SAT-W	9'-0"	FULL HEIGHT FRP ALL WALLS
	C54	DRY STORAGE	QT	QB	FRP	FRP	FRP	FRP	SAT-W	9'-0"	FULL HEIGHT FRP ALL WALLS

BUILDING - CENTER

ROOM FINISH SCHEDULE											
	NO.	ROOM NAME	FLOOR	BASE	WALLS				CEILING	HEIGHT	REMARKS
					NORTH	EAST	SOUTH	WEST			
BUILDING - SOUTH WING	S01	CORRIDOR	LVT-1/2	RB-P	P-X	P-X	P-X/ RHP	P-X/ RHP	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S02	CORRIDOR	LVT-1/2	RB-P	P-X/ RHP	P-X/ RHP	P-X/ RHP	P-X/ RHP	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S03	LOUNGE	CPT-1	RB-P	P-X	-	-	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S04	CORRIDOR	LVT-1/2	RB-P	P-X/ RHP	P-X/ RHP	P-X/ RHP	P-X/ RHP	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S05	LOUNGE	CPT-1	RB-P	-	-	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S06	NURSE	LVT-2	RB	P-X	P-X	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S07	I.T. ROOM	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	S08	STORAGE	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	S09	SPA	CT-1	-	PE-X/ CTN/CTF	PE-X/ CTN	PE-X/ CTN/CTF	PE-X/ CTN/CTF	SAT-1	9'-8"	CTN TYPICAL, PROVIDE CTF AT SHOWER WALLS-SEE SPA ELEVATIONS ON DWG. A5.2
	S10	SUPPLY	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	9'-8"	-
	S11	LINEN	VCT	RB	P-X	P-X	P-X	P-X	DW	10'-3"	CEILING AT BOTTOM OF TRUSSES
	S12	CORRIDOR	LVT-1/2	RB-P	P-X/ RHP	P-X	P-X/ RHP	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S13	-	-	-	-	-	-	-	-	-	-
	S14	SOILED	VCT	RB	FRP	FRP	FRP	FRP	DW	10'-3"	CEILING AT BOTTOM OF TRUSSES
	S15	MECHANICAL	CONC	RB	P-X	P-X	P-X	P-X	DW	10'-3"	CEILING AT BOTTOM OF TRUSSES
	S16	CHARTS	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	S17	OFFICE	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-2	8'-0"	-
	S18	WORK	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-2	8'-0"	-
	S19	RESTROOM	CT-1	CB	PE-X	PE-X	CTF	PE-X	SAT-2	8'-0"	-
	S20	MEDS	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	S21	CORRIDOR	LVT-1/2	RB-P	P-X	P-X/ RHP	P-X	P-X/ RHP	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S22	DINING	LVT-3	RB-P	P-X	P-X	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	S23	SERVERY	QT	QB	FRP	FRP	FRP	FRP	SAT-W	9'-0"	FULL HEIGHT FRP ALL WALLS
BUILDING - NORTH WING	N01	CORRIDOR	LVT-1/2	RB-P	P-X/ RHP	P-X/ RHP	P-X/ RHP	P-X/ RHP	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N02	LOUNGE	CPT-1	RB-P	-	-	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N03	CORRIDOR	LVT-1/2	RB-P	P-X/ RHP	P-X	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N04	LOUNGE	CPT-1	RB-P	P-X	-	-	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N05	-	-	-	-	-	-	-	-	-	-
	N06	NURSE	LVT-2	RB	P-X	P-X	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N07	I.T. ROOM	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	N08	STORAGE	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	N09	SPA	CT-1	-	PE-X/ CTN/CTF	PE-X/ CTN	PE-X/ CTN/CTF	PE-X/ CTN/CTF	SAT-1	9'-8"	CTN TYPICAL, PROVIDE CTF AT SHOWER WALLS-SEE SPA ELEVATIONS ON DWG. A5.2
	N10	SUPPLY	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	9'-8"	-
	N11	LINEN	VCT	RB	P-X	P-X	P-X	P-X	DW	10'-3"	CEILING AT BOTTOM OF TRUSSES
	N12	CORRIDOR	LVT-1/2	RB-P	P-X/ RHP	P-X	P-X/ RHP	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N13	-	-	-	-	-	-	-	-	-	-
	N14	SOILED	VCT	RB	FRP	FRP	FRP	FRP	DW	10'-3"	CEILING AT BOTTOM OF TRUSSES
	N15	MECHANICAL	CONC	RB	P-X	P-X	P-X	P-X	DW	10'-3"	CEILING AT BOTTOM OF TRUSSES
	N16	CHARTS	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	N17	OFFICE	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-2	8'-0"	-
	N18	WORK	LVT-1	RB	P-X	P-X	P-X	P-X	SAT-2	8'-0"	-
	N19	RESTROOM	CT-1	CB	CTF	PE-X	PE-X	PE-X	SAT-2	8'-0"	-
	N20	MEDS	VCT	RB	P-X	P-X	P-X	P-X	SAT-3	8'-0"	-
	N21	CORRIDOR	LVT-1/2	RB-P	P-X	P-X	P-X	P-X/ RHP	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N22	DINING	LVT-3	RB-P	P-X	P-X	P-X	P-X	SAT-1/DW	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
	N23	SERVERY	QT	QB	FRP	FRP	FRP	FRP	SAT-W	9'-0"	FULL HEIGHT FRP ALL WALLS
RESIDENT ROOMS	SOUTH WING (1XX)	RESIDENT BEDROOM	LVT-2	RB	P-X	P-X	P-X	P-X	DWDW-T	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
		RESIDENT BATHROOM	CT-1	TB	PE-X	PE-X	PE-X	PE-X	DW	7'-8"	-
	NORTH WING (2XX)	RESIDENT BEDROOM	LVT-2	RB	P-X	P-X	P-X	P-X	DWDW-T	VARIABLES	SEE REFLECTED CEILING PLAN FOR HEIGHTS
		RESIDENT BATHROOM	CT-1	TB	PE-X	PE-X	PE-X	PE-X	DW	7'-8"	-

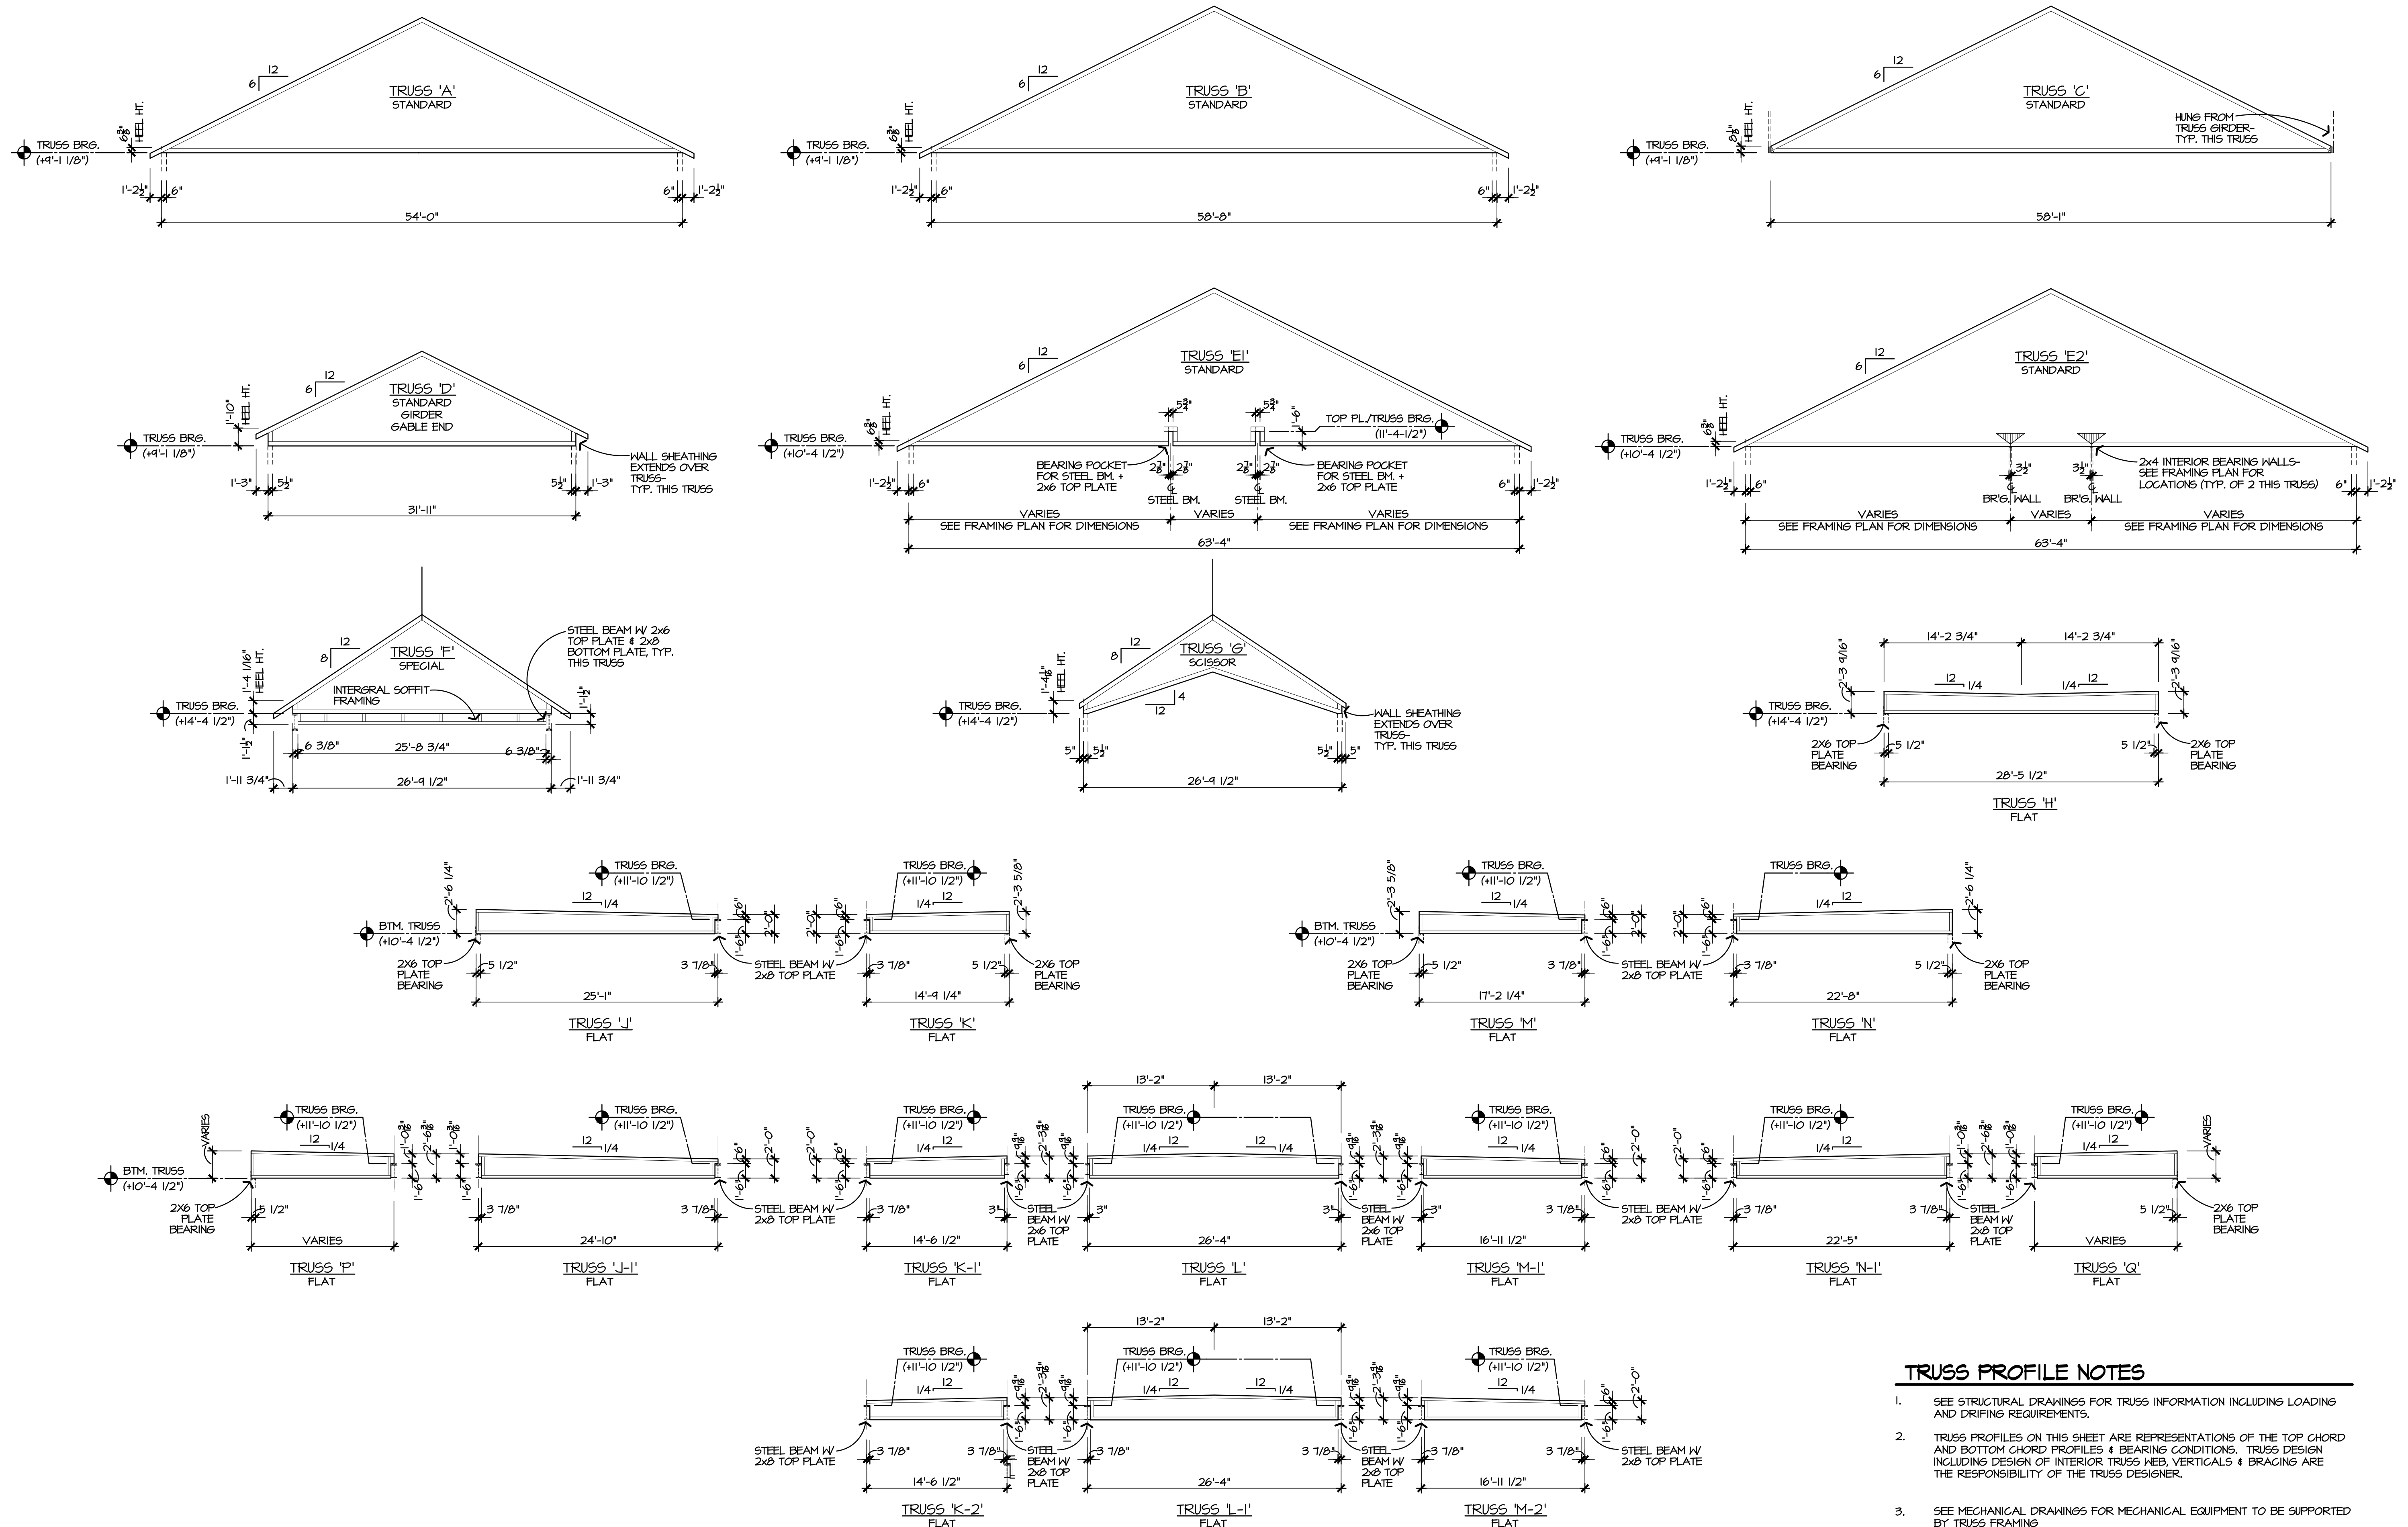

TRUSS PROFILE TYPES

SCALE: 1/8" = 1'-0"

TRUSS PROFILE NOTES

- SEE STRUCTURAL DRAWINGS FOR TRUSS INFORMATION INCLUDING LOADING AND DRIFING REQUIREMENTS.
- TRUSS PROFILES ON THIS SHEET ARE REPRESENTATIONS OF THE TOP CHORD AND BOTTOM CHORD PROFILES & BEARING CONDITIONS. TRUSS DESIGN INCLUDING DESIGN OF INTERIOR TRUSS WEB, VERTICALS & BRACING ARE THE RESPONSIBILITY OF THE TRUSS DESIGNER.
- SEE MECHANICAL DRAWINGS FOR MECHANICAL EQUIPMENT TO BE SUPPORTED BY TRUSS FRAMING