

WRAP ALL EXTERIOR WALLS WITH MINIMUM 3/8" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

"SHEARWALL" DESIGNATES INTERIOR 2X4 STUDS SHEATHED W/ MINIMUM 3/8" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

- NOTES:**
1. PROVIDE 4" CONCRETE SLAB ON GRADE REINFORCED W/ WWF 6x6-W14W14 OVER 10 MIL POLY VAPOR BARRIER (LAP EDGES 6" MIN.) OVER 4" POROUS BASE. ALL DIMENSIONS REFERENCED TO CENTERLINE OF COLUMNS, FACE OF EXTERIOR VENEER, AND CENTERLINE OF INTERIOR BEARING WALLS. SEE ARCHITECTURAL AND STRUCTURAL SECTIONS TO DETERMINE EDGE OF SLAB. VERIFY DIMENSIONS PRIOR TO CONSTRUCTION.
 2. TOP OF EXTERIOR FTG. = F.F.E. -1'-4" AND FIN. GRADE -1'-0" (MIN.)
 3. SEE ARCH. DWGS. FOR DIMENSIONS NOT SHOWN.
 4. SEE DETAIL 5/5-3 FOR RECESSED SLAB DETAILS.
 5. SEE DETAIL 1/5-3 FOR SLAB CONTROL JOINTS (CJ). ALTERNATE LAYOUT PLANS MAY BE SUBMITTED FOR APPROVAL.
 6. SEE ARCHITECTURAL DRAWINGS, FOR LOCATIONS OF RECESSED AND/OR SLOPED SLAB AREAS. PROVIDE POSITIVE DRAINAGE FROM ALL PERIMETER WALLS TO FLOOR DRAIN. COORDINATE W/ PLUMBING DWGS. SEE DETAIL 5/5-3.
 7. LOCATE CONTROL JOINTS UNDERNEATH NON-BEARING WALLS WHERE POSSIBLE.
 8. PROVIDE (4) 2X6 @ EXT. WALLS, (5) 2X4 @ INT. WALLS BEARING (MIN.) AT ALL GIRDER TRUSSES BEARING POINTS AND SHEARWALL END POSTS W/ SIMPSON HT4 AT STUD BASE.
 9. REFER TO ARCHITECTURAL DRAWINGS FOR RATED WALL LOCATIONS.
 10. SEE FOOTING SCHEDULE FOR SIZES AND REINFORCING.
 11. PROVIDE THICKENED SLAB AS REQUIRED BY WASHER MANUFACTURER. CONTRACTOR TO PROVIDE AND INSTALL REBAR FRAME. SEE 13/5-3.
 12. ALL EXTERIOR STUDS SHALL BE 2x6 SPF NO. 2 STUDS AT 16" O.C. ALL INTERIOR STUDS AT BEARING WALLS AND SHEAR WALLS SHALL BE 2x4 SPF NO. 2 STUDS AT 16" O.C.
 13. PROVIDE (2) 6'-0" LONG #5 BARS AT RE-ENTRANT CORNERS, PLACE AT MID-DEPTH OF SLAB.
 14. INTERIOR FOOTING DIMENSIONS SHOULD NOT BE USED TO LOCATE INTERIOR WALLS. REFER TO ARCHITECTURAL DRAWINGS FOR ALL INTERIOR WALL DIMENSIONS.
 15. OMITTED
 16. OMITTED
 17. PROVIDE (2) 6'-0" LONG #5 BARS AT RE-ENTRANT CORNERS, PLACE AT MID-DEPTH OF SLAB.
 18. EARTHQUAKE DRAINS ARE REQUIRED ACROSS THE SITE TO MITIGATE SOIL LIQUEFACTION. THIS SHALL BE A DELEGATED DESIGN, BY OTHERS.

FOOTING SCHEDULE		
TYPE	SIZE	REBAR
F1	4'-0" X 4'-0" X 1'-0"	(4) #5s (3'-6" LONG) E.W.
F2	4'-0" X 4'-0" X 1'-4"	(4) #5s (3'-6" LONG) E.W., T&B
F3	3'-6" X 3'-6" X 1'-0"	(4) #5s (3'-0" LONG) E.W.
F4	6'-0" X 6'-0" X 1'-6"	(6) #6s (5'-6" LONG) E.W. T + B
F5	3'-0" X 3'-0" X 1'-4"	THICKENED SLAB (3) #5s (2'-6" LONG) E.W.
F6	4'-0" X 4'-0" X 1'-0"	THICKENED SLAB (3) #5s (3'-6" LONG) E.W.

STUD SCHEDULE				
PLATE HEIGHT	EXTERIOR WALLS ¹	INTERIOR WALLS ¹	CONSTRUCTION BRIDGING/BLOCKING LOCATIONS ²	NON-BEARING WALLS (U.N.O.)
10'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
12'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
14'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	THIRD-POINTS	2x4 @ 16" O.C.

¹ SEE PLANS FOR STUD SIZING DIFFERING FROM SCHEDULE.
² DURING CONSTRUCTION, BRIDGING/BLOCKING ELEMENTS ARE REQUIRED TO BRACE STUDS.

FOUNDATION PLAN

SCALE: 3/32"=1'-0"

KEY PLAN

ARCHITECTURAL CONCEPTS INC.
241 WEST HAY DRIVE, SUITE 202, LENOIR, NC 28759

THEODORE A. DEWITT
NORTH CAROLINA PE NO. 048492

HAUSER-CREECH INC.
P. 919.817.7579
F. 919.817.7676
4506 PEARCE RD., ZEBULON, NC 27597

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:

THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX

REVISIONS:

REV.	#	DATE	REVISION TITLE
------	---	------	----------------

PLOT DATE:


FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO. 1902	SCALE: AS NOTED
---------------------	--------------------

DRAWING NO.

S1.1

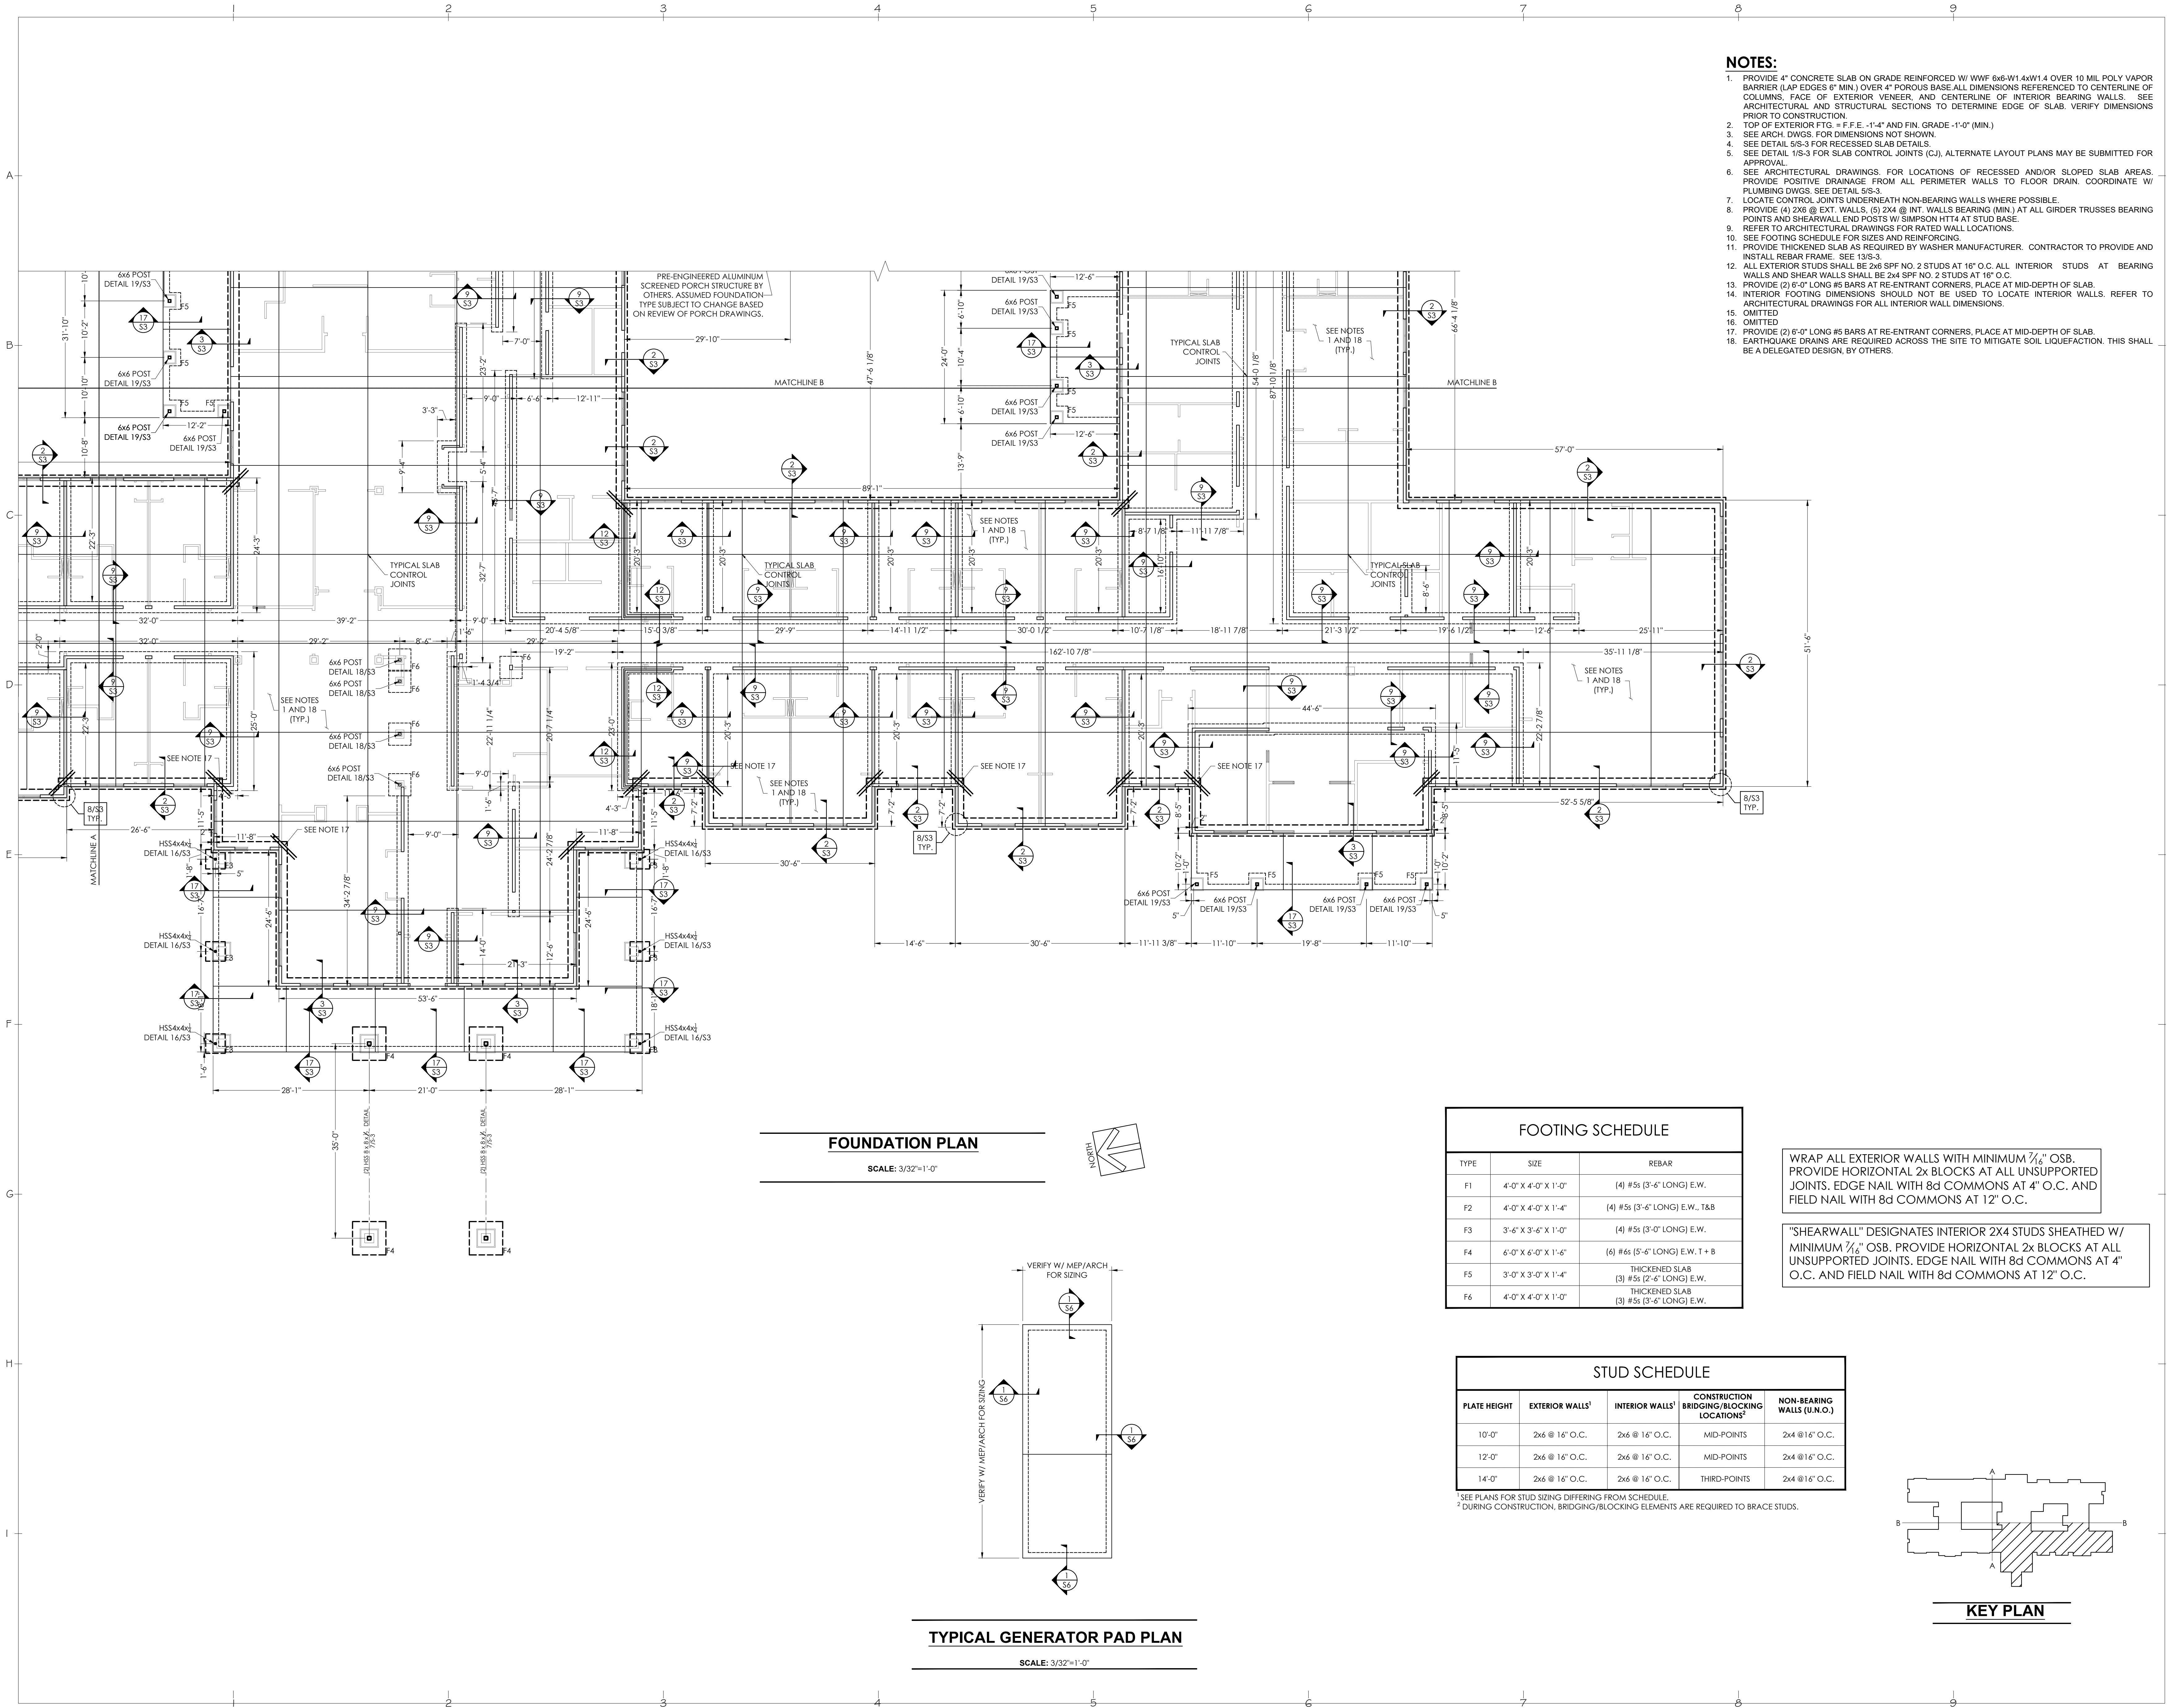

- NOTES:**
1. PROVIDE 4" CONCRETE SLAB ON GRADE REINFORCED W/ WWF 6x6-W1.4xW1.4 OVER 10 MIL POLY VAPOR BARRIER (LAP EDGES 6" MIN.) OVER 4" POROUS BASE. ALL DIMENSIONS REFERENCED TO CENTERLINE OF COLUMNS, FACE OF EXTERIOR VENEER, AND CENTERLINE OF INTERIOR BEARING WALLS. SEE ARCHITECTURAL AND STRUCTURAL SECTIONS TO DETERMINE EDGE OF SLAB. VERIFY DIMENSIONS PRIOR TO CONSTRUCTION.
 2. TOP OF EXTERIOR FTG. = F.F.E. -1'-4" AND FIN. GRADE -1'-0" (MIN.)
 3. SEE ARCH. DWGS. FOR DIMENSIONS NOT SHOWN.
 4. SEE DETAIL 5/S-3 FOR RECESSED SLAB DETAILS.
 5. SEE DETAIL 1/S-3 FOR SLAB CONTROL JOINTS (CJ), ALTERNATE LAYOUT PLANS MAY BE SUBMITTED FOR APPROVAL.
 6. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF RECESSED AND/OR SLOPED SLAB AREAS. PROVIDE POSITIVE DRAINAGE FROM ALL PERIMETER WALLS TO FLOOR DRAIN. COORDINATE W/ PLUMBING DWGS. SEE DETAIL 6/S-3.
 7. LOCATE CONTROL JOINTS UNDERNEATH NON-BEARING WALLS WHERE POSSIBLE.
 8. PROVIDE (4) 2x8 @ EXT. WALLS, (5) 2x4 @ INT. WALLS BEARING (MIN.) AT ALL GIRDER TRUSSES BEARING POINTS AND SHEARWALL END POSTS W/ SIMPSON HTT4 AT STUD BASE.
 9. REFER TO ARCHITECTURAL DRAWINGS FOR RATED WALL LOCATIONS.
 10. SEE FOOTING SCHEDULE FOR SIZES AND REINFORCING.
 11. PROVIDE THICKENED SLAB AS REQUIRED BY WASHER MANUFACTURER. CONTRACTOR TO PROVIDE AND INSTALL REBAR FRAME. SEE 13/S-3.
 12. ALL EXTERIOR STUDS SHALL BE 2x6 SPF NO. 2 STUDS AT 16" O.C. ALL INTERIOR STUDS AT BEARING WALLS AND SHEAR WALLS SHALL BE 2x4 SPF NO. 2 STUDS AT 16" O.C.
 13. PROVIDE (2) 6'-0" LONG #5 BARS AT RE-ENTRANT CORNERS, PLACE AT MID-DEPTH OF SLAB.
 14. INTERIOR FOOTING DIMENSIONS SHOULD NOT BE USED TO LOCATE INTERIOR WALLS. REFER TO ARCHITECTURAL DRAWINGS FOR ALL INTERIOR WALL DIMENSIONS.
 15. OMITTED.
 16. OMITTED.
 17. PROVIDE (2) 6'-0" LONG #5 BARS AT RE-ENTRANT CORNERS, PLACE AT MID-DEPTH OF SLAB.
 18. EARTHQUAKE DRAINS ARE REQUIRED ACROSS THE SITE TO MITIGATE SOIL LIQUEFACTION. THIS SHALL BE A DELEGATED DESIGN, BY OTHERS.

ARCHITECTURAL CONCEPTS INC.
241 WEST 14TH STREET, SUITE 201, LENOIR, NC 28540

THEODORE A. LEITES
NORTH CAROLINA PE NO. 048492

HAISER-CREECH INC.
P. 919.817.7579
F. 919.817.7676
F. 919.404.2427
4506 PEARCE RD., ZEBULON, NC 27597

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:

LEO BROWN GROUP

THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX

REVISIONS:

REV. #	DATE	REVISION TITLE
--------	------	----------------

PLOT DATE:

FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO.	SCALE:
1902	AS NOTED

DRAWING NO.

S1.2


FOOTING SCHEDULE		
TYPE	SIZE	REBAR
F1	4'-0" X 4'-0" X 1'-0"	(4) #5s (3'-6" LONG) E.W.
F2	4'-0" X 4'-0" X 1'-4"	(4) #5s (3'-6" LONG) E.W., 1&B
F3	3'-6" X 3'-6" X 1'-0"	(4) #5s (3'-0" LONG) E.W.
F4	6'-0" X 6'-0" X 1'-6"	(6) #6s (5'-6" LONG) E.W., 1 + B
F5	3'-0" X 3'-0" X 1'-4"	THICKENED SLAB (3) #5s (2'-6" LONG) E.W.
F6	4'-0" X 4'-0" X 1'-0"	THICKENED SLAB (3) #5s (3'-6" LONG) E.W.

WRAP ALL EXTERIOR WALLS WITH MINIMUM 7/8" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

"SHEARWALL" DESIGNATES INTERIOR 2X4 STUDS SHEATHED W/ MINIMUM 7/8" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

STUD SCHEDULE				
PLATE HEIGHT	EXTERIOR WALLS ¹	INTERIOR WALLS ¹	CONSTRUCTION BRIDGING/BLOCKING LOCATIONS ²	NON-BEARING WALLS (U.N.O.)
10'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
12'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
14'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	THIRD-POINTS	2x4 @ 16" O.C.


¹SEE PLANS FOR STUD SIZING DIFFERING FROM SCHEDULE.
² DURING CONSTRUCTION, BRIDGING/BLOCKING ELEMENTS ARE REQUIRED TO BRACE STUDS.

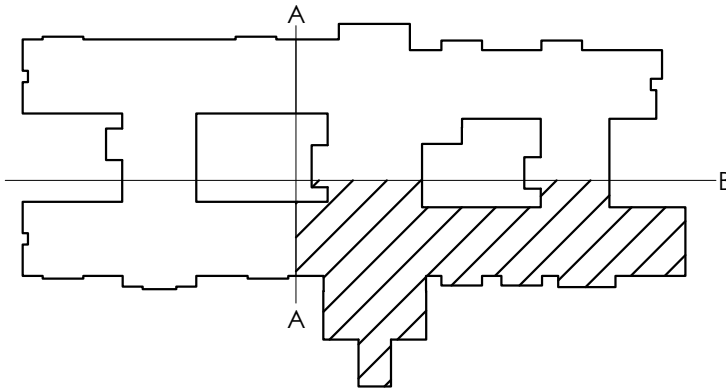

KEY PLAN

WRAP ALL EXTERIOR WALLS WITH MINIMUM $\frac{7}{16}$ " OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

"SHEARWALL" DESIGNATES INTERIOR 2X4 STUDS SHEATHED W/ MINIMUM $\frac{7}{16}$ " OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

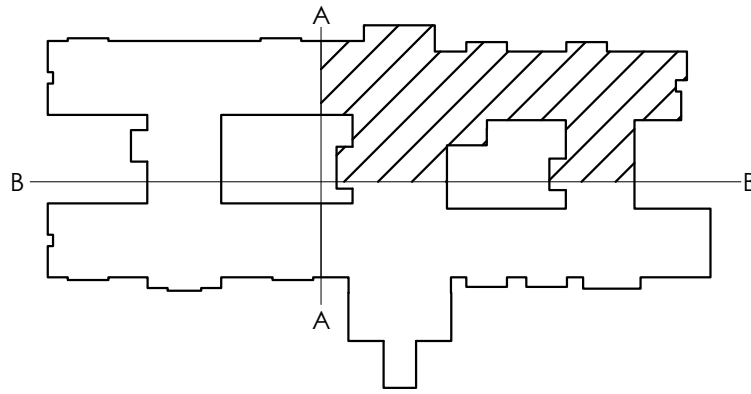

KEY PLAN

FOOTING SCHEDULE

TYPE	SIZE	REBAR
F1	4'-0" X 4'-0" X 1'-0"	(4) #5s (3'-6" LONG) E.W.
F2	4'-0" X 4'-0" X 1'-4"	(4) #5s (3'-6" LONG) E.W., T&B
F3	3'-6" X 3'-6" X 1'-0"	(4) #5s (3'-0" LONG) E.W.
F4	6'-0" X 6'-0" X 1'-6"	(6) #6s (5'-6" LONG) E.W., T + B
F5	3'-0" X 3'-0" X 1'-4"	THICKENED SLAB (3) #5s (2'-6" LONG) E.W.
F6	4'-0" X 4'-0" X 1'-0"	THICKENED SLAB (3) #5s (3'-6" LONG) E.W.

STUD SCHEDULE


PLATE HEIGHT	EXTERIOR WALLS ¹	INTERIOR WALLS ¹	CONSTRUCTION BRIDGING/BLOCKING LOCATIONS ²	NON-BEARING WALLS (U.N.O.)
10'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
12'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
14'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	THIRD-POINTS	2x4 @ 16" O.C.

¹SEE PLANS FOR STUD SIZING DIFFERING FROM SCHEDULE.

²DURING CONSTRUCTION, BRIDGING/BLOCKING ELEMENTS ARE REQUIRED TO BRACE STUDS.





NOTES:

1. PROVIDE 4" CONCRETE SLAB ON GRADE REINFORCED W/ WWF 6x6-W1.4xW1.4 OVER 10 MIL POLY VAPOR BARRIER (LAP EDGES 6" MIN.) OVER 4" POROUS BASE ALL DIMENSIONS REFERENCED TO CENTERLINE OF COLUMNS, FACE OF EXTERIOR VENEER, AND CENTERLINE OF INTERIOR BEARING WALLS. SEE ARCHITECTURAL AND STRUCTURAL SECTIONS TO DETERMINE EDGE OF SLAB. VERIFY DIMENSIONS PRIOR TO CONSTRUCTION.
2. TOP OF EXTERIOR FTG. = F.F.E. -1'-4" AND FIN. GRADE -1'-0" (MIN.)
3. SEE ARCH. DWGS. FOR DIMENSIONS NOT SHOWN.
4. SEE DETAIL 5/S-3 FOR RECESSED SLAB DETAILS.
5. SEE DETAIL 1/S-3 FOR SLAB CONTROL JOINTS (CJ), ALTERNATE LAYOUT PLANS MAY BE SUBMITTED FOR APPROVAL.
6. SEE ARCHITECTURAL DRAWINGS, FOR LOCATIONS OF RECESSED AND/OR SLOPED SLAB AREAS. PROVIDE POSITIVE DRAINAGE FROM ALL PERIMETER WALLS TO FLOOR DRAIN. COORDINATE W/ PLUMBING DWGS. SEE DETAIL 5/S-3.
7. LOCATE CONTROL JOINTS UNDERNEATH NON-BEARING WALLS WHERE POSSIBLE.
8. PROVIDE (4) 2x6 @ EXT. WALLS, (6) 2x4 @ INT. WALLS BEARING (MIN.) AT ALL GIRDER TRUSSES BEARING POINTS AND SHEARWALL END POSTS W/ SIMPSON HTTA AT STUD BASE.
9. REFER TO ARCHITECTURAL DRAWINGS FOR RATED WALL LOCATIONS.
10. SEE FOOTING SCHEDULE FOR SIZES AND REINFORCING.
11. PROVIDE THICKENED SLAB AS REQUIRED BY WASHER MANUFACTURER. CONTRACTOR TO PROVIDE AND INSTALL REBAR FRAME. SEE 13/S-3.
12. ALL EXTERIOR STUDS SHALL BE 2x6 SPF NO. 2 STUDS AT 16" O.C. ALL INTERIOR STUDS AT BEARING WALLS AND SHEAR WALLS SHALL BE 2x4 SPF NO. 2 STUDS AT 16" O.C.
13. PROVIDE (2) 8'-0" LONG #5 BARS AT RE-ENTRANT CORNERS, PLACE AT MID-DEPTH OF SLAB.
14. INTERIOR FOOTING DIMENSIONS SHOULD NOT BE USED TO LOCATE INTERIOR WALLS. REFER TO ARCHITECTURAL DRAWINGS FOR ALL INTERIOR WALL DIMENSIONS.
15. OMITTED
16. OMITTED
17. PROVIDE (2) 8'-0" LONG #5 BARS AT RE-ENTRANT CORNERS, PLACE AT MID-DEPTH OF SLAB.
18. EARTHQUAKE DRAINS ARE REQUIRED ACROSS THE SITE TO MITIGATE SOIL LIQUEFACTION. THIS SHALL BE A DELEGATED DESIGN, BY OTHERS.

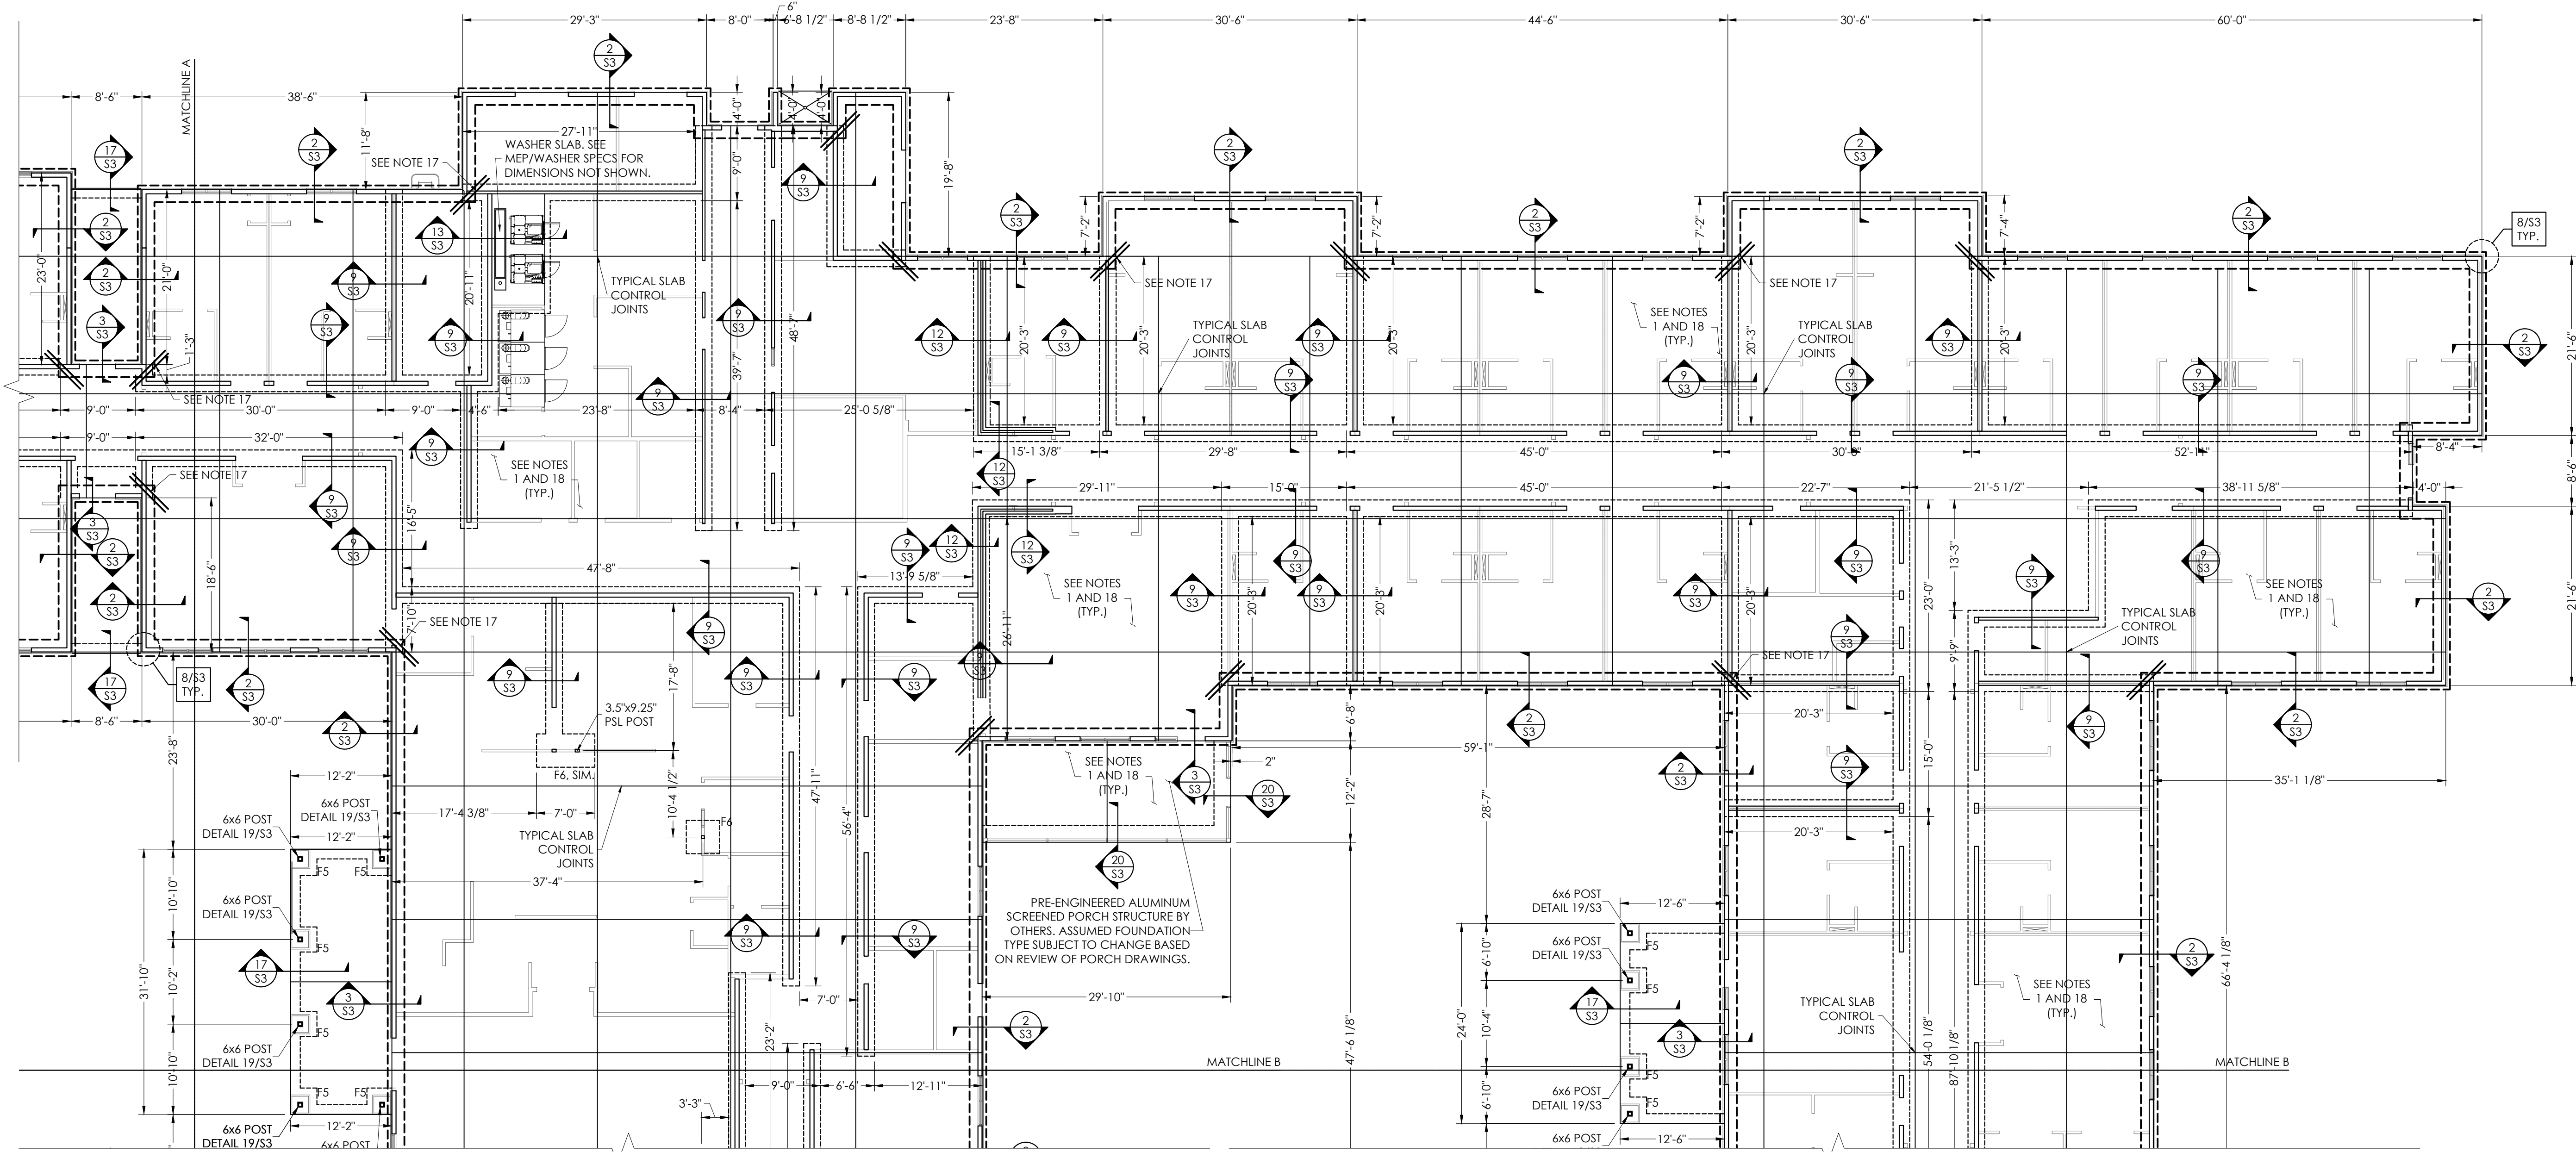

FOUNDATION PLAN

SCALE: 3/32"=1'-0"

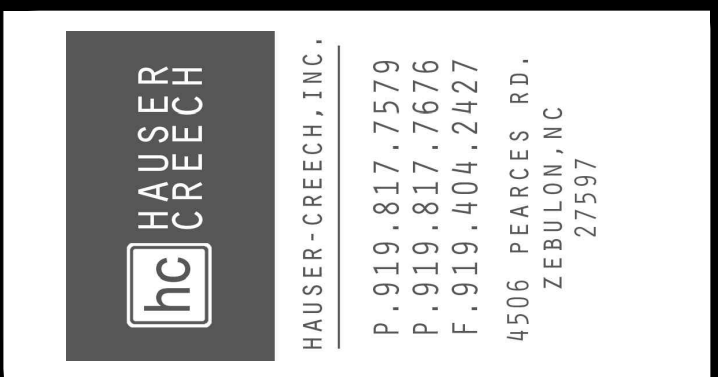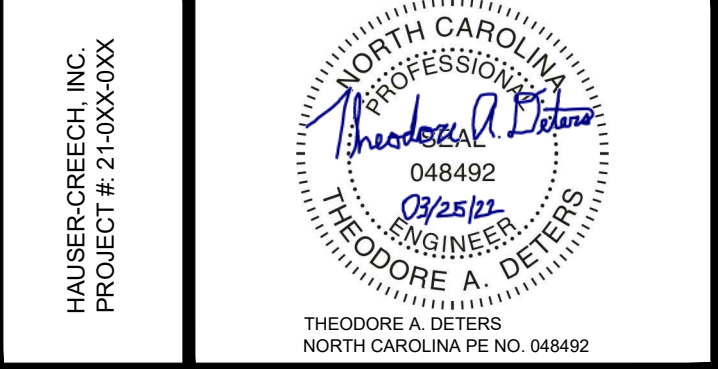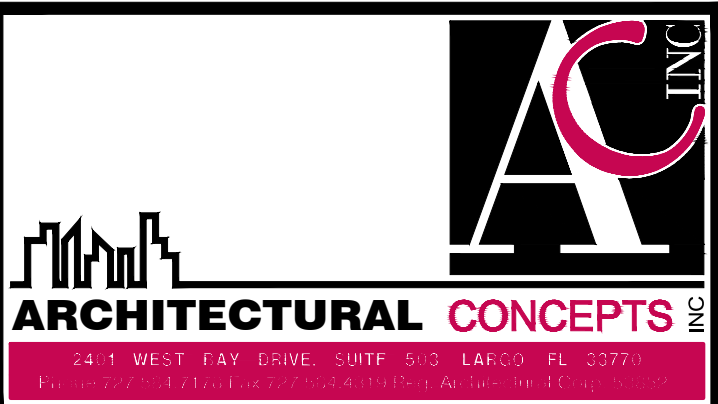

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:



THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX
REVISIONS:	
REV. #	DATE REVISION TITLE

PLOT DATE:




FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO. 1902	SCALE: AS NOTED
---------------------	--------------------

DRAWING NO.

S1.3

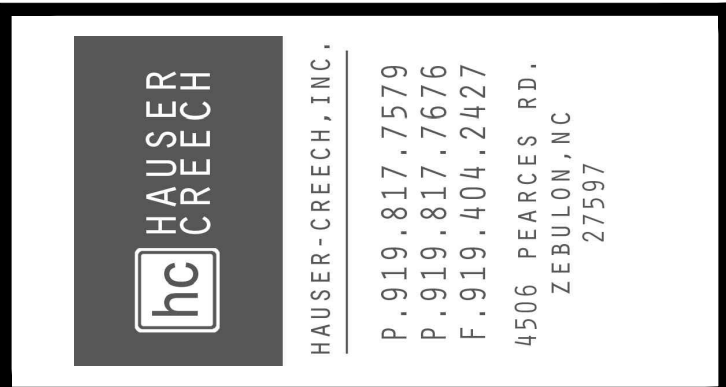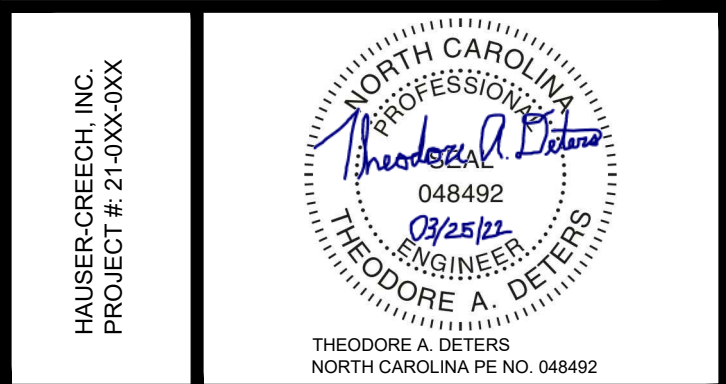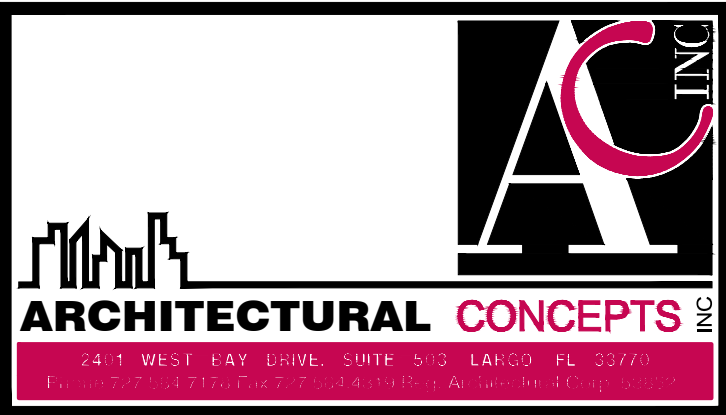

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:

LEO BROWN GROUP

THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS	
THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.	
PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX
REVISIONS:	
REV. #	DATE REVISION TITLE

PLOT DATE:


FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO. 1902

SCALE: AS NOTED



DRAWING NO. S2.0

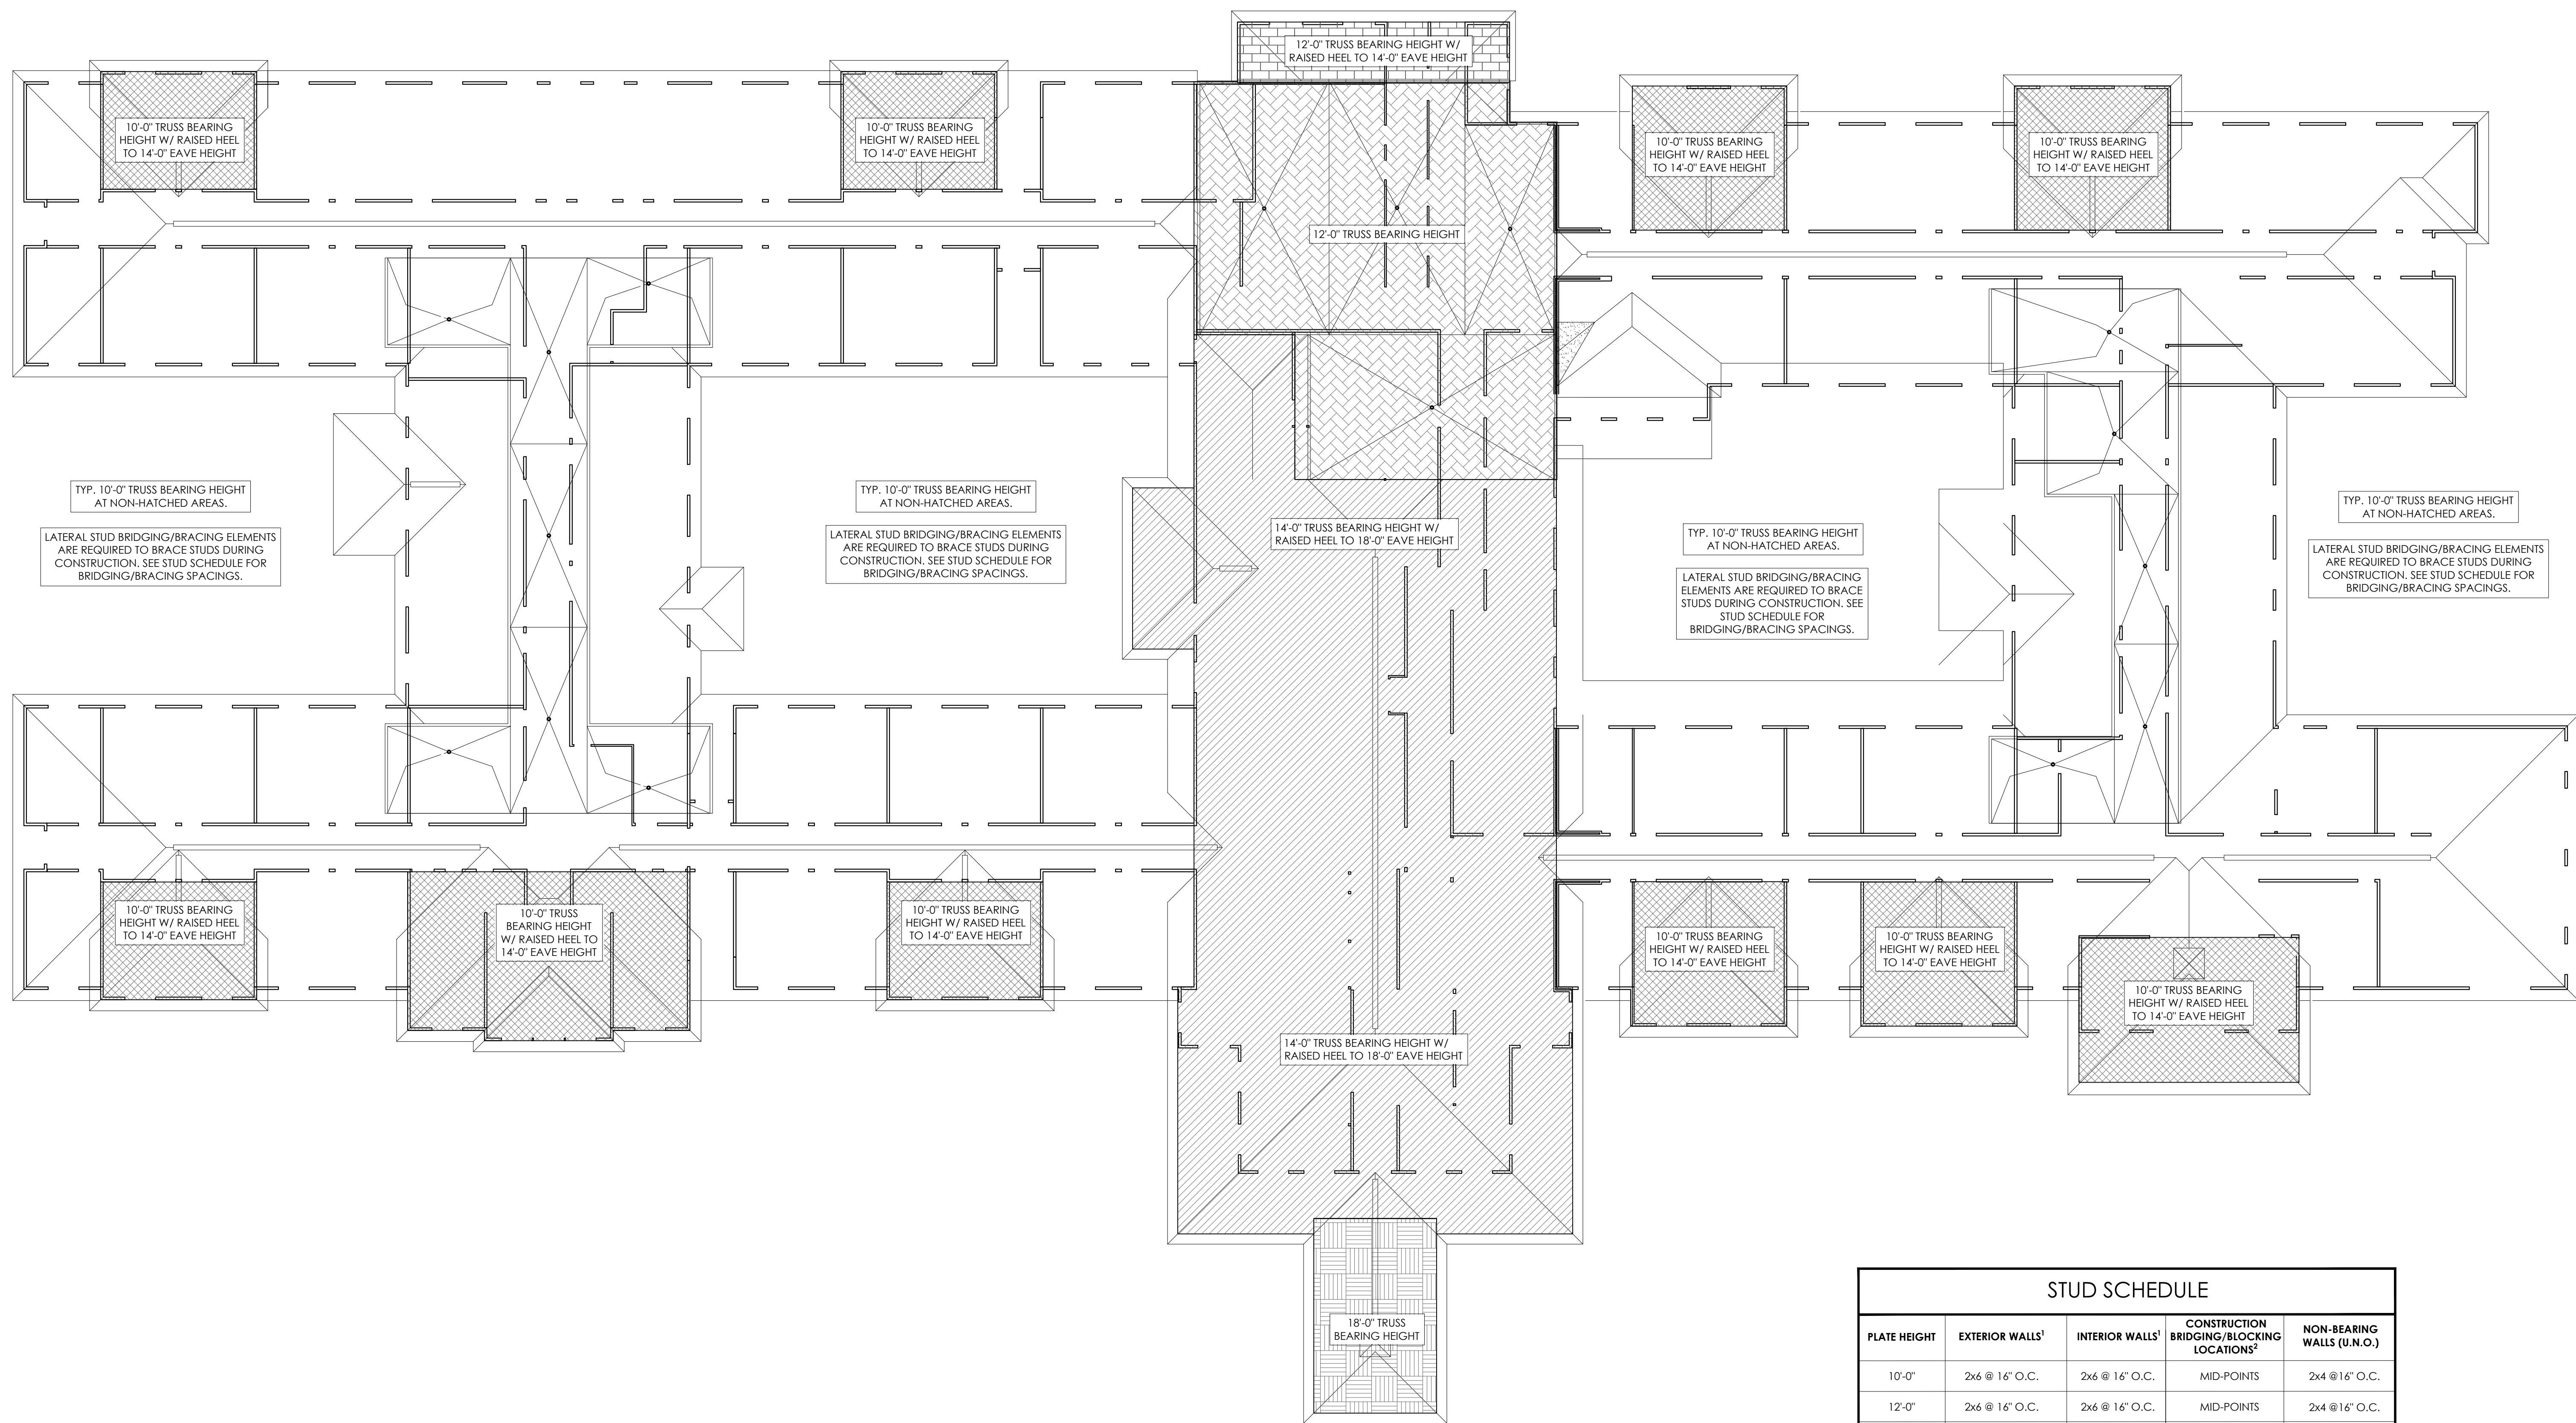


STUD SCHEDULE				
PLATE HEIGHT	EXTERIOR WALLS ¹	INTERIOR WALLS ¹	CONSTRUCTION BRIDGING/BLOCKING LOCATIONS ²	NON-BEARING WALLS (U.N.O.)
10'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
12'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
14'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	THIRD-POINTS	2x4 @ 16" O.C.

¹ SEE PLANS FOR STUD SIZING DIFFERING FROM SCHEDULE.
² DURING CONSTRUCTION, BRIDGING/BLOCKING ELEMENTS ARE REQUIRED TO BRACE STUDS.

TRUSS BEARING HEIGHT PLAN
SCALE: 1/16"=1'-0"

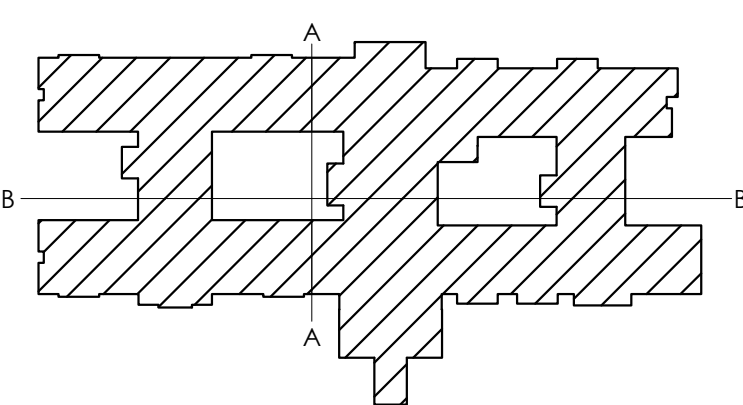

KEY PLAN

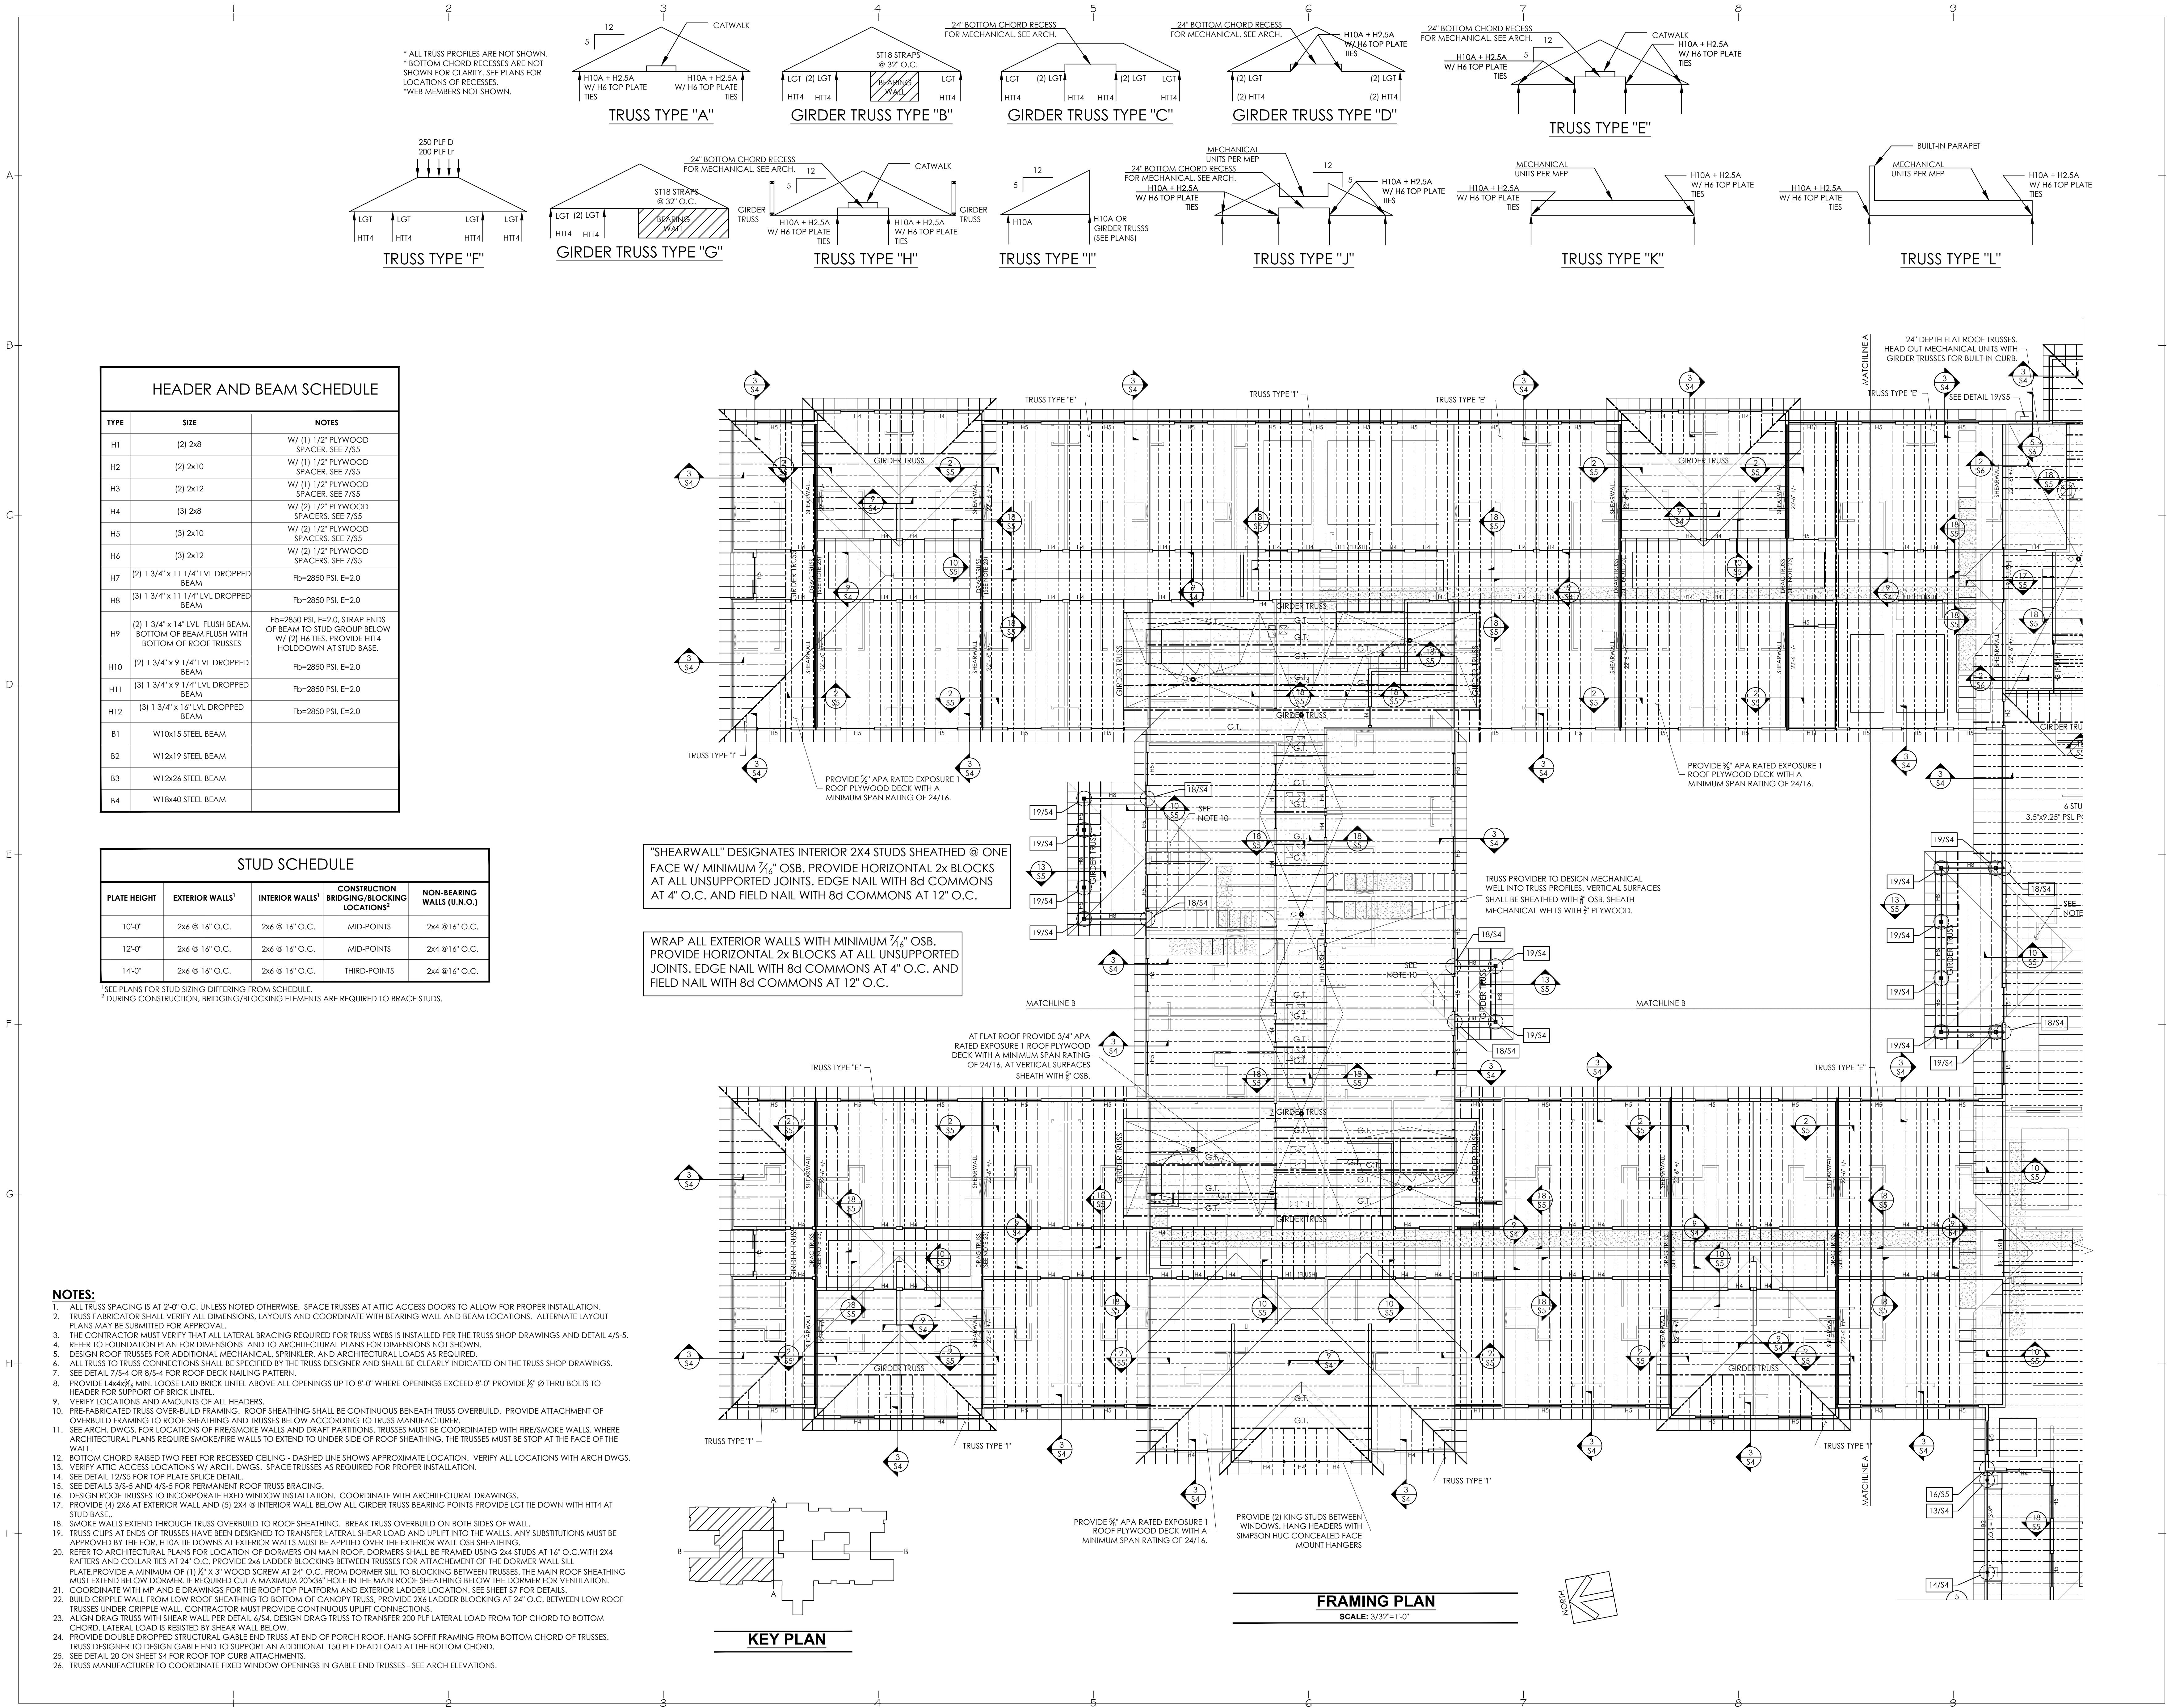

* ALL TRUSS PROFILES ARE NOT SHOWN.
* BOTTOM CHORD RECESSES ARE NOT SHOWN FOR CLARITY. SEE PLANS FOR LOCATIONS OF RECESSES.
* WEB MEMBERS NOT SHOWN.

TRUSS TYPE "A"

GIRDER TRUSS TYPE "B"

GIRDER TRUSS TYPE "C"

GIRDER TRUSS TYPE "D"

TRUSS TYPE "E"

TRUSS TYPE "F"

GIRDER TRUSS TYPE "G"

TRUSS TYPE "H"

TRUSS TYPE "I"

TRUSS TYPE "J"

TRUSS TYPE "K"

TRUSS TYPE "L"

HEADER AND BEAM SCHEDULE

TYPE	SIZE	NOTES
H1	(2) 2x8	W/ (1) 1/2" PLYWOOD SPACER. SEE 7/55
H2	(2) 2x10	W/ (1) 1/2" PLYWOOD SPACER. SEE 7/55
H3	(2) 2x12	W/ (1) 1/2" PLYWOOD SPACER. SEE 7/55
H4	(3) 2x8	W/ (2) 1/2" PLYWOOD SPACERS. SEE 7/55
H5	(3) 2x10	W/ (2) 1/2" PLYWOOD SPACERS. SEE 7/55
H6	(3) 2x12	W/ (2) 1/2" PLYWOOD SPACERS. SEE 7/55
H7	(2) 1 3/4" x 11 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H8	(3) 1 3/4" x 11 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H9	(2) 1 3/4" x 14" LVL FLUSH BEAM. BOTTOM OF BEAM FLUSH WITH BOTTOM OF ROOF TRUSSES	Fb=2850 PSI, E=2.0, STRAP ENDS OF BEAM TO STUD GROUP BELOW W/ (2) H6 TIES. PROVIDE HTT4 HOLDDOWN AT STUD BASE.
H10	(2) 1 3/4" x 9 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H11	(3) 1 3/4" x 9 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H12	(3) 1 3/4" x 16" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
B1	W10x15 STEEL BEAM	
B2	W12x19 STEEL BEAM	
B3	W12x26 STEEL BEAM	
B4	W18x40 STEEL BEAM	

STUD SCHEDULE

PLATE HEIGHT	EXTERIOR WALLS ¹	INTERIOR WALLS ¹	CONSTRUCTION BRIDGING/BLOCKING LOCATIONS ²	NON-BEARING WALLS (U.N.O.)
10'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
12'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
14'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	THIRD-POINTS	2x4 @ 16" O.C.

¹SEE PLANS FOR STUD SIZING DIFFERING FROM SCHEDULE.
²DURING CONSTRUCTION, BRIDGING/BLOCKING ELEMENTS ARE REQUIRED TO BRACE STUDS.

"SHEARWALL" DESIGNATES INTERIOR 2X4 STUDS SHEATHED @ ONE FACE W/ MINIMUM 7/16" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

WRAP ALL EXTERIOR WALLS WITH MINIMUM 7/16" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

FRAMING PLAN

SCALE: 3/32"=1'-0"

KEY PLAN

NOTES:

- ALL TRUSS SPACING IS AT 2'-0" O.C. UNLESS NOTED OTHERWISE. SPACE TRUSSES AT ATTIC ACCESS DOORS TO ALLOW FOR PROPER INSTALLATION.
- TRUSS FABRICATOR SHALL VERIFY ALL DIMENSIONS, LAYOUTS AND COORDINATE WITH BEARING WALL AND BEAM LOCATIONS. ALTERNATE LAYOUT PLANS MAY BE SUBMITTED FOR APPROVAL.
- THE CONTRACTOR MUST VERIFY THAT ALL LATERAL BRACING REQUIRED FOR TRUSS WEBS IS INSTALLED PER THE TRUSS SHOP DRAWINGS AND DETAIL 4/5-5.
- REFER TO FOUNDATION PLAN FOR DIMENSIONS AND TO ARCHITECTURAL PLANS FOR DIMENSIONS NOT SHOWN.
- DESIGN ROOF TRUSSES FOR ADDITIONAL MECHANICAL, SPRINKLER, AND ARCHITECTURAL LOADS AS REQUIRED.
- ALL TRUSS TO TRUSS CONNECTIONS SHALL BE SPECIFIED BY THE TRUSS DESIGNER AND SHALL BE CLEARLY INDICATED ON THE TRUSS SHOP DRAWINGS.
- SEE DETAIL 7/5-4 OR 8/5-4 FOR ROOF DECK NAILING PATTERN.
- PROVIDE 1x4x6, MIN. LOOSE LAID BRICK LINTEL ABOVE ALL OPENINGS UP TO 8'-0" WHERE OPENINGS EXCEED 8'-0" PROVIDE 1/2" @ THRU BOLTS TO HEADER FOR SUPPORT OF BRICK LINTEL.
- VERIFY LOCATIONS AND AMOUNTS OF ALL HEADERS.
- PRE-FABRICATED TRUSS OVER-BUILD FRAMING. ROOF SHEATHING SHALL BE CONTINUOUS BENEATH TRUSS OVERBUILD. PROVIDE ATTACHMENT OF OVERBUILD FRAMING TO TRUSSES BELOW ACCORDING TO TRUSS MANUFACTURER.
- SEE ARCH. DWGS. FOR LOCATIONS OF FIRE/SMOKE WALLS AND DRAFT PARTITIONS. TRUSSES MUST BE COORDINATED WITH FIRE/SMOKE WALLS. WHERE ARCHITECTURAL PLANS REQUIRE SMOKE/FIRE WALLS TO EXTEND TO UNDER SIDE OF ROOF SHEATHING, THE TRUSSES MUST BE STOP AT THE FACE OF THE WALL.
- BOTTOM CHORD RAISED TWO FEET FOR RECESSED CEILING. DASHED LINE SHOWS APPROXIMATE LOCATION. VERIFY ALL LOCATIONS WITH ARCH DWGS.
- VERIFY ATTIC ACCESS LOCATIONS W/ ARCH. DWGS. SPACE TRUSSES AS REQUIRED FOR PROPER INSTALLATION.
- SEE DETAIL 12/5-5 FOR TOP PLATE SPLICE DETAIL.
- SEE DETAILS 3/5-5 AND 4/5-5 FOR PERMANENT ROOF TRUSS BRACING.
- DESIGN ROOF TRUSSES TO INCORPORATE FIXED WINDOW INSTALLATION. COORDINATE WITH ARCHITECTURAL DRAWINGS.
- PROVIDE (4) 2x6 AT EXTERIOR WALL AND (5) 2x4 @ INTERIOR WALL BELOW ALL GIRDER TRUSS BEARING POINTS PROVIDE LGT TIE DOWN WITH HTT4 AT STUD BASE.
- SMOKE WALLS EXTEND THROUGH TRUSS OVERBUILD. BREAK TRUSS OVERBUILD ON BOTH SIDES OF WALL.
- TRUSS CLIPS AT ENDS OF TRUSSES HAVE BEEN DESIGNED TO TRANSFER LATERAL SHEAR LOAD AND UPLIFT INTO THE WALLS. ANY SUBSTITUTIONS MUST BE APPROVED BY THE EOR. H10A TIE DOWNS AT EXTERIOR WALLS MUST BE APPLIED OVER THE EXTERIOR WALL OSB SHEATHING.
- REFER TO ARCHITECTURAL PLANS FOR LOCATION OF DORMERS ON MAIN ROOF. DORMERS SHALL BE FRAMED USING 2x4 STUDS AT 16" O.C. WITH 2x4 RAFTERS AND COLLAR TIES AT 24" O.C. PROVIDE 2x6 LADDER BLOCKING BETWEEN TRUSSES FOR ATTACHMENT OF THE DORMER WALL SILL PLATE PROVIDE A MINIMUM OF (1) 1/2" x 3" WOOD SCREW AT 24" O.C. FROM DORMER SILL TO BLOCKING BETWEEN TRUSSES. THE MAIN ROOF SHEATHING MUST EXTEND BELOW DORMER. IF REQUIRED CUT A MAXIMUM 20"x36" HOLE IN THE MAIN ROOF SHEATHING BELOW THE DORMER FOR VENTILATION.
- COORDINATE WITH MP AND E DRAWINGS FOR THE ROOF TOP PLATFORM AND EXTERIOR LADDER LOCATION. SEE SHEET S7 FOR DETAILS.
- BUILD CRIPPLE WALL FROM LOW ROOF SHEATHING TO BOTTOM OF CANOPY TRUSS. PROVIDE 2x6 LADDER BLOCKING AT 24" O.C. BETWEEN LOW ROOF TRUSSES UNDER CRIPPLE WALL. CONTRACTOR MUST PROVIDE CONTINUOUS UPLIFT CONNECTIONS.
- ALIGN DRAG TRUSS WITH SHEAR WALL PER DETAIL 6/5-4. DESIGN DRAG TRUSS TO TRANSFER 200 PLF LATERAL LOAD FROM TOP CHORD TO BOTTOM CHORD. LATERAL LOAD IS RESISTED BY SHEAR WALL BELOW.
- PROVIDE DOUBLE DROPPED STRUCTURAL GABLE END TRUSS AT END OF PORCH ROOF. HANG SOFFIT FRAMING FROM BOTTOM CHORD OF TRUSSES. TRUSS DESIGNER TO DESIGN GABLE END TO SUPPORT AN ADDITIONAL 150 PLF DEAD LOAD AT THE BOTTOM CHORD.
- SEE DETAIL 20 ON SHEET S4 FOR ROOF TOP CURB ATTACHMENTS.
- TRUSS MANUFACTURER TO COORDINATE FIXED WINDOW OPENINGS IN GABLE END TRUSSES - SEE ARCH ELEVATIONS.

ARCHITECTURAL CONCEPTS INC.
241 WEST HAY DRIVE, SUITE 500, LENOIR, NC 28759

THEODORE A. DEWITT
NORTH CAROLINA PE NO. 048492

HAUSER-CREECH INC.
PROJECT # 2014-001
P: 919.817.7579
F: 919.817.7676
4506 PEARCE RD.,
ZEBULON, NC 27597

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:

LEO BROWN GROUP

THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX

REV. #	DATE	REVISION TITLE
--------	------	----------------

PLOT DATE:


FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO. 1902	SCALE: AS NOTED
---------------------	--------------------

DRAWING NO.

S2.1

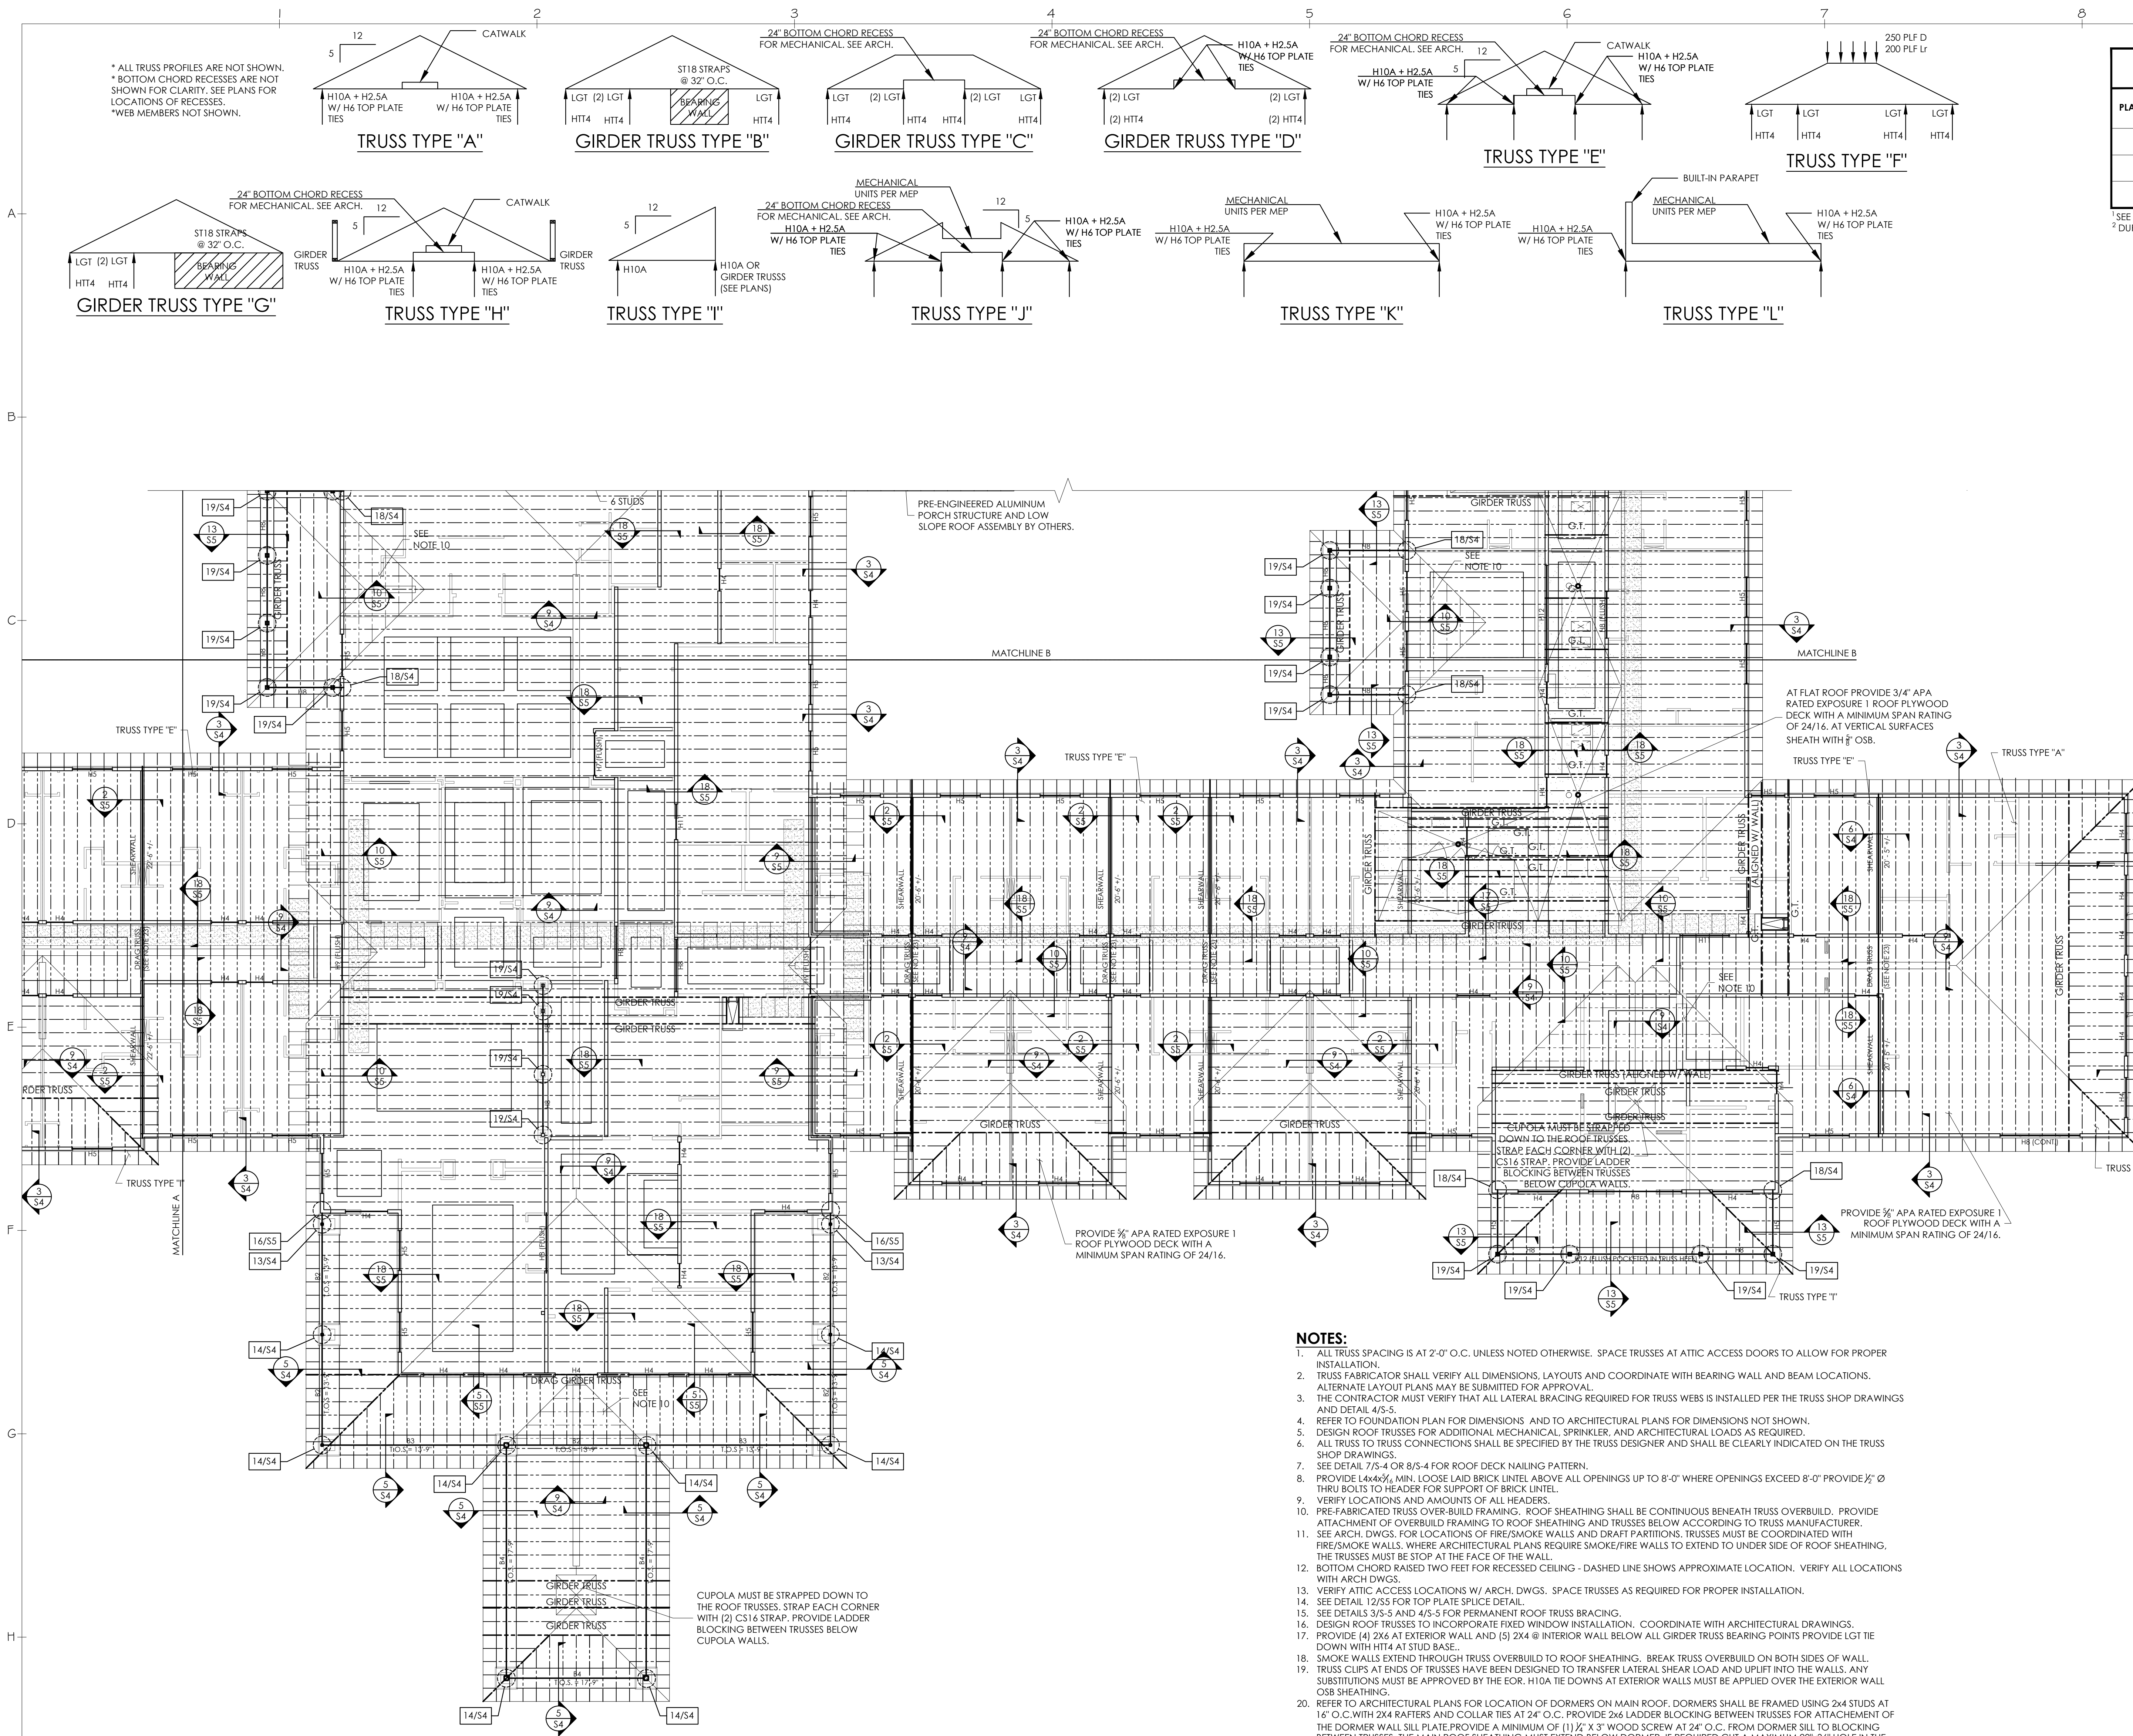

"SHEARWALL" DESIGNATES INTERIOR 2X4 STUDS SHEATHED @ ONE FACE W/ MINIMUM 7/8" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

WRAP ALL EXTERIOR WALLS WITH MINIMUM 7/8" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

FRAMING PLAN

SCALE: 3/32"=1'-0"

STUD SCHEDULE

PLATE HEIGHT	EXTERIOR WALLS ¹	INTERIOR WALLS ¹	CONSTRUCTION BRIDGING/BLOCKING LOCATION	NON-BEARING WALLS (U.N.O.)
10'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
12'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
14'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	THIRD-POINTS	2x4 @ 16" O.C.

¹SEE PLANS FOR STUD SIZING DIFFERING FROM SCHEDULE.


² DURING CONSTRUCTION, BRIDGING/BLOCKING ELEMENTS ARE REQUIRED TO BRACE STUDS.

HEADER AND BEAM SCHEDULE


TYPE	SIZE	NOTES
H1	(2) 2x8	W/ (1) 1/2" PLYWOOD SPACER, SEE 7/55
H2	(2) 2x10	W/ (1) 1/2" PLYWOOD SPACER, SEE 7/55
H3	(2) 2x12	W/ (1) 1/2" PLYWOOD SPACER, SEE 7/55
H4	(3) 2x8	W/ (2) 1/2" PLYWOOD SPACERS, SEE 7/55
H5	(3) 2x10	W/ (2) 1/2" PLYWOOD SPACERS, SEE 7/55
H6	(3) 2x12	W/ (2) 1/2" PLYWOOD SPACERS, SEE 7/55
H7	(2) 1 3/4" x 11 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H8	(3) 1 3/4" x 11 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H9	(2) 1 3/4" x 14" LVL FLUSH BEAM, BOTTOM OF BEAM FLUSH WITH BOTTOM OF ROOF TRUSSES	Fb=2850 PSI, E=2.0. STRAP ENDS OF BEAM TO STUD GROUP BELOW W/ (2) H6 TIES. PROVIDE HTT4 HOLDDOWN AT STUD BASE.
H10	(2) 1 3/4" x 9 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H11	(3) 1 3/4" x 9 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H12	(3) 1 3/4" x 16" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
B1	W10x15 STEEL BEAM	
B2	W12x19 STEEL BEAM	
B3	W12x26 STEEL BEAM	
B4	W18x40 STEEL BEAM	

NOTES:

- ALL TRUSS SPACING IS AT 2'-0" O.C. UNLESS NOTED OTHERWISE. SPACE TRUSSES AT ATTIC ACCESS DOORS TO ALLOW FOR PROPER INSTALLATION.
- TRUSS FABRICATOR SHALL VERIFY ALL DIMENSIONS, LAYOUTS AND COORDINATE WITH BEARING WALL AND BEAM LOCATIONS. ALTERNATE LAYOUT PLANS MAY BE SUBMITTED FOR APPROVAL.
- THE CONTRACTOR MUST VERIFY THAT ALL LATERAL BRACING REQUIRED FOR TRUSS WEBS IS INSTALLED PER THE TRUSS SHOP DRAWINGS AND DETAIL 4/5-5.
- REFER TO FOUNDATION PLAN FOR DIMENSIONS AND TO ARCHITECTURAL PLANS FOR DIMENSIONS NOT SHOWN.
- DESIGN ROOF TRUSSES FOR ADDITIONAL MECHANICAL, SPARKLER, AND ARCHITECTURAL LOADS AS REQUIRED.
- ALL TRUSS TO TRUSS CONNECTIONS SHALL BE SPECIFIED BY THE TRUSS DESIGNER AND SHALL BE CLEARLY INDICATED ON THE TRUSS SHOP DRAWINGS.
- SEE DETAIL 7/5-4 OR 8/5-4 FOR ROOF DECK NAILING PATTERN.
- PROVIDE 1/4"x6"x6", MIN. LOOSE LAD BRICK UNTEL ABOVE ALL OPENINGS UP TO 8'-0" WHERE OPENINGS EXCEED 8'-0" PROVIDE 1/2" Ø THRU BOLTS TO HEADER FOR SUPPORT OF BRICK UNTEL.
- VERIFY LOCATIONS AND AMOUNTS OF ALL HEADERS.
- PRE-FABRICATED TRUSS OVER BUILD FRAMING. ROOF SHEATHING SHALL BE CONTINUOUS BENEATH TRUSS OVERBUILD. PROVIDE ATTACHMENT OF OVERBUILD FRAMING TO ROOF SHEATHING AND TRUSSES BELOW ACCORDING TO TRUSS MANUFACTURER.
- SEE ARCH. DWGS. FOR LOCATIONS OF FIRE/SMOKE WALLS AND DRAFT PARTITIONS. TRUSSES MUST BE COORDINATED WITH FIRE/SMOKE WALLS. WHERE ARCHITECTURAL PLANS REQUIRE SMOKE/FIRE WALLS TO EXTEND TO UNDER SIDE OF ROOF SHEATHING, THE TRUSSES MUST BE STOP AT THE FACE OF THE WALL.
- BOTTOM CHORD RAISED TWO FEET FOR RECESSED CEILING - DASHED LINE SHOWS APPROXIMATE LOCATION. VERIFY ALL LOCATIONS WITH ARCH DWGS.
- VERIFY ATTIC ACCESS LOCATIONS W/ ARCH. DWGS. SPACE TRUSSES AS REQUIRED FOR PROPER INSTALLATION.
- SEE DETAIL 12/55 FOR TOP PLATE SPLICE DETAIL.
- SEE DETAILS 3/5-5 AND 4/5-5 FOR PERMANENT ROOF TRUSS BRACING.
- DESIGN ROOF TRUSSES TO INCORPORATE FIXED WINDOW INSTALLATION. COORDINATE WITH ARCHITECTURAL DRAWINGS.
- PROVIDE (4) 2x6 AT EXTERIOR WALL AND (5) 2x4 @ INTERIOR WALL BELOW ALL GIRDER TRUSS BEARING POINTS PROVIDE LGT TIE DOWN WITH HTT4 AT STUD BASE.
- SMOKE WALLS EXTEND THROUGH TRUSS OVERBUILD TO ROOF SHEATHING. BREAK TRUSS OVERBUILD ON BOTH SIDES OF WALL. TRUSS CLIPS AT ENDS OF TRUSSES HAVE BEEN DESIGNED TO TRANSFER LATERAL SHEAR LOAD AND UPLIFT INTO THE WALLS. ANY SUBSTITUTIONS MUST BE APPROVED BY THE EOR. H10A TIE DOWNS AT EXTERIOR WALLS MUST BE APPLIED OVER THE EXTERIOR WALL OSB SHEATHING.
- REFER TO ARCHITECTURAL PLANS FOR LOCATION OF DORMERS ON MAIN ROOF. DORMERS SHALL BE FRAMED USING 2x4 STUDS AT 16" O.C. WITH 2x4 RAFTERS AND COLLAR TIES AT 24" O.C. PROVIDE 2x6 LADDER BLOCKING BETWEEN TRUSSES FOR ATTACHMENT OF THE DORMER WALL SILL PLATE PROVIDE A MINIMUM OF (1) 1/2" x 3" WOOD SCREW AT 24" O.C. FROM DORMER SILL TO BLOCKING BETWEEN TRUSSES. THE MAIN ROOF SHEATHING MUST EXTEND BELOW DORMER. IF REQUIRED CUT A MAXIMUM 20"x36" HOLE IN THE MAIN ROOF SHEATHING BELOW THE DORMER FOR VENTILATION.
- COORDINATE WITH MP AND E DRAWINGS FOR THE ROOF TOP PLATFORM AND EXTERIOR LADDER LOCATION. SEE SHEET S7 FOR DETAILS.
- BUILD CRIPPLE WALL FROM LOW ROOF SHEATHING TO BOTTOM OF CANOPY TRUSS. PROVIDE 2x6 LADDER BLOCKING AT 24" O.C. BETWEEN LOW ROOF TRUSSES UNDER CRIPPLE WALL. CONTRACTOR MUST PROVIDE CONTINUOUS UPLIFT CONNECTIONS.
- ALIGN DRAG TRUSS WITH SHEAR WALL PER DETAIL 6/54. DESIGN DRAG TRUSS TO TRANSFER 200 PLF LATERAL LOAD FROM TOP CHORD TO BOTTOM CHORD. LATERAL LOAD IS RESISTED BY SHEAR WALL BELOW.
- PROVIDE DOUBLE DROPPED STRUCTURAL GABLE END TRUSS AT END OF PORCH ROOF. HANG SOFFIT FRAMING FROM BOTTOM CHORD OF TRUSSES. TRUSS DESIGNER TO DESIGN GABLE END TO SUPPORT AN ADDITIONAL 150 PLF DEAD LOAD AT THE BOTTOM CHORD.
- SEE DETAIL 20 ON SHEET S4 FOR ROOF TOP CURB ATTACHMENTS.
- TRUSS MANUFACTURER TO COORDINATE FIXED WINDOW OPENINGS IN GABLE END TRUSSES - SEE ARCH ELEVATIONS.

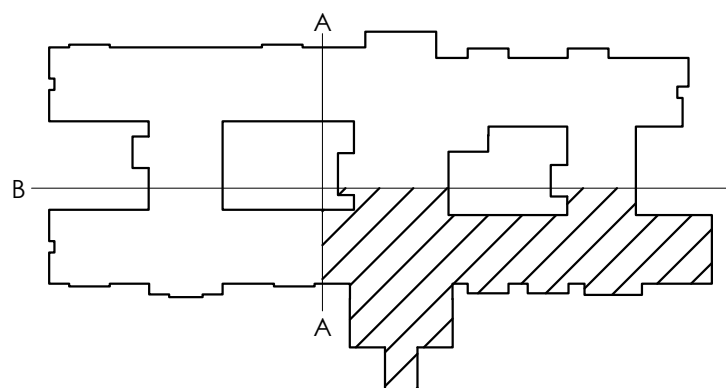

KEY PLAN

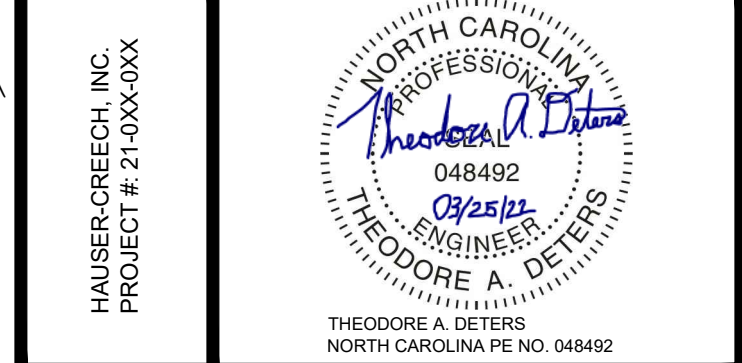

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:



THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR USE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX
REVISIONS:	
REV. #	DATE REVISION TITLE


PLOT DATE:

FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO. 1902	SCALE: AS NOTED
DRAWING NO.	

S2.2

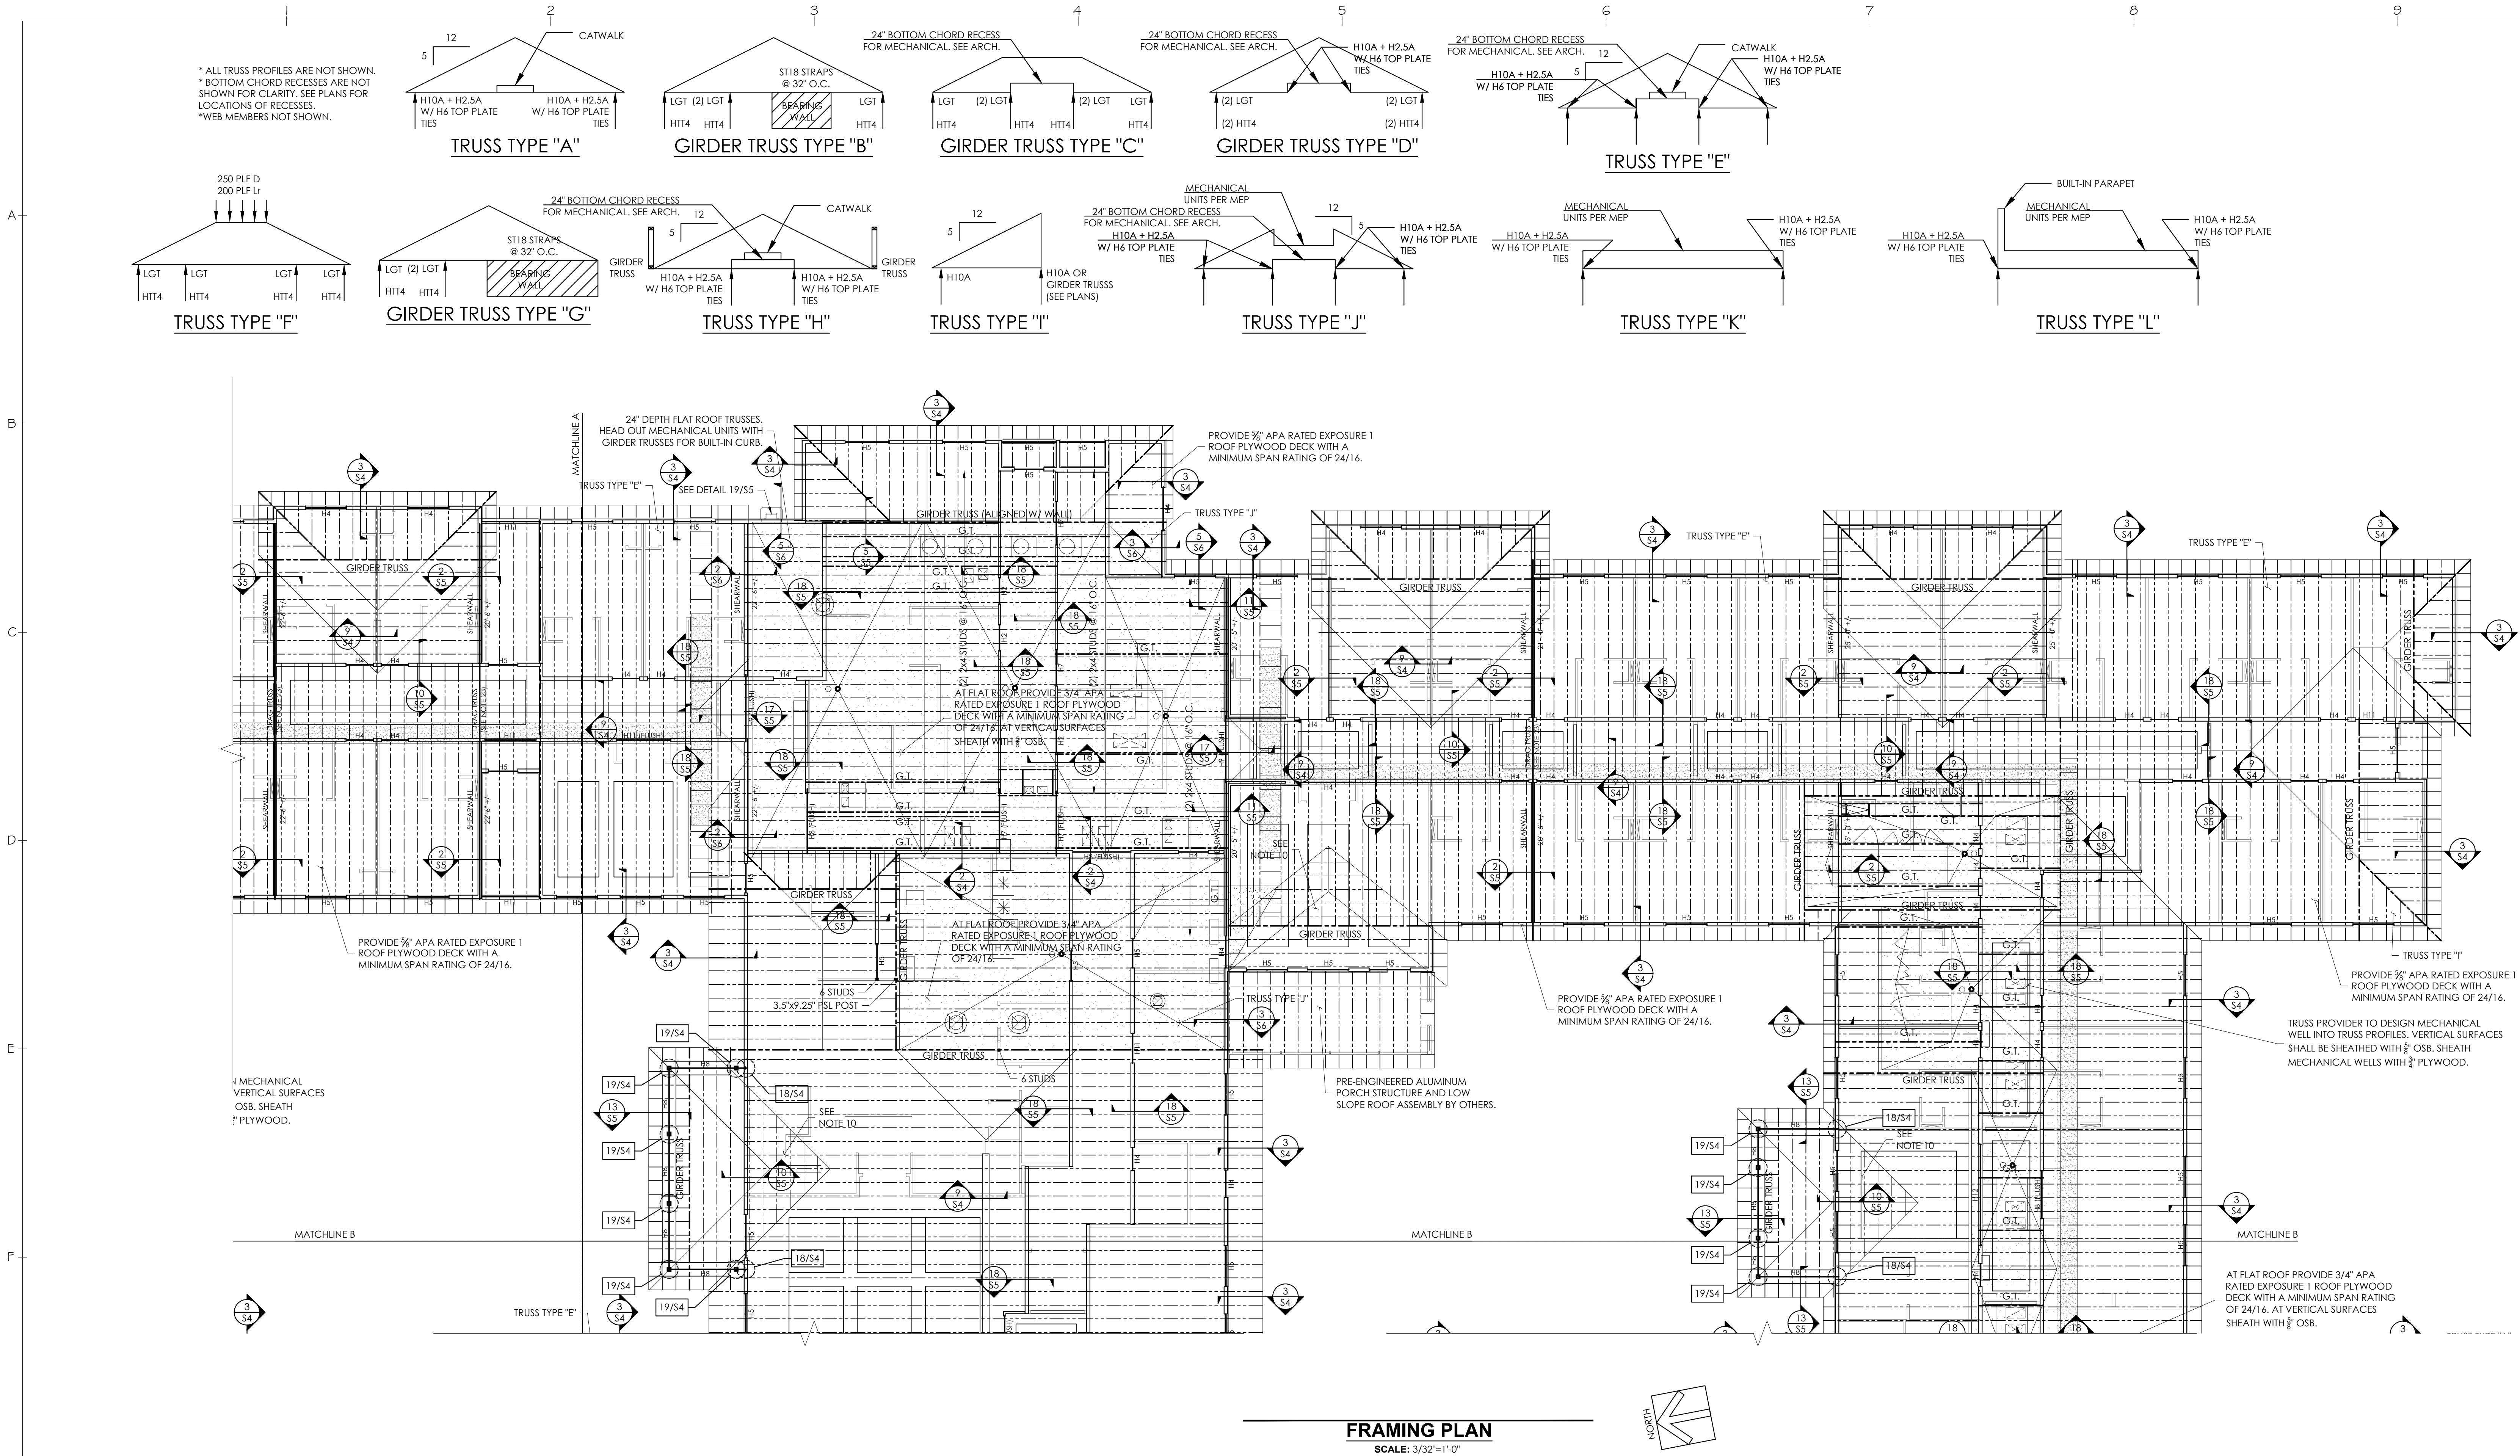

NOTES:

- ALL TRUSS SPACING IS AT 2'-0" O.C. UNLESS NOTED OTHERWISE. SPACE TRUSSES AT ATTIC ACCESS DOORS TO ALLOW FOR PROPER INSTALLATION.
- TRUSS FABRICATOR SHALL VERIFY ALL DIMENSIONS, LAYOUTS AND COORDINATE WITH BEARING WALL AND BEAM LOCATIONS. ALTERNATE LAYOUT PLANS MAY BE SUBMITTED FOR APPROVAL.
- THE CONTRACTOR MUST VERIFY THAT ALL LATERAL BRACING REQUIRED FOR TRUSS WEBS IS INSTALLED PER THE TRUSS SHOP DRAWINGS AND DETAIL 4/5-S.
- REFER TO FOUNDATION PLAN FOR DIMENSIONS, AND TO ARCHITECTURAL PLANS FOR DIMENSIONS NOT SHOWN.
- DESIGN ROOF TRUSSES FOR ADDITIONAL MECHANICAL SPRINKLER, AND ARCHITECTURAL LOADS AS REQUIRED.
- ALL TRUSS TO TRUSS CONNECTIONS SHALL BE SPECIFIED BY THE TRUSS DESIGNER AND SHALL BE CLEARLY INDICATED ON THE TRUSS SHOP DRAWINGS.
- SEE DETAIL 7/8-4 OR 8/4-S FOR ROOF DECK VAULTING PATTERN.
- PROVIDE 1/4"x4"x3/4" MIN. LOOSE LAID BRICK UNTEL ABOVE ALL OPENINGS UP TO 8'-0" WHERE OPENINGS EXCEED 8'-0" PROVIDE 1/2" Ø THRU BOLTS TO HEADER FOR SUPPORT OF BRICK UNTEL.
- VERIFY LOCATIONS AND AMOUNTS OF ALL HEADERS.
- PRE-FABRICATED TRUSS OVERBUILD FRAMING. ROOF SHEATHING SHALL BE CONTINUOUS BENEATH TRUSS OVERBUILD. PROVIDE ATTACHMENT OF OVERBUILD FRAMING TO ROOF SHEATHING AND TRUSSES BELOW ACCORDING TO TRUSS MANUFACTURER.
- SEE ARCH. DWGS. FOR LOCATIONS OF FIRE/SMOKE WALLS AND DRAFT PARTITIONS. TRUSSES MUST BE COORDINATED WITH FIRE/SMOKE WALLS. WHERE ARCHITECTURAL PLANS REQUIRE SMOKE/FIRE WALLS TO EXTEND TO UNDER SIDE OF ROOF SHEATHING, THE TRUSSES MUST BE STOP AT THE FACE OF THE WALL.
- BOTTOM CHORD RAISED TWO FEET FOR RECESSED CEILING - DASHED LINE SHOWS APPROXIMATE LOCATION. VERIFY ALL LOCATIONS WITH ARCH DWGS.
- VERIFY ATTIC ACCESS LOCATIONS W/ ARCH. DWGS. SPACE TRUSSES AS REQUIRED FOR PROPER INSTALLATION.
- SEE DETAIL 12/55 FOR TOP PLATE SPLICE DETAIL.
- SEE DETAILS 3/5-S AND 4/5-S FOR PERMANENT ROOF TRUSS BRACING.
- DESIGN ROOF TRUSSES TO INCORPORATE FIXED WINDOW INSTALLATION. COORDINATE WITH ARCHITECTURAL DRAWINGS.
- PROVIDE (4) 2x6 AT EXTERIOR WALL AND (5) 2x4 @ INTERIOR WALL BELOW ALL GIRDER TRUSS BEARING POINTS PROVIDE LGT TIE DOWN WITH HT4 AT STUD BASE.
- SMOKE WALLS EXTEND THROUGH TRUSS OVERBUILD TO ROOF SHEATHING. BREAK TRUSS OVERBUILD ON BOTH SIDES OF WALL.
- TRUSS CLIPS AT ENDS OF TRUSSES HAVE BEEN DESIGNED TO TRANSFER LATERAL SHEAR LOAD AND UPLIFT INTO THE WALLS. ANY SUBSTITUTIONS MUST BE APPROVED BY THE EOR. H10A TIE DOWNS AT EXTERIOR WALLS MUST BE APPLIED OVER THE EXTERIOR WALL OSB SHEATHING.
- REFER TO ARCHITECTURAL PLANS FOR LOCATION OF DORMERS ON MAIN ROOF. DORMERS SHALL BE FRAMED USING 2x4 STUDS AT 14" O.C. WITH 2x4 RAFTERS AND COLLAR TIES AT 24" O.C. PROVIDE 2x6 LADDER BLOCKING BETWEEN TRUSSES FOR ATTACHMENT OF THE DORMER WALL SILL PLATE PROVIDE A MINIMUM OF (1) 1/2" X 3" WOOD SCREW AT 24" O.C. FROM DORMER SILL TO BLOCKING BETWEEN TRUSSES. THE MAIN ROOF SHEATHING MUST EXTEND BELOW DORMER. IF REQUIRED CUT A MAXIMUM 20"x36" HOLE IN THE MAIN ROOF SHEATHING BELOW THE DORMER FOR VENTILATION.
- COORDINATE WITH MP AND E DRAWINGS FOR THE ROOF TOP PLATFORM AND EXTERIOR LADDER LOCATION. SEE SHEET S7 FOR DETAILS.
- BUILD CRIPPLE WALL FROM LOW ROOF SHEATHING TO BOTTOM OF CANOPY TRUSS. PROVIDE 2x6 LADDER BLOCKING AT 24" O.C. BETWEEN LOW ROOF TRUSSES UNDER CRIPPLE WALL. CONTRACTOR MUST PROVIDE CONTINUOUS UPLIFT CONNECTIONS.
- ALIGN DRAG TRUSS WITH SHEAR WALL PER DETAIL 4/5-A. DESIGN DRAG TRUSS TO TRANSFER 200 PLF LATERAL LOAD FROM TOP CHORD TO BOTTOM CHORD. LATERAL LOAD IS RESISTED BY SHEAR WALL BELOW.
- PROVIDE DOUBLE DROPPED STRUCTURAL GABLE END TRUSS AT END OF PORCH ROOF. HANG SOFFIT FRAMING FROM BOTTOM CHORD OF TRUSSES. TRUSS DESIGNER TO DESIGN GABLE END TO SUPPORT AN ADDITIONAL 150 PLF DEAD LOAD AT THE BOTTOM CHORD.
- SEE DETAIL 20 ON SHEET S4 FOR ROOF TOP CURB ATTACHMENTS.
- TRUSS MANUFACTURER TO COORDINATE FIXED WINDOW OPENINGS IN GABLE END TRUSSES - SEE ARCH ELEVATIONS.

STUD SCHEDULE

PLATE HEIGHT	EXTERIOR WALLS ¹	INTERIOR WALLS ¹	CONSTRUCTION BRIDGING/BLOCKING LOCATIONS ²	NON-BEARING WALLS (U.N.O.)
10'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
12'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	MID-POINTS	2x4 @ 16" O.C.
14'-0"	2x6 @ 16" O.C.	2x6 @ 16" O.C.	THIRD-POINTS	2x4 @ 16" O.C.


¹SEE PLANS FOR STUD SIZING DIFFERING FROM SCHEDULE.
²DURING CONSTRUCTION, BRIDGING/BLOCKING ELEMENTS ARE REQUIRED TO BRACE STUDS.

HEADER AND BEAM SCHEDULE



TYPE	SIZE	NOTES
H1	(2) 2x8	W/ (1) 1/2" PLYWOOD SPACER. SEE 7/55
H2	(2) 2x10	W/ (1) 1/2" PLYWOOD SPACER. SEE 7/55
H3	(2) 2x12	W/ (1) 1/2" PLYWOOD SPACER. SEE 7/55
H4	(3) 2x8	W/ (2) 1/2" PLYWOOD SPACERS. SEE 7/55
H5	(3) 2x10	W/ (2) 1/2" PLYWOOD SPACERS. SEE 7/55
H6	(3) 2x12	W/ (2) 1/2" PLYWOOD SPACERS. SEE 7/55
H7	(2) 1 3/4" x 11 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H8	(3) 1 3/4" x 11 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H9	(2) 1 3/4" x 14" LVL FLUSH BEAM, BOTTOM OF BEAM FLUSH WITH BOTTOM OF ROOF TRUSSES	Fb=2850 PSI, E=2.0. STRAP ENDS OF BEAM TO STUD GROUP BELOW W/ (2) H6 TIES. PROVIDE HT4 HOLDDOWN AT STUD BASE.
H10	(2) 1 3/4" x 9 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H11	(3) 1 3/4" x 9 1/4" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
H12	(3) 1 3/4" x 16" LVL DROPPED BEAM	Fb=2850 PSI, E=2.0
B1	W10x15 STEEL BEAM	
B2	W12x19 STEEL BEAM	
B3	W12x26 STEEL BEAM	
B4	W18x40 STEEL BEAM	

"SHEARWALL" DESIGNATES INTERIOR 2X4 STUDS SHEATHED @ ONE FACE W/ MINIMUM 1/4" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

WRAP ALL EXTERIOR WALLS WITH MINIMUM 1/4" OSB. PROVIDE HORIZONTAL 2x BLOCKS AT ALL UNSUPPORTED JOINTS. EDGE NAIL WITH 8d COMMONS AT 4" O.C. AND FIELD NAIL WITH 8d COMMONS AT 12" O.C.

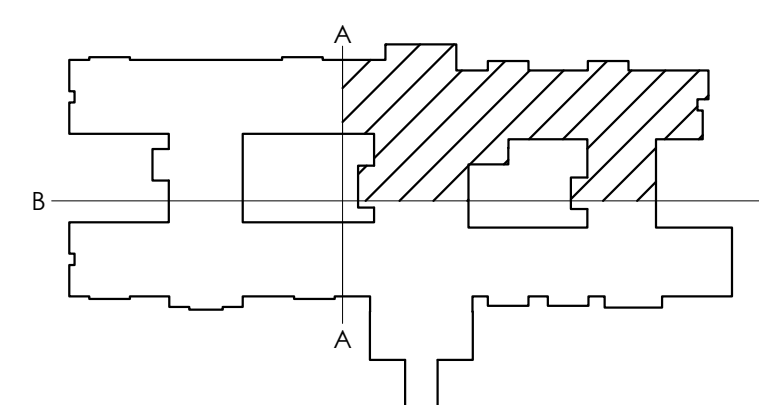

KEY PLAN

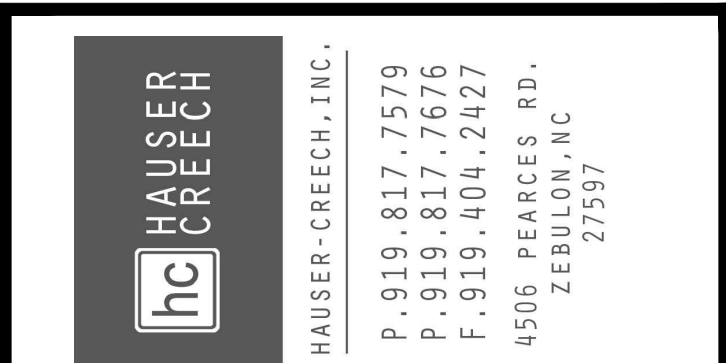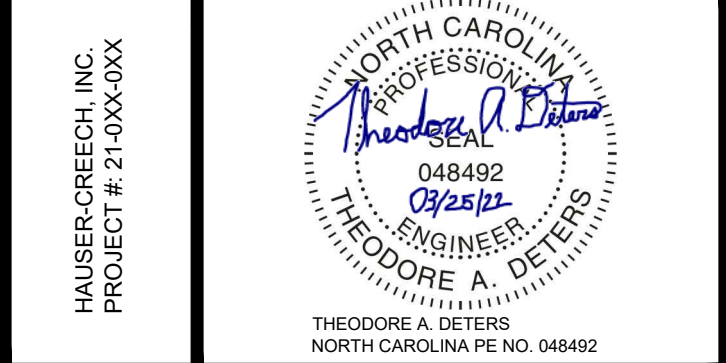

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:



THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX
REVISIONS:	
REV. #	DATE REVISION TITLE

PLOT DATE:

FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO.


1902

SCALE:

AS NOTED

DRAWING NO.

S2.3

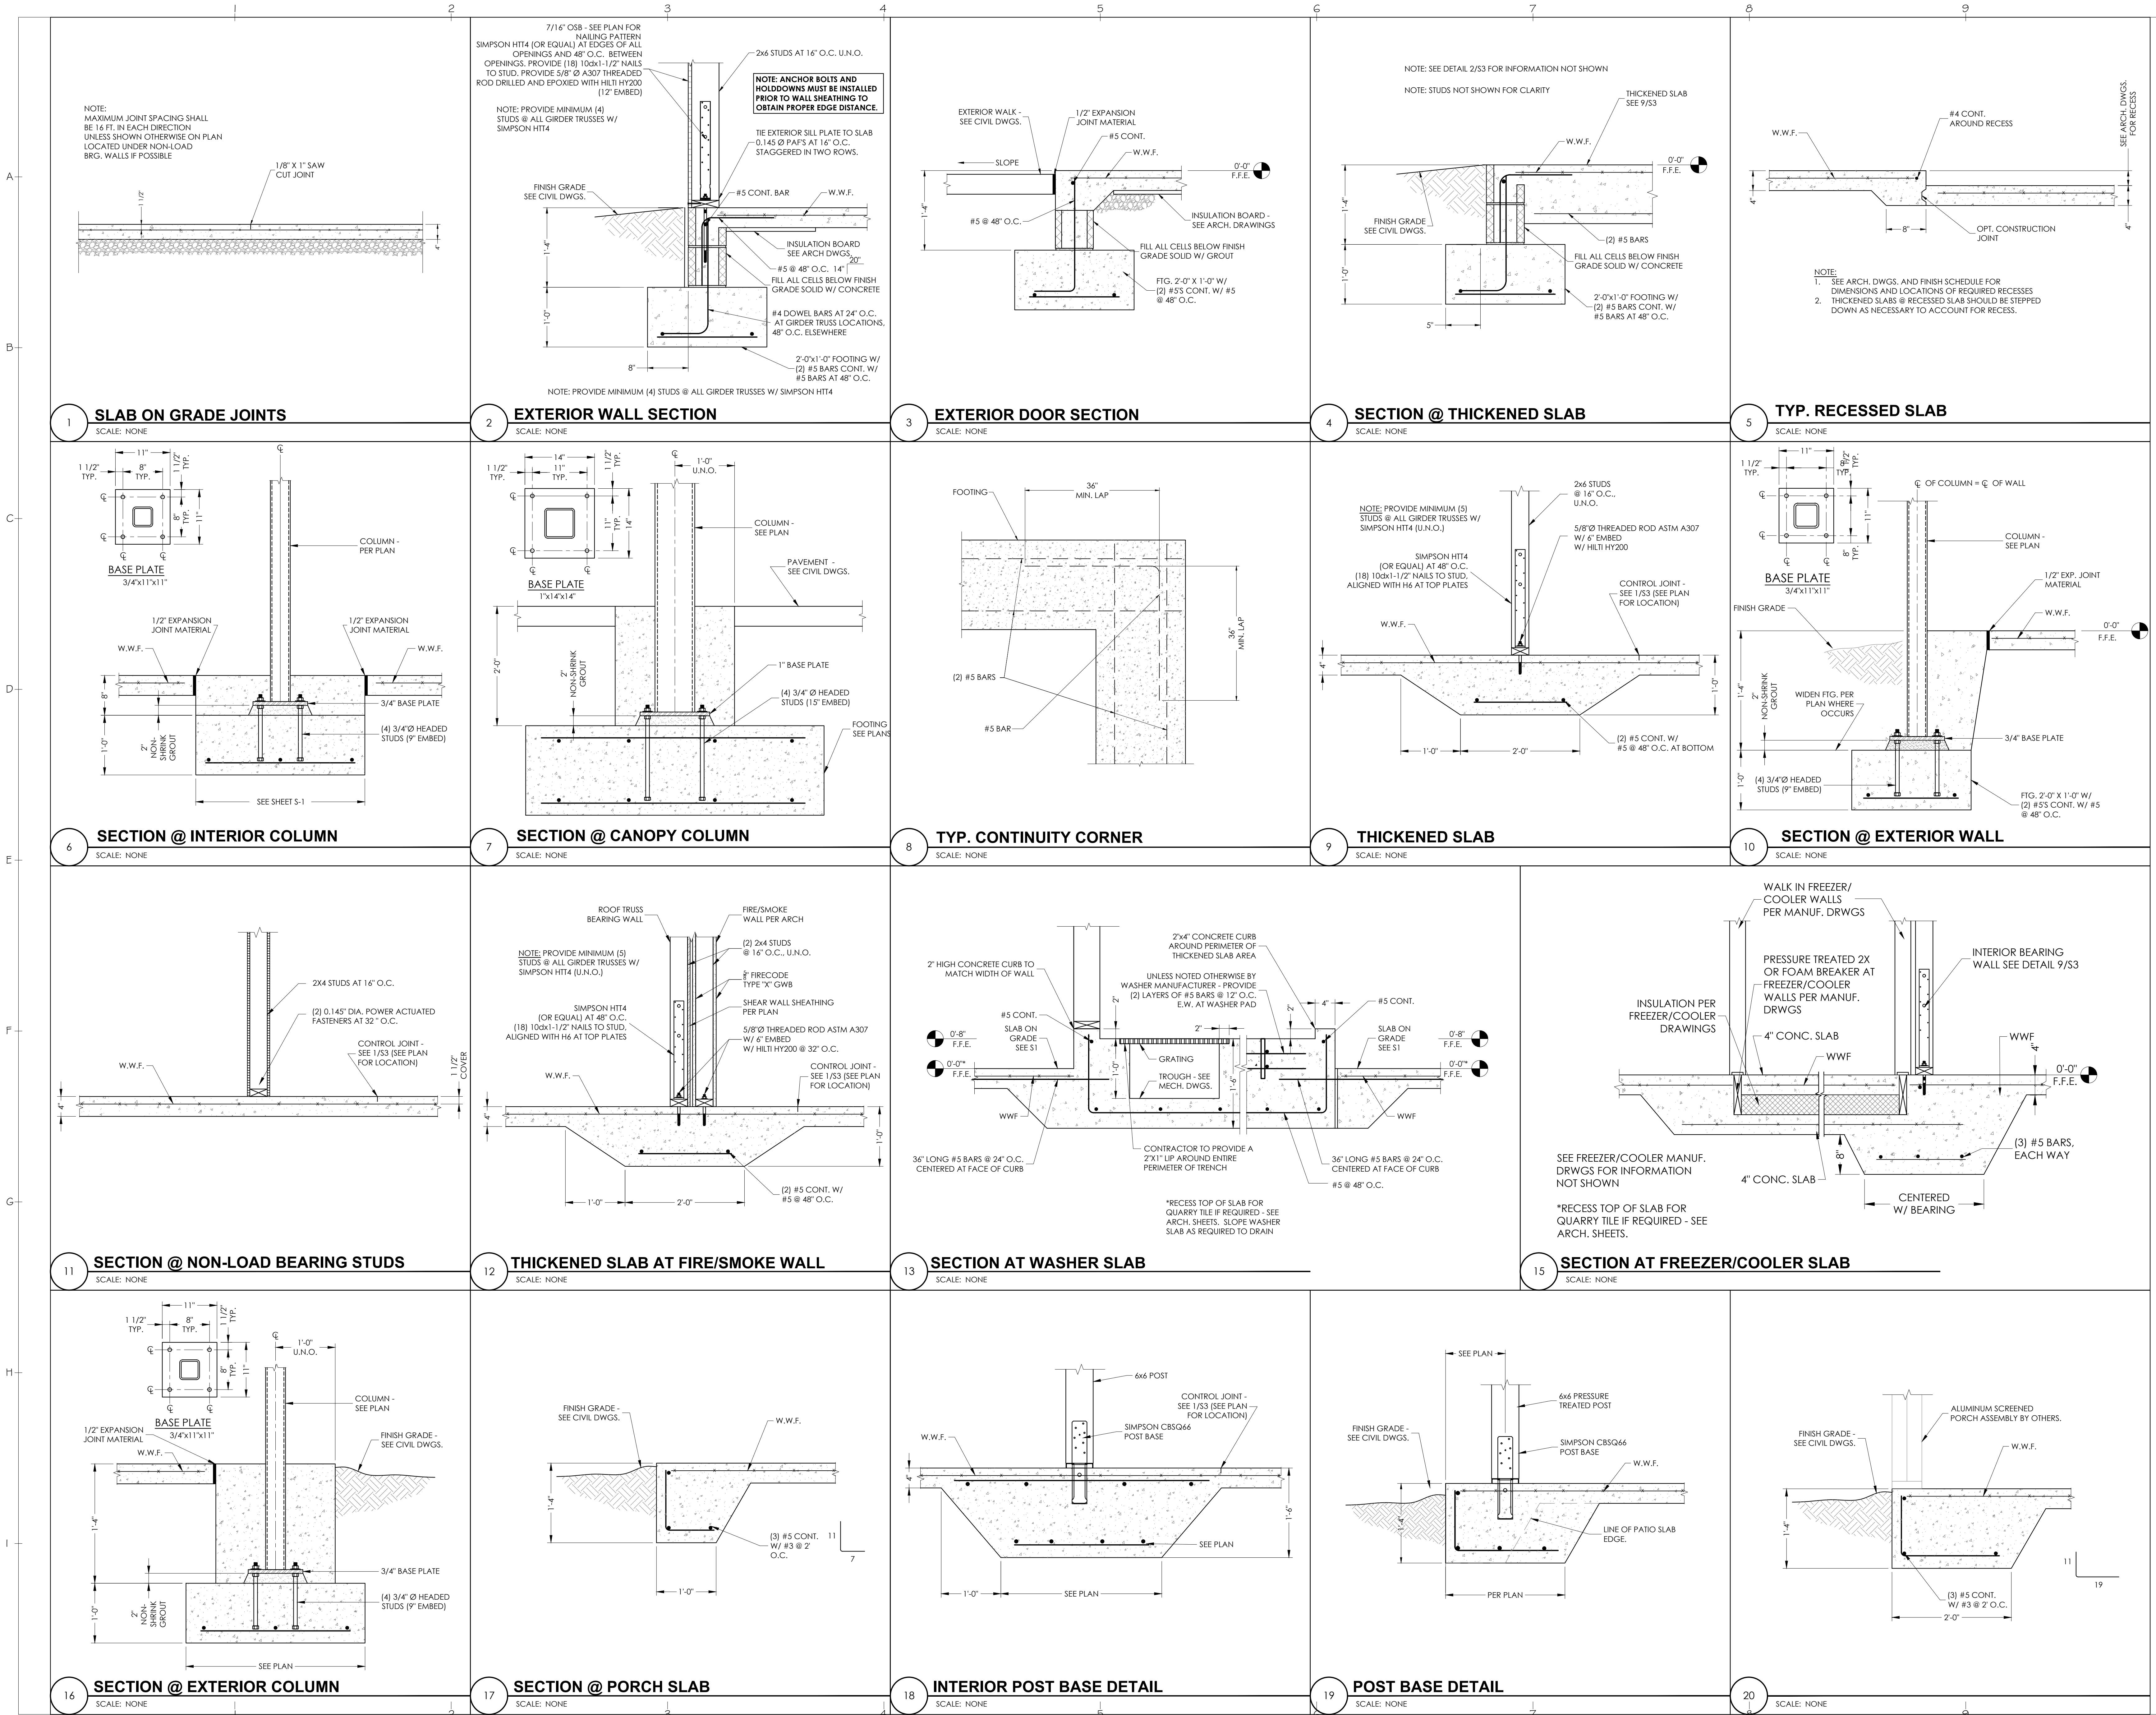

ARCHITECTURAL CONCEPTS INC.
241 WEST 1ST STREET, SUITE 200, LENOIR, NC 28755

THEODORE A. DEWITT
PROFESSIONAL ENGINEER
048492
NORTH CAROLINA
TRUSTEES & LIES
NORTH CAROLINA PE NO. 048492

HAUSER-CREECH INC.
P. 919.817.7579
P. 919.817.7676
F. 919.404.2427
4506 PEARCE RD.
ZEBULON, NC 27597

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:

LEO BROWN GROUP

THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX

REVISIONS:	REV.	DATE	REVISION TITLE
------------	------	------	----------------

PLOT DATE:


FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO. 1902	SCALE: AS NOTED
---------------------	--------------------


DRAWING NO.

S3

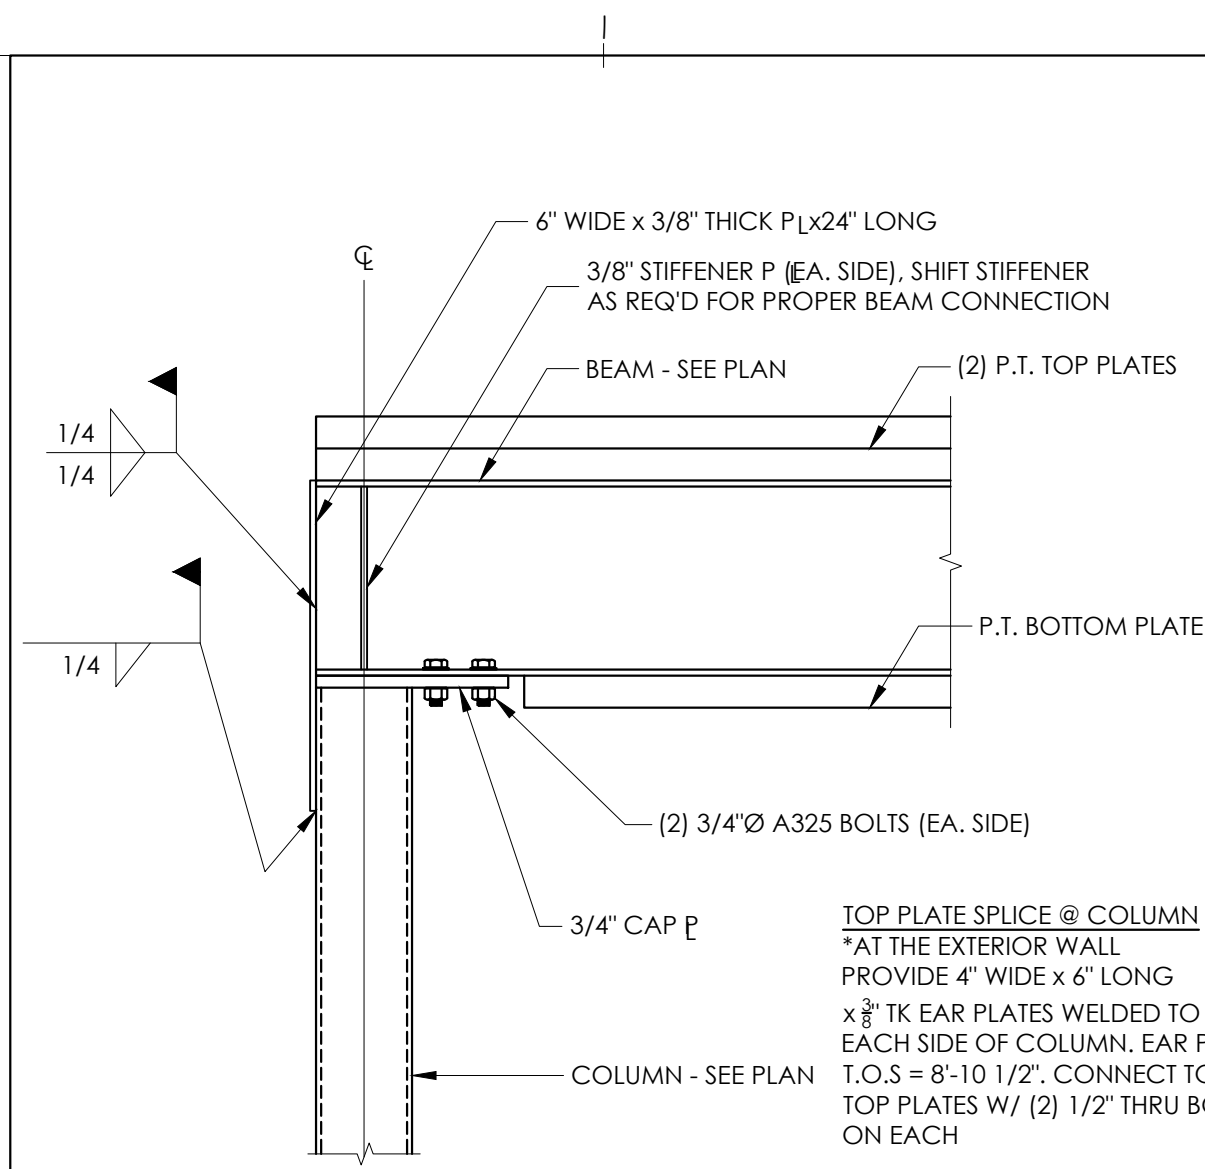


1 BEAM DETAIL @ COLUMN

SCALE: NONE

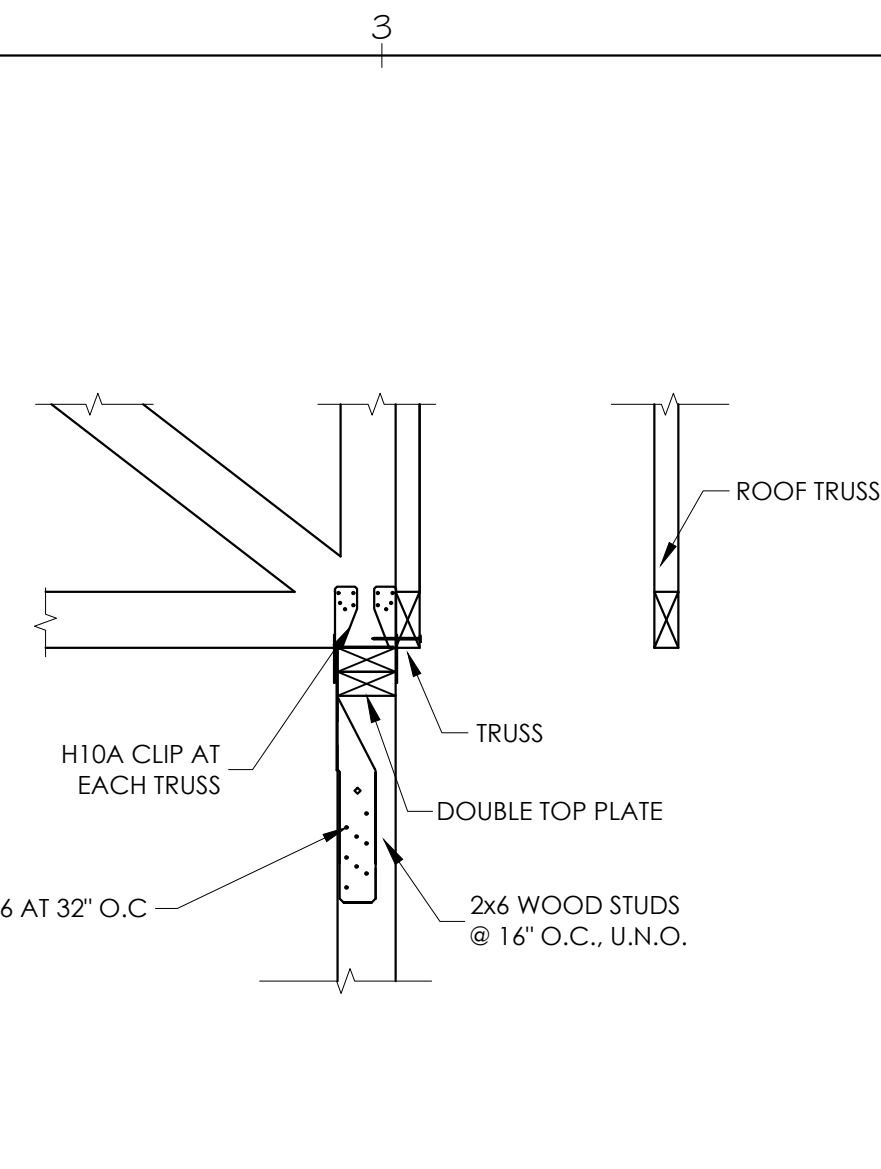


2 INTERIOR TRUSS BEARING

SCALE: NONE

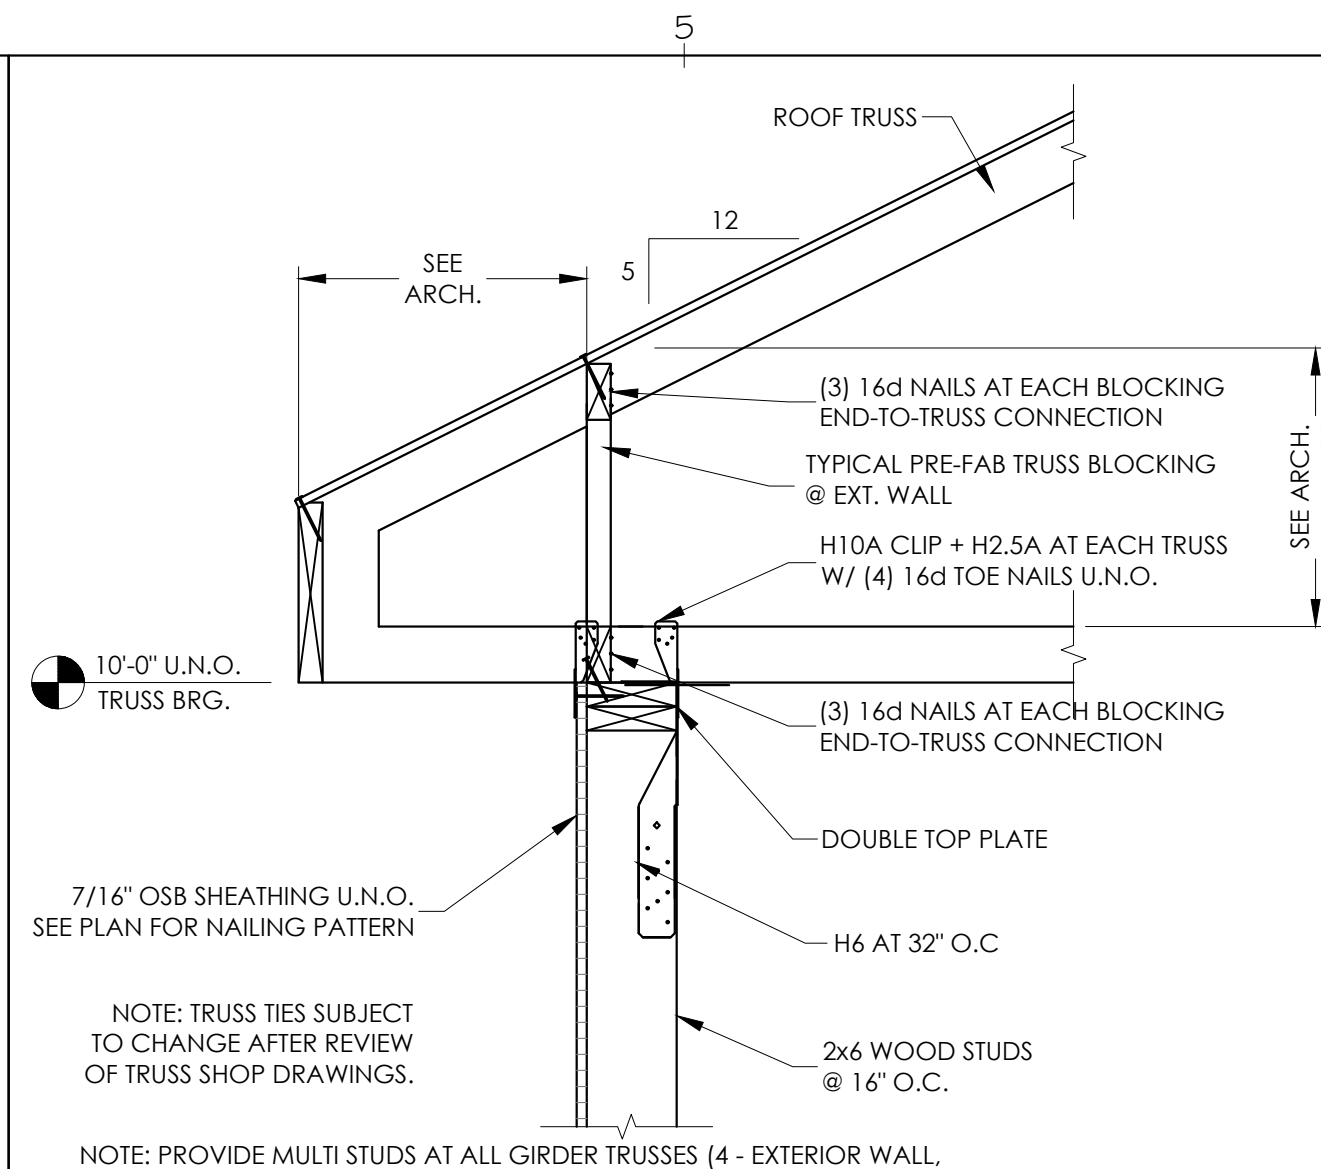


3 PREFAB. TRUSS @ EXT. WALL

SCALE: NONE

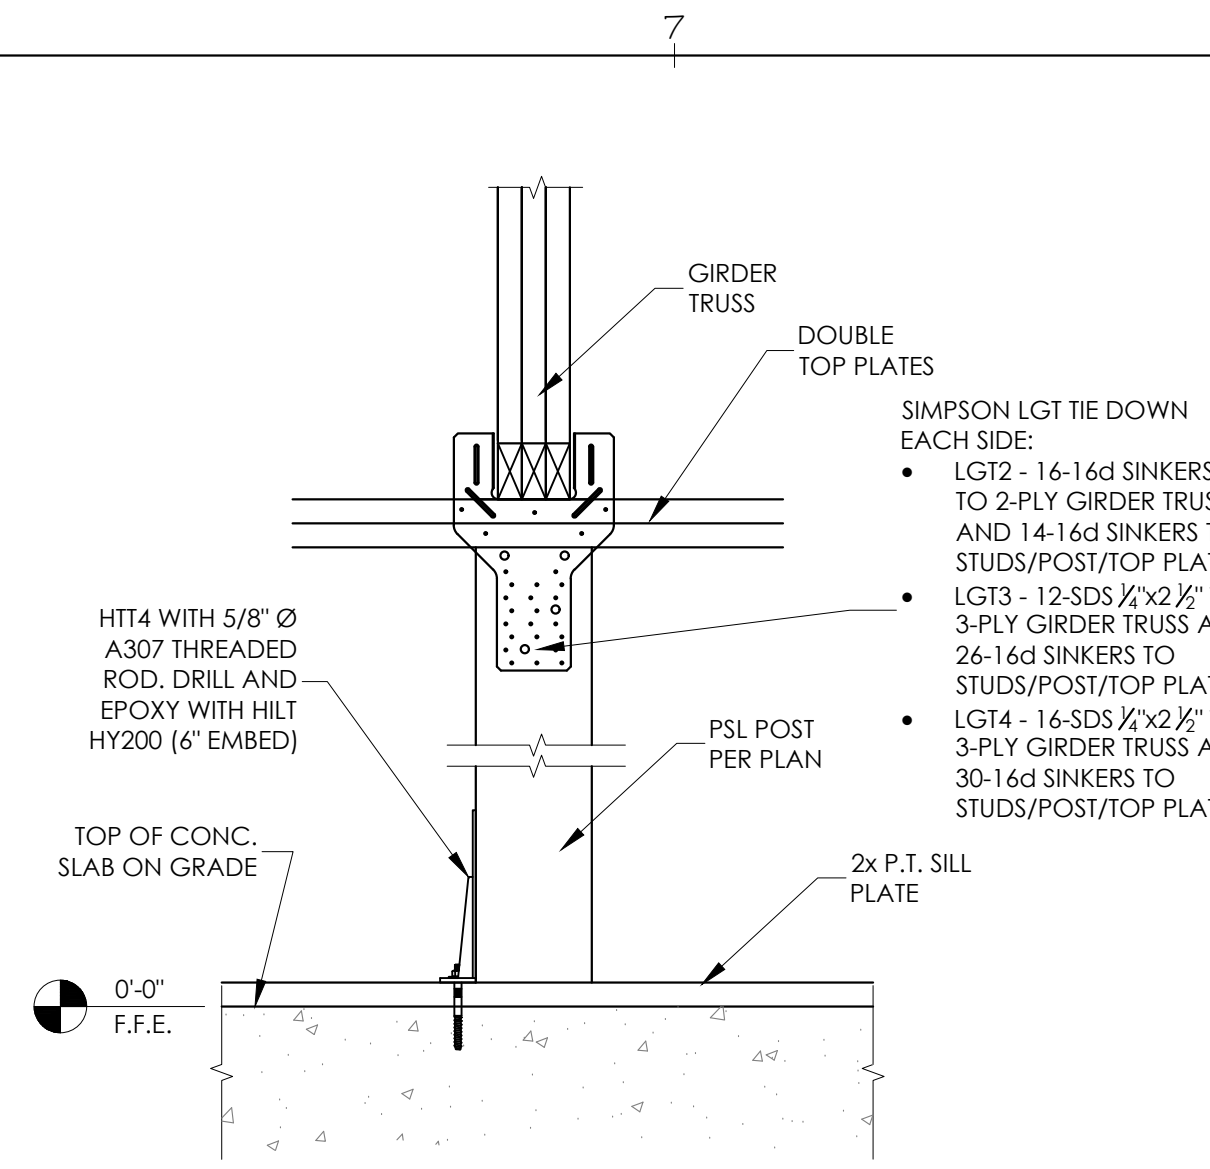


4 GIRDER TIE DOWN

SCALE: NONE

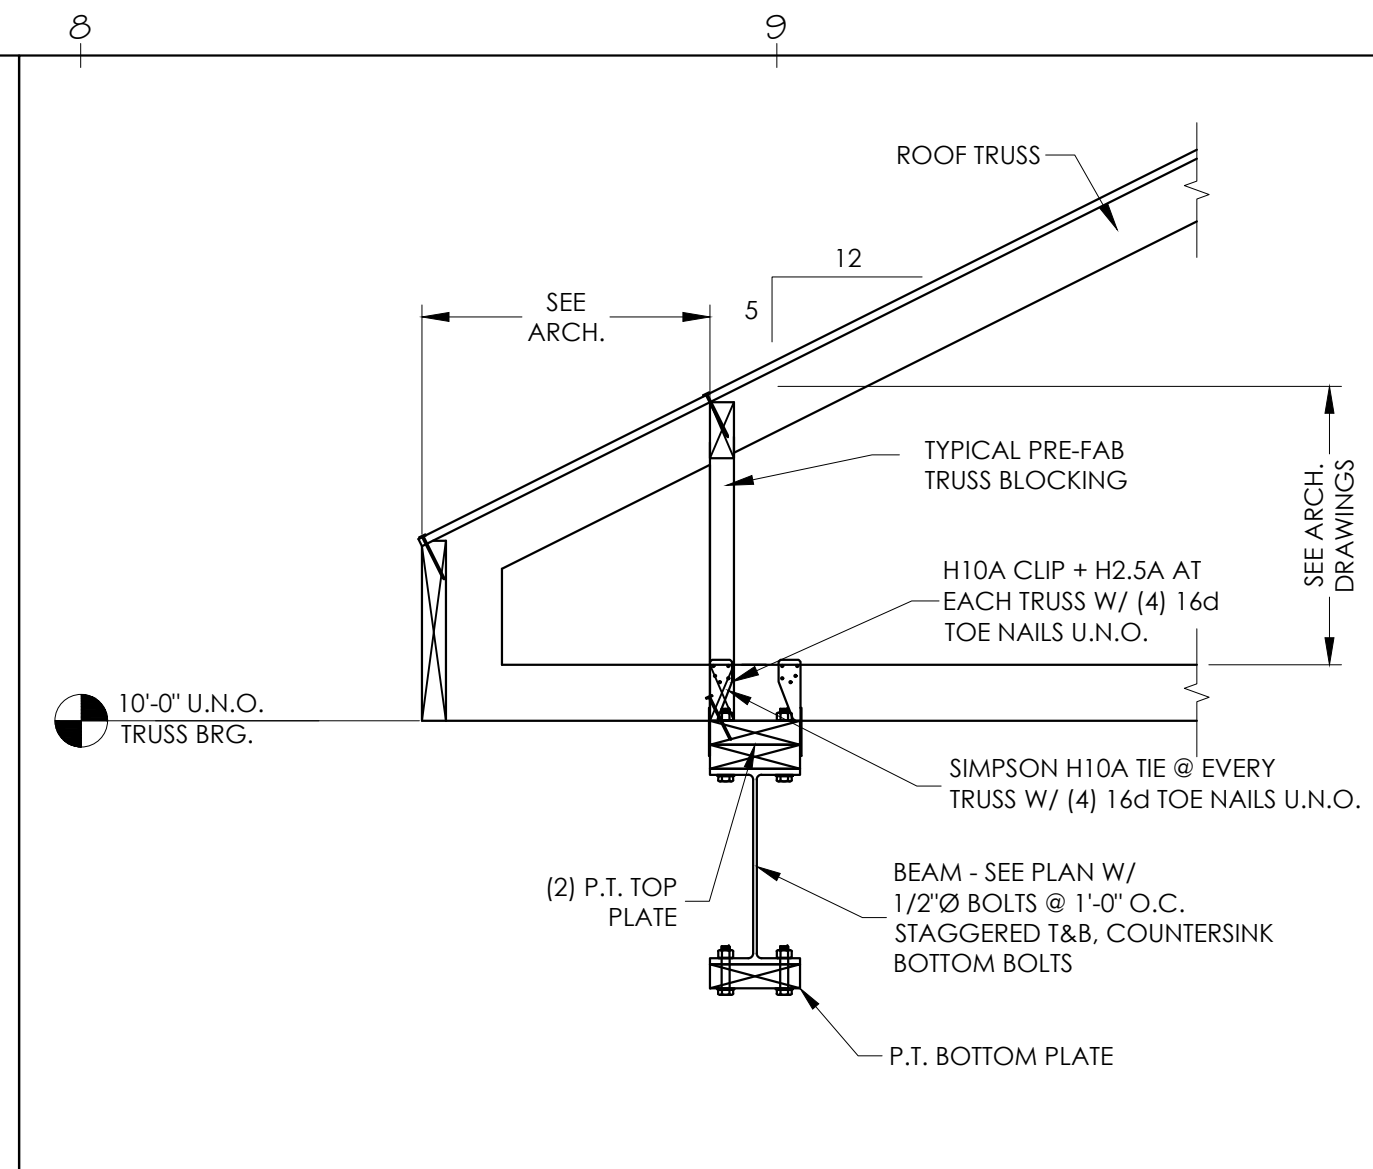


5 TRUSS BEARING @ BEAM

SCALE: NONE

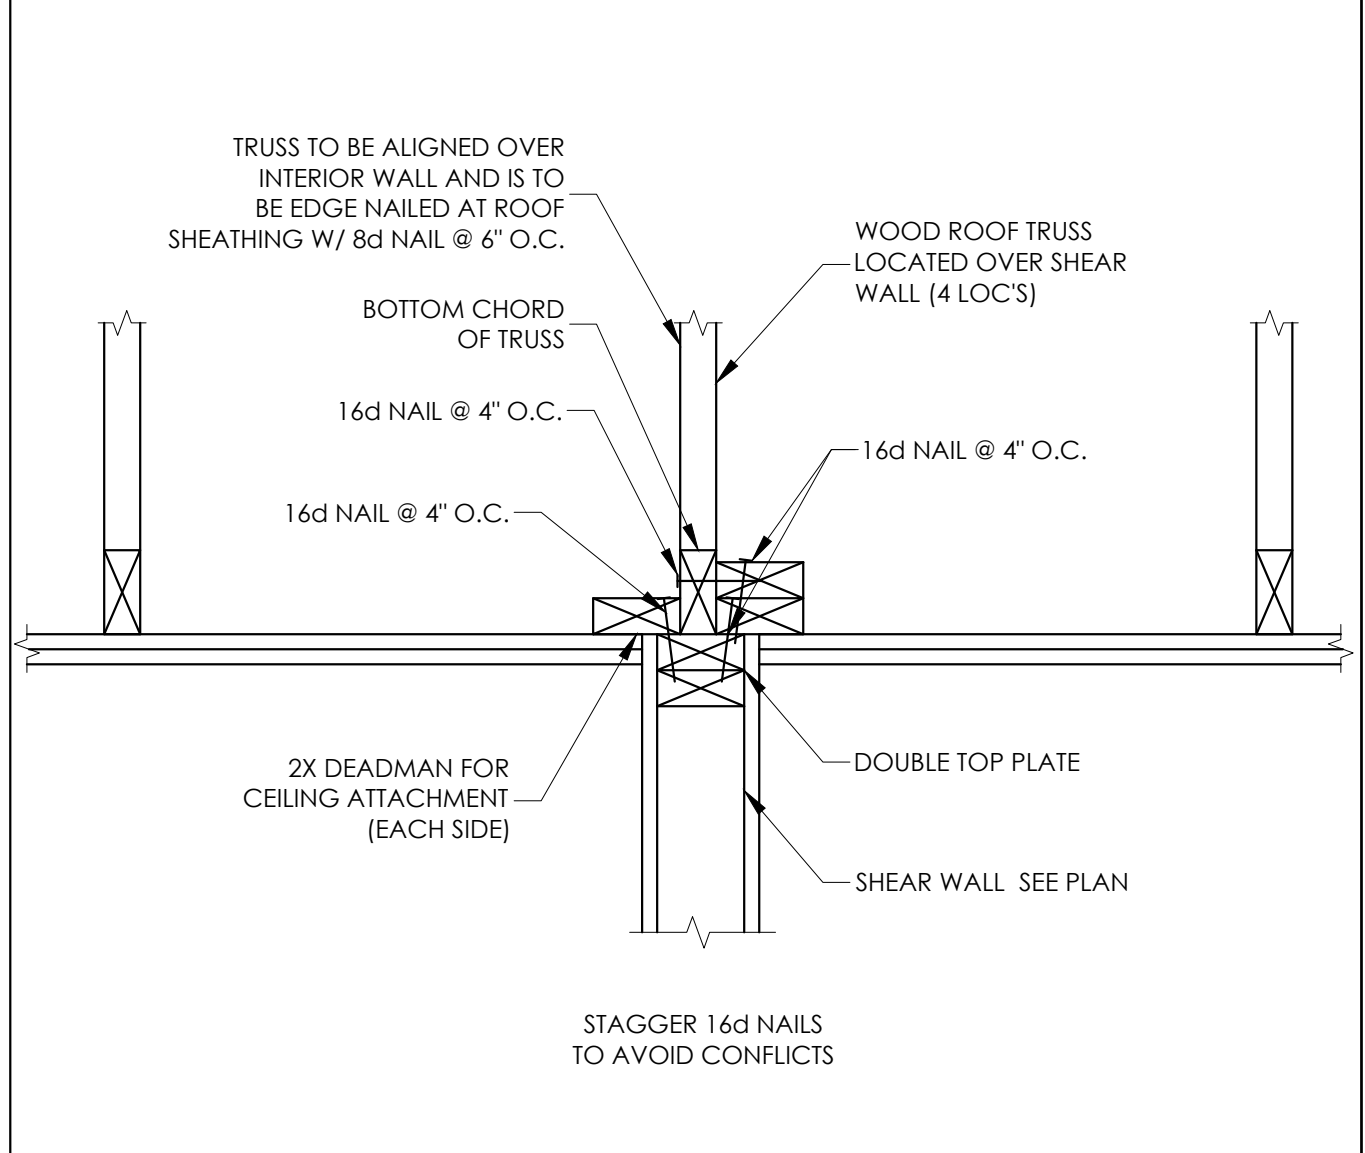


6 SHEARWALL AT DRAG TRUSS

SCALE: NONE

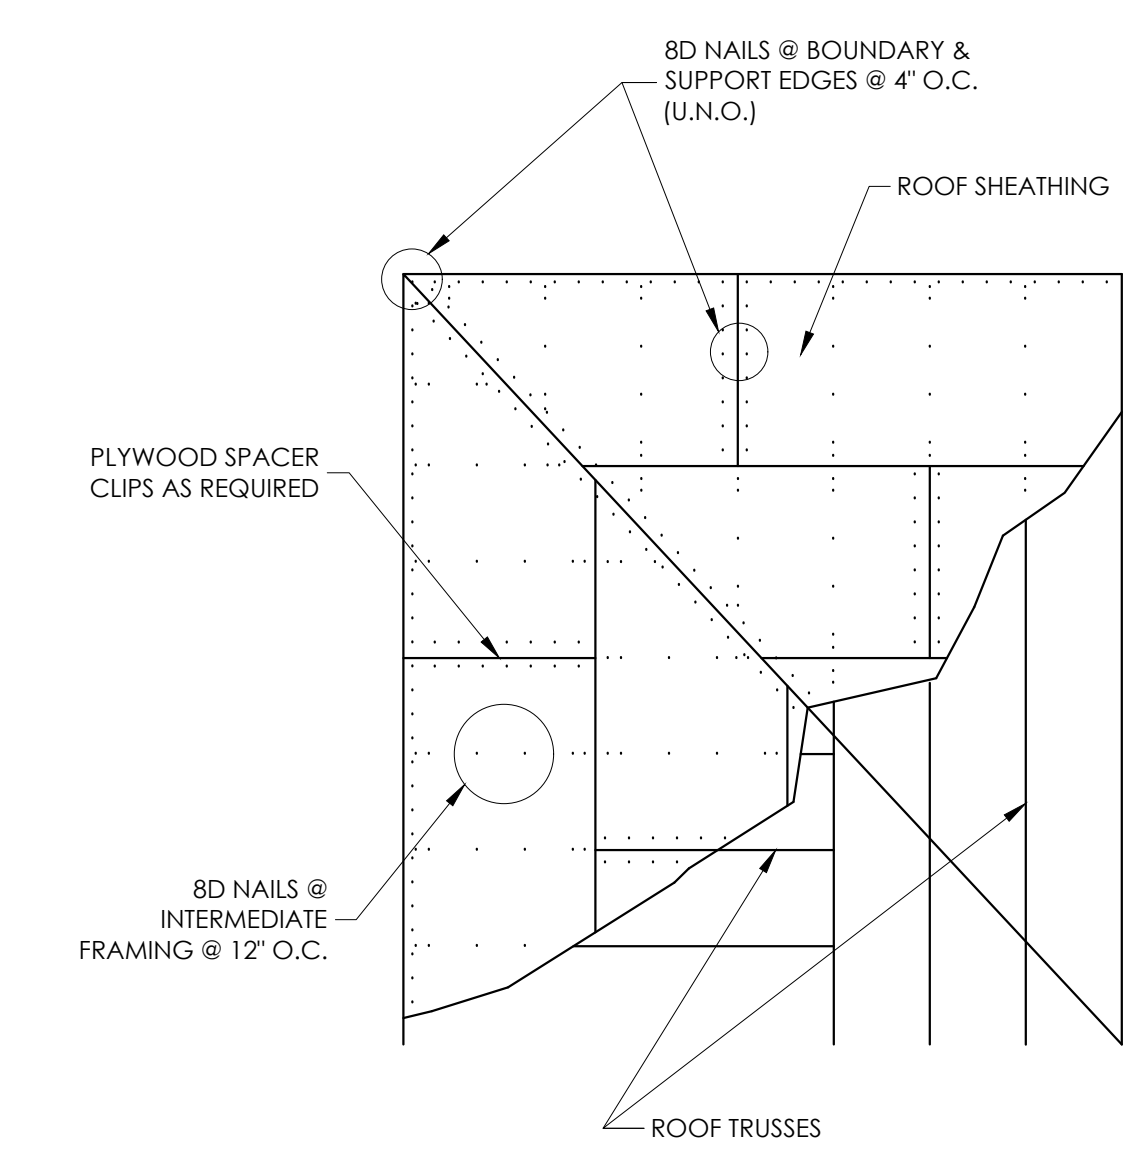


7 ROOF DECK NAILING PATTERN

SCALE: NONE

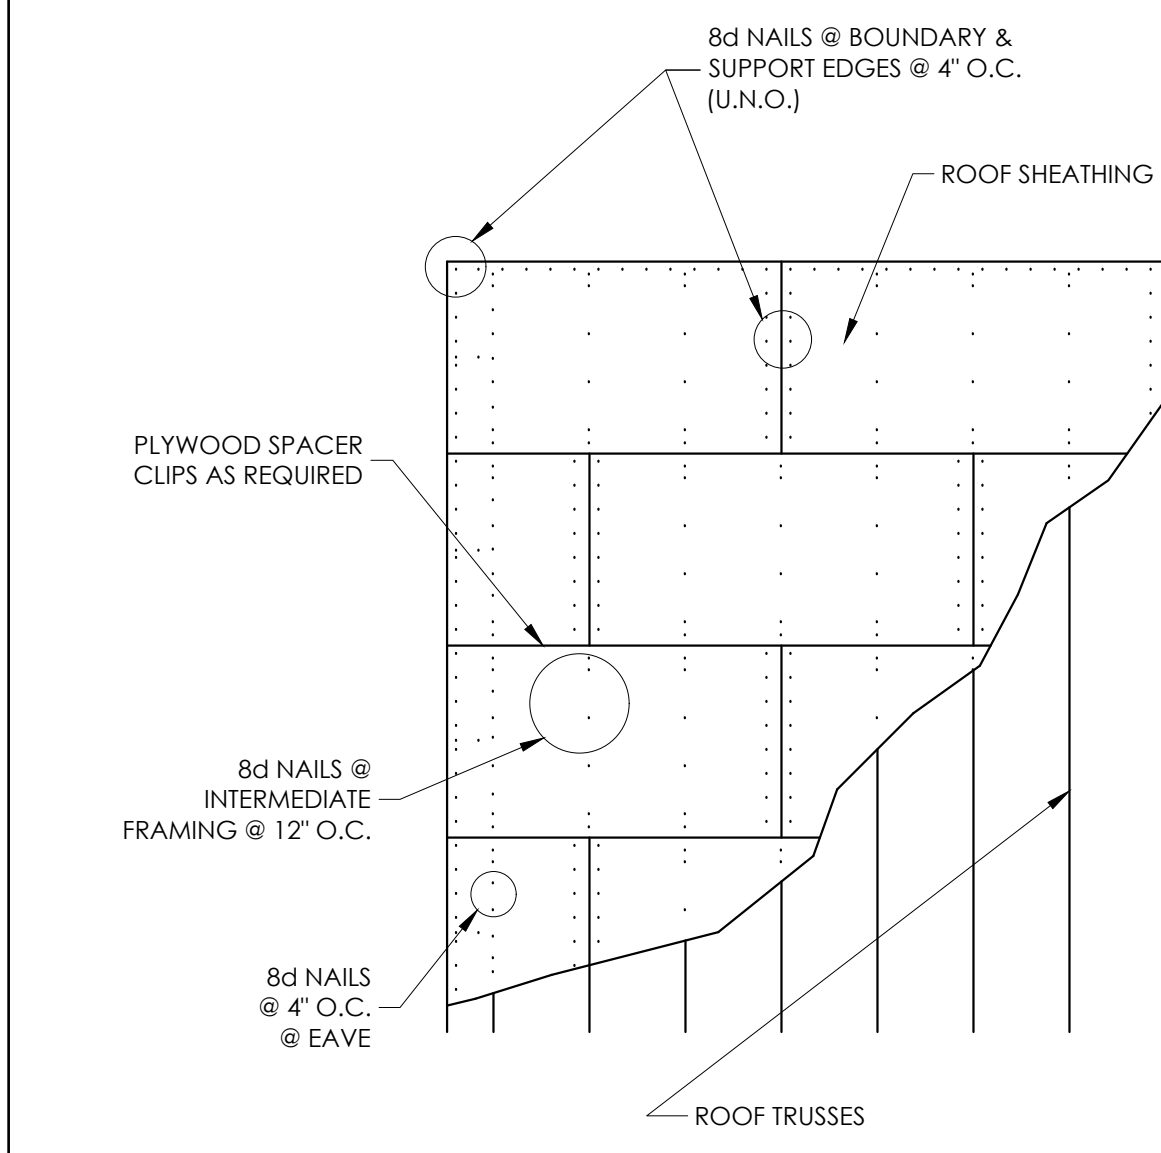


8 ROOF DECK NAILING PATTERN

SCALE: NONE

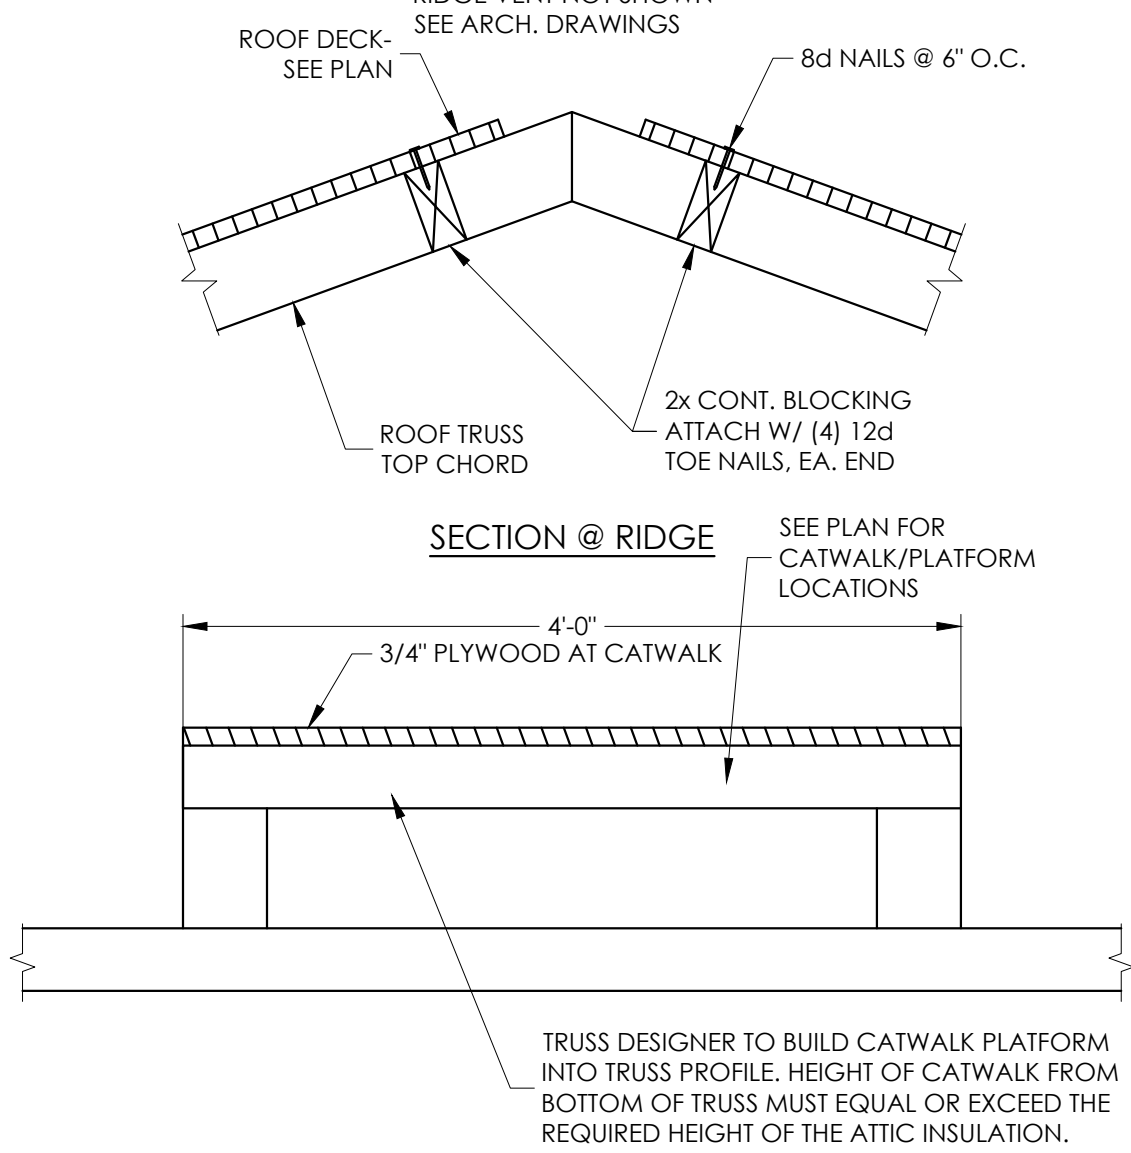


9 SECTION AT RIDGE AND CATWALK

SCALE: NONE

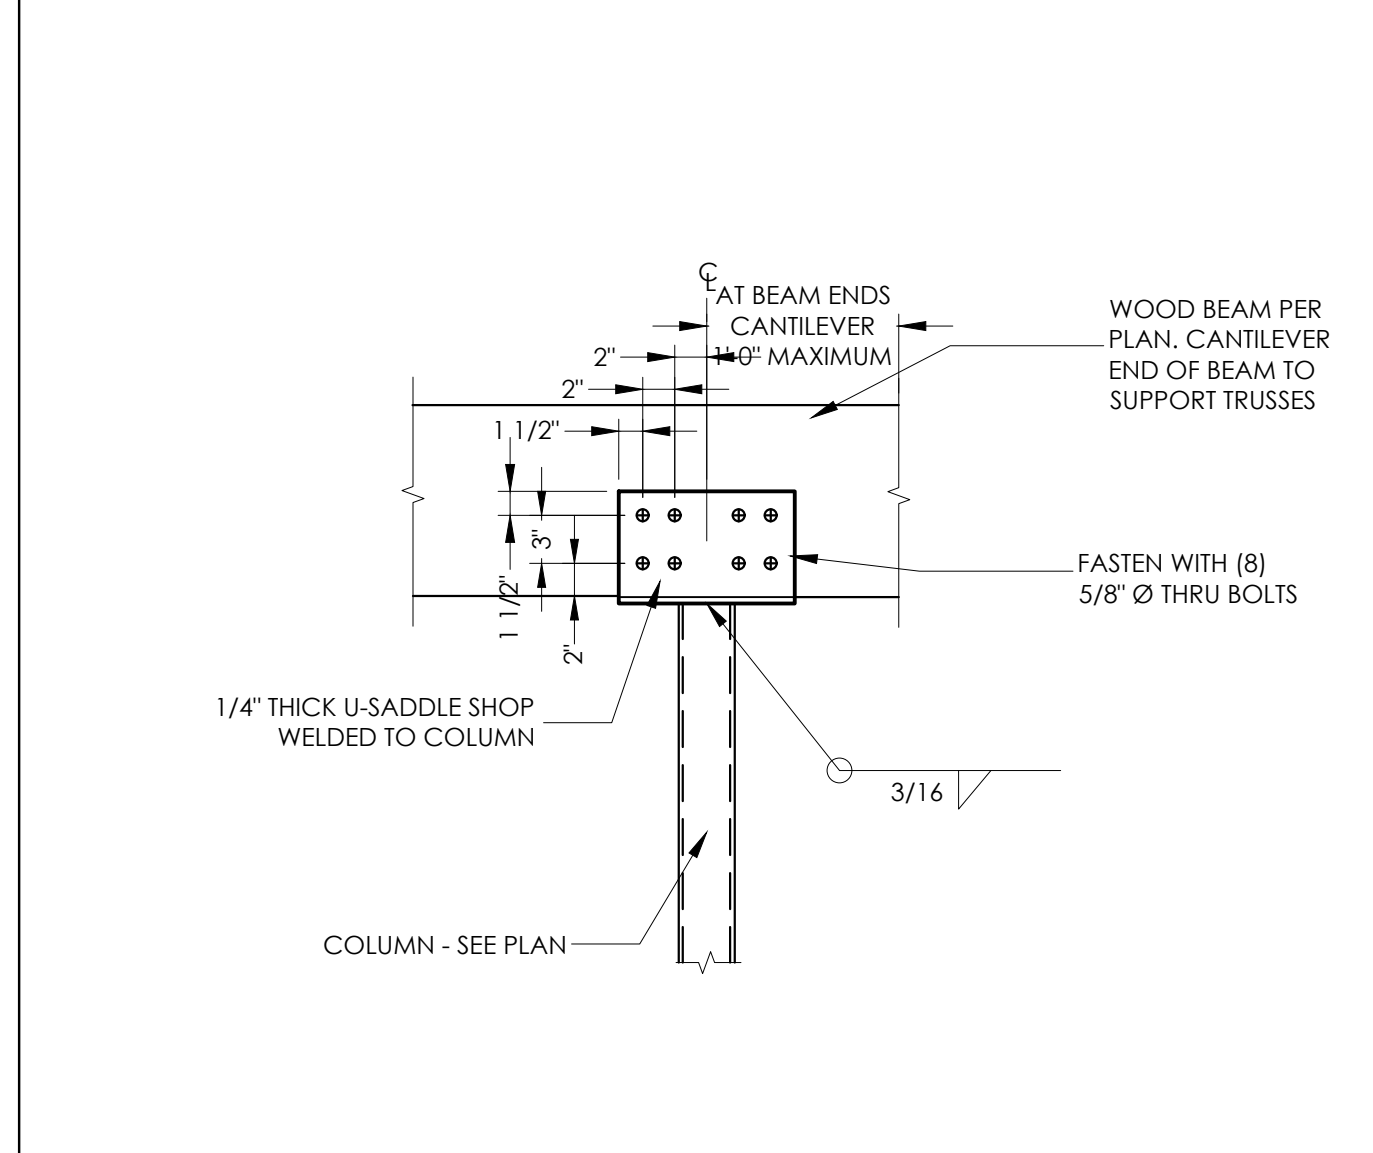


10 WOOD BEAM ON STEEL COLUMN

SCALE: NONE

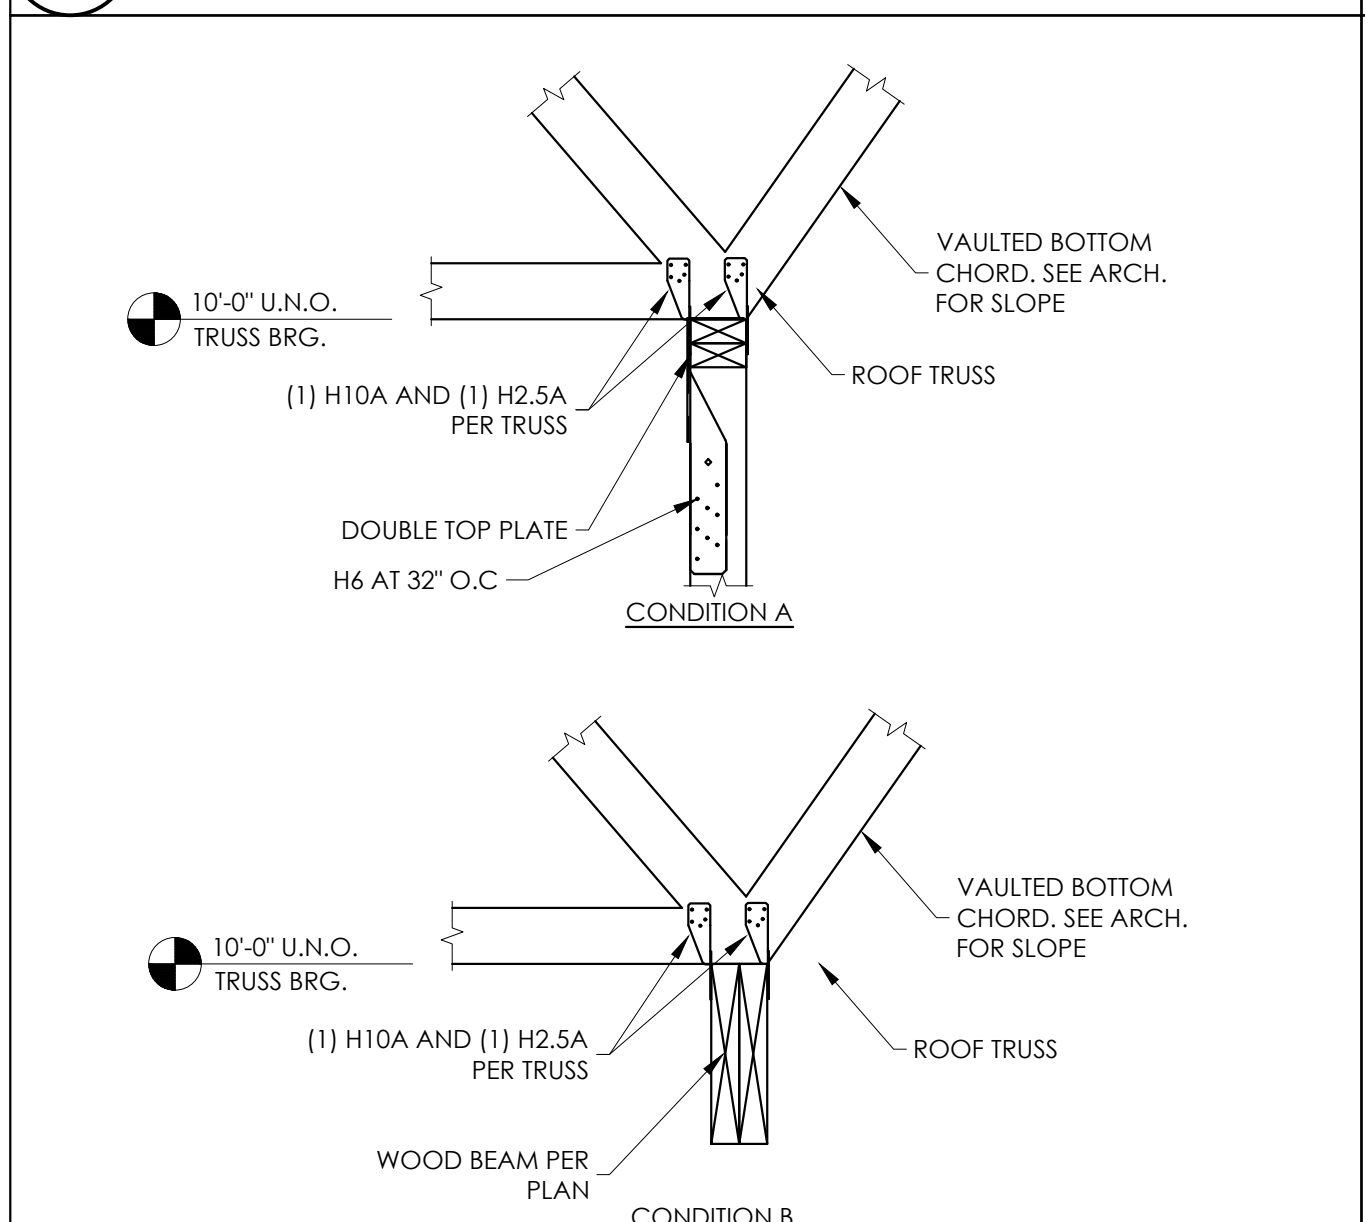


11 TRUSS @ INTERIOR BEAM BEARING

SCALE: NONE

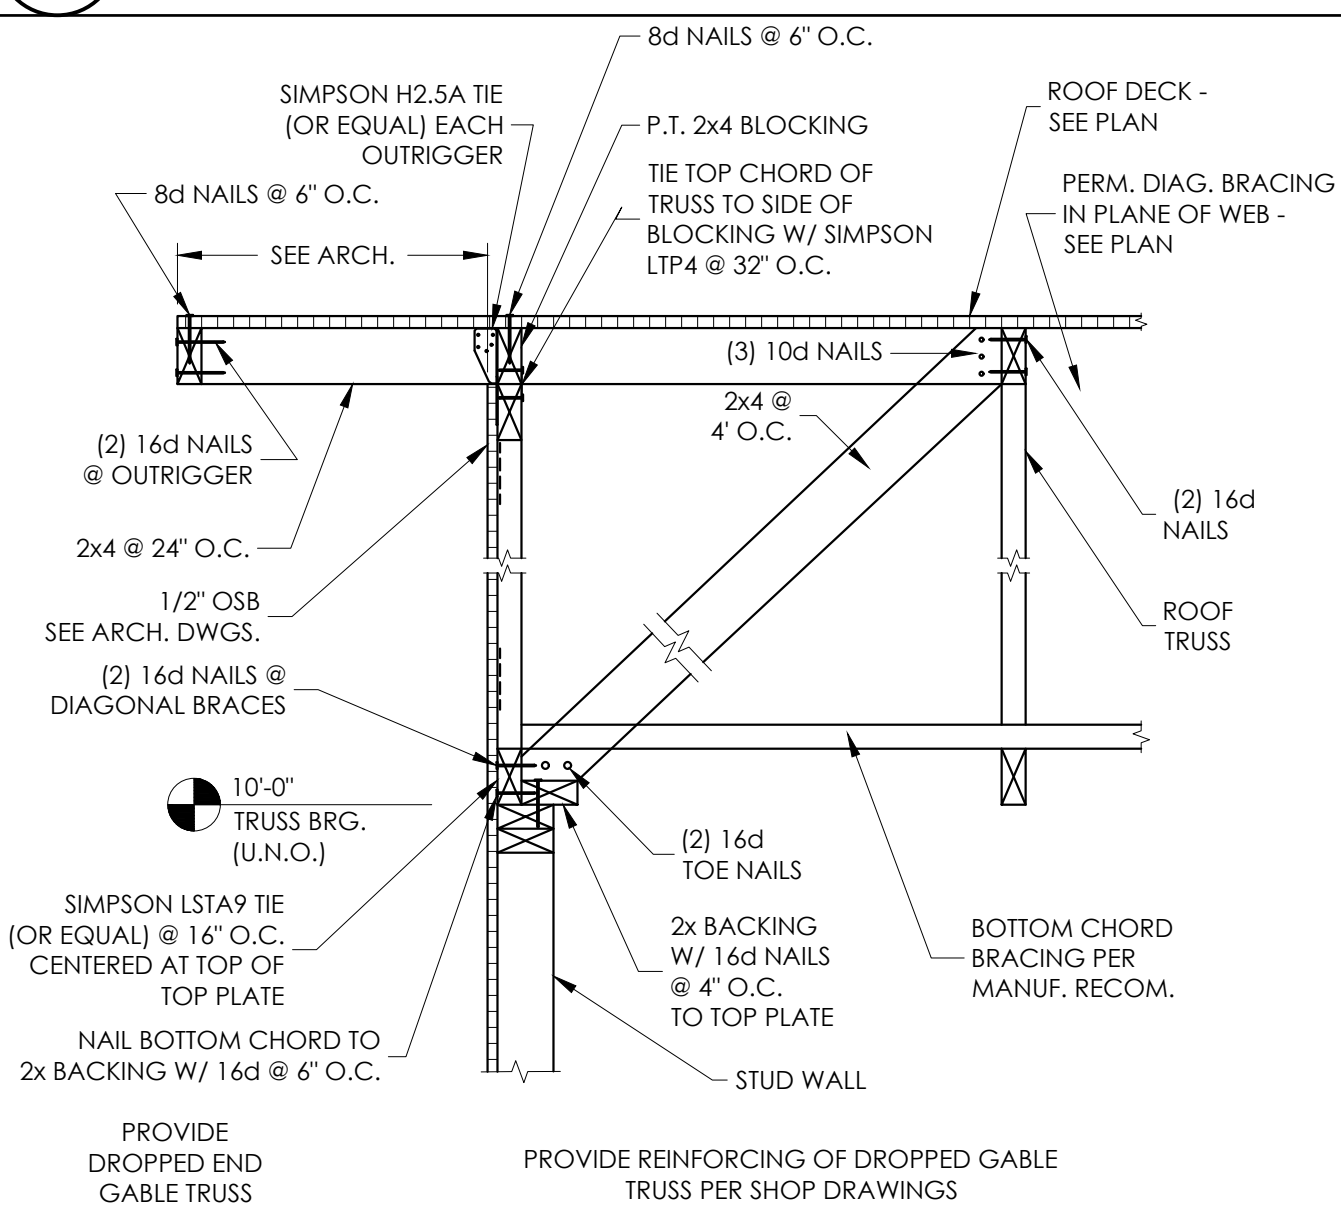


12 RAKE SECTION @ EXT. WALL

SCALE: NONE

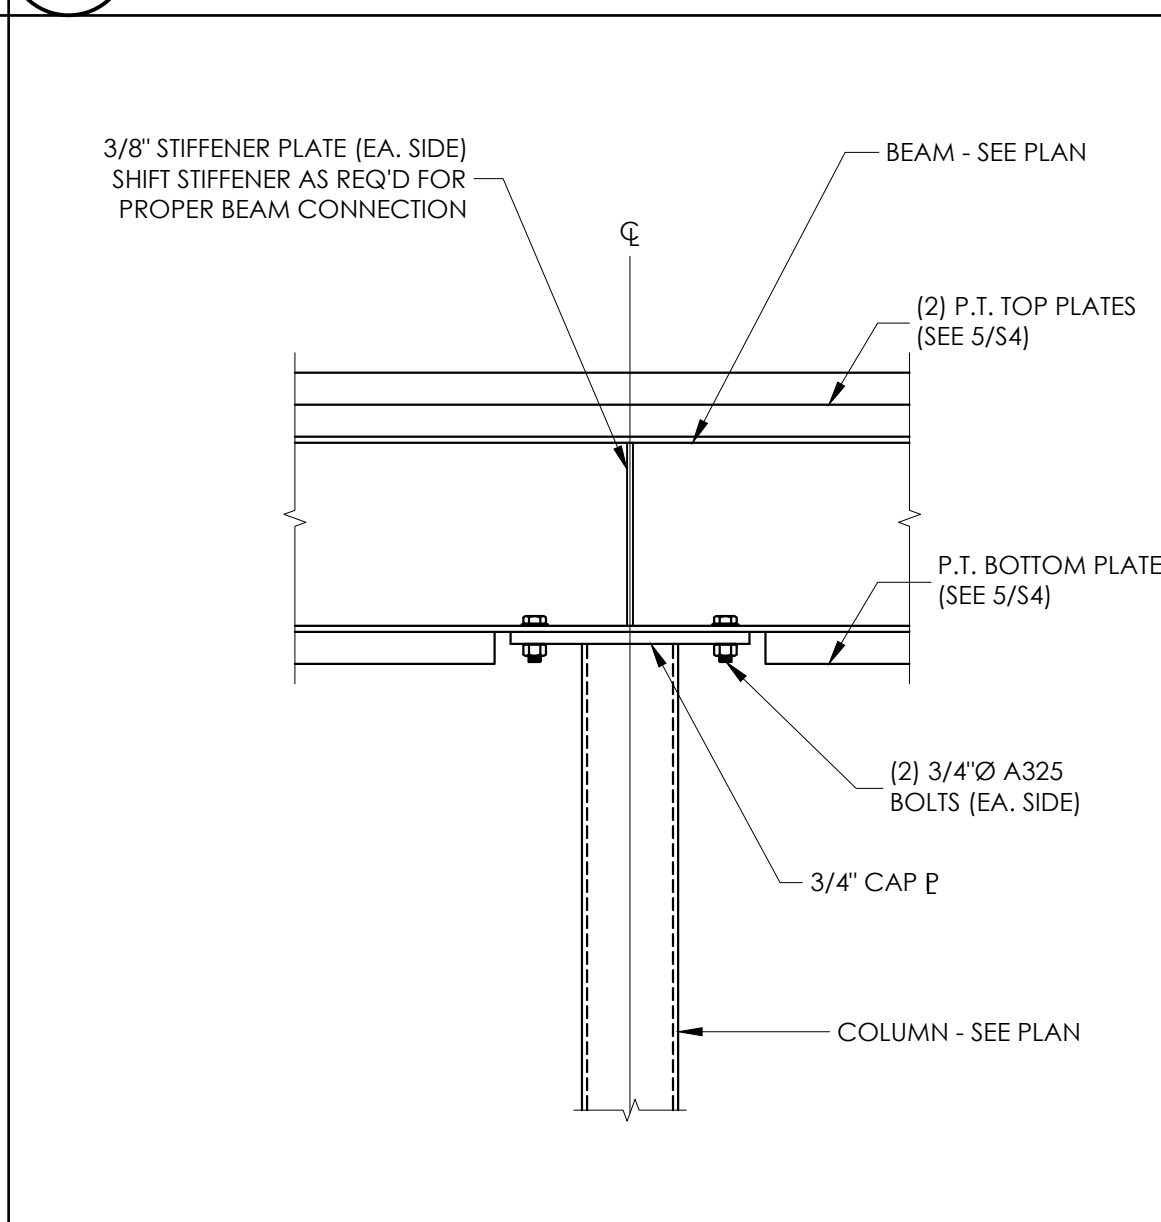


13 BEAM-TO-COLUMN CONNECTION

SCALE: NONE

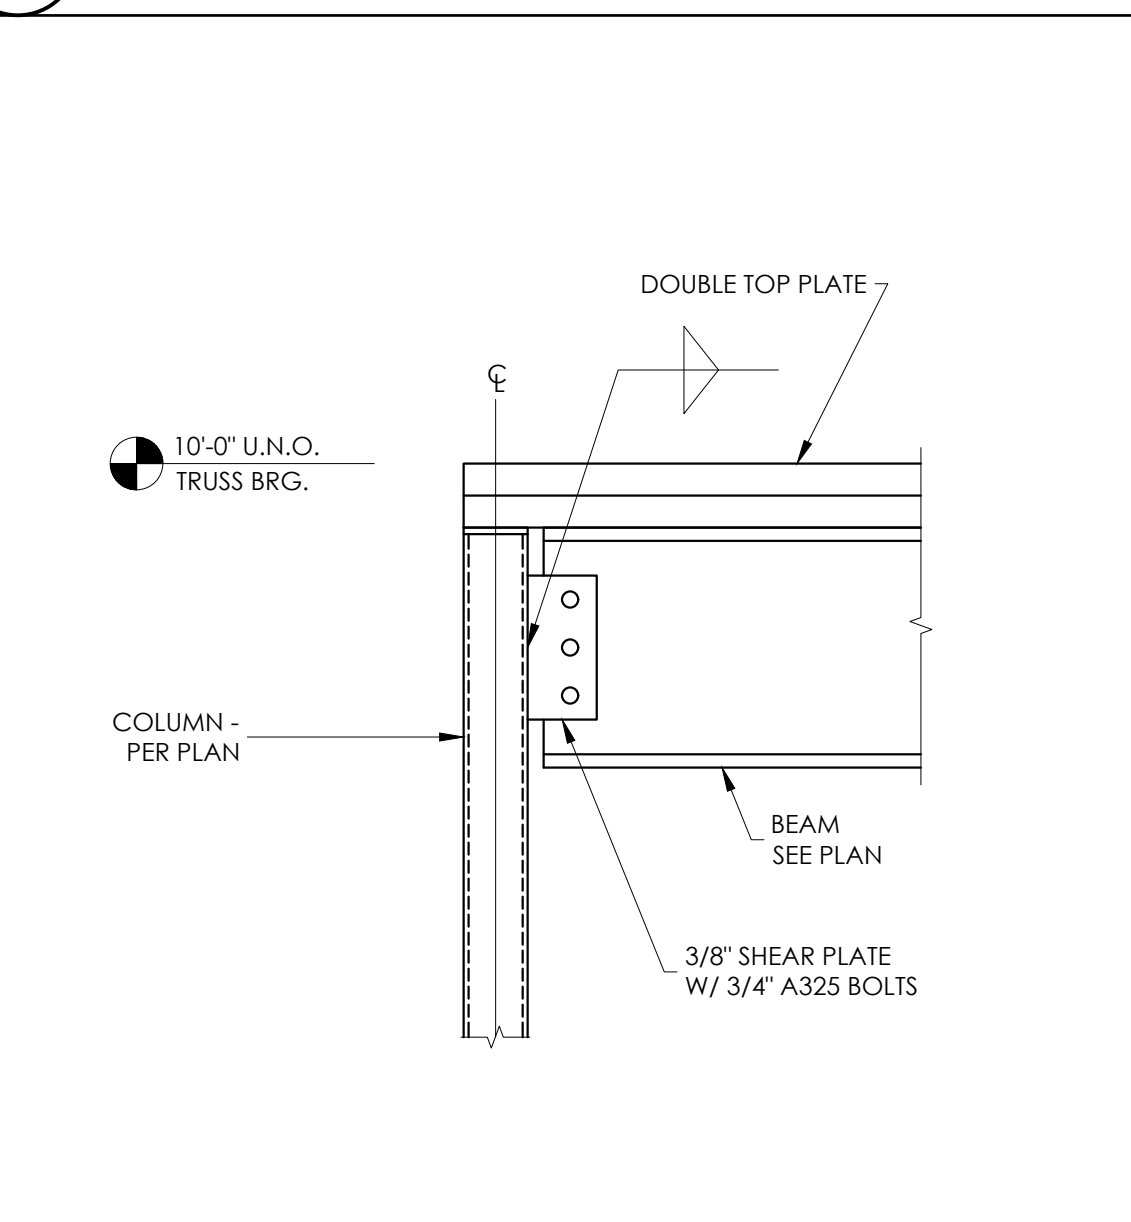


14 SHEAR CONNECTION

SCALE: NONE

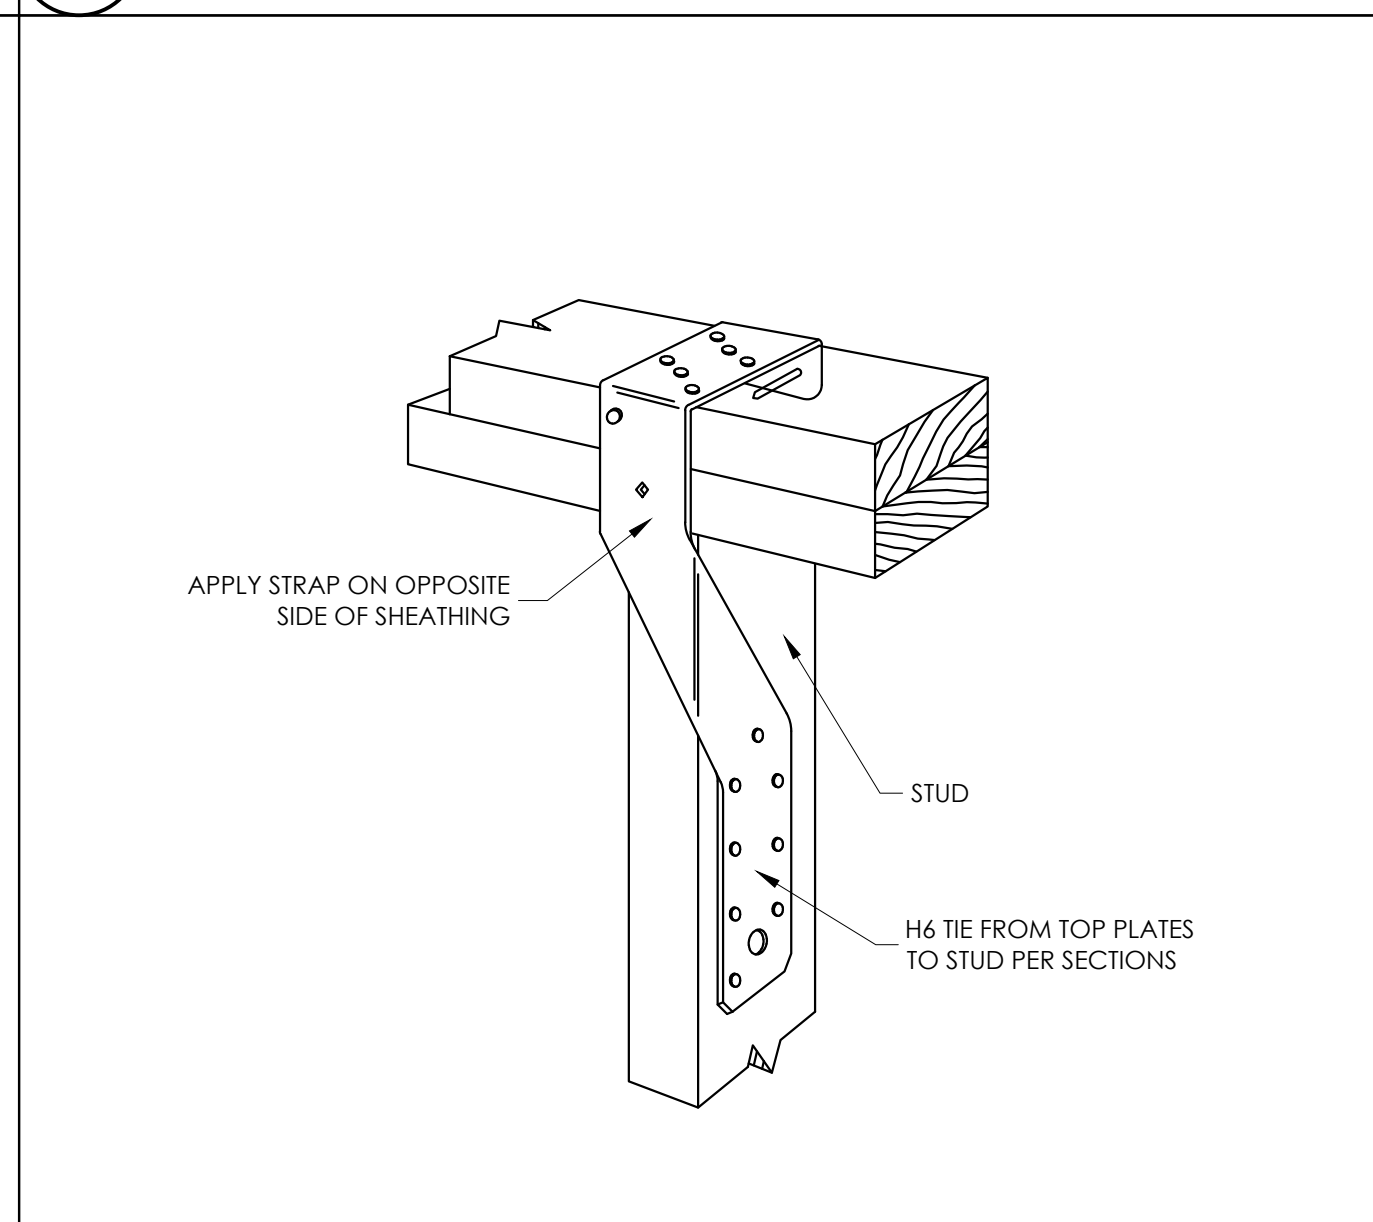


15 H6 TIE PERSPECTIVE

SCALE: NONE

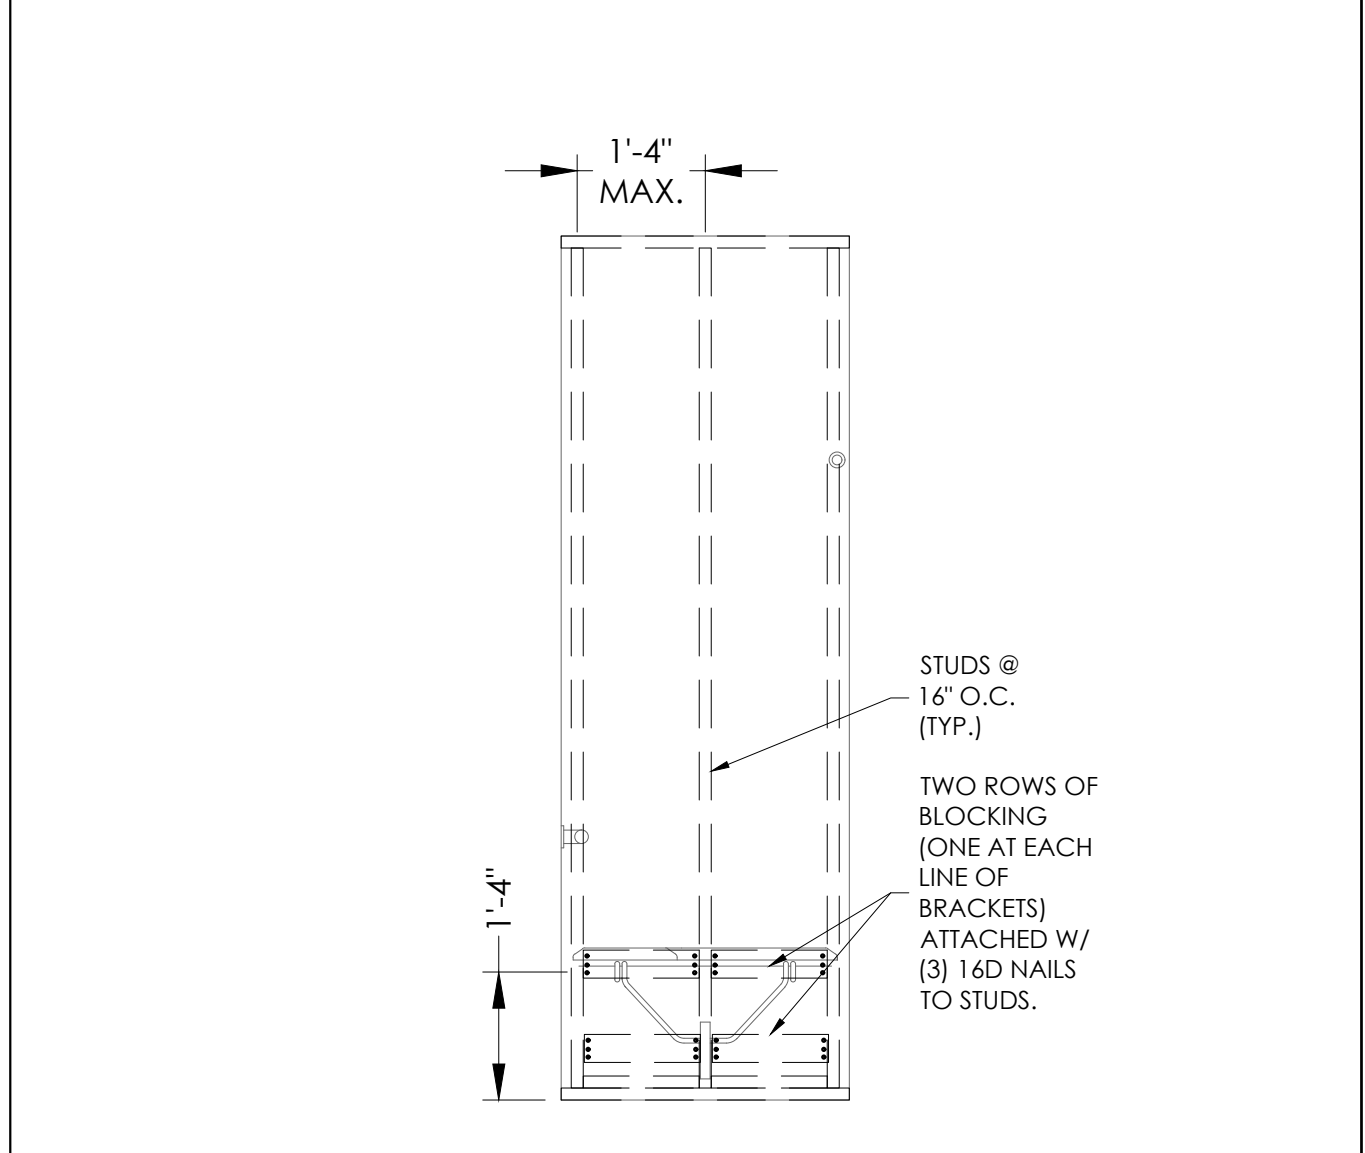


16 ELEVATION - SHOWER SEAT

SCALE: NONE

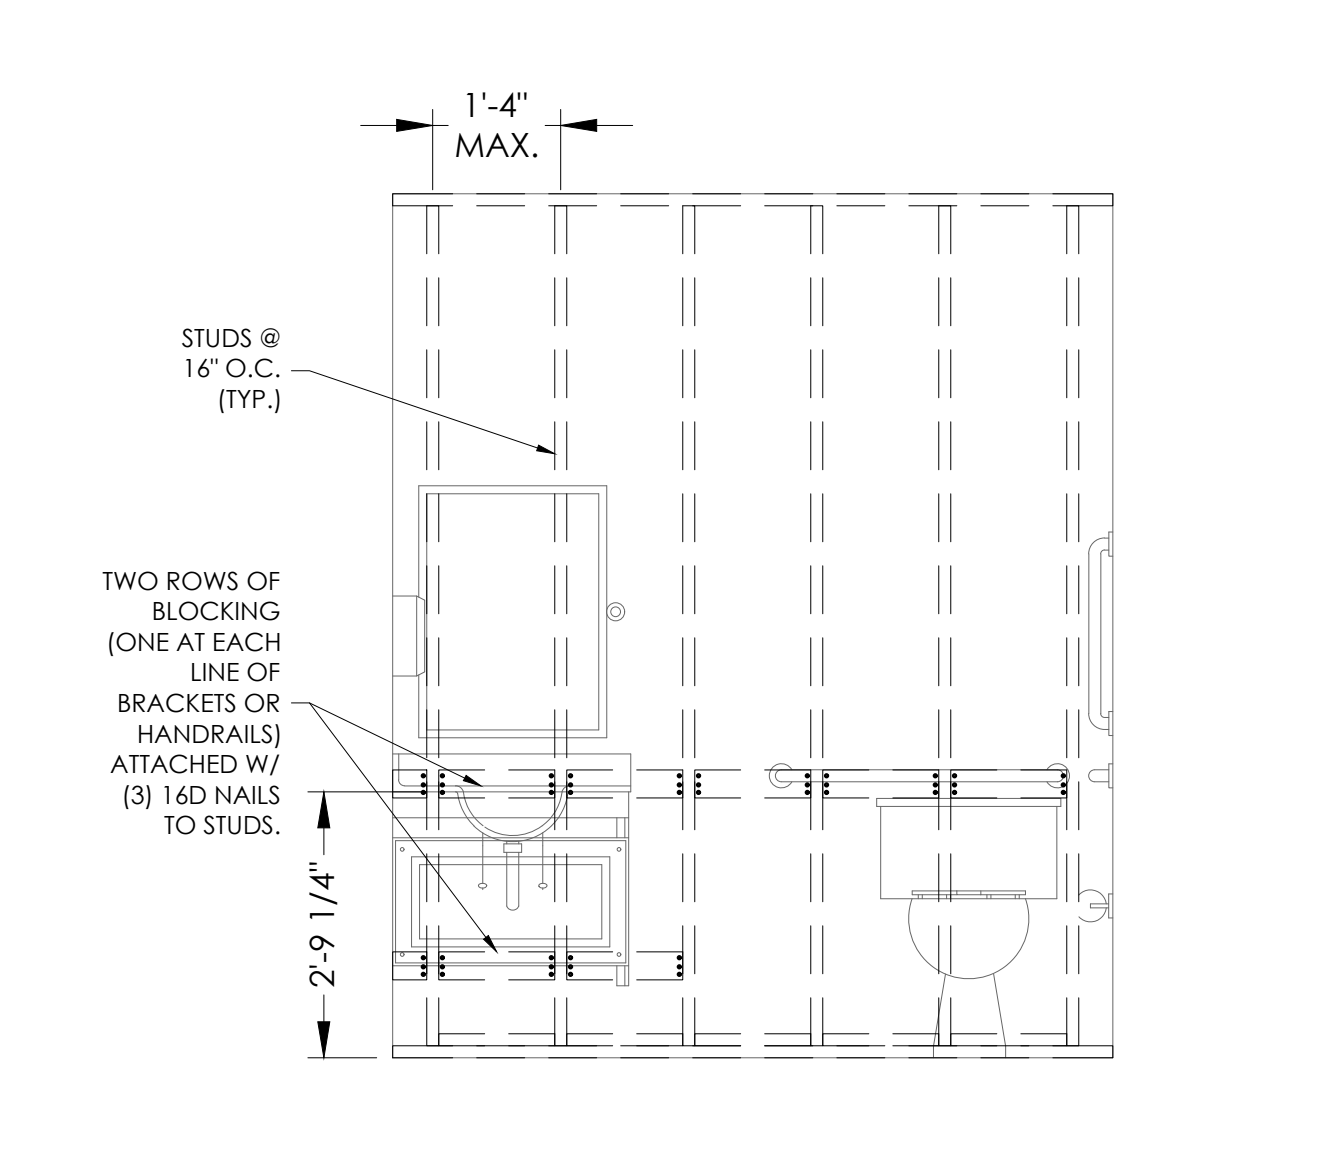


17 ELEVATION - TOILET AND SINK

SCALE: NONE

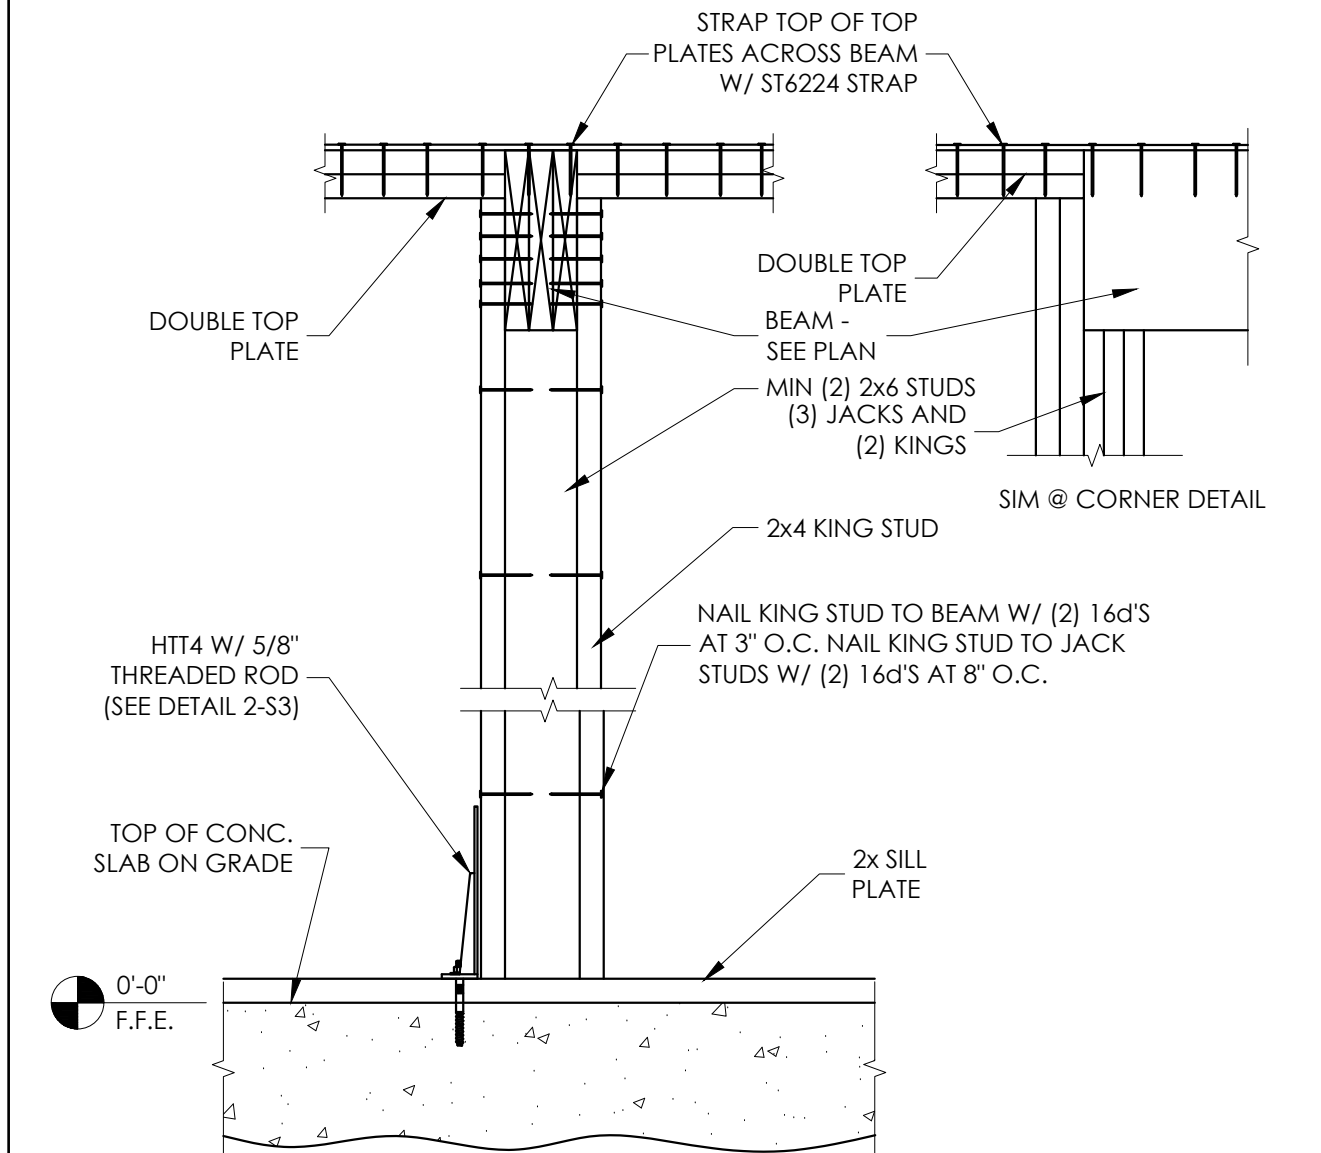


18 BEAM POCKET DETAIL

SCALE: NONE

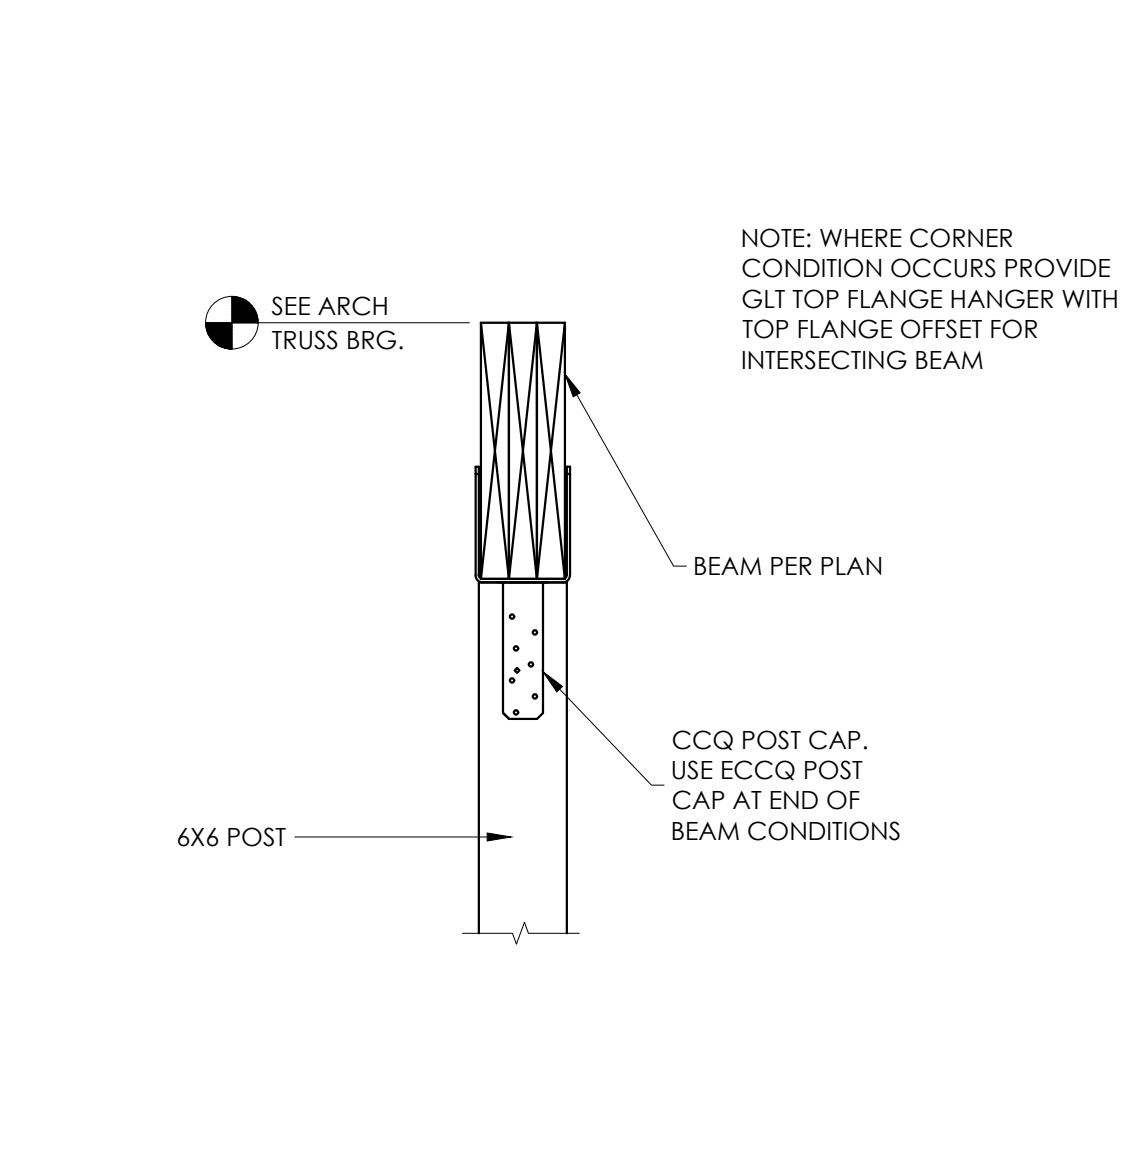

19 POST-BEAM CONNECTION

SCALE: NONE

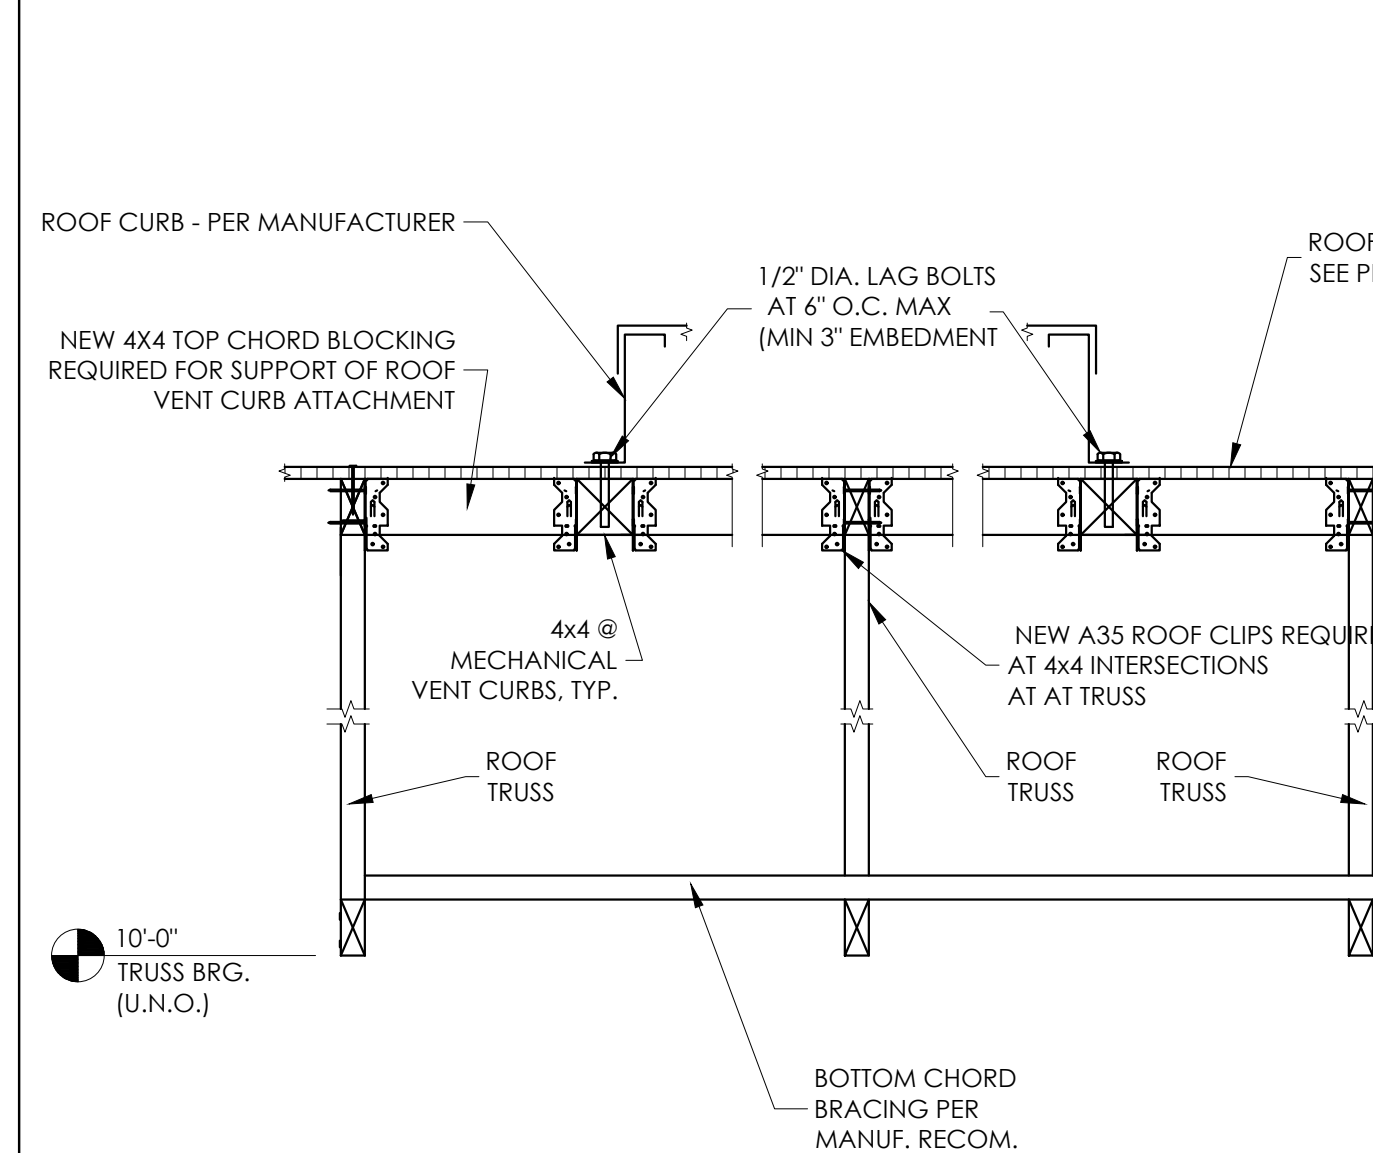

20 ROOFTOP MECHANICAL CURB

SCALE: NONE

ARCHITECTURAL CONCEPTS INC.
1241 WEST HAY DRIVE, SUITE 500, CAROL, NC 27010

THEODORE A. DEWITT
PROFESSIONAL ENGINEER
048492
NORTH CAROLINA
THEODORE A. DEWITT
1515 E. 10TH ST., SUITE 200
ZEBULON, NC 27597

HAUSER-CREECH INC.
PROJECT # 2019-001
P. 919.817.7579
P. 919.817.7676
F. 919.408.2427
4506 PEARCE RD.
ZEBULON, NC 27597

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:

LEO BROWN GROUP

THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-22
FOR CONSTRUCTION:	XX-XX-XX

REVISIONS:

REV.	#	DATE	REVISION TITLE

PLOT DATE:


FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO. 1902

SCALE: AS NOTED

DRAWING NO. S4

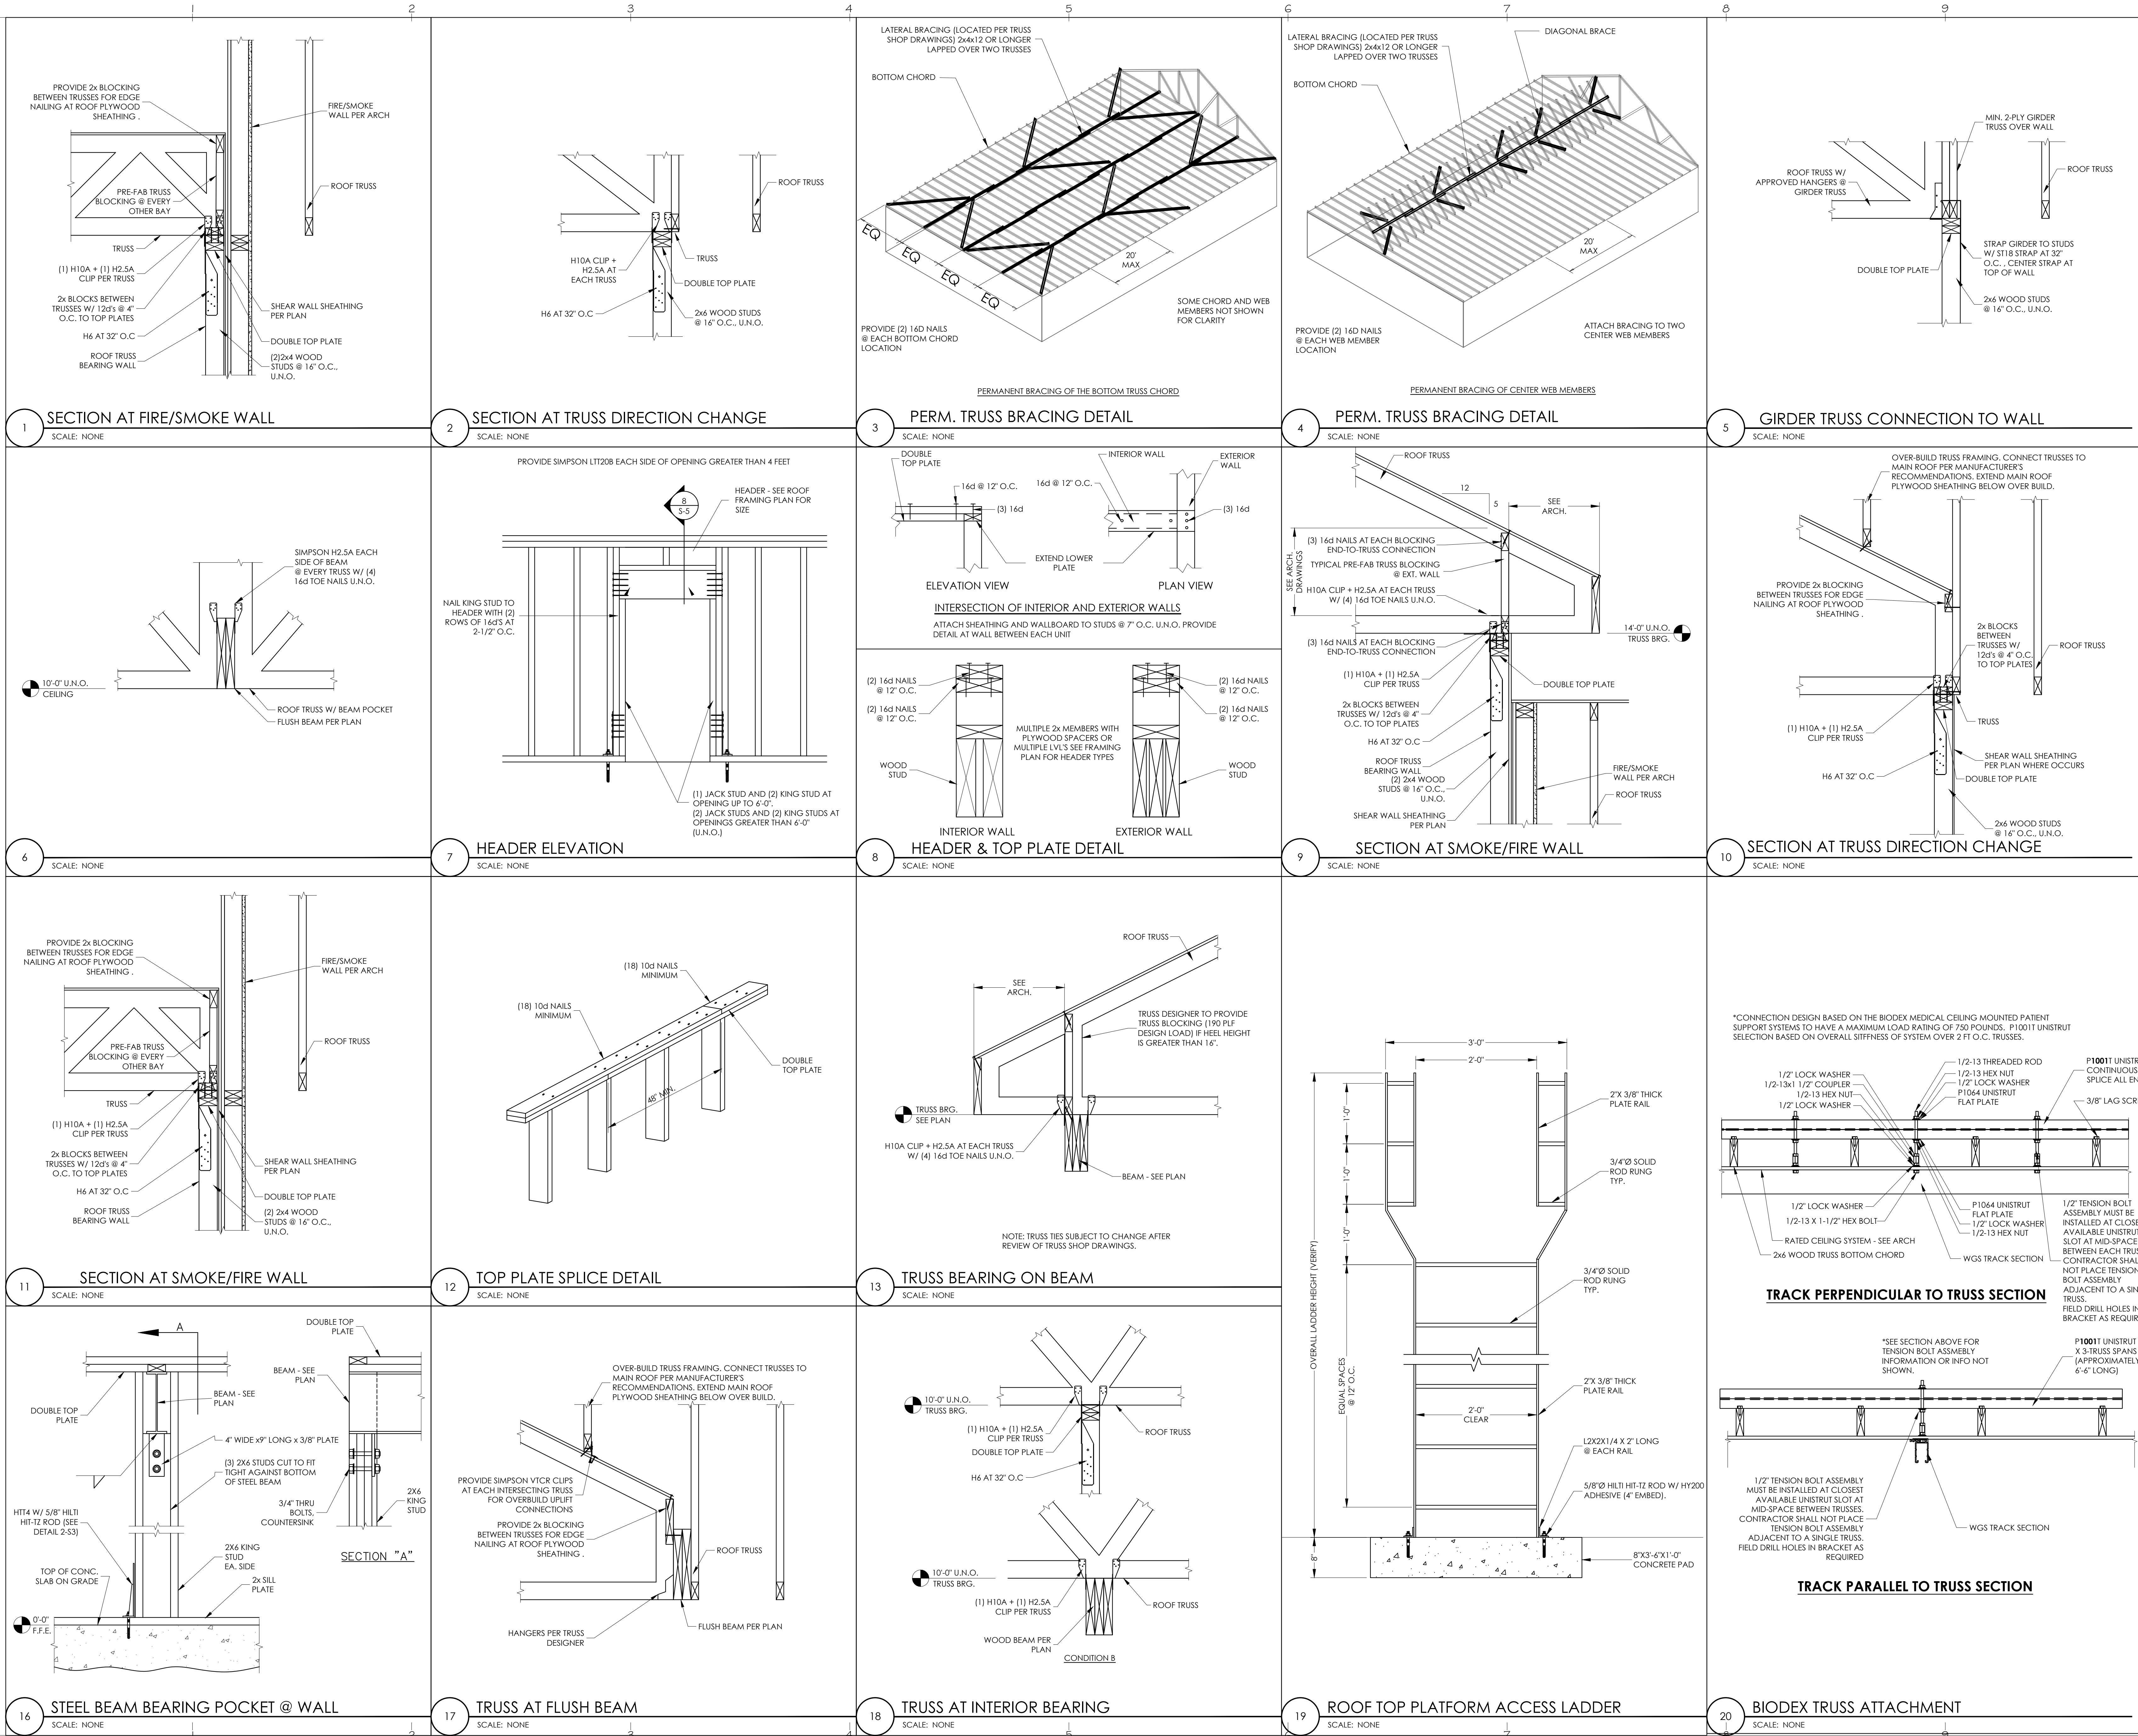

ARCHITECTURAL CONCEPTS INC.
241 WEST HAY DRIVE, SUITE 202, LENOIR, NC 28755

THEODORE A. DEWITT
NORTH CAROLINA PE NO. 048492

LEO BROWN
NORTH CAROLINA PE NO. 048492

HAUSER-CREECH INC.
PROJECT # 2024-001

HAUSER-CREECH INC.
P: 919.817.7579
P: 919.817.7676
F: 919.408.2477
4506 PEARCE RD.,
ZEBULON, NC 27597

TO THE BEST OF THE ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION.

PROPOSED:

LEO BROWN GROUP

THE EMBASSY AT MOREHEAD CITY

A NEW SKILLED NURSING, MEMORY CARE, & ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS

THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC. UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE COPYRIGHT AND PATENT LAWS.

PUBLICATION	DATE
CONCEPT:	XX-XX-XX
SCHEMATIC DESIGN:	07-16-21
PRELIMINARY DESIGN:	07-01-21
DESIGN DEVELOPMENT:	09-01-21
PERMIT SET:	03-25-22
BID SET:	10-15-21
FOR CONSTRUCTION:	XX-XX-XX

REVISIONS:

REV. #	DATE	REVISION TITLE
--------	------	----------------

PLOT DATE:


FILE LOCATION:

SHEET DESCRIPTION:




PROJECT NO. 1902	SCALE: AS NOTED
---------------------	--------------------

DRAWING NO.

S5

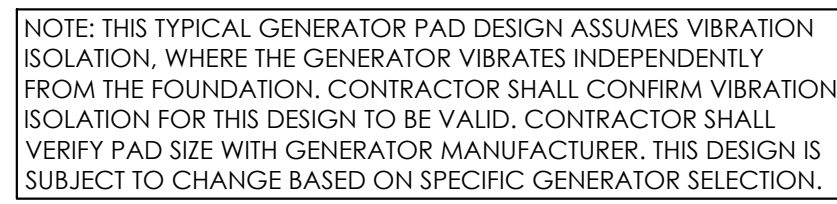

SCALE: NONE

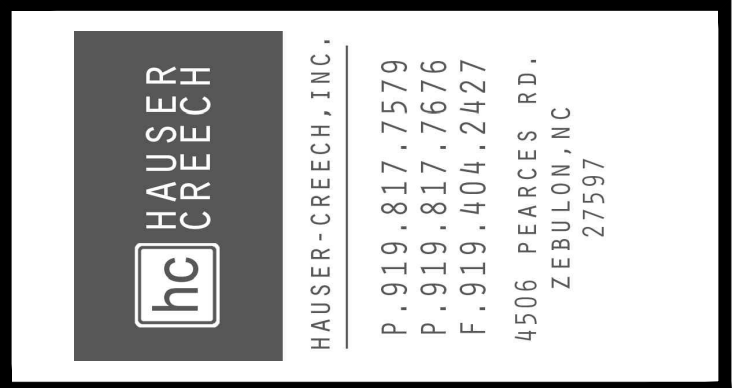

PROPOSED:



A NEW SKILLED NURSING,
MEMORY CARE, &
ASSISTED LIVING FACILITY

3822 GALANTIS DRIVE
MOREHEAD CITY, NC 28557

DO NOT SCALE PRINTS
THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN
ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS INC.
UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE
PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE
COPYRIGHT AND PATENT LAWS.

PLOT DATE:

FILE LOCATION:

SHEET DESCRIPTION:

PROJECT NO.

1902

DRAWING NO.

SCALE:

AS NOTED

S6

